


(12)


TECHNICAL REPORT P-54
November 1975
Consolidation of RPMA at Fayetteville, NC

**STRUCTURAL FIRE PROTECTION/PREVENTION
CONSOLIDATION STUDY FOR FAYETTEVILLE, NC
AREA**

by
David W. Brown

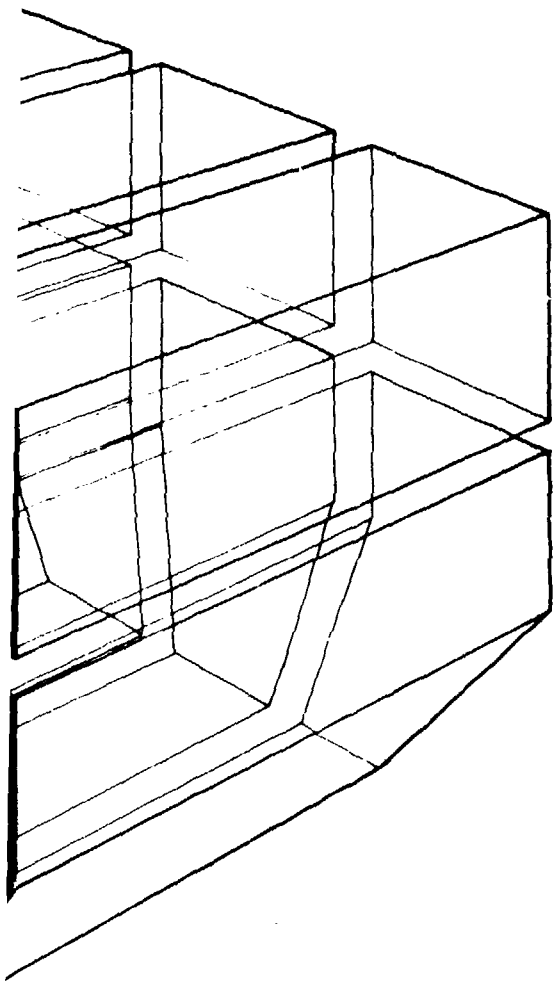

D D C
RECEIVED
DEC 9 1975
RECEIVED
C



Approved for public release; distribution unlimited.

The contents of this report are not to be used for advertising, publication, or promotional purposes. Citation of trade names does not constitute an official indorsement or approval of the use of such commercial products. The findings of this report are not to be construed as an official Department of the Army position, unless so designated by other authorized documents.

A

**DESTROY THIS REPORT WHEN IT IS NO LONGER NEEDED
DO NOT RETURN IT TO THE ORIGINATOR**

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

| REPORT DOCUMENTATION PAGE | | READ INSTRUCTIONS BEFORE COMPLETING FORM |
|--|-----------------------|---|
| 1. REPORT NUMBER (14) CERL-TR-54 | 2. GOVT ACCESSION NO. | 3. RECIPIENT'S CATALOG NUMBER |
| (6) STRUCTURAL FIRE PROTECTION/PREVENTION CONSOLIDATION STUDY FOR FAYETTEVILLE, NC AREA | | (9) DATE OF REPORT & PERIOD COVERED FINAL rept. |
| 7. AUTHOR(s) (10) David W. Brown | | 8. CONTRACT OR GRANT NUMBER(s) |
| 9. PERFORMING ORGANIZATION NAME AND ADDRESS CONSTRUCTION ENGINEERING RESEARCH LABORATORY P.O. Box 4005 Champaign, IL 61820 | | 10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS U.S. Army Project Order ENG-CERL-75-2 |
| 11. CONTROLLING OFFICE NAME AND ADDRESS | | (11) 12. REPORT DATE Nov 1975 |
| 14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office) (16) CERL - 75-2 | | 13. NUMBER OF PAGES 27 (12-28 p.) |
| | | 15. SECURITY CLASSIFICATION Unclassified |
| 16. DISTRIBUTION STATEMENT (of this Report) Approved for public release; distribution unlimited. | | 15a. DECLASSIFICATION/DOWNGRADING SCHEDULE |
| 17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report) | | |
| 18. SUPPLEMENTARY NOTES Copies are obtainable from National Technical Information Service Springfield, VA 22151 | | |
| 19. KEY WORDS (Continue on reverse side if necessary and identify by block number) firefighting requirements fire prevention manpower fire protection consolidation | | |
| 20. ABSTRACT (Continue on reverse side if necessary and identify by block number) This study analyzed the structural firefighting requirements at Fort Bragg and Pope Air Force Base, located at Fayetteville, NC. The study requirements were (1) to evaluate present resources and requirements for structural fire protection and prevention, and (2) to determine if consolidation would result in substantial manpower or equipment reductions. Fire prevention/protection consolidation was to | | |

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)

Block 20 continued.

be evaluated both as an integral part of a joint facilities engineering consolidation organization and as a stand-alone consolidation organization.

The results of the study indicate that because of the widespread locations of the Air Force and Army airfields and mission-essential facilities, both installations are manned at the minimum acceptable level of structural firefighting companies. The number of fire companies cannot be reduced and still meet the minimum DOD response requirements.

Relocation of the temporary Fire Station Number 3 at Fort Bragg will provide coverage for areas at Fort Bragg which do not now meet the DOD response requirements and will reduce the current overlapping of the Bragg-Pope response coverages. An expansion of the Bragg-Pope mutual aid agreement to have Pope AFB assume responsibility for some of the structural protection in the northwest section of Fort Bragg is recommended. This will allow the most advantageous relocation of Fort Bragg Station Number 3.

Consolidation of the individual fire protection/prevention activities will not significantly reduce required equipment, manpower, or facilities. At most, anticipated annual savings of \$88,801, or 4.6 percent, would result from the reduction of five supervisory positions after consolidation. However, these savings do not appear to warrant consolidation at this time, since command and reporting requirements will remain distinct until the entire RPMA organization at Ft Bragg and Pope AFB might be consolidated. This is pending the final result of the ongoing RPMA Consolidation Study.

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)

FOREWORD

The research was conducted for the Directorate of Facilities Engineering, Office of the Chief of Engineers, under U.S. Army Project Order ENG-CERL-75-2, dated 25 June 1975, for Phase II of RPMA Consolidation at Fayetteville, NC. The work was performed by the Data Systems Branch, Facilities Operations and Maintenance Division (FM), Construction Engineering Research Laboratory (CERL), Champaign, IL.

Mr. Jeffrey G. Kirby, Data Systems Branch, CERL, was the Principal Investigator for this study. The OCE Technical Monitor was LTC John Burt, DAEN-FEP. The study was conducted under the general supervision of Mr. Richard J. Colver, Chief, Data Systems Branch, and Mr. E. A. Lotz, Acting Chief, FM.

Appreciation is expressed to Chief H. Engle at Fort Bragg and Chief J. Robinson at Pope Air Force Base for their support in the collection of the required data.

COL Melvyn D. Remus is Commander and Director of CERL and Dr. L. R. Shaffer is Deputy Director.

CONTENTS

| | |
|---|----|
| DD FORM 1473 | 1 |
| FOREWORD | 3 |
| 1 INTRODUCTION | 5 |
| Background | |
| Purpose | |
| Approach | |
| 2 FORT BRAGG ANALYSIS | 7 |
| Existing Operations | |
| Work Requirements | |
| Fire Company Responses | |
| Available Firefighting Resources | |
| 3 POPE AFB ANALYSIS | 11 |
| Existing Operations | |
| Work Requirements | |
| Fire Company Responses | |
| Available Firefighting Resources | |
| 4 FIRE FLOW ANALYSIS | 14 |
| Fire Flow Required | |
| Pumpers Required | |
| 5 INTERSERVICE SUPPORT AGREEMENT ANALYSIS | 17 |
| Mutual Aid Agreement | |
| Reciprocal Agreement | |
| 6 CONSOLIDATION EVALUATION | 18 |
| Fire Station Requirements | |
| Resource Requirements | |
| Reporting Requirements of Consolidated Fire Departments | |
| 7 CONCLUSIONS AND RECOMMENDATIONS | 21 |
| APPENDIX A: DOD Fire Response Requirements | 23 |
| APPENDIX B: Existing Response Coverages for the Fort Bragg Fire Department | 24 |
| APPENDIX C: Overlap of Response Coverages for Fort Bragg and Pope AFB | 26 |
| APPENDIX D: Existing Response Coverages for Pope AFB Fire Department | 27 |
| DISTRIBUTION | |

STRUCTURAL FIRE PROTECTION/
PREVENTION CONSOLIDATION STUDY
FOR FAYETTEVILLE, NC AREA

1 INTRODUCTION

Background. In a memorandum dated 13 May 1975, the Deputy Assistant Secretary of Defense (Installations and Housing) expanded the requirements of the lead service conducting the Consolidation of Real Property Maintenance Activities (RPMA) Survey to include the functional area of structural fire protection.¹ The established guidelines for Consolidation of RPMA Surveys at Military Installations were directed to be used.

The Acting Deputy Director, Directorate of Facilities Engineering, Office of the Chief of Engineers, requested the Construction Engineering Research Laboratory (CERL) to include the Fire Consolidation Study for the Fayetteville, NC area in the on-going RPMA Consolidation study for that area.²

CERL conducted a survey of the Fayetteville area (Fort Bragg and Pope AFB) from August through October 1975 to collect the required data for the economic evaluation of fire services. (See Figure 1 for a map of the area.)

Purpose. The purpose of this report is to present an analysis of structural firefighting services in the Fayetteville, NC area--including available and required resource requirements and responsiveness of existing Interservice Support Agreements--in order to evaluate the possibilities and economies of consolidating such services.

Approach. A detailed survey was made of the structural fire protection in the Fayetteville area. The data collected included:

- a. An inventory of the existing mobile firefighting apparatus and associated personnel.
- b. Fire prevention inspection requirements for each installation.

¹ Memorandum, Deputy Assistant Secretary of Defense (I&H), 13 May 1975, Subject: Consolidation of Real Property Maintenance Activities (RPMA) at Military Installations.

² Letter, Acting Deputy Director, Facilities Engineering, OCE, 17 June 1975, Subject: Consolidation of Real Property Maintenance Activities (RPMA) at Military Installations.

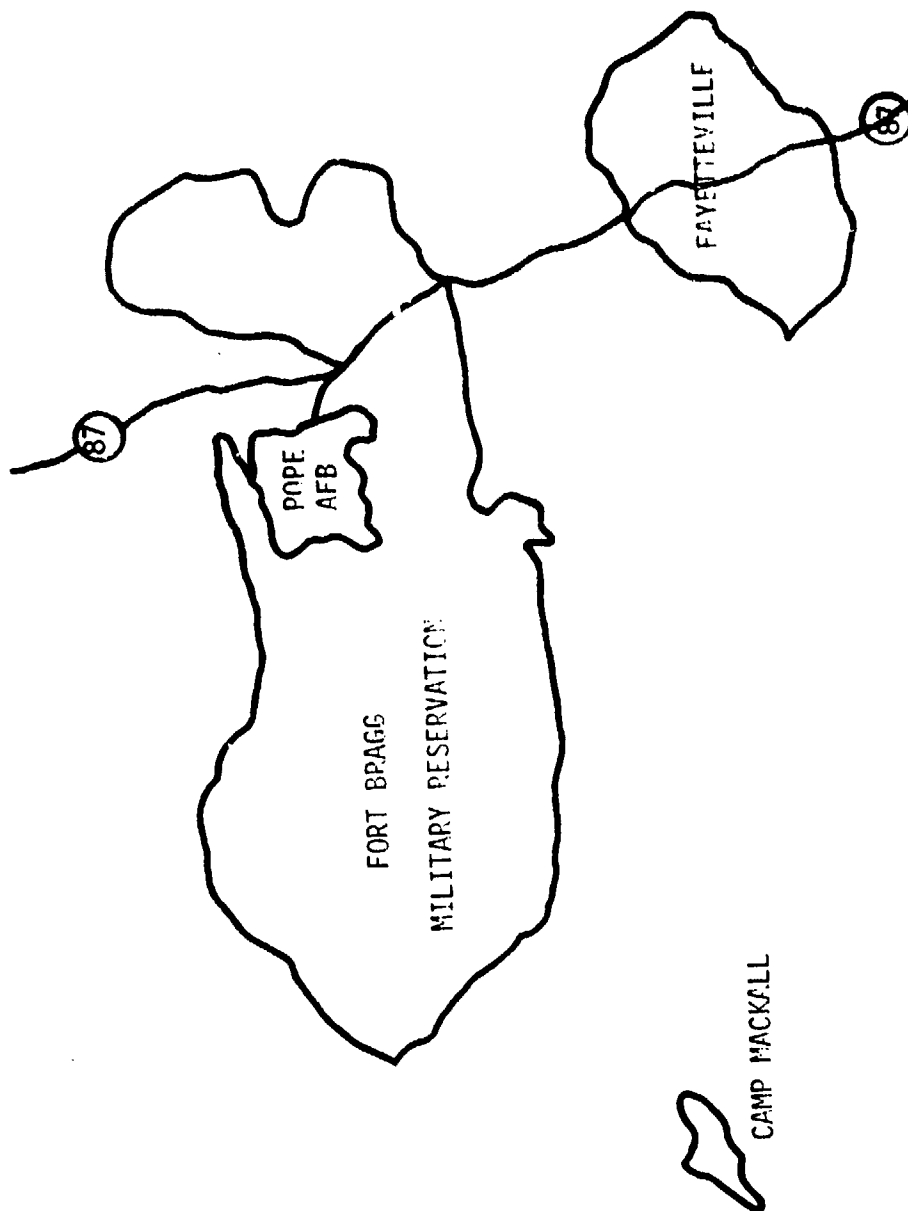


Figure 1. Map of Fayetteville, North Carolina area.

c. The maximum fire flow* requirement and fire flow available for the principal risk facility on each installation. (These figures were used to determine the required number of fire companies for each area in accordance with the DOD guidelines presented in Appendix A.)

The study also included the following:

- a. An evaluation of the number of fire companies and locations (stations) according to the DOD response (distance and time) requirement.
- b. An evaluation of the possibility of firefighting assistance from outside the installations and the effectiveness of such assistance.
- c. An investigation of the feasible alternatives for consolidation, based on an evaluation of requirements for mobile apparatus/personnel and fire protection coverage.
- d. Determination of the manpower and cost savings resulting from expanded cooperation or consolidation.

2 FORT BRAGG ANALYSIS

Existing Operations. Fort Bragg operates five fire companies at three station locations. The installation's fire risk is considered high because of its high-rise hospital, large commissary, mission-essential facilities, and high volume of air traffic.

Fire Station Number 1. Fire Station Number 1 is the main structural fire station and has two fire companies which operate two 750 pumpers and a standby 750 pumper used for maintenance rotation. Both active pumpers are manned with four firefighters. The station also houses the Central Communications Center which is operated by the firefighters on a 2-hour rotational shift basis. The center monitors the alarms, plus anti-intrusion and sprinkler systems. Four personnel spaces are allotted to this function. Station Number 1 also has an extinguisher repair shop which performs repairing and recharging services for the installation. The firefighters service approximately 3,500 extinguishers each month, and one personnel space is authorized for this function. The fire prevention inspectors are located at this station.

SAAP Fire Station. Simmons Army Airfield (SAAF) Fire Station has two

* The fire flow is the quantity of water required through the distribution system for domestic use and for firefighting which includes hose stream and sprinkler requirements.

cross-manned fire companies operating two P-4 vehicles and a standby 530 crash vehicle. One P-4 vehicle is manned with four firefighters and the second is manned with three firefighters. The SAAF Fire Station is required to provide both structural and crash protection; the P-4 vehicles can function for either requirement. SAAF has 38 buildings, a 5,000 foot (1524 m) runway, and over 370 aircraft stationed, with an average of 700 takeoffs and landings every 24 hours.

Fire Station Number 3. This temporary Fire Station has one cross-manned fire company to operate one 750 pumper, manned with four firefighters, and one 530 crash vehicle. This company provides structural protection to the east side of the post and standby support to Womack Army Hospital's Medi-vac and Gabriel Field's aerial demonstrations. In addition to the 11 firefighters required for one fire company, three firefighters have been recognized to augment the crash requirement. Master planning requirements call for this station to be relocated.

Camp MacKall. Field troops stationed at Camp MacKall, located near the Fort Bragg reservation, provide local fire protection. Their training is provided by the Fort Bragg Fire Chief.

Ranger Stations. Three isolated ranger stations on the Fort Bragg reservation are protected by mutual aid agreements to provide the first response. Ranger Station Number 1 is covered by the Raeford Fire Department, distance 18.2 miles (29.3 km); Ranger Station Number 2 is covered by the Southern Pine Fire Department, distance 21 miles (33.8 km); and Ranger Station Number 3 is covered by the Voss Fire Department, distance 11.6 miles (18.7 km).

Work Requirements

Firefighters. The firefighters work a rotating, 24-hour shift, 7 days a week, performing 10 hours of productive work per day with 14 hours on standby. The firefighters work 72 hours per week and are required to receive four hours of proficiency training each week. They are responsible for daily maintenance of fire equipment, semi-annual tests of fire hoses, semi-annual maintenance and water flow tests of 1,440 fire hydrants, monthly service and/or repair of over 3,500 fire extinguishers, and updating of pre-plans for over 5,000 facilities. The firefighters augment the fire inspectors for the annual family housing inspection and for periodic checks of theaters, clubs, and other gathering places. They also augment the alarm maintenance personnel who test and inspect alarm and sprinkler systems.

Inspection. Fire inspectors' duties include administering the fire prevention program and instructing installation personnel in the use of first aid and fire extinguishers. Inspection responsibility covers 20,253,905 sq ft (1,881,649 m²) of building space, which includes 4,212 family housing units (not counting the 150 units under construction), approximately 4,000,000 sq ft (372,000 m²) of open storage, and 184

range buildings. Since the 1974 manpower survey team interpreted the DA and FORSCOM policy as not recognizing fire protection inspectors for inspection of installations which have fire companies, only one such position has been allotted--for the inspection of Camp MacKall and 30 U.S. Army Reserve Centers, which depend entirely on civilian fire protection. However, since the fire chief assigns firefighters to perform alarm room and extinguisher repair duties, three additional spaces have been made available for fire inspectors in an attempt to meet the installations' inspection requirements. Specific inspection duties are listed below:

- a. Approximately two-thirds of one fire inspector's time is required by the Inspector General teams (1,356 hours).
- b. Fort Bragg's fire department inspects 30 U.S. Army Reserve Units and Camp MacKall annually, requiring approximately 170 hours of inspection and travel time.
- c. All family housing units are inspected annually and newcomers are briefed. The firefighters assist with the family housing inspections.
- d. The administrative buildings, warehouses, service buildings, troop housing, hospital complex, outside storage, and recreation buildings require quarterly inspection.
- e. Food service facilities such as clubs, post exchanges, and bowling alleys require weekly inspection.

These inspection requirements total over 14,000 hours for just the quarterly and weekly inspections. Since the fire department has only four inspectors, all the requirements cannot be satisfied. See Table 1.

Alarm Maintenance. The alarm maintenance section, which repairs and maintains the fire alarm and anti-intrusion systems, has two personnel assigned to the Fire Chief from the DFAE Interior Electrical Systems Maintenance Section. This section is also supported by firefighter labor.

Extinguisher Repair. As mentioned earlier, 3,500 extinguishers are repaired and/or charged monthly. One fire extinguisher repairman is authorized for this duty; however, the firefighters rotate the duty.

This service is performed without charge, except for the cost of the CO₂. Fort Bragg stores 10,000 gal (38 m³) of CO₂ to meet the requirements of both Bragg and Pope AFB.

Fire Company Responses. Fire Stations Number 1 and Number 3 respond to the main cantonment area; the SAAF Fire Station is responsible for the airfield, including all of the buildings. A small area in the southern section of Fort Bragg, consisting of warehousing, operational buildings,

Table 1

Fire Prevention and Protection Division, Fort Bragg, North Carolina

Fire Inspection Work Schedule FY 70

| Description | Frequency of Insp. | Allowed Time Each Inspection | Total Time Required | Units or Bldgs. | Totals hours | Remarks |
|--|--------------------|------------------------------|---------------------|-----------------|--------------|---------|
| Family Housing | Annually | 1/2 hrs | 1/2 hrs | 4,459 | 2,229 1/2 | |
| Family Housing | Newcomers | 1/2 hrs | 1/2 hrs | 2,821 | 1,410 1/2 | 3,640 |
| US Army Reserve Units & Camp Mackall | Annually | 5 1/2 hrs | 5 1/2 hrs | 31 | 162 | 168 |
| Administration Bldg | Quarterly | 1 1/2 hrs | 6 hrs | 190 | 1,140 | |
| Warehouses, Services Buildings | Quarterly | 2 hrs | 8 hrs | 127 | 1,016 | |
| Troop Housing | Quarterly | 1 hr | 4 hrs | 2,301 | 9,204 | |
| Hospital Temp-Clinic | Quarterly | 1 hr | 4 hrs | 173 | 692 | |
| Hospital Perm | Quarterly | 6 hrs | 24 hrs | 1 | 24 | |
| Outside Storage | Quarterly | 2 hrs | 8 hrs | 5 | 40 | |
| Recreation Bldgs | Quarterly | 1 hr | 4 hrs | 8 | 32 | 12,184* |
| Clubs, PX, Bowling Aileys where food is served | Weekly | 1 hr | 52 hrs | 36 | 1,872* | 1,872* |

* This includes 1,356 hours required by Inspector General team.

etc., is not within the required 2 miles (3.2 km) and 4 1/2 minutes from any fire station. Appendix A gives the DOD requirements for a fire company's response. Master planning requirements established by the Fort Bragg Planning Board call for relocating the temporary Fire Station Number 3 to a permanent location which will reduce the above deficiency. See Appendix B for a map of Fort Bragg and the response coverages attained from existing fire station locations. The overlap of coverage between Fort Bragg and Pope AFB is shown in Appendix C.

Available Firefighting Resources. Table 2 summarizes available firefighting resources in terms of personnel and equipment.

3 POPE AFB ANALYSIS

Existing Operations. Pope AFB operates five fire companies at two station locations. However, the two stations are within half a mile (.8 km) of each other and therefore can be considered as one location. Pope AFB has a high fire risk due to industrial areas, aircraft maintenance hangars, POL proximity to the pump house, and large volume of air traffic, including C5 aircraft.

Fire Station Number 1. Station Number 1, the airfield's crash rescue station, has four fire companies which operate the five major aircraft-firefighting vehicles and are cross-trained for the one structural pumper. Station 1 also houses the alarm room, the fire extinguisher maintenance activity, and the inspection team.

Fire Station Number 2. Station Number 2 houses two structural pumps, one of which is used for rotational maintenance. Neither pumper is authorized a personnel slot; however, one fire company consisting of four cross-trained firefighters and one extra man to monitor the phone has been stationed at this location. The men are cross-manned for the structural pumper and crash vehicles. These spaces were obtained from the crash requirement authorized for the airfield.

Work Requirements

Firefighters. The operational personnel (firefighters) work a rotating 24-hour shift, 7 days a week. They are responsible for maintaining proficiency in firefighting techniques and performing daily equipment maintenance. The firefighters perform fire flow tests on 175 fire hydrants and keep the hydrants painted. They also supplement the Technical Services Section for the annual family housing inspection, and inspect assembly areas during peak times. Duties also include crash requirements such as ramp patrols and standby.

Table 2

Available Firefighting Resources, Fort Bragg

| <u>Personnel</u> | | |
|------------------|---|--------------------|
| <u>Quantity</u> | <u>Description</u> | <u>Grade Level</u> |
| 1 | Fire Chief | GS/11 |
| 3 | Assistant Fire Chief | GS/9 |
| 1 | Chief, Fire Prevention Inspector | GS/8 |
| 5 | Station Captain | GS/7 |
| 7 | Crew Chief | GS/6 |
| 3 | Fire Prevention Inspector | GS/6 |
| 12 | Firefighter (Driver-Operator) | GS/5 |
| 24 | Firefighter | GS/4 |
| 5 | Firefighter (Trainee) | GS/3 |
| 61 | Total | |
| 2 | Communication Installer--detailed from Interior Electrical Shop, DFAE | WG/11 |

| <u>Equipment</u> | |
|------------------|--|
| 4 | 750 - Pumper (one for rotational maintenance) |
| 2 | 530 - Crash Vehicle (one for rotational maintenance at SAAF and one for hospital medi-vac) |
| 2 | P-4 Crash Vehicle |
| 1 | Sedan |
| 4 | Pickup Truck |
| 1 | Panel Truck |
| 1 | Light Utility Truck |

Inspection. Air Force Manual 26-3 provides for four fire inspectors for Pope AFB.³ The Pope AFB Fire Department has the four inspectors plus a Chief of Technical Services who is not one of the recognized Assistant Fire Chiefs, but has been recognized as a special local requirement. Inspection responsibility of these five personnel includes 340 buildings with 2,547,000 sq ft (236,600 m²) of building space and open storage.* The 461 family housing units are inspected annually with aid from the firefighters. An orientation briefing is given to newcomers within 30 days after their arrival.

Other routine duties include: (1) weekly inspections of recreational facilities such as the 10 service clubs and bowling alleys, (2) monthly inspections of 108 facilities including maintenance hangers and technical facilities, (3) quarterly inspections of 53 facilities such as administrative buildings and barracks.

Fire prevention inspections are adequately covered by the Technical Services Section and all requirements are currently being met. The fire inspectors spend approximately 5 hours in the field each day, 2 to 2 1/2 hours studying technical publications, and the remainder performing office work. Each fire inspector is spending between 10 and 12 hours a week studying, which appears to be at least twice the time usually available to this type of personnel. The study time allowed for the four inspectors is greater than 2,000 hours per year.

Alarm Maintenance. Technical Services performs minor maintenance on alarm systems, and the Base Civil Engineer does the major maintenance or contracts the work. Alarm maintenance is performed under contract on 20 facilities.

Alarm Room and Extinguisher Maintenance. Manpower evaluations do not recognize spaces for the alarm room or for extinguisher maintenance. The fire chief rotates four military firefighters to serve as dispatchers for the central alarm center. Extinguisher maintenance is also performed by a military firefighter. CO₂ is obtained from Fort Bragg for the fire extinguishers.

Prime Beef. Pope AFB has a special requirement for a 12-man Prime Beef Team. This team can be called up at any time, but is backed up by a reserve team. The total Prime Beef manpower requirement is 20.

³ Air Force Manpower Standards, Direct Support, AFM 26-3, Vol IV, 2 February 1973.

* The square footage for buildings and open storage given here was the figure used to determine the number of inspectors and supervisors by Pope AFB on the last manpower survey. However, this study only revealed 1,773,578 sq ft (164,770 m²) as determined by Real Estate Management Section, BCE. This would reduce the requirement for inspectors to three.

Fire Company Responses. The Pope AFB fire companies are within the specified response requirements (Appendix A). Appendix D shows a map of the response coverage attained for the existing fire stations at Pope AFB. The overlap of coverage between Pope AFB and Fort Bragg, shown in Appendix C, will be reduced when Fort Bragg Station Number 3 is relocated.

Available Firefighting Resources. Table 3 summarizes available firefighting resources in terms of personnel and equipment. The Prime Beef Team has an additional supervisory requirement of two spaces.

4 FIRE FLOW ANALYSIS

Fire Flow Required. The maximum fire flow requirements were determined for both Fort Bragg and Pope AFB, based on the facility with the principal fire risk at each installation. The fire risks are considered high at both areas.

Fort Bragg Requirements. Fort Bragg's principal risk, the commissary (52,942 sq ft [4918.5 m²]), is within the 2 mile (3.2 km), 4 1/2 minute response requirement from Station Number 1. The building is noncombustible and has a sprinkler system. The maximum fire flow requirement as specified in TM 5-813-6⁴ is 1,500 gpm (.0946 m³/sec) plus the sprinkler requirement of 1,000 gpm (.06309 m³/sec); a total facility requirement of 2,500 gpm (.1577 m³/sec). The available fire flow is 2,440 gpm (.1539 m³/sec), as determined from the water flow test performed by the Fort Bragg Fire Department.

Pope AFB Requirements. Pope AFB's principal risk, the general technical building (32,832 sq ft [3050 m²]), is within the 2 mile (3.2 km), 4 1/2 minute response requirement. The building is noncombustible and has a sprinkler system.

The maximum fire flow requirement as specified in AFM 88-10⁵ is 1,500 gpm (.0946 m³/sec) plus the sprinkler requirement of 600 gpm (.038 m³/sec); a total facility requirement of 2,100 gpm (.1325 m³/sec). The fire flow available is 1,769 gpm (.1116 m³/sec) as determined from the water flow test performed by the Pope AFB Fire Department.

Pumpers Required. The required number of pumpers is predicted based on 75 percent of the largest single fire flow requirement using a 750 gpm

⁴ *Water Supply for Fire Protection*, TM 5-813-6 (Department of the Army, October 1965).

⁵ *Water Supply for Fire Protection*, AFM 88-10, Chap 6 (Department of the Air Force, 2 July 1958).

Table 3

Available Firefighting Resources, Pope AFB

Civilian Personnel

| <u>Quantity</u> | <u>Description</u> | <u>Grade Level</u> |
|-----------------|-----------------------------|--------------------|
| 1 | Fire Chief | GS/11 |
| 3 | Assistant Fire Chief | GS/9 |
| 1 | Assistant Fire Chief | GS/7 |
| 1 | Chief, Technical Services | GS/8 |
| 4 | Crew Chief | GS/6 |
| 1 | Fire Prevention Inspector | GS/6 |
| 3 | Fire Prevention Inspector | GS/5 |
| 10 | Driver | GS/5 |
| 5 | Firefighter | GS/5 |
| 11 | Firefighter | GS/4 |
| 4 | Firefighter | GS/3 |
| 1 | Administrative Clerk-Typist | GS/2 |
| 45 | Total | |

Military Personnel

| | | |
|----|--------------------------------------|------|
| 1 | Deputy Fire Chief | MSgt |
| 1 | Assistant Chief, Training | TSgt |
| 2 | Station Captain | TSgt |
| 3 | Assistant Station Captain | TSgt |
| 7 | Crew Chief | SSgt |
| 1 | Extinguisher Repairman (firefighter) | Sgt |
| 1 | Rescue man | Sgt |
| 4 | Dispatcher (firefighter) | Sgt |
| 6 | Driver | Sgt |
| 1 | Firefighter | Sgt |
| 7 | Firefighter | A/IC |
| 16 | Firefighter | Amn |
| 50 | Total | |

Total Civilian and Military manpower is 95.

Table 3 (cont'd)

Equipment

| | | |
|---|-------|--|
| 1 | P-4 | Crash Vehicle |
| 2 | P-2 | Crash Vehicle |
| 2 | F-7 | R/W Foamer |
| 2 | W/D | Water Disburser |
| 1 | P-6 | Ramp patrol vehicle |
| 1 | P-13 | Ramp patrol vehicle |
| 1 | P-10 | Rescue vehicle |
| 1 | P-8 | Pumper |
| 1 | P-12 | Pumper (750) |
| 1 | 530-B | Pumper |
| 2 | 750-A | Pumper (in storage) |
| 1 | C/A | Carry-all, Fire Chief Vehicle |
| 2 | P/U | Pickup, Ass't. Chief Vehicle and Extinguisher Maintenance Vehicle |

(.047 m³/sec) capacity pump as the standard. The actual water flow available for each facility discussed above is greater than two-thirds of the estimated requirement.

Table 4 provides the number of pumps required based on the fire flow analysis, and the number of pumps actually available at each installation.

Table 4

Number of Pumps Required Based on Fire Flow Analysis

| | <u>Pope AFB</u> | <u>Fort Bragg</u> |
|---|---------------------------------------|--------------------------------------|
| Fire flow required/available (gpm) (within .66 requirement) | 2,100 (.1325 m ³ /sec) | 2,500 (.1577 m ³ /sec) |
| Required capacity (gpm) (75% of fire flow) | 1,575 (.09937 m ³ /sec) | 1,875 (.1183 m ³ /sec) |
| Number of pumps required (750 gpm capacity [.047 m ³ /sec]) | 2 | 3 |
| Number of pumps now manned | 2 | 3 |
| | (cross-manned) | |

5 INTERSERVICE SUPPORT AGREEMENT ANALYSIS

The Interservice Support Agreements (ISSAs) in the Fayetteville area were analyzed to determine if response time requirements could be met by fire departments outside the installations.

Mutual Aid Agreement. Pope AFB and Fort Bragg have a mutual aid agreement to provide firefighting assistance. Pope AFB has agreed to respond to and assist the Fort Bragg Fire Department with fires in the eight Army facilities located on Pope AFB. The fire departments provide each other with direct response when all fire companies of the responsible fire department have responded to previous alarms, or when backup support is requested for major fires. The departments also assist each other for aircraft crashes.

The overlap in response coverage between Fort Bragg and Pope AFB will no longer exist when the Fort Bragg Fire Station Number 3 is relocated. Cooperation in establishing the proper response coverage when the station is relocated can be achieved either by consolidating the fire departments under one chief or by expanding the ISSA.

Reciprocal Agreement. Fort Bragg has emergency reciprocal agreements with the Fayetteville Fire Department, Spring Lake Fire Department, and all the volunteer fire departments within Cumberland County. All the agreements call for the maximum assistance that can be spared without endangering fire protection at the fire department called, and will be furnished without charge or claims.

The Fayetteville Fire Department provides Fort Bragg with a ladder truck on request but requires approximately 30 minutes to respond from a distance of 14 miles (22.5 km). The other fire departments require in excess of 30 minutes to respond to a call from Fort Bragg from distances ranging from 3 (4.8 km) to over 30 miles (48.3 km). The volunteer fire departments surrounding the two installations can provide backup support but cannot provide the required response coverage.

6 CONSOLIDATION EVALUATION

Fire Station Requirements. The two fire stations at Pope AFB in effect operate as one station. The base's master plan provides for enlargement of the main station so that Station Number Two can be eliminated. Since Pope AFB Fire Department is cross-manned for crash and structural fire-fighting and the only manpower spaces are authorized for crash vehicles, there appears to be no justification to remove or reduce the structural capability. Pope AFB currently can meet all its fire protection requirements.

Fort Bragg requires the three stations that now exist to meet the time and distance response requirements. Simmons Army Airfield (SAAF) is located on the far east edge of the geographical area under consideration, which eliminates a consolidation between the SAAF Fire Station and the other two Fort Bragg fire stations. The SAAF fire station is now cross-manned to handle both the structural and crash requirements at the airfield.

Because of the widely scattered operational, industrial, and warehouse facilities, the main cantonment area at Fort Bragg needs two stations to meet required time and distance responses. At present, the southeast edge of the cantonment area is not within the required 2 mile (3.2 km), 4 1/2 minute response requirement (see Appendix C).

Due to the location and requirements of the Air Force and Army airfields, the long reaction times for outside fire departments, and the DOD response and distance requirements, the combined area of Fort Bragg and Pope AFB requires the existing four fire stations. However, Fort Bragg's relocation plans for Fire Station Number 3 will facilitate meeting all the response requirements. A consolidation of the fire departments at the two installations would aid in relocating the fire station at the most advantageous site. The present overlap in response coverage between the Pope AFB fire station and Fort Bragg Station Number 3 could be

eliminated or at least reduced by having the Pope AFB fire station assume responsibility for this overlap area.

Resource Requirements. The manpower and cost savings that would result from consolidating the fire departments would come from a reduction in the supervisory levels. The Fort Bragg supervisory level now consists of five personnel; the Pope AFB level consists of eight personnel. The consolidated fire department would require four fire stations and eight supervisory personnel as shown in Table 5. This elimination of five supervisors (one Fire Chief, three Assistant Fire Chiefs, and one Chief Fire Prevention Inspector [Technical Services]) would effect savings of approximately \$88,801, including upgrading the Fire Chief from GS 11 to GS 12 and the Assistant Fire Chiefs from GS 9 to GS 10. A Deputy Fire Chief with Prime Beef responsibilities, as now exists at Pope AFB, would be included.

As a result of consolidation, the two communication centers would be centralized at one location to serve both installations, which would reduce the personnel requirement from eight to four. However, since the Pope AFB Fire Department does not have spaces recognized for dispatchers and must use firefighters, and since Fort Bragg is recognized for four alarm room operators, this consolidation, although desirable, would not produce monetary savings. Some labor time would become available for other tasks, however. The consolidation of the communication centers will require a study to determine the operations plan and the one-time conversion costs.

The fire extinguisher maintenance could be centralized at one location, which would reduce the requirement from two repairmen to one. Again, the cost savings would not be apparent, since the Pope AFB Fire Department has not been recognized for a repairman. It is possible, however, that some labor time would become available for other tasks.

Although consolidation is not expected to reduce the requirement for fire inspectors except at the supervisory level, a more efficient inspection program could be developed. The Fort Bragg Fire Department staffing criteria do not allow fire inspectors for on-post duties. As a consequence all of the on-post inspection cannot be performed by firefighters. Pope AFB Fire Department, however, has been allowed five inspectors, based upon square footage of installation facilities. Pope AFB just barely exceeds the square footage requirement for four inspectors. (See footnote on page 13.) This allows each inspector a generous study period of 2 to 2 1/2 hours per day. Under consolidated activities, a reduction of one half of the study time allowed for Pope inspectors would produce a half-time inspector who could be used to fill the inspection deficiency at Fort Bragg. Fort Bragg has been allowed one inspector to inspect facilities outside the installation, such as USAR Centers and Camp MacKall. The consolidation of fire inspection for the two fire departments can result in the reduction of one inspection supervisor.

Table 5
Consolidated Fire Department--Supervisors

| <u>Quantity</u> | <u>Description</u> | <u>Grade Level</u> |
|-----------------|---|--------------------|
| 1 | Fire Chief | GS/12 |
| 1 | Deputy Fire Chief | M Sgt |
| 3 | Assistant Fire Chiefs | GS/10 |
| 1 | Chief, Fire Prevention Inspector | GS/8 |
| 1 | Assistant Chief for local Air Force crash requirement | GS/7 |
| <u>1</u> | Air Force Prime Beef Supervisor | T Sgt |
| 8 | Total | |

Reporting Requirements of Consolidated Fire Departments. For an RPMA consolidation, the Fire Chief of the consolidated fire department could report to the head of the joint facilities engineering consolidation organization. For a stand-alone consolidation, the Fire Chief could be independent of any other consolidation effort and report to a representative of both installation commanders.

In either case, the structure of the consolidated fire department would be unaffected. Thus, the evaluation of the feasibility of consolidated fire prevention/protection is independent of the consideration of RPMA consolidation.

Consolidation would offer no savings in terms of a reduction of operational personnel. The number of fire companies and required operational personnel spaces are justified by the DOD requirements for structural fire protection.

7 CONCLUSIONS AND RECOMMENDATIONS

Consolidating the fire departments at Fort Bragg and Pope AFB will not result in a reduction in the existing fire companies. Consolidation could, however, save approximately \$88,801 per year, a 4.6 percent savings, through reduction in supervisory personnel requirements. In addition, some efficiencies in operation and use of resources could be achieved by centralizing the communication centers, fire extinguisher repair shops, and inspection sections; and by relocating Fort Bragg Fire Station Number 3. Efficiencies resulting from centralization of repair shops and inspection sections can also be realized through expansion of existing ISSAs. The relocation of Fort Bragg Fire Station Number 3 will take place in any case, but expansion of Pope AFB coverage to include the northern portion of Fort Bragg can also be handled by ISSA. If either consolidation or ISSA expansion is pursued, an operations plan must be developed along with a detailed analysis of one-time costs.

The apparent savings from reduction of supervisory requirements do not seem to justify a separate stand-alone consolidation at this time, since command responsibilities and reporting requirements will remain distinct until such time as the entire RPMA organization is consolidated. If and when this happens, the fire protection/prevention services could be considered within the RPMA consolidation plan. Until such time, it is recommended that the existing ISSAs be expanded to improve response coverage and use of existing personnel.

APPENDIX A:

DOD FIRE RESPONSE REQUIREMENTS⁶

Fire Companies Response Distances/Times. Where property at risk involves operational, industrial, technical school, warehousing, and hospital facilities, fire companies shall be located within 2 miles (3.2 km) and time for fire company response shall not exceed 4.5 minutes.


Where property at risk involves administrative, training, community, commercial, dormitory, BOQ/VOQ, multi-family housing, and like facilities, fire companies shall be located within 3 miles (4.8 km) and time required for fire company response shall not exceed 6 minutes.

Where property at risk involves individual or duplex family housing (compact build-up area), trailer courts, and like facilities, fire companies shall be located within 5 miles (8 km) and time required for fire company response shall not exceed 8.5 minutes.

Where property at risk involves isolated single family housing and/or incidental structures, fire companies shall be located within 7 miles (11.3 km) and time required for fire company response shall not exceed 10 minutes.

⁶ Memorandum, Deputy Assistant Secretary of Defense (I&H), 13 May 1975, Subject: Consolidation of Real Property Maintenance Activities (RPMA) at Military Installations.

APPENDIX B:
EXISTING RESPONSE COVERAGE FOR THE FORT BRAGG FIRE DEPARTMENT

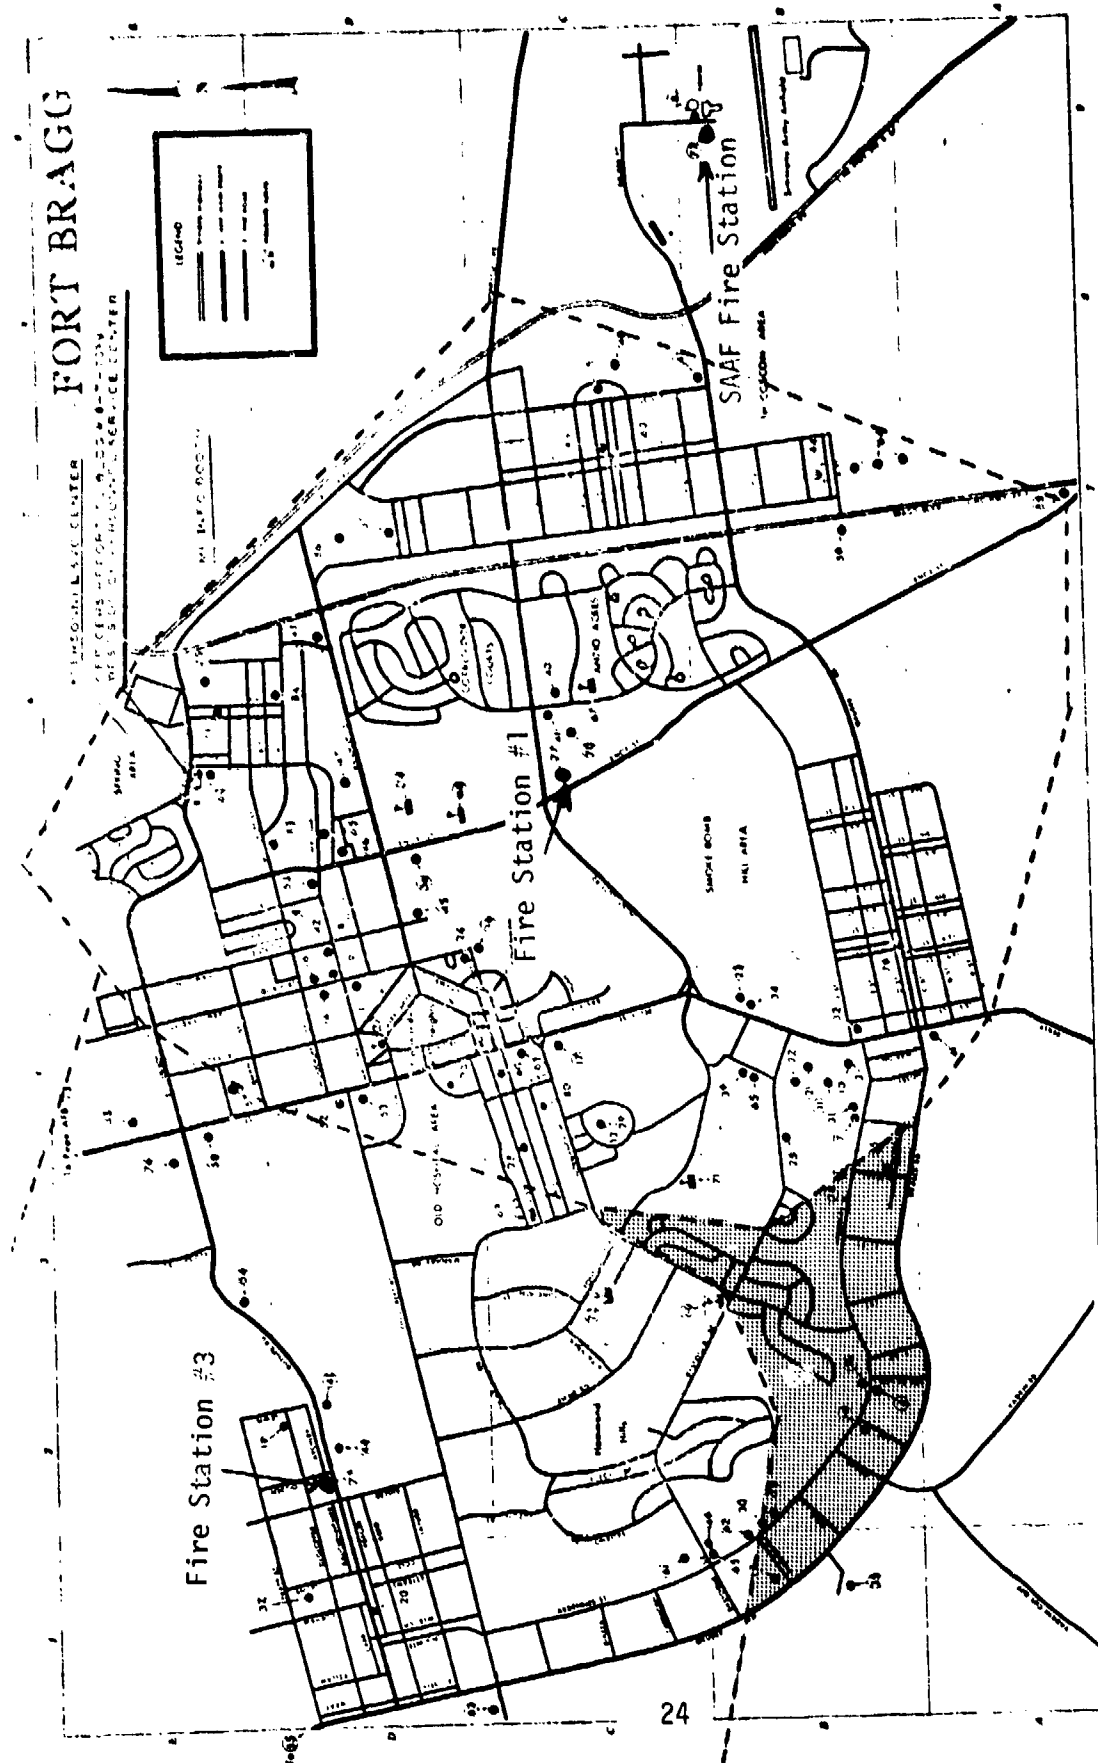

Dotted line is the boundary of the 2 mile (3.2 km), 4.5 min response requirement for each station.
Shaded area contains some facilities requiring this response but not obtaining it from any station.

FORT BRAGG NORTH CAROLINA

MAJOR UNIT HEADQUARTERS

1. XVIII Abn Corps & Ft Bragg 4D
2. 82d Abn Div 1B
3. JFK Cen for Mil Asst 4B
4. XVIII Abn Corps Arty 2B
5. 1st COSCOM 8C
6. 16th MP Group 4D
7. 35th Signal Group 4B
8. 12th Combat Avn Group 9B
9. HQ Command 5D
10. USAIMA 4B
11. First ROTC Region 4F
12. MEDDAC (Womack Army Hosp) 4C
13. FORSIC 1E
14. USAACEBD 4D
15. USA Readiness Group 3B
16. 504th ASA Bde 2B
17. USA Parachute Team 4C
18. USACC Agency 5D
19. USA NCO Academy 2D
20. USACID (Field Ofc) 1D

BILLETING TRANSIENT

21. Office (Moon Hall) 4B
22. Hardy Hall 4B
23. Left House 4B
24. Normandy House 5D
25. Delmont House 4B

CHAPLAIN ACTIVITIES

26. JFK Memorial Chapel 3B
27. Main Post Chapel 4D
28. Religious Educ Center 4C

MEDICAL ACTIVITIES

29. Womack Army Hosp 4C
30. LaFlamme Dental Clinic 2B
31. Rohde Dental Clinic 4B
32. Dependant Dental Clinics 4B
33. Veterinary Activities 4E

NCO OPEN MESSSES

34. Main NCOOM & Pool 4B
35. 82d NCOOM & Pool 1B

OFFICERS OPEN MESSSES

36. Pool & Golf Course 5C
37. Annex 7D
38. Annex & Annex 4D

POST EXCHANGE ACTIVITIES

39. Main PX (Incl Post Ofc, Banks, Cafeteria, Etc) 4B
40. Mallonee Village 6C
41. Service Stations 4A, 8B, 6C, 2D
42. Admin Offices 5D

PROVOST MARSHAL ACTIVITIES

43. Information Booth 6D
44. Area Confinement Facility 2D
45. PM Office 5D
46. Registration Vehicles 5D
47. Freeway and NC Driver Testing 6D
48. Vehicle Inspection 6D

RECREATION SERVICES

49. Allen Pool 8C
50. Atchley Pool 1C
51. Hedrick Stadium 4D
52. Hocking Felt House 2B
53. Lee Field House 4D
54. Main Post Library 5D
55. McFadden Pond Picnic Area 3E
56. McKellars Lodge 1D
57. Playhouse 5D
58. Recreation Equipment Rental 4E
59. Riding Stables 4E
60. Stryker Golf Course 7B
61. Tennis Courts 4C, 7C, 6E
62. Tumble Stadium 1C
63. Tucker Field House & Pool 1B
64. Youth Center 4C
65. Youth Activities Rec Area 7B, 7A
66. Bowling Alleys 1B, 4B, 5D

SCHOOLS DEPENDENTS


67. Butler 3B
68. McJannet 6C
69. Inman Jr High 5D
70. Kindergarten & Nursery 3C
71. Malonee Village Nursery 6C
72. McKel 3C
73. Murray 3C
74. Pope AFB 4E
75. Bowery 5D

MISCELLANEOUS

76. Commissary 6E
77. Facilities Engineering 4E
78. Fire Station 4C, 2D, 5B
79. Museum, 82d Abn Div 2B
80. Museum, Special Forces 5B
81. Overton Annexpress Rep House 4C, 7C
82. Personnel Services Center 6E
83. Range Control HQ 7D
84. Recycling Center 5D
85. Retirement Services 6D
86. Statue (Iron Minel) 7A
87. Cemetery 7D

APPENDIX C:

OVERLAP OF RESPONSE COVERAGES FOR FORT BRAGG AND POPE AIR FORCE BASE

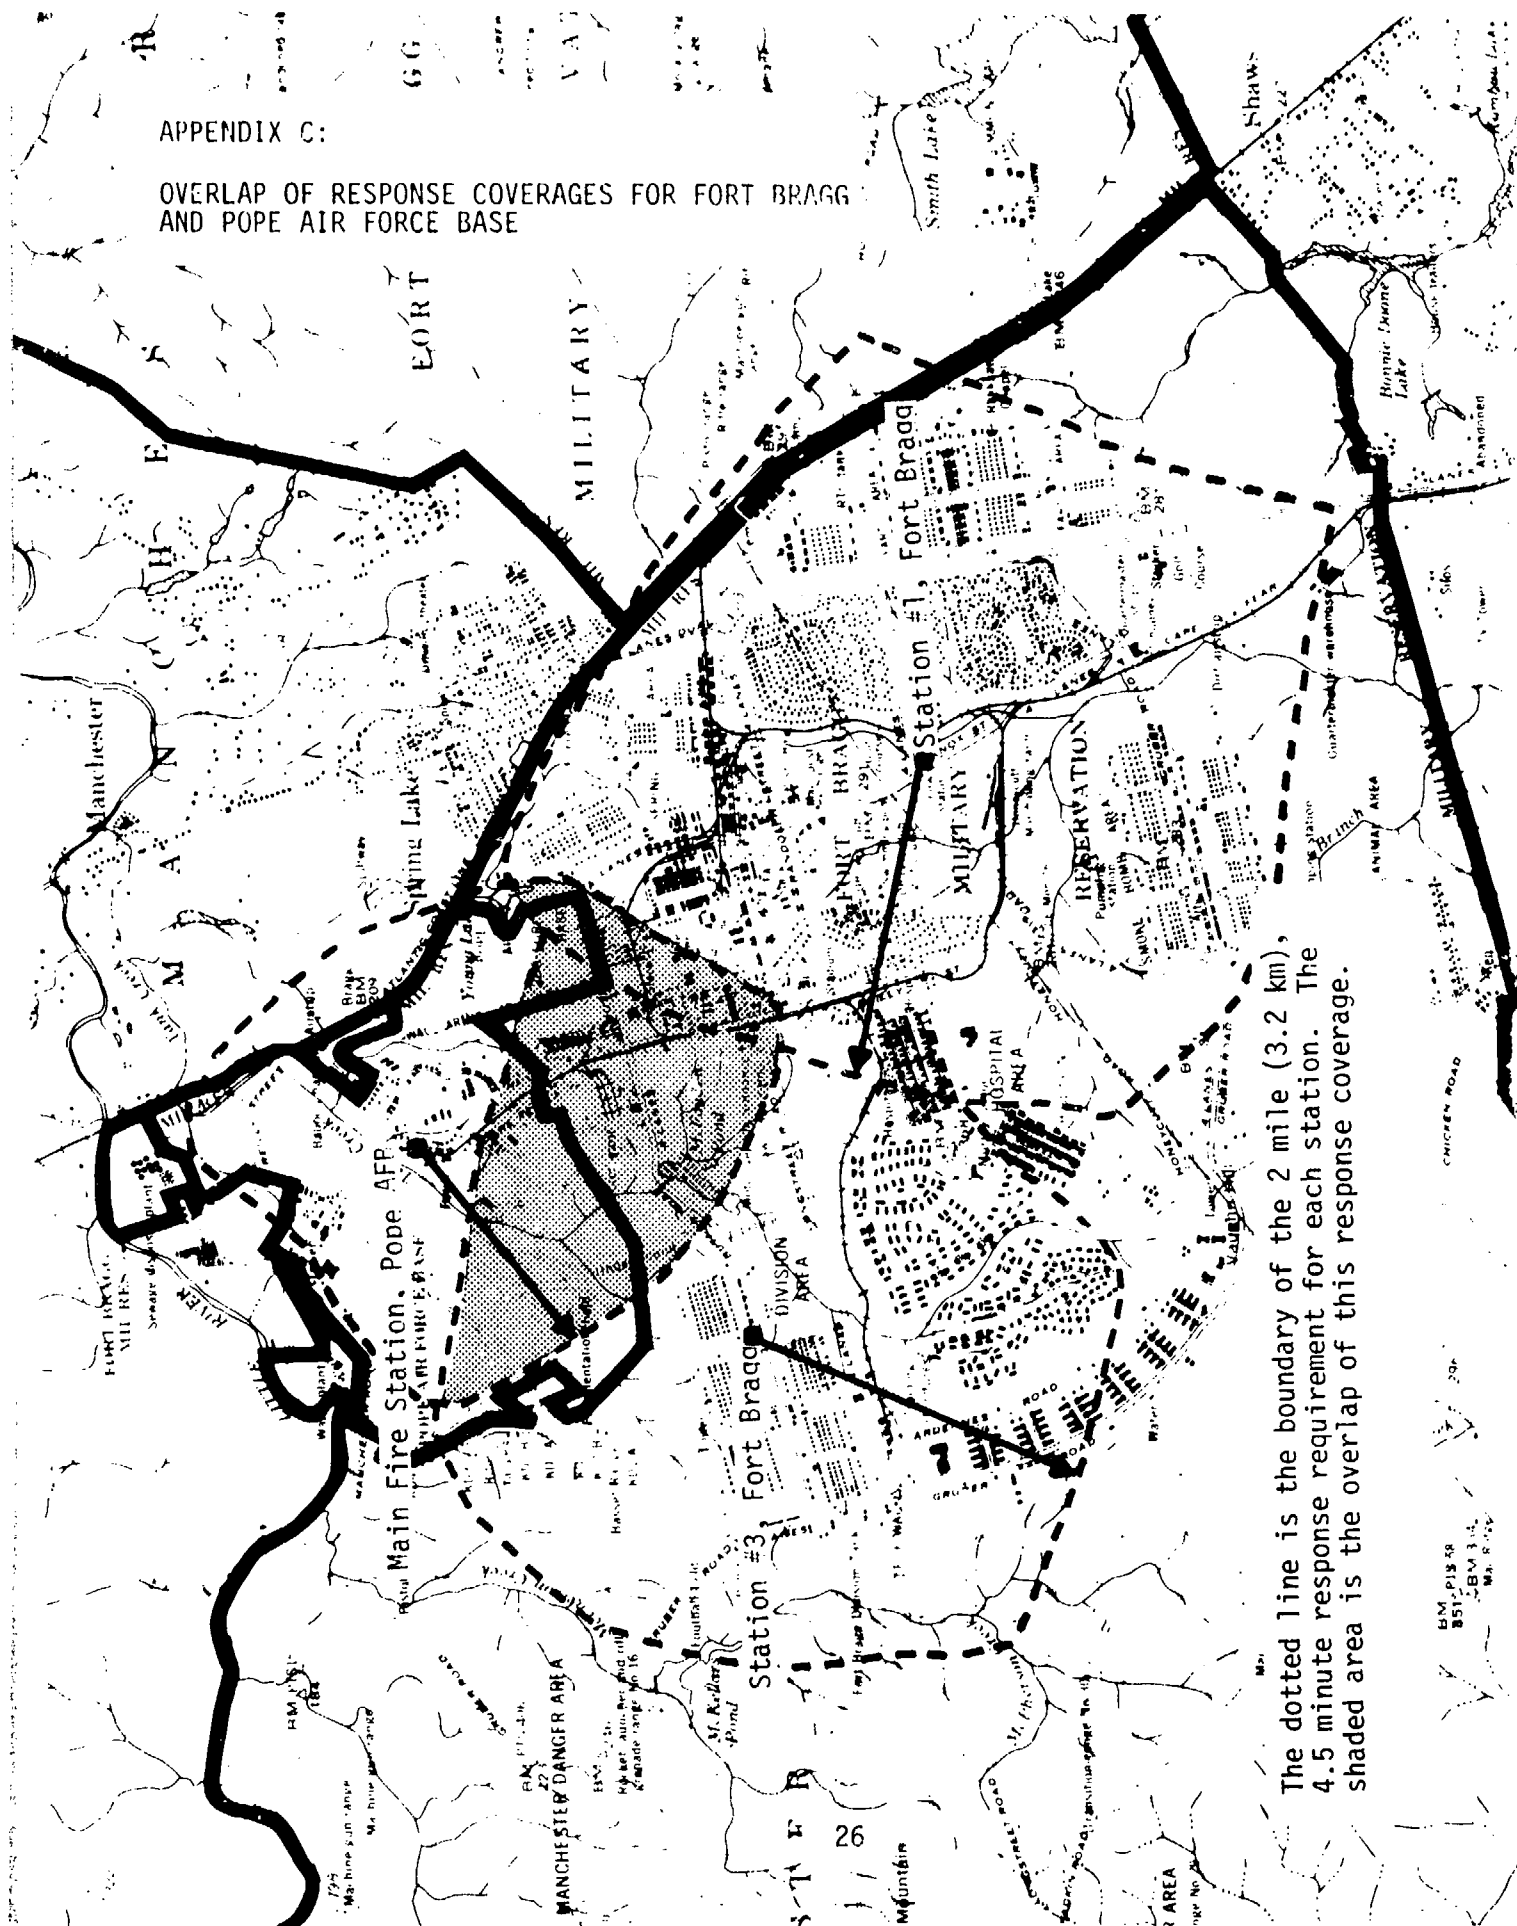


The dotted line is the boundary of the 2 mile (3.2 km),
4.5 minute response requirement for each station. The
shaded area is the overlap of this response coverage.

MAN-PIST
BSI-PM 3.1
MA 8.15

APPENDIX D:

EXISTING RESPONSE COVERAGE FOR THE POPE AIR FORCE BASE FIRE DEPARTMENT

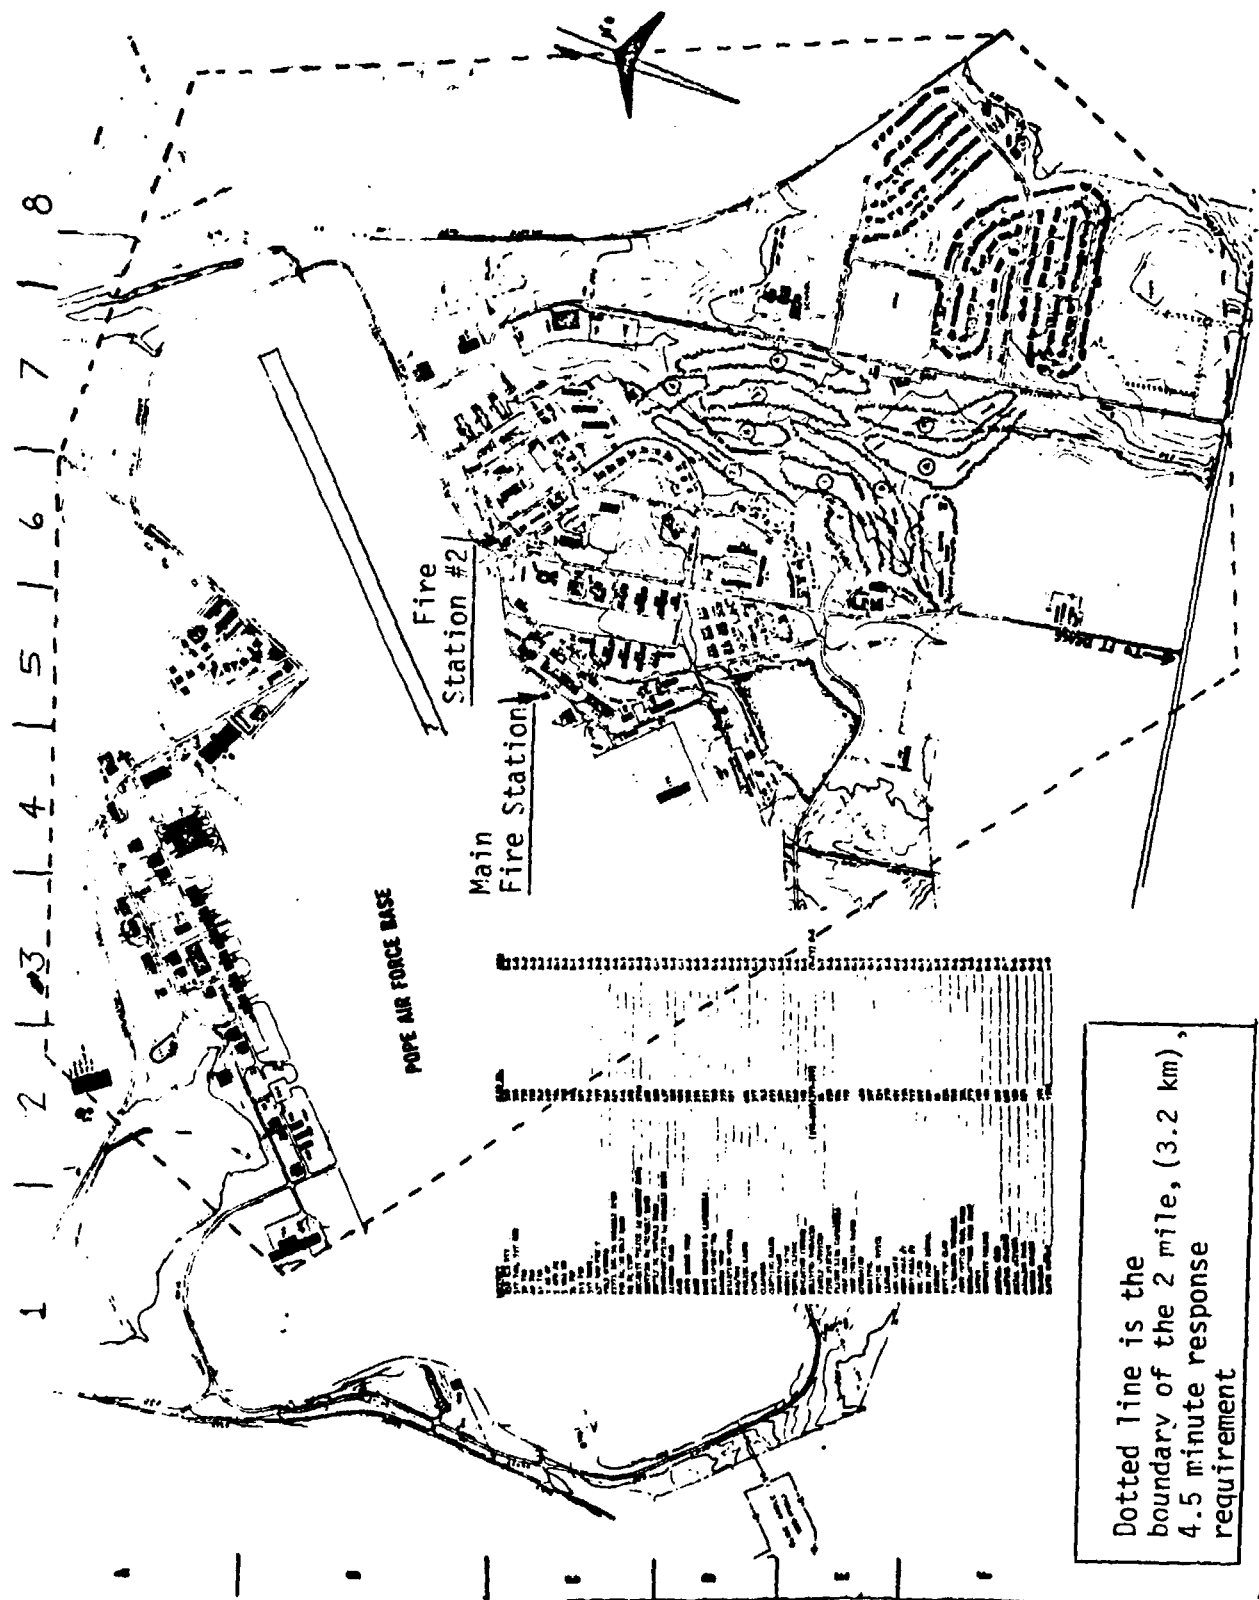

CERL DISTRIBUTION

Chief of Engineers
ATTN: DAEN-RDM
ATTN: DAEN-FEP
ATTN: DAEN-FEF (5)
Department of the Army
WASH DC 20314

Commander
317 Combat Support Group (MAC)
ATTN: DE (2)
Pope AFB, NC 28308

Commander
Headquarters-18th Airborne Corps
and Fort Bragg
ATTN: AFZA-FE (2)
Fayetteville, NC 28307

Directorate of Civil Engineering
ATTN: AF-PREMA/LTC C. Medlock
WASH DC 20330

Defense Documentation Center
ATTN: TCA
Cameron Station
Alexandria, VA 22314

Library of Congress (2)
Exchange and Gift Div
ATTN: American & British
WASH DC 20540

Defense Logistics Studies Information
Exchange (2)
U.S. Army Logistics Management Center
ATTN: AMXMC-D
Ft. Lee, VA 23801

Commander
Headquarters MAC, AF (2)
ATTN: DEMM/LTC E. F. Lednicky
Scott AFB, IL 62225

Commander
Headquarters USA Forces Command (2)
ATTN: AFEN-EA/H. A. Logan
Ft McPherson, GA 30330