

FINAL SUBMITTAL

**VOLUME II OF II, APPENDICES E & F**

**ENERGY SAVINGS OPPORTUNITY SURVEY  
FORT GILLEM, GEORGIA**

Prepared for

**SAVANNAH DISTRICT  
CORPS OF ENGINEERS  
SAVANNAH, GEORGIA**

Under

**CONTRACT NO. DACA21-91-C-0097**

September 1992

EMC No. 3105-000

19971016 247

**E M C ENGINEERS, INC.**  
1950 Spectrum Circle  
Suite B-312  
Marietta, Georgia 30067  
Phone (404) 952-3697




DEPARTMENT OF THE ARMY  
CONSTRUCTION ENGINEERING RESEARCH LABORATORIES, CORPS OF ENGINEERS  
P.O. BOX 9005  
CHAMPAIGN, ILLINOIS 61826-9005

REPLY TO  
ATTENTION OF: TR-I Library

17 Sep 1997

Based on SOW, these Energy Studies are unclassified/unlimited.  
Distribution A. Approved for public release.

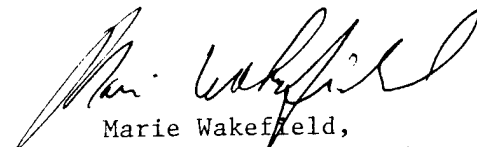  
Marie Wakefield,  
Librarian Engineering

This report has been prepared at the request of the client, and the observations, conclusions, and recommendations contained herein constitute the opinions of E M C Engineers, Inc. In preparing this report, EMC has relied on some information supplied by the client, the client's employees, and others, which we gratefully acknowledge. Because no warranties were given with this source of information, E M C Engineers, Inc. cannot make certification or give assurances except as explicitly defined in this report.

# TABLE OF CONTENTS

<u>Section</u>	<u>Page</u>
<b>VOLUME I</b>	
List of Abbreviations .....	ix
<b>EXECUTIVE SUMMARY</b>	
1.0 INTRODUCTION	
1.1 Authority for Study .....	1-1
1.2 Purpose of Study .....	1-1
1.3 Scope of Work .....	1-1
1.4 Organization of Submittal .....	1-2
1.5 Work Accomplished .....	1-2
1.6 Previous Utility Conservation Studies .....	1-6
2.0 UTILITY CONSUMPTION AND RATES	
2.1 General .....	2-1
2.2 Utility Rates .....	2-1
2.2.1 Electrical Rates .....	2-1
2.2.2 Natural Gas Rates .....	2-2
2.2.3 Water and Sewer Rates .....	2-3
2.3 Historical Consumption of Utilities .....	2-3
2.3.1 Historical Electrical Energy Consumption .....	2-3
2.3.2 Historical Natural Gas Consumption .....	2-6
2.4 Summary of Utilities .....	2-8
2.5 Basis for Economic Analysis .....	2-8
2.5.1 ECIP Guidance .....	2-8
2.5.2 Basis for Energy Cost Savings Benefits .....	2-9
2.5.3 Basis for Labor and Material Costs .....	2-10
2.6 Demand Side Management .....	2-10
3.0 EVALUATION OF ENERGY CONSERVATION OPPORTUNITIES	
3.1 General .....	3-1
3.2 ECOs Evaluated .....	3-1
3.3 Analysis Methodology .....	3-6
3.4 ECO Analysis .....	3-7
3.4.1 ECO 1 - Insulation .....	3-8
3.4.1.1 - Insulate Walls and Roofs .....	3-8
3.4.2.1 - Insulate Pipes and Ducts .....	3-13
3.4.2 ECO 2 - Insulated Windows .....	3-18
3.4.3 ECO 3 - Weatherstripping and Caulking .....	3-20
3.4.4 ECO 4 - Domestic Hot Water Temperature .....	3-23
3.4.5 ECO 5 - Install High Efficiency Electric Motors .....	3-25

## TABLE OF CONTENTS (Continued)

<u>Section</u>	<u>Page</u>
3.4.6 ECO 6 - Economizers .....	3-28
3.4.7 ECO 7 - Control Hot Water Circulation Pump .....	3-31
3.4.8 ECO 8 - Install Low-Flow Shower and Faucet Fixtures .....	3-34
3.4.9 ECO 9 - Heat Reclaim from Hot Refrigerant Gas .....	3-37
3.4.10 ECO 10 - Prevent Air Stratification .....	3-40
3.4.11 ECO 11 - Replace Street Lights .....	3-43
3.4.12 ECO 12 - Revise or Repair HVAC Controls .....	3-46
3.4.13 ECO 13 - Thermal Storage .....	3-49
3.4.14 ECO 14 - Radiant Heaters and Loading Dock Seals .....	3-51
3.4.14.1 - Radiant Heaters .....	3-51
3.4.14.2 - Loading Dock Seals .....	3-54
3.4.15 ECO 15 - Separate Light Switches .....	3-57
3.4.16 ECO 16 - Investigate Post Demand Usage .....	3-62
3.4.17 ECO 17 - Boiler Operation Schedule .....	3-71
3.4.18 ECO 18 - Replace Exit Sign Bulbs with Fluorescent Bulb Kit .....	3-73
3.4.19 ECO 19 - Previous Lighting Study Review .....	3-76
3.5 ECO Project Summary .....	3-79
3.6 Results .....	3-85
4.0 ENERGY CONSERVATION PROJECTS	
4.1 Project Development .....	4-1
4.2 ECIP Projects .....	4-2
4.3 Non-ECIP Projects .....	4-2
4.3.1 QRIP Project .....	4-2
4.3.2 MCA Program-1 .....	4-2
4.3.3 MCA Program-2 .....	4-5
4.3.4 Low-Cost/No-Cost Project .....	4-5
4.4 NAF Projects .....	4-6
5.0 SUMMARY AND RECOMMENDATIONS	
5.1 Summary .....	5-1
5.1.1 ECOs Evaluated .....	5-1
5.1.2 Results .....	5-1
5.1.3 Energy Project Development .....	5-6
5.2 Recommendations .....	5-8

## TABLE OF CONTENTS (Continued)

### LIST OF APPENDICES

#### VOLUME I

- A SCOPE OF WORK AND CONFIRMATION NOTICES
- B UTILITY RATES AND HISTORICAL CALCULATIONS
- C ECO BACKUP CALCULATIONS
  - C-1.1 WALL INSULATION
  - C-1.2 ROOF INSULATION
  - C-1.3 PIPE AND DUCT INSULATION
  - C-2 INSULATED GLASS
  - C-3 WEATHERSTRIPPING AND CAULKING
  - C-4 MEASURE HOT WATER TEMPERATURES
  - C-5 ELECTRIC MOTORS
  - C-6 ADD ECONOMIZERS
  - C-7 CONTROL HOT WATER CIRCULATION PUMPS
  - C-8 INSTALL LOW-FLOW SHOWER AND FAUCET FIXTURES
  - C-9 HEAT RECLAIM FOR HOT REFRIGERANT GAS
  - C-10 PREVENT AIR STRATIFICATION
  - C-11 REPLACE STREET LIGHTS
  - C-12 REVISE OR REPAIR HVAC CONTROLS
  - C-13 THERMAL STORAGE
  - C-14.1 LOADING DOCK SEALS
  - C-14.2 RADIANT HEATERS
  - C-15.1 BUILDING 200 LIGHTING CONTROLS
  - C-15.2 SEPARATE SWITCHES TO CONTROL LIGHTING
  - C-16 INVESTIGATE POST DEMAND USAGE
  - C-17 EVALUATE BOILER OPERATION
  - C-18 EXIT SIGN RETROFIT
  - C-19 LIGHTING UPGRADES
  - C-20 COMPUTER SIMULATION SUMMARIES
- D ECO PROJECT BACKUP CALCULATIONS
  - D-1 ECIP PROJECT
  - D-2 QRIP PROJECT
  - D-3 FAMILY HOUSING PROJECT
  - D-4 NAF PROJECT
  - D-5 OTHER ENERGY PROJECTS

#### VOLUME II

- E COMPUTER SIMULATIONS
- F FIELD SURVEY NOTES

**TABLE OF CONTENTS (Continued)**

**LIST OF TABLES**

<u>Table</u>		<u>Page</u>
1-1	Scope of Work Summary .....	1-4
2-1	Electrical Energy Consumption .....	2-4
2-2	Natural Gas Consumption .....	2-6
2-3	FY91 Utility Usage and Cost Comparison .....	2-8
2-4	Uniform Present Worth Factors .....	2-9
3-1	Energy Conservation Opportunities List .....	3-2
3-2	Nonfeasible ECOs .....	3-3
3-3	Buildings Added .....	3-3
3-4	Building ECO Matrix .....	3-4
3-5	Computer Simulation Buildings .....	3-7
3-6	Wall Insulation .....	3-11
3-7	Roof Insulation .....	3-12
3-8	Duct and Pipe Recommended Thicknesses .....	3-16
3-9	Pipe Insulation .....	3-17
3-10	Duct Insulation .....	3-17
3-11	Insulated Windows .....	3-19
3-12	Weatherstripping and Caulking .....	3-22
3-13	Domestic Hot Water Temperature Measurements .....	3-24
3-14	Install High Efficiency Electric Motors .....	3-27
3-15	Economizers .....	3-30
3-16	Control Hot Water Circulation Pump .....	3-33
3-17	Install Low-Flow Shower and Faucet Fixtures .....	3-36
3-18	Heat Reclaim from Hot Refrigerant Gas .....	3-39
3-19	Prevent Air Stratification .....	3-42
3-20	Replace Street Lights .....	3-45
3-21	Revise or Repair HVAC Controls .....	3-48
3-22	Thermal Storage .....	3-50
3-23	Radiant Heaters .....	3-53
3-24	Loading Dock Seals .....	3-56
3-25	Separate Light Switches .....	3-60
3-26	FY91 Historical Electrical Demand - Fort Gillem .....	3-67
3-27	Demand Savings Comparison .....	3-70
3-28	Replace Exit Sign Bulbs with Fluorescent Bulb Kit .....	3-74
3-29	Previous Lighting Study Review .....	3-78
3-30	Energy Conservation Opportunities List .....	3-80
3-31	Economic Summary of ECOs, Listed by ECO Number .....	3-81
3-32	Economic Summary of ECOs, Listed by SIR .....	3-83

TABLE OF CONTENTS (Continued)

LIST OF TABLES

<u>Table</u>		<u>Page</u>
4-1	MCA Project-1 Summary .....	4-4
4-2	NAF Economic Summary .....	4-7
5-1	Economic Summary of ECOs, Listed by ECO Number .....	5-2
5-2	Economic Summary of ECOs, Listed by SIR .....	5-4
5-3	Projects Economic Summary .....	5-7

LIST OF FIGURES

<u>Figure</u>		<u>Page</u>
2-1	Electrical Consumption .....	2-5
2-2	Natural Gas Consumption .....	2-7
3-1	FY91 Typical Hourly Demand, Summer - Fort Gillem .....	3-68
3-2	FY91 Typical Hourly Demand, Winter - Fort Gillem .....	3-69



## LIST OF ABBREVIATIONS

ACH	-	air changes per hour
AAFES	-	Army Air Force Exchange Service
AHU	-	air handling unit
Bldg	-	building
cfm	-	cubic feet per minute
conf.	-	confirmation
DCU	-	digital control unit
DDC	-	direct digital control
DEH	-	Director of Engineering and Housing
DHW	-	domestic hot water
DX	-	direct expansion
ECIP	-	Energy Conservation Investment Program
ECO(s)	-	Energy Conservation Opportunity(ies)
ESOS	-	energy savings opportunity survey
F	-	Fahrenheit
FCU	-	fan coil unit
ft	-	foot, feet
FY	-	fiscal year
gpm	-	gallons per minute
hp	-	horsepower
HPS	-	high pressure sodium
hr	-	hour(s)
HW	-	hot water
in.	-	inch(es)
kVar	-	kilovolt amp reactive
kW	-	kilowatt, one thousand watts
kWh	-	kilowatt-hour, one thousand watthours
LAPS	-	lighting automation panels
LBH	-	pounds per hour
lbm	-	pounds mass
LCCID	-	Life Cycle Cost in Design
MBtu	-	British thermal units (thousand)
mcf	-	thousand cubic feet

## LIST OF ABBREVIATIONS

(Continued)

MCA	-	Military Construction Army Program
MCP	-	Military Construction Program
NAF	-	non-appropriated funds
PRV	-	pressure reducing valve
psia	-	pounds per square inch, absolute
psig	-	pounds per square inch, gauge
QRIP	-	Quick Return on Investment Program
RCU	-	remote control unit
rpm	-	revolutions per minute
SES	-	Shared Energy Savings
SIOH	-	supervision, inspection, and overhead
SIR	-	Savings-to-Investment Ratio
SOW	-	Scope of Work
therm	-	100,000 Btus
UCS	-	utility control system
UPW	-	uniform present worth

APPENDIX E

COMPUTER ENERGY SIMULATION BACKUP DATA

BUILDING 101

# EMC ENGINEERS, INC.

PROJECT: FORT MCPHERSON & FORT GILLEM ESOS STUDY  
 LOCATION: FORT GILLEM  
 ECO: Computer Simulation Summary

EMC PROJECT: #3105.000  
 DATE: 13-APR-92  
 FILE: G101ECO.WK3  
 PREPARED BY: R. GERRANS  
 CHECKED BY:

CLIENT CONTRACT NO: DACA21-91-C-0097  
 CLIENT PROJECT ENG: TERRY SEABROOK

Bldg: G101 Area: 120,182 ft<sup>2</sup>

Run Description	Heating Gas Use (kBtu/yr)	Heating Electric Use (kWh/yr)	Cooling Electric Use (kWh/yr)	Fan Electric Use (kWh/yr)	Pump Electric Use (kWh/yr)	Lighting Electric Use (kWh/yr)	Recept. Electric Use (kWh/yr)	Total Electric Use (kWh/yr)	Peak Electric Demand (kW)	Total Gas Use (MBtu/yr)	Total Energy Use (Mbtu/yr)
Baseline	523,833	8,551	299,666	416,645	236,958	729,764	439,234	2,130,817	670	524	7,794
ECO#1 - Wall Savings/(Loss)	305,157	6,736	283,434	416,645	236,958	729,764	439,234	2,112,770	651	305	7,514
	218,676	1,815	16,232	0	0	0	0	18,047	19	219	280
ECO#2 Savings/(Loss)	401,179	6,910	297,925	416,645	236,958	729,764	439,234	2,127,435	661	401	7,660
	122,653	1,641	1,741	0	0	0	0	3,382	9	123	134
ECO#3 Savings/(Loss)	505,158	8,356	299,243	416,645	236,958	729,764	439,234	2,130,199	668	505	7,773
	18,675	196	423	0	0	0	0	618	2	19	21
ECO#6 Savings/(Loss)	523,833	8,551	297,878	416,645	236,958	729,764	439,234	2,129,030	670	524	7,788
	0	0	1,788	0	0	0	0	1,788	0	0	6
ECO#7 Savings/(Loss)	290,370	2,538	277,213	416,645	140,860	729,764	439,234	2,006,253	670	290	7,136
	233,463	6,013	22,453	0	96,098	0	0	124,564	0	233	658
ECO#12 Savings/(Loss)	221,515	2,047	192,948	349,638	132,000	729,764	439,234	1,845,631	613	222	6,519
	302,316	6,504	106,718	67,007	104,958	0	0	285,187	57	302	1,275
ECO#13 Savings/(Loss)	523,833	8,551	312,788	416,645	236,958	729,764	439,234	2,143,939	544	524	7,839
	0	0	(13,122)	0	0	0	0	(13,122)	126	0	(45)
ECO#15 Savings/(Loss)	565,330	9,020	281,067	416,645	236,958	613,004	439,234	1,995,929	670	565	7,375
	(41,498)	(469)	18,598	0	0	116,760	0	134,889	0	(41)	419

# E M C ENGINEERS, INC.

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation Bldg 101, Gilliam

ECO #1 - Wall Insulation

Wall U-value

- add R-9 to existing wall

$$R = 13.01$$

$$U = 0.08$$

$$\text{original } U = 0.25$$

$$\text{Area} = 35,512 \text{ ft}^2$$

$$\text{original } UA = 8,878$$

$$\text{Improved } UA = 2,841$$

$$\Delta UA = 6,037$$

Electric Savings

$$\text{Total Electric Savings} = 18,047 \text{ kWh/yr}$$

$$\text{Electric Savings} / \Delta UA = \boxed{3.0} \text{ kWh} / \Delta UA$$

Demand Savings

$$\text{Peak Demand Savings} = 19 \text{ kW}$$

$$\text{Demand Savings} / \Delta UA = \boxed{3.1 \times 10^{-3}} \text{ kW} / \Delta UA$$

Gas Savings

$$\text{Total Gas Savings} = 219 \text{ MBtu/yr}$$

$$\text{Gas Savings} / \Delta UA = \boxed{0.036} \text{ MBtu} / \Delta UA$$

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation Bldg 101, Gilman

ECO # 2 - Insulated glass

Window U-Value -ASHRAE F 27.13

-double pane, Al frame, argon

$U = 0.65$

Window shading coefficient ASHRAE F 27.26

-light blind.

$\Rightarrow 0.98$

Window Area = 6,468 ft<sup>2</sup>

Electric Savings

Total Electric Savings = 3,382 kWh/yr

Electric Savings / ft<sup>2</sup> =  $0.52$  kWh / ft<sup>2</sup>

Demand Savings

Peak Demand Savings = 9 kW

Demand Savings / ft<sup>2</sup> =  $1.4 \times 10^{-3}$  kW / ft<sup>2</sup>

Gas Savings

Total Gas Savings = 123 MBtu/yr

Gas Savings / ft<sup>2</sup> =  $0.019$  MBtu / ft<sup>2</sup>

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation - Bldg 101, Gilliam

ECO # 3 - Weather stripping + Caulking

$$Q = L (A \Delta t + B V^2)^{1/2}$$

A - stack coefficient = 0.0629 - 4 stories extrapolated ASHRAE Table F 23.7

B - wind coefficient = 0.0034 - medium shielding ASHRAE Table F 23.8

V - avg. wind velocity = 12.65 mph

$$\Delta t = 72^\circ F - 55^\circ F = 17^\circ F$$

L - effective length = Area \* (in<sup>2</sup>/ft<sup>2</sup>) - ASHRAE Table F 23.3

$$(A \Delta t + B V^2)^{1/2} = (0.0629(17) + 0.0034(12.65)^2)^{1/2} = 1.301$$

Present

windows : no w.s./c, single, hung, mason wall

window: 0.063

frame: 0.093

doors : no w.s./c, double, mason wall

door: 0.16

frame: 0.072

Improved

window : w.s./c, single, hung, mason wall

window: 0.032

frame: 0.019

doors : w.s./c, double, mason wall

door: 0.114

frame: 0.0143

Room 1 - no infiltration

Room 2

Window: 30 (28 ft<sup>2</sup>) = 840 ft<sup>2</sup>

doors: 7 (5' x 7') = 245 ft<sup>2</sup>



**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation - Bldg 101, Gilman

ECO #3 (cont)

Room 2 (cont)

Present

$$\begin{aligned} \text{window} &: 0.063 (840) = 52.9 \\ \text{frame} &: 0.093 (840) = 78.1 \\ \text{door} &: 0.16 (245) = 39.2 \\ \text{trans} &: 0.072 (245) = \underline{17.6} \\ & 187.9 \end{aligned}$$

$$Q = 187.9 (1.301) = 244 \text{ cfm}$$

Improved

$$\begin{aligned} \text{window} &: 0.032 (840) = 26.9 \\ \text{frame} &: 0.019 (840) = 16.0 \\ \text{door} &: 0.114 (245) = 27.9 \\ \text{trans} &: 0.0143 (245) = \underline{3.5} \\ & 74.3 \end{aligned}$$

$$Q = 74.3 (1.301) = 97 \text{ cfm}$$

$$\Delta Q = 244 - 97 = \boxed{147 \text{ cfm}}$$

Room 3 - no infiltration

Room 4

$$\text{windows} : 63 (28 \text{ ft}^2) = 1,764 \text{ ft}^2$$

Present

$$\begin{aligned} \text{window} &: 0.063 (1,764) = 111.1 \\ \text{frame} &: 0.093 (1,764) = \underline{164.1} \\ & 275.2 \end{aligned}$$

$$Q = 275.2 (1.301) = 358 \text{ cfm}$$

Improved

$$\begin{aligned} \text{window} &: 0.032 (1,764) = 56.4 \\ \text{frame} &: 0.019 (1,764) = \underline{33.5} \\ & 90.0 \end{aligned}$$

$$Q = 90.0 (1.301) = 117 \text{ cfm}$$

$$\Delta Q = 358 - 117 = \boxed{241 \text{ cfm}}$$

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation

Bldg 101, Gilliam

ECO # 3 (cont)Room 5

$$\text{windows: } 915 (28 \text{ ft}^2) = 2,560 \text{ ft}^2$$

Present

$$\text{window: } 0.063 (2,660) = 167.6$$

$$\text{Frame: } 0.093 (2,560) = \underline{242.4}$$

$$415.0$$

$$Q = 415.0 (1.301) = 540 \text{ cfm}$$

Improved

$$\text{window: } 0.032 (2,660) = 85.1$$

$$\text{Frame: } 0.019 (2,660) = \underline{50.5}$$

$$135.6$$

$$Q = 135.6 (1.301) = 176 \text{ cfm}$$

$$\Delta Q = 540 - 176 = \boxed{364 \text{ cfm}}$$

Totals

$$\text{Room 2: } 2,052 \text{ cfm} - 147 \text{ cfm} = 1905 \text{ cfm}$$

$$\text{Room 4: } 4,116 \text{ cfm} - 241 \text{ cfm} = 3875 \text{ cfm}$$

$$\text{Room 5: } 5,821 \text{ cfm} - 364 \text{ cfm} = 5457 \text{ cfm}$$

$$\Delta \text{ cfm} = \boxed{752 \text{ cfm}}$$

Electric Savings

$$\text{Total Electric Savings} = 668 \text{ kWh/yr}$$

$$\text{Electric Savings/cfm} = \boxed{0.89} \text{ kWh/cfm}$$

Demand Savings

$$\text{Peak Demand Savings} = 2 \text{ kW}$$

$$\text{Demand Savings/cfm} = \boxed{2.7 \times 10^{-3}} \text{ kW/cfm}$$

Gas Savings

$$\text{Total Gas Savings} = 1.9 \text{ MBtu/yr}$$

$$\text{Gas Savings} = \boxed{0.025} \text{ MBtu/cfm}$$

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation Bldg 101, Gilman

ECO # 6 - Economizers

- dry bulb economizers on 4<sup>th</sup> floor AHU's, 100% OA

Electric Savings

Total Electric Savings = 37,833 kWh/yr

Demand Savings

Peak Demand Savings = 0 kW

Gas Savings

Total Gas Savings = 0.0 MBtu/yr

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation

Bldg 101, Gilman

ECO #7 - Pump control

- Circulation Pumps - #W, P-W low speed

- Cycle w/ load

- Time clock: on 06:00 - 18:00 M-F, off otherwise  
for values 2, 4, 6

- DHW Pumps

- 1/2 LF

- Time clock on 06:00 - 18:00 M-F, off otherwise - off 5631 hrs

Savings =  $\frac{(0.25 \text{ HP}) (0.746 \text{ kW/HP}) (0.80) (5631 \text{ hrs})}{(0.746 \text{ kW/HP})} = \boxed{1.158} \text{ kWh/yr}$

Total Usage

$C4W1 + C4W2 + DTW + HW - 1.158$

$31,974 + 10,074 + 97,602 + 2,371 - 1.158 = 140,860 \text{ kWh/yr}$

Demand Savings

Peak Demand Savings =  $\boxed{0} \text{ kW}$

Electric Savings

Total Electric Savings =  $\boxed{124,564} \text{ kWh/yr}$

Gas Savings

Total Gas Savings =  $\boxed{233} \text{ MBtu/yr}$

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation Bldg 101, Gilman

ECO #12 - HVAC Controls

Fan coils (1<sup>st</sup> + 2<sup>nd</sup> floor)

- setback thermostat
- Fans on time clock : on: 06:00 - 18:00 M-F, off otherwise
- reset tstat set points; 70°F Heating 78°F Cooling

AHU<sub>1</sub> (4<sup>th</sup> floor)

- setback thermostat
- Fans on time clock : on: 0600-1800 M-F, off otherwise
- Reset deck temperature (directional)
- Reset tstat setpoints; 70°F Heating 78°F Cooling

AHU<sub>2</sub> (1<sup>st</sup> + 2<sup>nd</sup> floor)

- Reset tstat setpoints; 70°F Heating 78°F Cooling

ICU<sub>1</sub> 3<sup>rd</sup> floor

- Reset tstat setpoints; 70°F Heating 78°F Cooling

Pumps

- Add cycling controls

Electric Savings

Total Electric Savings = 285,187 kWh/yr

Demand Savings

Peak Demand Savings = 57 kW

Gas Savings

Total Gas Savings = 302 MBtu/yr

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation Bldg 101, G. floor

ECO # 13 - Thermal Storage

Discharge Tank : 2100 - 15:00

Charge Tank : 0100 - 0600

Tank Capacity: 751 Tons/hr

Chiller Capacity: 125 Tons

Demand Savings

#1 chiller kw/ton = 1.147 kw/ton

#2 chiller " = 1.129 kw/ton

#3 chiller " = 1.064 kw/ton

Peak Demand (Avg) = 116 tons

Peak Demand Savings = 116 \* 1.085 = 125.8 = 126 kw

% Peak Chiller

11%

19%

70%

⇒ 1.085 kw/ton

Additional Electrical

Additional Electrical = 13,122 kWh/yr

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation Bldg 101, Gilman

ECO # 15 - Lighting Reduction

Light Reduction

reduction = 16%

Rm	Present (w)	Reduced (w)
1	12,100	10,164
2	12,800	10,752
3	18,320	15,309
4	34,930	29,341
5	58,740	49,342
6	<u>28,750</u>	<u>24,150</u>
	166,140	139,558

Reduced kWh = 116,760 kWh/yr

Electric Factor

Reduced electric use = cooling - heating 18,598 - 496 = 18,102 kWh/yr

Electric savings / lighting kWh =  $\boxed{0.16}$  kWh saved / kWh lighting

Gas Factor

Increased gas use = 41.7 MBtu/yr

Gas increase / lighting kWh =  $\boxed{3.6 \times 10^{-4}}$  MBtu / kWh

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB 3105.000

SHEET NO. 1 OF \_\_\_\_\_

CALCULATED BY RMPH DATE 3/6/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Computer Simulation

Bldg 101, G. Law Landing

Bldg Type: Brick Admin

Area: 120,182 ft<sup>2</sup>

ERO: 1, 2, 3, 6, 12, 18

Assumptions:


- Heating db = 72 °F
- Cooling db = 76 °F
- Infiltration: 1/2 ACH in fan coil areas
- OA Ventilation: 10% in AHU's



**E M C ENGINEERS, INC.**  
 Denver • Colorado Springs • Atlanta • West Germany

Comp Simulation Flg 101, G. 11em


Wall U-Value - ASHRAE Table F 22.4



Material	R-Value
Outside Surface (15 mph wind)	0.17
4" Face brick	1.24
8" Conc block w/ vermiculite	1.92
Inside Surface (still air)	0.68
<b>Total</b>	<b>4.01</b>

$$U = \frac{1}{R} = \frac{1}{4.01} = \boxed{0.25}$$

Roof U-Value - ASHRAE Table F 22.4

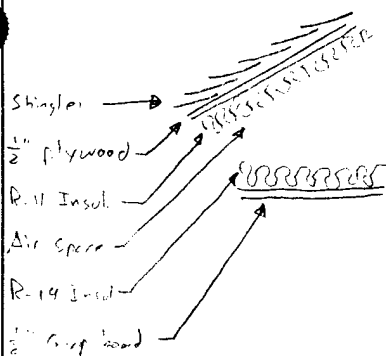

Material	R-Value
Outside Surface (15 mph wind)	0.17
Shingles	0.44
1/2" Plywood	0.62
R-11 Insulation	11.0
Air Space	1.24
R-14 Insulation	19.0
1/2" Gyp. Board	0.45
Inside Surface (still Air)	0.68
<b>Total</b>	<b>33.6</b>

$$U = \frac{1}{33.6} = \boxed{0.03}$$

Window U-Value - ASHRAE Table F 27.13

- Single pane, casement, Al Frame  $\Rightarrow U = \boxed{1.10}$

Window shade - ASHRAE Table F 27.25

- light venetian blinds

$$\Rightarrow \boxed{0.67}$$

Slab Perimeter Coefficient - ASHRAE Table F 25.5

$$F_2 = \boxed{0.62} \text{ Btu/h/°F ft}$$

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB 3105.000

SHEET NO. 2 OF \_\_\_\_\_

CALCULATED BY [Signature] DATE 3/5/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Comp. Srm Bldg 101, Gilman

Misc Loads - Assumed

<u>Rm</u>	<u>Ft<sup>2</sup>/ft<sup>2</sup></u>	
1	6	- comp. rooms + office
2	3	- office
3	6	- comp. rooms + office
4	4	- office, computer
5	4	- office, computer
6	3	- office, computer

Lighting Loads - From ECO #15

<u>Rm</u>	<u>Watts</u>
1	12,100
2	12,800
3	18,820
4	24,920
5	58,740
6	23,750

People - From field survey estimates

<u>Rm</u>	<u>People</u>
1	66
2	36
3	45
4	80
5	192
6	77

Infiltration

- Only in fan coil areas
- Assume 1 1/2 Air Changes/Hour - very drafty as per field survey

Ventilation

- Assume 10% OA - from mech. equip schedules

**E M C ENGINEERS, INC.**  
Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_  
CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
SCALE \_\_\_\_\_

Computer Simulation Bldg 101, Gilliam

Baseline (cont)

Pumps

$$\text{CHW Pump \#1: } \frac{(10 \text{ HP})(0.746 \frac{\text{kW}}{\text{HP}})(0.35)}{(0.865 \text{ eff})} = 7.3 \text{ kW} * 4,380 \frac{\text{kWh}}{\text{yr}} = 31,974 \text{ kWh/yr}$$

$$\text{CHW Pump \#2: } \frac{(3 \text{ HP})(0.746 \frac{\text{kW}}{\text{HP}})(0.95)}{(0.812 \text{ eff})} = 2.3 \text{ kW} + 4,380 \frac{\text{kWh}}{\text{yr}} = 10,074 \text{ kWh/yr}$$

$$\text{DTW Pump: } \frac{(30 \text{ HP})(0.746 \frac{\text{kW}}{\text{HP}})(0.95)}{(0.90 \text{ eff})} = 21.1 \text{ kW} + 8,760 \frac{\text{kWh}}{\text{yr}} = 184,836 \text{ kWh/yr}$$

$$\text{HW Pump: } \frac{(3 \text{ HP})(0.746 \frac{\text{kW}}{\text{HP}})(0.95)}{(0.812 \text{ eff})} = 2.3 \text{ kW} * 4,380 \frac{\text{kWh}}{\text{yr}} = \frac{10,074 \text{ kWh/yr}}{\boxed{236,958} \text{ kWh/yr}}$$

## 01 Card - Job Information

-----  
 Project: FT MCPHERSON & FT GILLEM EEAP  
 Location: FT GILLEM, BLDG 101  
 Program User: R. GERRANS

## -----CARD 08-- Climatic Information-----

	Summer	Winter	Summer	Summer	Winter		Summer	Winter
Weather	Clearness	Clearness	Design	Design	Design	Building	Ground	Ground
Code	Number	Number	Dry Bulb	Wet Bulb	Dry Bulb	Orientation	Reflect	Reflect
ATLANTA								

## -----CARD 09-- Load Simulation Periods-----

1st Month	Last Month	Peak	1st Month	Last Month	1st Month	Last Month
Cooling	Cooling	Cooling	Summer	Summer	Daylight	Daylight
Simulation	Simulation	Load Hr	Period	Period	Savings	Savings
MAY	OCT					

## ----- Load Section Alternative #1 -----

## ---- Load Alternative ----

Number	Description
1	BLDG G101, BASELINE

## -----CARD 20-- General Room Parameters-----

Room	Reference	Room	Floor	Floor	Const	Plenum	Acoustic	Floor to	Duplicate	Duplicate	Perimeter
Number	Number	Descrip	Length	Width	Type	Height	Ceiling	Floor	Floors	Rooms per	Depth
							Resistance	Height	Multiplier	Zone	
1	1	1ST FL AHU	20697	1		2		10			
2	2	1ST FL FC	10260	1		2		10			
3	3	2ND FL AHU	168.3	62		2		10			
4	4	2ND FL FC	280	73.5		2		10			
5	5	3RD FL FC	29105	1		2		10			
6	6	4TH FL AHU	29105	1		2		10			

## -----CARD 21-- Thermostat Parameters -----

Room Number	Cooling Room Design DB	Room Design RH	Cooling T'stat Driftpoint	Cooling T'stat Schedule	Heating Room Design DB	Heating T'stat Driftpoint	Heating T'stat Schedule	T'stat Location Flag	Mass / No. Hrs Average	Carpet On Floor
1	76			CLG	72		HTG			
2	76			CLG	72		HTG			
3	76			CLG	72		HTG			
4	76			CLG	72		HTG			
5	76			CLG	72		HTG			
6	76			CLG	72		HTG			

## -----CARD 22-- Roof Parameters -----

Room Number	Roof Number	Roof Equal to Floor?	Roof Length	Roof Width	Roof U-Value	Const Type	Roof Direction	Roof Tilt	Roof Alpha
6	1	YES			.03	39			

## -----CARD 24-- Wall Parameters -----

Room Number	Wall Number	Wall Length	Wall Height	Wall U-Value	Wall Constuc Type	Wall Direction	Wall Tilt	Wall Alpha	Ground Reflectance Multiplier
M	1		10	.25	87				
1	1	203.5				45			
1	2	125				135			
1	3	203.5				225			
1	4	188.5				315			
2	1	141.5				45			
2	2	83.5				135			
2	3	141.5				225			
2	4	20				315			
3	1	62				45			
3	2	80				135			
3	3	62				225			
3	4	80				315			
4	1	283				45			
4	2	103.5				135			
4	3	283				225			
4	4	103.5				315			
5	1	345				45			
5	2	163.5				135			
5	3	345				225			
5	4	163.5				315			
6	1	345				45			
6	2	163.5				135			
6	3	345				225			
6	4	163.5				315			

## -----CARD 25-- Wall/Glass Parameters -----

Room Number	Wall Number	Glass Length	Glass Width	Pct Glass or No. of Windows	Glass U-Value	Shading Coefficient	External Shading Type	Internal Shading Type	Percent Solar Ret.	Visible Air Transmittance	Inside Visible Reflectance
M	1	7	4		1.1	.67					

## -----CARD 25-- Wall/Glass Parameters -----

Room Number	Wall Number	Glass Length	Glass Width	Pct Glass or No. of Windows	Glass U-Value	Shading Coefficient	External Shading Type	Internal Shading Type	Percent Solar to Ret. Air	Visible Transmittance	Inside Visible Reflectance
1	1			15							
1	2			9							
1	3			6							
1	4			8							
2	1			13							
2	2			7							
2	3			8							
2	4			2							
3	1			5							
3	2										
3	3										
3	4										
4	1			26							
4	2			10							
4	3			19							
4	4			8							
5	1			31							
5	2			18							
5	3			28							
5	4			18							
6	1										
6	2										
6	3										
6	4										

## -----CARD 26-- Schedules -----

Room Number	People	Lights	Ventilation	Infiltration	Reheat Minimum	Cooling Fans	Heating Fan	Auxiliary Fan	Room Exhaust	Daylighting Controls
1	ADMPPL	ADMLGTEQ	AVAIL	AVAIL		AVAIL				
2	ADMPPL	ADMLGTEQ	OFF	AVAIL		AVAIL				
3	ADMPPL	ADMLGTEQ	AVAIL	OFF		AVAIL				
4	ADMPPL	ADMLGTEQ	OFF	AVAIL		AVAIL				
5	G1013PPL	G1013LGT	OFF	AVAIL		AVAIL				
6	ADMPPL	ADMLGTEQ	AVAIL	OFF		AVAIL				

## -----CARD 27-- People and Lights -----

Room Number	People Value	People Units	People Sensible	People Latent	Lighting Value	Lighting Units	Lighting Fixture Type	Ballast Factor	Percent Lights to Ret. Air	--- Daylighting --- Reference Point 1	Reference Point 2
1	66	PEOPLE	250	200	12100	WATTS					
2	36	PEOPLE	250	200	12800	WATTS					

## -----CARD 27-- People and Lights -----

Room Number	People Value	People Units	People Sensible	People Latent	Lighting Value	Lighting Units	Lighting Fixture Type	Ballast Factor	Percent Lights to		--- Daylighting ---	
									Ret. Air	Reference Point 1	Reference Point 2	Reference Point 2
3	45	PEOPLE	250	200	18820	WATTS						
4	80	PEOPLE	250	200	34930	WATTS						
5	192	PEOPLE	250	200	58740	WATTS						
6	77	PEOPLE	250	200	28750	WATTS						

## -----CARD 28-- Miscellaneous Equipment -----

Room Number	Misc Equipment Number	Equipment Descrip	Energy Consump		Schedule Code	Energy Meter Code	Percent of Load Sensible	Percent Misc. Load to Room	Percent Misc. Sens to Ret. Air	Radiant Fraction	Optional Air Path
			Value	Units							
1	1	MISC EQUIP	6	BTUH-SF	ADMLGTEQ	ELEC					
2	1	MISC EQUIP	3	BTUH-SF	ADMLGTEQ	ELEC					
3	1	MISC EQUIP	6	BTUH-SF	ADMLGTEQ	ELEC					
4	1	MISC EQUIP	4	BTUH-SF	ADMLGTEQ	ELEC					
5	1	MISC EQUIP	4	BTUH-SF	G1013EQ	ELEC					
6	1	MISC EQUIP	3	BTUH-SF	ADMLGTEQ	ELEC					

## -----CARD 29-- Room Airflows -----

Room Number	-----Ventilation-----		-----Heating-----		-----Cooling-----		-----Infiltration-----		-----Heating-----		--Reheat Minimum--	
	Value	Units	Value	Units	Value	Units	Value	Units	Value	Units	Value	Units
1	10	PCT-MCLG	10	PCT-MCLG								
2					1.5	ACH-HR	1.5	ACH-HR				
3	10	PCT-MCLG	10	PCT-MCLG								
4					1.5	ACH-HR	1.5	ACH-HR				
5					1.5	ACH-HR	1.5	ACH-HR				
6	10	PCT-MCLG	10	PCT-MCLG								

## -----CARD 32-- Exposed Floor Parameters -----

Room Number	Exposed Slab			Exposed Floor						
	Floor Number	Perimeter Length	Loss Coefficient	Floor Area	Floor U-Value	Const Type	Temp Flag	Cooling Temp	Heating Temp	Adjacent Room No
1	1	700.5	.62							
2	1	386.5	.62							

----- System Section Alternative #1 -----

```

-----CARD 39-- System Alternative -----
Number      Description
1           BLDG G101, BASELINE

```

```

-----CARD 40--- System Type -----
-----OPTIONAL VENTILATION SYSTEM-----
System      Ventil      Fan
Set         System    Deck      Cooling Heating Cooling Heating Static
Number Type   Location SADBvh  SADBvh  Schedule Schedule Pressure
1           SZ
2           FC
3           SZ
4           FC
5           FC
6           SZ

```

```

-----CARD 41-- Zone Assignment -----
System
Set         Ref #1      Ref #2      Ref #3      Ref #4      Ref #5      Ref #6
Number      Begin  End    Begin  End    Begin  End    Begin  End    Begin  End
1           1      1
2           2      2
3           3      3
4           4      4
5           5      5
6           6      6

```

```

-----CARD 42--- Fan SP and Duct Parameters-----
System Cool Heat Return Mn Exh Aux Rm Exh Cool Return Supply Supply Return
Set     Fan Fan Fan Fan Fan Fan Fan Mtr Fan Mtr Duct Duct Air
Number SP  SP  SP  SP  SP  SP  SP  Loc  Loc  Ht Gn  Loc  Path
1       2.5
2       .5
3       2.5
4       .5
5       .5
6       2.5
SUPPLY RETAIR SUPPLY RETAIR SUPPLY RETAIR SUPPLY
OTHER  OTHER  OTHER  OTHER  OTHER  OTHER  OTHER  DUCTED ROOMDK ROOMDK ROOMDK DUCTED

```

```

-----CARD 45--- Equipment Schedules -----
System Main      Direct  Indirect Auxiliary Main      Main      Reheat  Mech.  Auxiliary
Set     Cooling      Evap    Evap    Cooling Heating Preheat Reheat  Humidity Heating
Number Coil      Economizer Coil    Coil    Coil    Coil    Coil    Coil    Humidity Coil
1       CLGC
2       CLGC
3       CLGC
4       CLGC
5       CLGC
6       CLGC
HTGC HTGC HTGC HTGC HTGC HTGC

```



----- Equipment Section Alternative #1 -----

-----CARD 59-- Equipment Description / TOD Schedules -----

Alternative Number	Time of Day Schedule	Elec Consump	Elec Demand	Demand Limit	Alternative Description
1	1				BLDG G101, BASELINE

-----CARD 60-- Cooling Load Assignment-----

Load Asgn Ref	All Coil	Cooling Equipment	-Group 1-	-Group 2-	-Group 3-	-Group 4-	-Group 5-	-Group 6-	-Group 7-	-Group 8-	-Group 9-
Ref	Cool Ref	Sizing	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End
1	1	BLKPLANT	1	1							
2	2	BLKPLANT	3	3							
3	3	BLKPLANT	6	6							
4	4	BLKPLANT	2	2	4	5					

-----CARD 62-- Cooling Equipment Parameters -----

Cool Ref	Equip Code	Num Of	-----COOLING-----			-----HEAT RECOVERY-----				Seq Order	Demand Seq	
Num	Name	Units	--Capacity-- Value	Units	Value	Units	Value	Units	Value	Units	Num	Type
1	EQ1121S	1										
2	EQ1120S	1										
3	EQ1171L	1										
4	EQ1122L	2										

-----CARD 63-- Cooling Pumps and References -----

Cool Ref	---CHILLED WATER---	---CONDENSER---	---HT REC or AUX---	Switch-						
Num	Full Load Value	Full Load Units	Full Load Value	Full Load Units	Full Load Value	Full Load Units	Control	Cold Storage	Cooling Tower	Misc. Access.
1	7.3	KW								
2	2.3	KW								
4	21.1	KW								

-----CARD 65-- Heating Load Assignment -----

Load Assignment Reference	All Coil Heating Ref	-Group 1-	-Group 2-	-Group 3-	-Group 4-	-Group 5-	-Group 6-	-Group 7-	-Group 8-	-Group 9-
Reference	Heating Ref	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End	Begin End
1	1	2	2	4	5					
2	2	1	1	3	3	6	6			

## -----CARD 67-- Heating Equipment Parameters -----

Heat Ref	Equip Code	Number Of	HW Pmp Full Ld	Units	Cap'y Value	Units	Energy Rate	Units	Seq Order	Switch over	Hot Strg	Misc. Acc.	Cogen	Demand Limit
1	EQ2001	1	21.1	KW	5250	MBH								
2	EQ2002	1	2.3	KW	589.6	MBH								

## -----CARD 69-- Fan Equipment Parameters -----

System Set	Cooling Fan	Heating Fan	Return Fan	Exhaust Fan	Auxiliary Supply	Room Exhaust	Optional Ventilation
1	EQ4003						
3	EQ4003						
4	EQ4371						
5	EQ4371						
6	EQ4003						

## Utility Description Reference Table

## Schedules:

ADMLGTEQ ADMIN LIGHTING AND EQUIPMENT  
 ADMPPPL ADMIN PEOPLE SCHEDULE  
 AVAIL AVAILABLE (100%)  
 CLG COOLING TSTAT SCHEDULE  
 CLGC COOLING COIL SCHEDULE  
 G1013EQ G101 3RD FLOOR EQUIPMENT SCHEDULE  
 G1013LGT G101 3RD FLOOR LIGHTING SCHEDULE  
 G1013PPL G101 3RD FLOOR PEOPLE SCHEDULE  
 HTG HEATING TSTAT SCHEDULE  
 HTGC HEATING COIL SCHEDULE  
 OFF ALWAYS OFF

## System:

FC FAN COIL  
 SZ SINGLE ZONE

## Equipment:

## Cooling:

EQ1120S AIR-CLD RECIP <20 TONS  
 EQ1121S AIR-CLD RECIP 20-35 TONS  
 EQ1122L AIR-CLD RECIP >55 TONS  
 EQ1171L AIR-CLD COND COMP 35-60 TONS

## Heating:

EQ2001 GAS FIRE TUBE HOT WATER  
 EQ2002 GAS FIRE TUBE STEAM

## Fan:

EQ4003 FC CENTRIF. FAN C.V.  
 EQ4371 FAN COIL SUPPLY FAN

Schedule Name: ADMLGTEQ

Project: ADMIN LIGHTING AND EQUIPMENT SC

Location:

Client:

Program User:

Comments: OFFICE LIGHTING

Starting Month: JAN Ending Month: DEC

Starting Day Type: DSGN Ending Day Type: WKDY

Hour Util Percent

Hour	Util Percent
0	5
7	80
8	100
12	80
13	100
16	80
17	40
18	5
24	

Starting Month: JAN Ending Month: DEC

Starting Day Type: SAT Ending Day Type: SUN

Hour Util Percent

Hour	Util Percent
0	5
24	

Schedule Name: ADMPPPL  
Project: ADMIN PEOPLE SCHEDULE  
Location:  
Client:  
Program User: D JONES  
Comments: OFFICE PEOPLE SCHEDULE

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: WKDY

Hour	Util Percent
0	0
7	50
8	100
11	80
12	40
13	80
14	100
16	70
17	30
18	0
24	

Starting Month: JAN Ending Month: DEC  
Starting Day Type: SAT Ending Day Type: SUN

Hour	Util Percent
0	0
24	

Schedule Name: AVAIL  
Project: AVAILABLE (100)  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: HTG  
Starting Day Type: DSGN Ending Day Type: SUN

Hour	Util Percent
0	100
24	

Schedule Name: CLG  
Project: COOLING TSTAT SCHEDULE  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: SUN

Hour	Temperature
0	76
24	

Schedule Name: CLGC  
Project: COOLING COIL SCHEDULE  
Location:  
Client:  
Program User: R. GERRANS  
Comments:

Starting Month: JAN Ending Month: APR  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent  
-----  
0 0  
24

Starting Month: MAY Ending Month: OCT  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent  
-----  
0 100  
24

Starting Month: NOV Ending Month: HTG  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent  
-----  
0 0  
24

Schedule Name: G1013EQ  
Project: G101 3RD FLOOR EQUIPMENT SCHEDU  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: WKDY

Hour Util Percent  
-----  
0 20  
7 80  
8 100  
12 80  
13 100  
16 80  
17 40  
18 20  
24

Starting Month: JAN Ending Month: DEC  
Starting Day Type: SAT Ending Day Type: SUN

Hour Util Percent  
-----  
0 20  
24

Schedule Name: G1013LGT  
Project: G101 3RD FLOOR LIGHTING SCHEDU  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: WKDY

Hour	Util Percent
0	80
8	100
12	80
13	100
16	80
24	

Starting Month: JAN Ending Month: DEC  
Starting Day Type: SAT Ending Day Type: SUN

Hour	Util Percent
0	80
24	

Schedule Name: G1013PPL  
Project: G101 3RD FLOOR PEOPLE SCHEDULE  
Location:  
Client:  
Program User: D JONES  
Comments: OFFICE PEOPLE SCHEDULE

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: WKDY

Hour	Util Percent
0	5
7	50
8	100
11	80
12	40
13	80
14	100
16	70
17	30
18	5
24	

Starting Month: JAN Ending Month: DEC  
Starting Day Type: SAT Ending Day Type: SUN

Hour	Util Percent
0	5
24	

Schedule Name: HTG  
Project: HEATING TSTAT SCHEDULE  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Temperature  
-----  
0 72  
24

Schedule Name: HTGC  
Project: HEATING COIL SCHEDULE  
Location:  
Client:  
Program User: R. GERRANS  
Comments:

Starting Month: JAN Ending Month: APR  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent  
-----  
0 100  
24

Starting Month: MAY Ending Month: OCT  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent  
-----  
0 0  
24

Starting Month: NOV Ending Month: HTG  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent  
-----  
0 100  
24

Schedule Name: OFF  
Project: ALWAYS OFF  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: HTG  
Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent  
-----  
0 0  
24

\*\*\*\*\*  
\*\*\*\*\*  
\*\*  
\*\* T R A C E 6 0 0 A N A L Y S I S \*\*  
\*\*  
\*\* by \*\*  
\*\*  
\*\*\*\*\*  
\*\*\*\*\*

FT MCPHERSON & FT GILLEM EEAP  
FT GILLEM, BLDG 101

R. GERRANS

Weather File Code: ATLANTA.  
Location: ATLANTA, GEORGIA  
Latitude: 33.0 (deg)  
Longitude: 84.0 (deg)  
Time Zone: 6  
Elevation: 1,005 (ft)  
Barometric Pressure: 28.8 (in. Hg)

Summer Clearness Number: 0.90  
Winter Clearness Number: 0.90  
Summer Design Dry Bulb: 92 (F)  
Summer Design Wet Bulb: 74 (F)  
Winter Design Dry Bulb: 22 (F)  
Summer Ground Relectance: 0.20  
Winter Ground Relectance: 0.20

Air Density: 0.0731 (Lbm/cuft)  
Air Specific Heat: 0.2444 (Btu/lbm/F)  
Density-Specific Heat Prod: 1.0727 (Btu-min./hr/cuft/F)  
Latent Heat Factor: 4,721.8 (Btu-min./hr/cuft)  
Enthalpy Factor: 4.3883 (Lb-min./hr/cuft)

Design Simulation Period: May To October  
System Simulation Period: January To December  
Cooling Load Methodology: TETD/Time Averaging

Time/Date Program was Run: 13:26:13 4/ 7/92  
Dataset Name: G101-B .TM



AIRFLOW - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- S Y S T E M S U M M A R Y -----  
 (Design Airflow Quantities)

System Number	System Type	Main					Auxil. Supply Airflow (Cfm)	Room Exhaust Airflow (Cfm)
		Outside Airflow (Cfm)	Cooling Airflow (Cfm)	Heating Airflow (Cfm)	Return Airflow (Cfm)	Exhaust Airflow (Cfm)		
1	SZ	2,123	21,228	21,228	21,228	2,123	0	0
2	FC	0	11,285	11,285	13,337	2,052	0	0
3	SZ	1,130	11,305	11,305	11,305	1,130	0	0
4	FC	0	29,327	29,327	33,443	4,116	0	0
5	FC	0	44,831	44,831	50,652	5,821	0	0
6	SZ	2,445	24,447	24,447	24,447	2,445	0	0
Totals		5,698	142,422	142,422	154,411	17,687	0	0

CAPACITY - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- S Y S T E M S U M M A R Y -----  
 (Design Capacity Quantities)

System Number	System Type	Cooling				Cooling Totals (Tons)	Heating							Heating Totals (Btuh)	
		Main Sys. Capacity (Tons)	Aux. Sys. Capacity (Tons)	Opt. Capacity (Tons)	Vent Capacity (Tons)		Main Sys. Capacity (Btuh)	Aux. Sys. Capacity (Btuh)	Preheat Capacity (Btuh)	Reheat Capacity (Btuh)	Humidif. Capacity (Btuh)	Opt. Capacity (Btuh)	Vent Capacity (Btuh)		
1	SZ	35.8	0.0	0.0	0.0	35.8	-238,028	0	0	0	0	0	0	0	-238,028
2	FC	21.5	0.0	0.0	0.0	21.5	-207,119	0	0	0	0	0	0	0	-207,119
3	SZ	20.0	0.0	0.0	0.0	20.0	-82,461	0	0	0	0	0	0	0	-82,461
4	FC	48.9	0.0	0.0	0.0	48.9	-393,153	0	0	0	0	0	0	0	-393,153
5	FC	75.8	0.0	0.0	0.0	75.8	-553,725	0	0	0	0	0	0	0	-553,725
6	SZ	41.2	0.0	0.0	0.0	41.2	-249,438	0	0	0	0	0	0	0	-249,438
Totals		243.1	0.0	0.0	0.0	243.1	-1,723,924	0	0	0	0	0	0	0	-1,723,924

The building peaked at hour 15 month 8 with a capacity of 243.0 tons

ENGINEERING CHECKS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- E N G I N E E R I N G   C H E C K S -----

System Number	Main/ Auxiliary	System Type	Percent Outside Air	----- Cooling -----				--- Heating ---		Floor Area Sq Ft
				Cfm/ Sq Ft	Cfm/ Ton	Sq Ft /Ton	Btuh/ Sq Ft	Cfm/ Sq Ft	Btuh/ Sq Ft	
1	Main	SZ	10.00	1.03	592.8	578.0	20.76	1.03	-11.50	20,697
2	Main	FC	0.00	1.10	525.1	477.4	25.14	1.10	-20.19	10,260
3	Main	SZ	10.00	1.08	565.1	521.6	23.00	1.08	-7.90	10,435
4	Main	FC	0.00	1.43	599.5	420.7	28.52	1.43	-19.10	20,580
5	Main	FC	0.00	1.54	591.6	384.1	31.24	1.54	-19.03	29,105
6	Main	SZ	10.00	0.84	594.0	707.2	16.97	0.84	-8.57	29,105

System 1 Peak SZ - SINGLE ZONE

***** COOLING COIL PEAK *****					CLG SPACE PEAK *****			HEATING COIL PEAK *****					
Peaked at Time ==>					Mo/Hr: 8/15			Mo/Hr: 6/16			Mo/Hr: 13/ 1		
Outside Air ==>					OADB/WB/HR: 92/ 74/105.0			OADB: 96			OADB: 22		
Space	Ret. Air	Ret. Air	Net	Percnt	*	Space	Percnt	*	Space Peak	Coil Peak	Percnt		
Sens.+Lat.	Sensible	Latent	Total	Of Tot	*	Sensible	Of Tot	*	Space Sens	Tot Sens	Of Tot		
(Btuh)	(Btuh)	(Btuh)	(Btuh)	(%)	*	(Btuh)	(%)	*	(Btuh)	(Btuh)	(%)		
Envelope Loads													
Skylite Solr	0	0	0	0.00	*	0	0.00	*	0	0	0.00		
Skylite Cond	0	0	0	0.00	*	0	0.00	*	0	0	0.00		
Roof Cond	0	0	0	0.00	*	0	0.00	*	0	0	0.00		
Glass Solar	45,752	0	45,752	10.65	*	50,008	16.24	*	0	0	0.00		
Glass Cond	19,078	0	19,078	4.44	*	22,940	7.45	*	-64,372	-64,372	27.04		
Wall Cond	34,427	10,006	44,433	10.34	*	41,008	13.32	*	-58,750	-75,825	31.86		
Partition	0	0	0	0.00	*	0	0.00	*	0	0	0.00		
Exposed Floor	0	0	0	0.00	*	0	0.00	*	-21,715	-21,715	9.12		
Infiltration	0	0	0	0.00	*	0	0.00	*	0	0	0.00		
Sub Total==>	99,257	10,006	109,263	25.43	*	113,955	37.02	*	-144,838	-161,912	68.02		
Internal Loads					*			*					
Lights	41,297	0	41,297	9.61	*	41,297	13.41	*	0	0	0.00		
People	29,700		29,700	6.91	*	16,500	5.36	*	0	0	0.00		
Misc	124,182	0	124,182	28.90	*	124,182	40.34	*	0	0	0.00		
Sub Total==>	195,179	0	195,179	45.42	*	181,979	59.11	*	0	0	0.00		
Ceiling Load	10,006	-10,006	0	0.00	*	11,918	3.87	*	-17,075	0	0.00		
Outside Air	0	0	87,507	20.37	*	0	0.00	*	0	-113,854	47.83		
Sup. Fan Heat			37,739	8.78	*		0.00	*		37,739	-15.85		
Ret. Fan Heat		0	0	0.00	*		0.00	*		0	0.00		
Duct Heat Pkup		0	0	0.00	*		0.00	*		0	0.00		
CV/UNDR Sizing	0		0	0.00	*	0	0.00	*	0	0	0.00		
Exhaust Heat		0	0	0.00	*		0.00	*		0	0.00		
Terminal Bypass		0	0	0.00	*		0.00	*		0	0.00		
Grand Total==>	304,442	0	429,688	100.00	*	307,853	100.00	*	-161,912	-238,028	100.00		

-----COOLING COIL SELECTION-----

-----AREAS-----

	Total Capacity	Sens Cap.	Coil Airfl	Entering DB/WB/HR			Leaving DB/WB/HR			Gross Total	Glass (sf)	(%)
	(Tons)	(Mbh)	(cfm)	Deg F	Deg F	Grains	Deg F	Deg F	Grains	Floor	20,697	
Main Clg	35.8	429.7	366.1	21,228	77.6	64.5	73.3	60.8	57.9	70.1	Part	0
Aux Clg	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	ExFlr	700
Opt Vent	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	Roof	0
0												0
Totals	35.8	429.7									Wall	7,205
												1,064
												15

-----HEATING COIL SELECTION-----

-----AIRFLOWS (cfm)-----

-----ENGINEERING CHECKS-----

-----TEMPERATURES (F)-----

	Capacity	Coil Airfl	Ent	Lvg	Type	Cooling	Heating	Clg % OA	10.0	Type	Clg	Htg
	(Mbh)	(cfm)	Deg F	Deg F	Vent	2,123	2,123	Clg Cfm/Sqft	1.03	SADE	62.5	79.1
Main Htg	-238.0	21,228	67.0	77.5	Infil	0	0	Clg Cfm/Ton	592.84	Plenum	77.5	69.4
Aux Htg	0.0	0	0.0	0.0	Supply	21,228	21,228	Clg Sqft/Ton	578.01	Return	76.0	72.0
Preheat	-0.0	21,228	67.0	60.8	Mincfm	0	0	Clg Btuh/Sqft	20.76	Ret/OA	77.6	67.0
Reheat	0.0	0	0.0	0.0	Return	21,228	21,228	No. People	66	Runarnd	76.0	72.0
Humidif	0.0	0	0.0	0.0	Exhaust	2,123	2,123	Htg % OA	10.0	Fn MtrID	0.4	0.0
Opt Vent	0.0	0	0.0	0.0	Rm Exh	0	0	Htg Cfm/Sqft	1.03	Fn BldTD	0.3	0.0
Total	-238.0				Auxil	0	0	Htg Btuh/Sqft	-11.50	Fn Frict	0.9	0.0

System 2 Block FC - FAN COIL

\*\*\*\*\* COOLING COIL PEAK \*\*\*\*\* CLG SPACE PEAK \*\*\*\*\* HEATING COIL PEAK \*\*\*\*\*  
 Peaked at Time ==> Mo/Hr: 8/15 \* Mo/Hr: 6/15 \* Mo/Hr: 13/ 1  
 Outside Air ==> OADB/WB/HR: 92/ 74/105.0 \* OADB: 96 \* OADB: 22

	Space Sens.+Lat. (Btuh)	Ret. Air Sensible (Btuh)	Ret. Air Latent (Btuh)	Net Total (Btuh)	Percnt Of Tot (%)	*	Space Sensible (Btuh)	Percnt Of Tot (%)	*	Space Peak Space Sens (Btuh)	Coil Peak Tot Sens (Btuh)	Percnt Of Tot (%)
Envelope Loads												
Skylite Solr	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Skylite Cond	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Roof Cond	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Glass Solar	39,480	0	0	39,480	15.31	*	36,120	17.38	*	0	0	0.00
Glass Cond	15,061	0	0	15,061	5.84	*	18,665	8.98	*	-50,820	-50,820	24.54
Wall Cond	18,185	5,892	0	24,077	9.34	*	18,973	9.13	*	-28,150	-37,270	17.99
Partition	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Exposed Floor	0	0	0	0	0.00	*	0	0.00	*	-11,982	-11,982	5.78
Infiltration	84,589	0	0	84,589	32.80	*	44,463	21.39	*	-110,057	-110,057	53.14
Sub Total==>	157,315	5,892	0	163,207	63.29	*	118,221	56.88	*	-201,008	-210,129	101.45
Internal Loads												
Lights	43,686	0	0	43,686	16.94	*	43,686	21.02	*	0	0	0.00
People	16,200	0	0	16,200	6.28	*	9,000	4.33	*	0	0	0.00
Misc	30,780	0	0	30,780	11.94	*	30,780	14.81	*	0	0	0.00
Sub Total==>	90,666	0	0	90,666	35.16	*	83,466	40.16	*	0	0	0.00
Ceiling Load	5,892	-5,892	0	0	0.00	*	6,147	2.96	*	-9,120	0	0.00
Outside Air	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Sup. Fan Heat	0	0	0	3,009	1.17	*	0	0.00	*	0	3,009	-1.45
Ret. Fan Heat	0	1,003	0	1,003	0.39	*	0	0.00	*	0	0	0.00
Duct Heat Pkup	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
CV/UNDR Sizing	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Exhaust Heat	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Terminal Bypass	0	0	0	0	-0.00	*	0	0.00	*	0	0	0.00
Grand Total==>	253,873	1,003	0	257,885	100.00	*	207,834	100.00	*	-210,129	-207,119	100.00

-----COOLING COIL SELECTION-----

	Total Capacity		Sens Cap. (Mbh)	Coil Airfl (cfm)	Entering DB/WB/HR			Leaving DB/WB/HR			Gross Total		Glass (sf)	(% )
	(Tons)	(Mbh)			Deg F	Deg F	Grains	Deg F	Deg F	Grains	Floor	Part		
Main Clg	21.5	257.9	202.0	11,285	76.1	63.2	69.8	58.6	55.6	63.7	10,260	0		
Aux Clg	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	387	0		
Opt Vent	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	0	0		
Totals	21.5	257.9									Wall	3,865	840 22	

-----HEATING COIL SELECTION-----

	Capacity		Ent Deg F	Lvg Deg F	Type	AIRFLOWS (cfm)		--ENGINEERING CHECKS--			--TEMPERATURES (F)---		
	(Mbh)	(cfm)				Cooling	Heating	Clg % OA	0.0	Type	Clg	Htg	
Main Htg	-207.1	11,285	72.2	89.4	Vent	0	0	Clg Cfm/Sqft	1.10	SADB	58.8	89.4	
Aux Htg	0.0	0	0.0	0.0	Infil	2,052	2,052	Clg Cfm/Ton	525.12	Plenum	77.8	69.2	
Preheat	-0.0	11,285	72.2	58.8	Supply	11,285	11,285	Clg Sqft/Ton	477.42	Return	76.0	72.0	
Reheat	0.0	0	0.0	0.0	Mincfm	0	0	Clg Btuh/Sqft	25.14	Ret/OA	76.0	72.0	
Humidif	0.0	0	0.0	0.0	Return	11,285	11,285	No. People	36	Runarnd	76.0	72.0	
Opt Vent	0.0	0	0.0	0.0	Exhaust	0	0	Htg % OA	0.0	Fn MtrTD	0.1	0.0	
Total	-207.1				Rm Exh	0	0	Htg Cfm/Sqft	1.10	Fn BldTD	0.1	0.0	
					Auxil	0	0	Htg Btuh/Sqft	-20.19	Fn Frict	0.2	0.0	

System 3 Peak SZ - SINGLE ZONE

***** COOLING COIL PEAK *****					***** CLG SPACE PEAK *****			***** HEATING COIL PEAK *****				
Peaked at Time ==>	Mo/Hr: 8/15				*	Mo/Hr: 6/16		*	Mo/Hr: 13/ 1			
Outside Air ==>	OADB/WB/HR: 92/ 74/105.0				*	OADB: 96		*	OADB: 22			
	Space	Ret. Air	Ret. Air	Net	Perct	*	Space	Perct	*	Space Peak	Coil Peak	Perct
	Sens.+Lat.	Sensible	Latent	Total	Of Tot	*	Sensible	Of Tot	*	Space Sens	Tot Sens	Of Tot
	(Btuh)	(Btuh)	(Btuh)	(Btuh)	(%)	*	(Btuh)	(%)	*	(Btuh)	(Btuh)	(%)
Envelope Loads						*			*			
Skylite Solr	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Skylite Cond	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Roof Cond	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Glass Solar	2,800	0		2,800	1.17	*	2,520	1.51	*	0	0	0.00
Glass Cond	2,510	0		2,510	1.05	*	3,018	1.81	*	-8,470	-8,470	10.27
Wall Cond	16,683	4,262		20,944	8.73	*	18,762	11.22	*	-26,650	-33,458	40.57
Partition	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Exposed Floor	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Infiltration	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Sub Total==>	21,993	4,262		26,255	10.94	*	24,300	14.53	*	-35,120	-41,928	50.85
Internal Loads						*			*			
Lights	64,233	0		64,233	26.76	*	64,233	38.42	*	0	0	0.00
People	20,250			20,250	8.44	*	11,250	6.73	*	0	0	0.00
Misc	62,608	0	0	62,608	26.08	*	62,608	37.45	*	0	0	0.00
Sub Total==>	147,090	0	0	147,090	61.28	*	138,090	82.60	*	0	0	0.00
Ceiling Load	4,262	-4,262		0	0.00	*	4,793	2.87	*	-6,808	0	0.00
Outside Air	0	0	0	46,600	19.41	*	0	0.00	*	0	-60,631	73.53
Sup. Fan Heat				20,097	8.37	*		0.00	*		20,097	-24.37
Ret. Fan Heat		0		0	0.00	*		0.00	*		0	0.00
Duct Heat PkUp		0		0	0.00	*		0.00	*		0	0.00
OV/UNDR Sizing	0			0	0.00	*	0	0.00	*	0	0	0.00
Exhaust Heat		0	0	0	0.00	*		0.00	*		0	0.00
Terminal Bypass		0	0	0	0.00	*		0.00	*		0	0.00
Grand Total==>	173,345	0	0	240,042	100.00	*	167,183	100.00	*	-41,928	-82,461	100.00

-----COOLING COIL SELECTION-----

	Total Capacity		Sens Cap.	Coil Airfl	Entering DB/WB/HR			Leaving DB/WB/HR			AREAS			
	(Tons)	(Mbh)			(Mbh)	(cfm)	Deg F	Deg F	Grains	Deg F	Deg F	Grains	Gross Total	Glass (sf)
Main Clg	20.0	240.0	204.2	11,305	77.6	64.5	73.3	60.6	57.6	69.1	Floor	10,435		
Aux Clg	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	Part	0		
Opt Vent	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	ExFlr	0		
0											Roof	0		0
Totals	20.0	240.0									Wall	2,840		140
5														

-----HEATING COIL SELECTION-----

	Capacity		Coil Airfl	Ent	Lvg	Type		AIRFLOWS (cfm)		--ENGINEERING CHECKS--		--TEMPERATURES (F)---		
	(Mbh)	(cfm)				Deg F	Deg F	Cooling	Heating	Clg % OA	10.0	Type	Clg	Htg
Main Htg	-82.5	11,305	67.0	73.8	Infil		1,130	1,130	Clg Cfm/Sqft	1.08	SADB	62.2	75.5	
Aux Htg	0.0	0	0.0	0.0	Supply		11,305	11,305	Clg Cfm/Ton	565.13	Plenum	77.3	69.9	
Preheat	-0.0	11,305	67.0	60.6	Mincfm		0	0	Clg Sqft/Ton	521.64	Return	76.0	72.0	
Reheat	0.0	0	0.0	0.0	Return		11,305	11,305	Clg Btuh/Sqft	23.00	Ret/OA	77.6	67.0	
Humidif	0.0	0	0.0	0.0	Exhaust		1,130	1,130	No. People	45	Runarnd	76.0	72.0	
Opt Vent	0.0	0	0.0	0.0	Rm Exh		0	0	Htg % OA	10.0	Fn MtrTD	0.4	0.0	
Total	-82.5				Auxil		0	0	Htg Cfm/SqFt	1.08	Fn BldTD	0.3	0.0	
									Htg Btuh/SqFt	-7.90	Fn Frict	0.9	0.0	

System 4 Block FC - FAN COIL

***** COOLING COIL PEAK *****					***** CLG SPACE PEAK *****			***** HEATING COIL PEAK *****		
Peaked at Time ==>	Mo/Hr: 8/15				*	Mo/Hr: 6/16		*	Mo/Hr: 13/ 1	
Outside Air ==>	OADB/WB/HR: 92/ 74/105.0				*	OADB: 96		*	OADB: 22	
	Space Sens.+Lat. (Btuh)	Ret. Air Sensible (Btuh)	Ret. Air Latent (Btuh)	Net Total (Btuh)	Perct (%)	Space Sensible (Btuh)	Perct (%)	Space Peak (Btuh)	Coil Peak Tot Sens (Btuh)	Perct (%)
Envelope Loads										
Skylite Solr	0	0	0	0	0.00	0	0.00	0	0	0.00
Skylite Cond	0	0	0	0	0.00	0	0.00	0	0	0.00
Roof Cond	0	0	0	0	0.00	0	0.00	0	0	0.00
Glass Solar	93,492	0	0	93,492	15.93	88,200	18.12	0	0	0.00
Glass Cond	31,629	0	0	31,629	5.39	38,032	7.82	-106,722	-106,722	27.15
Wall Cond	33,260	10,983	0	44,243	7.54	39,338	8.08	-55,250	-73,494	18.69
Partition	0	0	0	0	0.00	0	0.00	0	0	0.00
Exposed Floor	0	0	0	0	0.00	0	0.00	0	0	0.00
Infiltration	169,672	0	0	169,672	28.91	86,537	17.78	-220,757	-220,757	56.15
Sub Total==>	328,053	10,983	0	339,036	57.76	252,107	51.81	-382,729	-400,973	101.99
Internal Loads										
Lights	119,216	0	0	119,216	20.31	119,216	24.50	0	0	0.00
People	36,000	0	0	36,000	6.13	20,000	4.11	0	0	0.00
Misc	82,320	0	0	82,320	14.02	82,320	16.92	0	0	0.00
Sub Total==>	237,536	0	0	237,536	40.47	221,536	45.52	0	0	0.00
Ceiling Load	10,983	-10,983	0	0	0.00	12,989	2.67	-18,244	0	0.00
Outside Air	0	0	0	0	0.00	0	0.00	0	0	0.00
Sup. Fan Heat	0	0	0	7,820	1.33	0	0.00	0	7,820	-1.99
Ret. Fan Heat	0	2,607	0	2,607	0.44	0	0.00	0	0	0.00
Duct Heat PKup	0	0	0	0	0.00	0	0.00	0	0	0.00
OV/UNDR Sizing	0	0	0	0	0.00	0	0.00	0	0	0.00
Exhaust Heat	0	0	0	0	0.00	0	0.00	0	0	0.00
Terminal Bypass	0	0	0	0	-0.00	0	0.00	0	0	0.00
Grand Total==>	576,572	2,607	0	586,999	100.00	486,632	100.00	-400,973	-393,153	100.00

-----COOLING COIL SELECTION-----

	Total Capacity			Coil Airfl (cfm)	Entering DB/WB/HR			Leaving DB/WB/HR			Gross Total		Glass (sf) (%)
	(Tons)	(Mbh)	(Mbh)		Deg F	Deg F	Grains	Deg F	Deg F	Grains	Floor	Part	
Main Clg	48.9	587.0	473.3	29,327	76.1	63.2	69.8	60.3	56.6	65.2	20,580	0	
Aux Clg	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	0	0	
Opt Vent	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	0	0	
Totals	48.9	587.0									7,730	1,764 23	

-----AREAS-----

-----HEATING COIL SELECTION-----

	Capacity		Coil Airfl (cfm)	Ent Deg F	Lvg Deg F	Type	AIRFLOWS (cfm)		--ENGINEERING CHECKS--		--TEMPERATURES (F)--		
	(Mbh)	(cfm)					Cooling	Heating	Clg % OA	0.0	Type	Clg	Htg
Main Htg	-393.2	29,327	72.2	84.7	Infil	4,116	4,116	Clg Cfm/Sqft	1.43	SADB	60.5	84.7	
Aux Htg	0.0	0	0.0	0.0	Supply	29,327	29,327	Clg Cfm/Ton	599.52	Plenum	77.7	69.2	
Preheat	-0.0	29,327	72.2	60.5	Mincfm	0	0	Clg Btuh/Sqft	28.52	Return	76.0	72.0	
Reheat	0.0	0	0.0	0.0	Return	29,327	29,327	No. People	80	Ret/OA	76.0	72.0	
Humidif	0.0	0	0.0	0.0	Exhaust	0	0	Htg % OA	0.0	Runarnd	76.0	72.0	
Opt Vent	0.0	0	0.0	0.0	Rm Exh	0	0	Htg Cfm/SqFt	1.43	Fn MtrTD	0.1	0.0	
Total	-393.2				Auxil	0	0	Htg Btuh/SqFt	-19.10	Fn BldTD	0.1	0.0	
										Fn Frict	0.2	0.0	

System 5 Block FC - FAN COIL

\*\*\*\*\* COOLING COIL PEAK \*\*\*\*\* CLG SPACE PEAK \*\*\*\*\* HEATING COIL PEAK \*\*\*\*\*

COOLING COIL PEAK					CLG SPACE PEAK			HEATING COIL PEAK		
Peaked at Time ==>	Mo/Hr: 8/15				*	Mo/Hr: 6/16		*	Mo/Hr: 13/ 1	
Outside Air ==>	OADB/WB/HR: 92/ 74/105.0				*	OADB: 96		*	OADB: 22	
	Space Sens.+Lat. (Btuh)	Ret. Air Sensible (Btuh)	Ret. Air Latent (Btuh)	Net Total (Btuh)	Percent Of Tot (%)	Space Sensible (Btuh)	Percent Of Tot (%)	Space Peak Space Sens (Btuh)	Coil Peak Tot Sens (Btuh)	Percent Of Tot (%)
Envelope Loads										
Skylite Solr	0	0	0	0	0.00	0	0.00	0	0	0.00
Skylite Cond	0	0	0	0	0.00	0	0.00	0	0	0.00
Roof Cond	0	0	0	0	0.00	0	0.00	0	0	0.00
Glass Solar	146,300	0	0	146,300	16.09	146,300	19.33	0	0	0.00
Glass Cond	47,694	0	0	47,694	5.25	57,350	7.58	-160,930	-160,930	29.06
Wall Cond	41,481	14,602	0	56,083	6.17	48,736	6.44	-68,450	-92,546	16.71
Partition	0	0	0	0	0.00	0	0.00	0	0	0.00
Exposed Floor	0	0	0	0	0.00	0	0.00	0	0	0.00
Infiltration	239,957	0	0	239,957	26.39	122,384	16.17	-312,203	-312,203	56.38
Sub Total==>	475,431	14,602	0	490,033	53.89	374,770	49.52	-541,583	-565,680	102.16
Internal Loads										
Lights	200,480	0	0	200,480	22.05	200,480	26.49	0	0	0.00
People	86,400	0	0	86,400	9.50	48,000	6.34	0	0	0.00
Misc	116,420	0	0	116,420	12.80	116,420	15.38	0	0	0.00
Sub Total==>	403,300	0	0	403,300	44.35	364,900	48.21	0	0	0.00
Ceiling Load	14,602	-14,602	0	0	0.00	17,157	2.27	-24,096	0	0.00
Outside Air	0	0	0	0	0.00	0	0.00	0	0	0.00
Sup. Fan Heat	0	0	0	11,955	1.31	0	0.00	0	11,955	-2.16
Ret. Fan Heat	0	3,985	0	3,985	0.44	0	0.00	0	0	0.00
Duct Heat Pkup	0	0	0	0	0.00	0	0.00	0	0	0.00
OV/UNDR Sizing	0	0	0	0	0.00	0	0.00	0	0	0.00
Exhaust Heat	0	0	0	0	0.00	0	0.00	0	0	0.00
Terminal Bypass	0	0	0	0	-0.00	0	0.00	0	0	0.00
Grand Total==>	893,333	3,985	0	909,273	100.00	756,826	100.00	-565,680	-553,725	100.00

-----COOLING COIL SELECTION-----

	Total Capacity (Tons)	Capacity (Mbh)	Sens Cap. (Mbh)	Coil Airfl (cfm)	Entering DB/WB/HR			Leaving DB/WB/HR			Gross Total		Glass (sf)	Area (%)
					Deg F	Deg F	Grains	Deg F	Deg F	Grains	Floor	Part		
Main Clg	75.8	909.3	732.7	44,831	76.1	63.2	69.8	60.1	56.5	65.2	29,105	0		
Aux Clg	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	0	0		
Opt Vent	0.0	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	0	0		
0														
Totals	75.8	909.3									Wall	10,170	2,660	26

-----HEATING COIL SELECTION-----

	Capacity (Mbh)	Coil Airfl (cfm)	Ent Deg F	Lvg Deg F	Type	AIRFLOWS (cfm)		--ENGINEERING CHECKS--			--TEMPERATURES (F)--		
						Cooling	Heating	Clg % OA	0.0	Type	Clg	Htg	
Main Htg	-553.7	44,831	72.2	83.8	Infil	5,821	5,821	Clg Cfm/Sqft	1.54	SADB	60.3	83.8	
Aux Htg	0.0	0	0.0	0.0	Supply	44,831	44,831	Clg Cfm/Ton	591.65	Plenum	77.6	69.4	
Preheat	-0.0	44,831	72.2	60.3	Mincfm	0	0	Clg Sqft/Ton	384.11	Return	76.0	72.0	
Reheat	0.0	0	0.0	0.0	Return	44,831	44,831	Clg Btuh/Sqft	31.24	Ret/OA	76.0	72.0	
Humidif	0.0	0	0.0	0.0	Exhaust	0	0	No. People	192	Runarnd	76.0	72.0	
Opt Vent	0.0	0	0.0	0.0	Rm Exh	0	0	Htg % OA	0.0	Fn MtrTD	0.1	0.0	
Total	-553.7				Auxil	0	0	Htg Cfm/SqFt	1.54	Fn BldTD	0.1	0.0	
								Htg Btuh/SqFt	-19.03	Fn Frict	0.2	0.0	

System 6 Peak SZ - SINGLE ZONE

\*\*\*\*\* COOLING COIL PEAK \*\*\*\*\* CLG SPACE PEAK \*\*\*\*\* HEATING COIL PEAK \*\*\*\*\*

COOLING COIL PEAK					CLG SPACE PEAK			HEATING COIL PEAK		
Peaked at Time ==>	Mo/Hr: 7/15				*	Mo/Hr: 6/16		*	Mo/Hr: 13/ 1	
Outside Air ==>	OADB/WB/HR: 92/ 74/105.0				*	OADB: 96		*	OADB: 22	
	Space Sens.+Lat. (Btuh)	Ret. Air Sensible (Btuh)	Ret. Air Latent (Btuh)	Net Total (Btuh)	Percnt Of Tot (%)	Space Sensible (Btuh)	Percnt Of Tot (%)	Space Peak Sens (Btuh)	Coil Peak Tot Sens (Btuh)	Percnt Of Tot (%)
Envelope Loads										
Skylite Solr	0	0	0	0	0.00	0	0.00	0	0	0.00
Skylite Cond	0	0	0	0	0.00	0	0.00	0	0	0.00
Roof Cond	0	57,062	0	57,062	11.55	0	0.00	0	-37,969	15.22
Glass Solar	0	0	0	0	0.00	0	0.00	0	0	0.00
Glass Cond	0	0	0	0	0.00	0	0.00	0	0	0.00
Wall Cond	61,630	11,620	0	73,251	14.83	72,410	20.41	-101,700	-123,812	49.64
Partition	0	0	0	0	0.00	0	0.00	0	0	0.00
Exposed Floor	0	0	0	0	0.00	0	0.00	0	0	0.00
Infiltration	0	0	0	0	0.00	0	0.00	0	0	0.00
Sub Total==>	61,630	68,683	0	130,313	26.39	72,410	20.41	-101,700	-161,781	64.86
Internal Loads										
Lights	98,124	0	0	98,124	19.87	98,124	27.66	0	0	0.00
People	34,650	0	0	34,650	7.02	19,250	5.43	0	0	0.00
Misc	87,315	0	0	87,315	17.68	87,315	24.61	0	0	0.00
Sub Total==>	220,089	0	0	220,089	44.57	204,689	57.69	0	0	0.00
Ceiling Load	68,683	-68,683	0	0	0.00	77,709	21.90	-60,081	0	0.00
Outside Air	0	0	0	99,989	20.25	0	0.00	0	-131,118	52.57
Sup. Fan Heat	0	0	0	43,461	8.80	0	0.00	0	43,461	-17.42
Ret. Fan Heat	0	0	0	0	0.00	0	0.00	0	0	0.00
Duct Heat Pkup	0	0	0	0	0.00	0	0.00	0	0	0.00
OV/UNDR Sizing	0	0	0	0	0.00	0	0.00	0	0	0.00
Exhaust Heat	0	0	0	0	0.00	0	0.00	0	0	0.00
Terminal Bypass	0	0	0	0	0.00	0	0.00	0	0	0.00
Sub Total==>	350,402	0	0	493,852	100.00	354,808	100.00	-161,781	-249,438	100.00

-----COOLING COIL SELECTION-----

-----AREAS-----

	Total Capacity (Tons)	Sens Cap. (Mbh)	Coil Airfl (cfm)	Entering DB/WB/HR			Leaving DB/WB/HR			Gross Total	Glass (sf)	(%)
				Deg F	Deg F	Grains	Deg F	Deg F	Grains	Floor		
Main Clg	41.2	493.9	420.4	77.6	64.5	73.3	60.8	57.9	70.1	29,105		
Aux Clg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0		
Opt Vent	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0		
Totals	41.2	493.9								29,105	10,170	0

-----HEATING COIL SELECTION-----

-----AIRFLOWS (cfm)-----

-----ENGINEERING CHECKS-----

-----TEMPERATURES (F)-----

	Capacity (Mbh)	Coil Airfl (cfm)	Ent Deg F	Lvg Deg F	Type	Cooling	Heating	Clg % OA	10.0	Type	Clg	Htg
Main Htg	-249.4	24,447	67.0	76.5	Vent	2,445	2,445	Clg Cfm/Sqft	0.84	SADB	62.5	78.2
Aux Htg	0.0	0	0.0	0.0	Infil	0	0	Clg Cfm/Ton	594.03	Plenum	83.4	65.5
Preheat	-0.0	24,447	67.0	60.8	Supply	24,447	24,447	Clg Sqft/Ton	707.22	Return	76.0	72.0
Reheat	0.0	0	0.0	0.0	Mincfm	0	0	Clg Btuh/Sqft	16.97	Ret/OA	77.6	67.0
Humidif	0.0	0	0.0	0.0	Return	24,447	24,447	No. People	77	Runarnd	76.0	72.0
Opt Vent	0.0	0	0.0	0.0	Exhaust	2,445	2,445	Htg % OA	10.0	Fn MtrTD	0.4	0.0
Total	-249.4				Rm Exh	0	0	Htg Cfm/Sqft	0.84	Fn BldTD	0.3	0.0
					Auxil	0	0	Htg Btuh/Sqft	-8.57	Fn Frict	0.9	0.0



MAIN SYSTEM COOLING - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- P E A K C O O L I N G L O A D S -----  
 (Main System)

Room Number	Description	Peak Time Mo/Hr	Space					Coil							
			OA Cond. DB/WB (F)	Rm Dry Blb (F)	Supp. Dry Bulb (F)	Space Air Flow (Cfm)	Space Sens. Load (Btuh)	Space Lat. Load (Btuh)	Peak Time Mo/Hr	OA Cond. DB/WB (F)	Rm Dry Blb (F)	Supp. Dry Bulb (F)	Coil Air Flow (Cfm)	Coil Sens. Load (Btuh)	Coil Lat. Load (Btuh)
1	1ST FL AHU	6/16	96 72	76	62.5	21,228	307,853	13,200	8/15	92	74 76	63.2	21,228	366,097	63,591
Zone	1 Total/Ave.		96 72	76	62.5	21,228	307,853	13,200		92	74 76	63.2	21,228	366,097	63,591
Zone	1 Block	6/16	96 72	76	62.5	21,228	307,853	13,200	8/15	92	74 76	63.2	21,228	366,097	63,591
System	1 Total/Ave.		96 72	76	62.5	21,228	307,853	13,200		92	74 76	63.2	21,228	366,097	63,591
System	1 Block	6/16	96 72	76	62.5	21,228	307,853	13,200	8/15	92	74 76	63.2	21,228	366,097	63,591
2	1ST FL FC	6/15	96 73	76	58.8	11,285	207,834	36,532	8/15	92	74 76	59.6	11,285	201,975	55,910
Zone	2 Total/Ave.		96 73	76	58.8	11,285	207,834	36,532		92	74 76	59.6	11,285	201,975	55,910
Zone	2 Block	6/15	96 73	76	58.8	11,285	207,834	36,532	8/15	92	74 76	59.6	11,285	201,975	55,910
System	2 Total/Ave.		96 73	76	58.8	11,285	207,834	36,532		92	74 76	59.6	11,285	201,975	55,910
System	2 Block	6/15	96 73	76	58.8	11,285	207,834	36,532	8/15	92	74 76	59.6	11,285	201,975	55,910
3	2ND FL AHU	6/16	96 72	76	62.2	11,305	167,183	9,000	8/15	92	74 76	62.4	11,305	204,208	35,835
Zone	3 Total/Ave.		96 72	76	62.2	11,305	167,183	9,000		92	74 76	62.4	11,305	204,208	35,835
Zone	3 Block	6/16	96 72	76	62.2	11,305	167,183	9,000	8/15	92	74 76	62.4	11,305	204,208	35,835
System	3 Total/Ave.		96 72	76	62.2	11,305	167,183	9,000		92	74 76	62.4	11,305	204,208	35,835
System	3 Block	6/16	96 72	76	62.2	11,305	167,183	9,000	8/15	92	74 76	62.4	11,305	204,208	35,835
4	2ND FL FC	6/16	96 72	76	60.5	29,327	486,632	55,400	8/15	92	74 76	61.3	29,327	473,294	113,705
Zone	4 Total/Ave.		96 72	76	60.5	29,327	486,632	55,400		92	74 76	61.3	29,327	473,294	113,705
Zone	4 Block	6/16	96 72	76	60.5	29,327	486,632	55,400	8/15	92	74 76	61.3	29,327	473,294	113,705
System	4 Total/Ave.		96 72	76	60.5	29,327	486,632	55,400		92	74 76	61.3	29,327	473,294	113,705
System	4 Block	6/16	96 72	76	60.5	29,327	486,632	55,400	8/15	92	74 76	61.3	29,327	473,294	113,705
5	3RD FL FC	6/16	96 72	76	60.3	44,831	756,826	94,121	8/15	92	74 76	61.1	44,831	732,695	176,578
Zone	5 Total/Ave.		96 72	76	60.3	44,831	756,826	94,121		92	74 76	61.1	44,831	732,695	176,578
Zone	5 Block	6/16	96 72	76	60.3	44,831	756,826	94,121	8/15	92	74 76	61.1	44,831	732,695	176,578
System	5 Total/Ave.		96 72	76	60.3	44,831	756,826	94,121		92	74 76	61.1	44,831	732,695	176,578
System	5 Block	6/16	96 72	76	60.3	44,831	756,826	94,121	8/15	92	74 76	61.1	44,831	732,695	176,578
6	4TH FL AHU	6/16	96 72	76	62.5	24,447	354,808	15,400	7/15	92	74 76	63.2	24,447	420,420	73,431
Zone	6 Total/Ave.		96 72	76	62.5	24,447	354,808	15,400		92	74 76	63.2	24,447	420,420	73,431
Zone	6 Block	6/16	96 72	76	62.5	24,447	354,808	15,400	7/15	92	74 76	63.2	24,447	420,420	73,431
System	6 Total/Ave.		96 72	76	62.5	24,447	354,808	15,400		92	74 76	63.2	24,447	420,420	73,431
System	6 Block	6/16	96 72	76	62.5	24,447	354,808	15,400	7/15	92	74 76	63.2	24,447	420,420	73,431

COOLING LOADS AT COIL PEAK - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- AIR FLOW COOLING LOADS -----  
 (At time of Coil Peak)

Room Number	Description	----- Ventilation -----			----- Optional Ventilation -----			----- Bypass -----			Ov/Undr Sizing (Btuh)
		Airflow (Cfm)	Sensible (Btuh)	Latent (Btuh)	Airflow (Cfm)	Sensible (Btuh)	Latent (Btuh)	Airflow (Cfm)	Sensible (Btuh)	Latent (Btuh)	
1	1ST FL AHU	2,123	37,116	50,391	0	0	0	0	0	0	0
Zone	1 Total/Ave.	2,123	37,116	50,391	0	0	0	0	0	0	0
Zone	1 Block	2,123	37,116	50,391	0	0	0	0	0	0	0
System	1 Total/Ave.	2,123	37,116	50,391	0	0	0	0	0	0	0
System	1 Block	2,123	37,116	50,391	0	0	0	0	0	0	0
2	1ST FL FC	0	0	0	0	0	0	0	0	0	0
Zone	2 Total/Ave.	0	0	0	0	0	0	0	0	0	0
Zone	2 Block	0	0	0	0	0	0	0	0	0	0
System	2 Total/Ave.	0	0	0	0	0	0	0	0	0	0
System	2 Block	0	0	0	0	0	0	0	0	0	0
3	2ND FL AHU	1,130	19,766	26,835	0	0	0	0	0	0	0
Zone	3 Total/Ave.	1,130	19,766	26,835	0	0	0	0	0	0	0
Zone	3 Block	1,130	19,766	26,835	0	0	0	0	0	0	0
System	3 Total/Ave.	1,130	19,766	26,835	0	0	0	0	0	0	0
System	3 Block	1,130	19,766	26,835	0	0	0	0	0	0	0
4	2ND FL FC	0	0	0	0	0	0	0	0	0	0
Zone	4 Total/Ave.	0	0	0	0	0	0	0	0	0	0
Zone	4 Block	0	0	0	0	0	0	0	0	0	0
System	4 Total/Ave.	0	0	0	0	0	0	0	0	0	0
System	4 Block	0	0	0	0	0	0	0	0	0	0
5	3RD FL FC	0	0	0	0	0	0	0	0	0	0
Zone	5 Total/Ave.	0	0	0	0	0	0	0	0	0	0
Zone	5 Block	0	0	0	0	0	0	0	0	0	0
System	5 Total/Ave.	0	0	0	0	0	0	0	0	0	0
System	5 Block	0	0	0	0	0	0	0	0	0	0
6	4TH FL AHU	2,445	41,958	58,031	0	0	0	0	0	0	0
Zone	6 Total/Ave.	2,445	41,958	58,031	0	0	0	0	0	0	0
Zone	6 Block	2,445	41,958	58,031	0	0	0	0	0	0	0
System	6 Total/Ave.	2,445	41,958	58,031	0	0	0	0	0	0	0
System	6 Block	2,445	41,958	58,031	0	0	0	0	0	0	0



MAIN SYSTEM HEATING - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- P E A K H E A T I N G L O A D S -----  
 (Main System)

Room Number	Description	Floor Area (Sq Ft)	Space					Coil				
			Peak Time Mo/Hr	OA Cond. DB/WB (F)	Rm Dry Blb (F)	Supp. Dry Bulb (F)	Space Air Flow (Cfm)	Space Sens. Load (Btuh)	Peak Time Mo/Hr	OA Cond. DB/WB (F)	Rm Dry Blb (F)	Supp. Dry Bulb (F)
1	1ST FL AHU	20,697	13/ 1	22 18 72	79.1	21,228	-161,912	13/ 1	22 18 72	79.1	21,228	-238,028
Zone	1 Total/Ave.	20,697		22 18 72	79.1	21,228	-161,912		22 18 72	79.1	21,228	-238,028
Zone	1 Block	20,697	13/ 1	22 18 72	79.1	21,228	-161,912	13/ 1	22 18 72	79.1	21,228	-238,028
System	1 Total/Ave.	20,697		22 18 72	79.1	21,228	-161,912		22 18 72	79.1	21,228	-238,028
System	1 Block	20,697	13/ 1	22 18 72	79.1	21,228	-161,912	13/ 1	22 18 72	79.1	21,228	-238,028
2	1ST FL FC	10,260	13/ 1	22 18 72	89.4	11,285	-210,129	13/ 1	22 18 72	89.4	11,285	-207,119
Zone	2 Total/Ave.	10,260		22 18 72	89.4	11,285	-210,129		22 18 72	89.4	11,285	-207,119
Zone	2 Block	10,260	13/ 1	22 18 72	89.4	11,285	-210,129	13/ 1	22 18 72	89.4	11,285	-207,119
System	2 Total/Ave.	10,260		22 18 72	89.4	11,285	-210,129		22 18 72	89.4	11,285	-207,119
System	2 Block	10,260	13/ 1	22 18 72	89.4	11,285	-210,129	13/ 1	22 18 72	89.4	11,285	-207,119
3	2ND FL AHU	10,435	13/ 1	22 18 72	75.5	11,305	-41,928	13/ 1	22 18 72	75.5	11,305	-82,461
Zone	3 Total/Ave.	10,435		22 18 72	75.5	11,305	-41,928		22 18 72	75.5	11,305	-82,461
Zone	3 Block	10,435	13/ 1	22 18 72	75.5	11,305	-41,928	13/ 1	22 18 72	75.5	11,305	-82,461
System	3 Total/Ave.	10,435		22 18 72	75.5	11,305	-41,928		22 18 72	75.5	11,305	-82,461
System	3 Block	10,435	13/ 1	22 18 72	75.5	11,305	-41,928	13/ 1	22 18 72	75.5	11,305	-82,461
4	2ND FL FC	20,580	13/ 1	22 18 72	84.7	29,327	-400,973	13/ 1	22 18 72	84.7	29,327	-393,153
Zone	4 Total/Ave.	20,580		22 18 72	84.7	29,327	-400,973		22 18 72	84.7	29,327	-393,153
Zone	4 Block	20,580	13/ 1	22 18 72	84.7	29,327	-400,973	13/ 1	22 18 72	84.7	29,327	-393,153
System	4 Total/Ave.	20,580		22 18 72	84.7	29,327	-400,973		22 18 72	84.7	29,327	-393,153
System	4 Block	20,580	13/ 1	22 18 72	84.7	29,327	-400,973	13/ 1	22 18 72	84.7	29,327	-393,153
5	3RD FL FC	29,105	13/ 1	22 18 72	83.8	44,831	-565,680	13/ 1	22 18 72	83.8	44,831	-553,725
Zone	5 Total/Ave.	29,105		22 18 72	83.8	44,831	-565,680		22 18 72	83.8	44,831	-553,725
Zone	5 Block	29,105	13/ 1	22 18 72	83.8	44,831	-565,680	13/ 1	22 18 72	83.8	44,831	-553,725
System	5 Total/Ave.	29,105		22 18 72	83.8	44,831	-565,680		22 18 72	83.8	44,831	-553,725
System	5 Block	29,105	13/ 1	22 18 72	83.8	44,831	-565,680	13/ 1	22 18 72	83.8	44,831	-553,725
6	4TH FL AHU	29,105	13/ 1	22 18 72	78.2	24,447	-161,781	13/ 1	22 18 72	78.2	24,447	-249,438
Zone	6 Total/Ave.	29,105		22 18 72	78.2	24,447	-161,781		22 18 72	78.2	24,447	-249,438
Zone	6 Block	29,105	13/ 1	22 18 72	78.2	24,447	-161,781	13/ 1	22 18 72	78.2	24,447	-249,438
System	6 Total/Ave.	29,105		22 18 72	78.2	24,447	-161,781		22 18 72	78.2	24,447	-249,438
System	6 Block	29,105	13/ 1	22 18 72	78.2	24,447	-161,781	13/ 1	22 18 72	78.2	24,447	-249,438

COOLING AIRFLOW HEAT GAIN/LOSS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- AIRFLOW HEAT GAIN AND LOSS -----  
 (At time of Coil Peak)

Room Number	Description	Duct Heat Pickup (Btuh)	Supply Fan Heat (Btuh)	Return Fan Heat (Btuh)	System Exhaust Heat Loss (Btuh)	Cooling							
						System Exhaust Total (Btuh)	Room Exhaust Airflow (Cfm)	Ducted Airflow (Cfm)	Plenum Airflow (Cfm)	Run Around Airflow (Cfm)	Corridr Airflow (Cfm)	System Return Airflow (Cfm)	
1	1ST FL AHU	0	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
Zone	1 Total/Ave.	0	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
Zone	1 Block	0	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
System	1 Total/Ave.	0	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
System	1 Block	0	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
2	1ST FL FC	0	3,009	1,003	0	4,012	0	0	0	0	0	0	11,285
Zone	2 Total/Ave.	0	3,009	1,003	0	4,012	0	0	0	0	0	0	11,285
Zone	2 Block	0	3,009	1,003	0	4,012	0	0	0	0	0	0	11,285
System	2 Total/Ave.	0	3,009	1,003	0	4,012	0	0	0	0	0	0	11,285
System	2 Block	0	3,009	1,003	0	4,012	0	0	0	0	0	0	11,285
3	2ND FL AHU	0	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
Zone	3 Total/Ave.	0	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
Zone	3 Block	0	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
System	3 Total/Ave.	0	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
System	3 Block	0	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
4	2ND FL FC	0	7,820	2,607	0	10,427	0	0	0	0	0	0	29,327
Zone	4 Total/Ave.	0	7,820	2,607	0	10,427	0	0	0	0	0	0	29,327
Zone	4 Block	0	7,820	2,607	0	10,427	0	0	0	0	0	0	29,327
System	4 Total/Ave.	0	7,820	2,607	0	10,427	0	0	0	0	0	0	29,327
System	4 Block	0	7,820	2,607	0	10,427	0	0	0	0	0	0	29,327
5	3RD FL FC	0	11,955	3,985	0	15,940	0	0	0	0	0	0	44,831
Zone	5 Total/Ave.	0	11,955	3,985	0	15,940	0	0	0	0	0	0	44,831
Zone	5 Block	0	11,955	3,985	0	15,940	0	0	0	0	0	0	44,831
System	5 Total/Ave.	0	11,955	3,985	0	15,940	0	0	0	0	0	0	44,831
System	5 Block	0	11,955	3,985	0	15,940	0	0	0	0	0	0	44,831
6	4TH FL AHU	0	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
Zone	6 Total/Ave.	0	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
Zone	6 Block	0	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
System	6 Total/Ave.	0	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
System	6 Block	0	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447

HEATING AIRFLOW HEAT GAIN/LOSS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- A I R F L O W H E A T G A I N A N D L O S S -----  
 (At time of Coil Peak)

Room Number	Description	Supply Fan Heat (Btuh)	Return Fan Heat (Btuh)	System Exhaust Heat Loss (Btuh)	Total (Btuh)	Heating					Run Around Corridor Airflow (Cfm)	System Return Airflow (Cfm)
						System Exhaust Airflow (Cfm)	Room Exhaust Airflow (Cfm)	Ducted Airflow (Cfm)	Plenum Airflow (Cfm)	Run Airflow (Cfm)		
1	1ST FL AHU	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
Zone	1 Total/Ave.	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
Zone	1 Block	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
System	1 Total/Ave.	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
System	1 Block	37,739	0	0	37,739	2,123	0	21,228	0	0	0	21,228
2	1ST FL FC	3,009	0	0	3,009	0	0	0	0	0	0	11,285
Zone	2 Total/Ave.	3,009	0	0	3,009	0	0	0	0	0	0	11,285
Zone	2 Block	3,009	0	0	3,009	0	0	0	0	0	0	11,285
System	2 Total/Ave.	3,009	0	0	3,009	0	0	0	0	0	0	11,285
System	2 Block	3,009	0	0	3,009	0	0	0	0	0	0	11,285
3	2ND FL AHU	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
Zone	3 Total/Ave.	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
Zone	3 Block	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
System	3 Total/Ave.	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
System	3 Block	20,097	0	0	20,097	1,130	0	11,305	0	0	0	11,305
4	2ND FL FC	7,820	0	0	7,820	0	0	0	0	0	0	29,327
Zone	4 Total/Ave.	7,820	0	0	7,820	0	0	0	0	0	0	29,327
Zone	4 Block	7,820	0	0	7,820	0	0	0	0	0	0	29,327
System	4 Total/Ave.	7,820	0	0	7,820	0	0	0	0	0	0	29,327
System	4 Block	7,820	0	0	7,820	0	0	0	0	0	0	29,327
5	3RD FL FC	11,955	0	0	11,955	0	0	0	0	0	0	44,831
Zone	5 Total/Ave.	11,955	0	0	11,955	0	0	0	0	0	0	44,831
Zone	5 Block	11,955	0	0	11,955	0	0	0	0	0	0	44,831
System	5 Total/Ave.	11,955	0	0	11,955	0	0	0	0	0	0	44,831
System	5 Block	11,955	0	0	11,955	0	0	0	0	0	0	44,831
6	4TH FL AHU	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
Zone	6 Total/Ave.	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
Zone	6 Block	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
System	6 Total/Ave.	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447
System	6 Block	43,461	0	0	43,461	2,445	0	24,447	0	0	0	24,447

ROOM PSYCHROMETRICS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- P S Y C H R O M E T R I C   S T A T E   P O I N T S -----

Room            2

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	76.0	63.2	50.0	69.8	29.2	
Main System						
Return Air Heat Pickup						-0.1
Return Fan						0.1
Return Air	76.0	63.2	50.0	69.8	29.2	
Outdoor Air	92.3	74.4	44.2	105.0	38.7	
Return/Outdoor Air Mix	76.0	63.2	50.0	69.8	29.2	
Blow through Fan						0.1
Entering Coil	76.1	63.2	49.9	69.8	29.2	
Leaving Coil	58.6	56.0	85.6	65.5	24.3	
Draw Through Fan						0.0
Duct Frictional Heat						0.2
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	58.8	56.1	85.0	65.5	24.3	
Supply Air	58.8	56.1	85.0	65.5	24.3	
Percent Outside Air		0.00	(%)			
Sensible Heat Ratio (SHR)		0.851				
Percent Supply Air Bypassing Coil		0.00	(%)			
Coil Airflow		11,285	(Cfm)			

ROOM PSYCHROMETRICS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- P S Y C H R O M E T R I C   S T A T E   P O I N T S -----

Room            4

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	76.0	63.2	50.0	69.8	29.2	
Main System						
Return Air Heat Pickup						-0.1
Return Fan						0.1
Return Air	76.0	63.2	50.0	69.8	29.2	
Outdoor Air	92.3	74.4	44.2	105.0	38.7	
Return/Outdoor Air Mix	76.0	63.2	50.0	69.8	29.2	
Blow through Fan						0.1
Entering Coil	76.1	63.2	49.9	69.8	29.2	
Leaving Coil	60.3	57.1	82.9	67.5	25.0	
Draw Through Fan						0.0
Duct Frictional Heat						0.2
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	60.5	57.2	82.3	67.5	25.0	
Supply Air	60.5	57.2	82.3	67.5	25.0	
Percent Outside Air			0.00 (%)			
Sensible Heat Ratio (SHR)			0.898			
Percent Supply Air Bypassing Coil			0.00 (%)			
Coil Airflow			29,327 (Cfm)			



ROOM PSYCHROMETRICS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- P S Y C H R O M E T R I C   S T A T E   P O I N T S -----

Room            5

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	76.0	63.2	50.0	69.8	29.2	
Main System						
Return Air Heat Pickup						-0.1
Return Fan						0.1
Return Air	76.0	63.2	50.0	69.8	29.2	
Outdoor Air	92.3	74.4	44.2	105.0	38.7	
Return/Outdoor Air Mix	76.0	63.2	50.0	69.8	29.2	
Blow through Fan						0.1
Entering Coil	76.1	63.2	49.9	69.8	29.2	
Leaving Coil	60.1	57.0	83.3	67.2	24.9	
Draw Through Fan						0.0
Duct Frictional Heat						0.2
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	60.3	57.0	82.7	67.2	24.9	
Supply Air	60.3	57.0	82.7	67.2	24.9	
Percent Outside Air		0.00	(%)			
Sensible Heat Ratio (SHR)		0.889				
Percent Supply Air Bypassing Coil		0.00	(%)			
Coil Airflow		44,831	(Cfm)			

ZONE PSYCHROMETRICS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- PSYCHROMETRIC STATE POINTS -----

Zone 1

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	76.0	63.2	50.0	69.8	29.2	
Main System						
Return Air Heat Pickup						0.0
Return Fan						0.0
Return Air	76.0	63.2	50.0	69.8	29.2	
Outdoor Air	92.3	74.4	44.2	105.0	38.7	
Return/Outdoor Air Mix	77.6	64.5	49.7	73.3	30.1	
Blow through Fan						0.0
Entering Coil	77.6	64.5	49.7	73.3	30.1	
Leaving Coil	60.8	57.9	84.5	70.0	25.5	
Draw Through Fan						0.7
Duct Frictional Heat						0.9
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	62.5	58.5	79.7	70.0	25.9	
Supply Air	62.5	58.5	79.7	70.0	25.9	
Percent Outside Air		10.00	(%)			
Sensible Heat Ratio (SHR)		0.959				
Percent Supply Air Bypassing Coil		0.00	(%)			
Coil Airflow		21,228	(Cfm)			

ZONE PSYCHROMETRICS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- P S Y C H R O M E T R I C   S T A T E   P O I N T S -----

Zone            3

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	76.0	63.2	50.0	69.8	29.2	
Main System						
Return Air Heat Pickup						0.0
Return Fan						0.0
Return Air	76.0	63.2	50.0	69.8	29.2	
Outdoor Air	92.3	74.4	44.2	105.0	38.7	
Return/Outdoor Air Mix	77.6	64.5	49.7	73.3	30.1	
Blow through Fan						0.0
Entering Coil	77.6	64.5	49.7	73.3	30.1	
Leaving Coil	60.6	57.7	84.9	69.7	25.4	
Draw Through Fan						0.7
Duct Frictional Heat						0.9
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	62.2	58.3	80.0	69.7	25.8	
Supply Air	62.2	58.3	80.0	69.7	25.8	
Percent Outside Air		10.00	(%)			
Sensible Heat Ratio (SHR)		0.949				
Percent Supply Air Bypassing Coil		0.00	(%)			
Coil Airflow		11,305	(Cfm)			

ZONE PSYCHROMETRICS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- P S Y C H R O M E T R I C   S T A T E   P O I N T S -----

Zone            6

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	76.0	63.2	50.0	69.8	29.2	
Main System						
Return Air Heat Pickup						0.0
Return Fan						0.0
Return Air	76.0	63.2	50.0	69.8	29.2	
Outdoor Air	92.0	74.4	44.6	105.0	38.6	
Return/Outdoor Air Mix	77.6	64.5	49.8	73.3	30.1	
Blow through Fan						0.0
Entering Coil	77.6	64.5	49.8	73.3	30.1	
Leaving Coil	60.8	57.9	84.5	70.0	25.5	
Draw Through Fan						0.7
Duct Frictional Heat						0.9
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	62.5	58.5	79.7	70.0	25.9	
Supply Air	62.5	58.5	79.7	70.0	25.9	
Percent Outside Air		10.00	(%)			
Sensible Heat Ratio (SHR)		0.958				
Percent Supply Air Bypassing Coil		0.00	(%)			
Coil Airflow		24,447	(Cfm)			

BUILDING U-VALUES - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- B U I L D I N G U - V A L U E S -----

Room Number	Description	Room U-Values (Btu/hr/sqft/F)									Room Mass (lb/ sqft)	Room Capac. (Btu/ sqft/F)
		Part.	ExFlr	Summr Skylt	Wintr Skylt	Roof	Summr Windo	Wintr Windo	Wall	Ceill.		
1	1ST FL AHU	0.000	0.620	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.6	5.11
Zone	1 Total/Ave.	0.000	0.620	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.6	5.11
System	1 Total/Ave.	0.000	0.620	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.6	5.11
2	1ST FL FC	0.000	0.620	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.5	5.10
Zone	2 Total/Ave.	0.000	0.620	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.5	5.10
System	2 Total/Ave.	0.000	0.620	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.5	5.10
3	2ND FL AHU	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	24.0	4.80
Zone	3 Total/Ave.	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	24.0	4.80
System	3 Total/Ave.	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	24.0	4.80
4	2ND FL FC	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.3	5.06
Zone	4 Total/Ave.	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.3	5.06
System	4 Total/Ave.	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	25.3	5.06
5	3RD FL FC	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	24.0	4.80
Zone	5 Total/Ave.	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	24.0	4.80
System	5 Total/Ave.	0.000	0.000	0.000	0.000	0.000	1.100	1.211	0.250	0.317	24.0	4.80
6	4TH FL AHU	0.000	0.000	0.000	0.000	0.030	0.000	0.000	0.250	0.317	36.6	9.46
Zone	6 Total/Ave.	0.000	0.000	0.000	0.000	0.030	0.000	0.000	0.250	0.317	36.6	9.46
System	6 Total/Ave.	0.000	0.000	0.000	0.000	0.030	0.000	0.000	0.250	0.317	36.6	9.46
Building		0.000	0.620	0.000	0.000	0.030	1.100	1.211	0.250	0.317	27.7	6.05

BUILDING AREAS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- B U I L D I N G   A R E A S -----

Room Number	Description	Number of Duplicate		Floor Area/Dupl Room (sqft)	Total Floor Area (sqft)	Partition Area (sqft)	Exposed			Net Roof Area (sqft)	Window Area (sqft)	Win /Wl (%)	Net Wall Area (sqft)
		Flr	Rm				Floor Area (sqft)	Skylight Area (sqft)	Sk1 /Rf (%)				
1	1ST FL AHU	1	1	20,697	20,697	0	700	0	0	0	1,064	15	6,141
Zone	1 Total/Ave.				20,697	0	700	0	0	0	1,064	15	6,141
System	1 Total/Ave.				20,697	0	700	0	0	0	1,064	15	6,141
2	1ST FL FC	1	1	10,260	10,260	0	387	0	0	0	840	22	3,025
Zone	2 Total/Ave.				10,260	0	387	0	0	0	840	22	3,025
System	2 Total/Ave.				10,260	0	387	0	0	0	840	22	3,025
3	2ND FL AHU	1	1	10,435	10,435	0	0	0	0	0	140	5	2,700
Zone	3 Total/Ave.				10,435	0	0	0	0	0	140	5	2,700
System	3 Total/Ave.				10,435	0	0	0	0	0	140	5	2,700
4	2ND FL FC	1	1	20,580	20,580	0	0	0	0	0	1,764	23	5,966
Zone	4 Total/Ave.				20,580	0	0	0	0	0	1,764	23	5,966
System	4 Total/Ave.				20,580	0	0	0	0	0	1,764	23	5,966
5	3RD FL FC	1	1	29,105	29,105	0	0	0	0	0	2,660	26	7,510
Zone	5 Total/Ave.				29,105	0	0	0	0	0	2,660	26	7,510
System	5 Total/Ave.				29,105	0	0	0	0	0	2,660	26	7,510
6	4TH FL AHU	1	1	29,105	29,105	0	0	0	0	29,105	0	0	10,170
Zone	6 Total/Ave.				29,105	0	0	0	0	29,105	0	0	10,170
System	6 Total/Ave.				29,105	0	0	0	0	29,105	0	0	10,170
Building					120,182	0	1,087	0	0	29,105	6,468	15	35,512

ASHRAE 90 ANALYSIS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- A S H R A E   9 0   A N A L Y S I S -----

Overall Roof U-Value = 0.030 (Btu/Hr/Sq Ft/F)  
 Overall Wall U-Value = 0.381 (Btu/Hr/Sq Ft/F)  
 Overall Building U-Value = 0.237 (Btu/Hr/Sq Ft/F)

Roof Overall Thermal Transfer Value (OTTVr) = 1.15 (Btu/Hr/Sq Ft)  
 Wall Overall Thermal Transfer Value (OTTVw) = 22.75 (Btu/Hr/Sq Ft)

^R

SYSTEM LOAD PROFILE - ALTERNATIVE 1  
 BLDG G101, BASELINE

Main System 1 SZ SINGLE ZONE

Percent Design Load	Cooling Load			Heating Load			Cooling Airflow			Heating Airflow		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	1.8	5	183	-11,901	5	48	1,061.4	0	0	0.0	0	0
5 - 10	3.6	11	385	-23,803	4	37	2,122.8	0	0	0.0	0	0
10 - 15	5.4	10	367	-35,704	4	41	3,184.2	0	0	0.0	0	0
15 - 20	7.2	9	345	-47,606	8	77	4,245.6	0	0	0.0	0	0
20 - 25	9.0	10	359	-59,507	9	91	5,307.0	0	0	0.0	0	0
25 - 30	10.7	7	263	-71,408	12	115	6,368.4	0	0	0.0	0	0
30 - 35	12.5	10	366	-83,310	11	114	7,429.8	0	0	0.0	0	0
35 - 40	14.3	3	114	-95,211	7	65	8,491.2	0	0	0.0	0	0
40 - 45	16.1	3	124	-107,112	8	79	9,552.6	0	0	0.0	0	0
45 - 50	17.9	3	108	-119,014	12	118	10,614.0	0	0	0.0	0	0
50 - 55	19.7	4	149	-130,915	3	34	11,675.4	0	0	0.0	0	0
55 - 60	21.5	3	109	-142,817	14	138	12,736.8	0	0	0.0	0	0
60 - 65	23.3	3	102	-154,718	4	40	13,798.2	0	0	0.0	0	0
65 - 70	25.1	6	217	-166,619	0	0	14,859.6	0	0	0.0	0	0
70 - 75	26.9	5	193	-178,521	0	0	15,921.0	0	0	0.0	0	0
75 - 80	28.6	2	84	-190,422	0	0	16,982.4	0	0	0.0	0	0
80 - 85	30.4	2	65	-202,324	0	0	18,043.8	0	0	0.0	0	0
85 - 90	32.2	4	130	-214,225	0	0	19,105.2	0	0	0.0	0	0
90 - 95	34.0	0	0	-226,126	0	0	20,166.6	0	0	0.0	0	0
95 - 100	35.8	0	0	-238,028	0	0	21,228.0	100	8,760	0.0	0	0
Hours Off	0.0	0	5,097	0	0	7,763	0.0	0	0	0.0	0	8,760

Main System 2 FC FAN COIL

Percent Design Load	Cooling Load			Heating Load			Cooling Airflow			Heating Airflow		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	1.1	10	264	-10,356	9	162	564.3	0	0	0.0	0	0
5 - 10	2.1	15	394	-20,712	4	73	1,128.5	0	0	0.0	0	0
10 - 15	3.2	9	225	-31,068	10	166	1,692.8	0	0	0.0	0	0
15 - 20	4.3	13	351	-41,424	10	177	2,257.0	0	0	0.0	0	0
20 - 25	5.4	6	156	-51,780	10	182	2,821.3	0	0	0.0	0	0
25 - 30	6.4	2	54	-62,136	10	173	3,385.5	0	0	0.0	0	0
30 - 35	7.5	9	232	-72,492	18	318	3,949.8	0	0	0.0	0	0
35 - 40	8.6	5	131	-82,848	21	372	4,514.1	0	0	0.0	0	0
40 - 45	9.7	5	124	-93,204	7	115	5,078.3	0	0	0.0	0	0
45 - 50	10.7	3	91	-103,560	0	0	5,642.6	0	0	0.0	0	0
50 - 55	11.8	6	171	-113,916	0	0	6,206.8	0	0	0.0	0	0
55 - 60	12.9	10	252	-124,272	0	0	6,771.1	0	0	0.0	0	0
60 - 65	14.0	0	0	-134,628	0	0	7,335.4	0	0	0.0	0	0
65 - 70	15.0	0	0	-144,984	0	0	7,899.6	0	0	0.0	0	0
70 - 75	16.1	6	150	-155,340	0	0	8,463.9	0	0	0.0	0	0
75 - 80	17.2	2	45	-165,696	0	0	9,028.1	0	0	0.0	0	0
80 - 85	18.3	0	0	-176,052	0	0	9,592.4	0	0	0.0	0	0
85 - 90	19.3	0	0	-186,408	0	0	10,156.6	0	0	0.0	0	0
90 - 95	20.4	0	0	-196,764	0	0	10,720.9	0	0	0.0	0	0
95 - 100	21.5	0	0	-207,119	0	0	11,285.2	100	8,760	0.0	0	0
Hours Off	0.0	0	6,120	0	0	7,022	0.0	0	0	0.0	0	8,760

SYSTEM LOAD PROFILE - ALTERNATIVE 1  
 BLDG G101, BASELINE

Main System 3 SZ SINGLE ZONE

Percent Design Load	Cooling Load			Heating Load			Cooling Airflow			Heating Airflow		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	1.0	8	325	-4,123	5	26	565.2	0	0	0.0	0	0
5 - 10	2.0	8	331	-8,246	2	10	1,130.5	0	0	0.0	0	0
10 - 15	3.0	15	609	-12,369	8	42	1,695.7	0	0	0.0	0	0
15 - 20	4.0	9	372	-16,492	6	31	2,260.9	0	0	0.0	0	0
20 - 25	5.0	10	398	-20,615	13	69	2,826.1	0	0	0.0	0	0
25 - 30	6.0	11	423	-24,738	7	36	3,391.4	0	0	0.0	0	0
30 - 35	7.0	3	138	-28,862	7	36	3,956.6	0	0	0.0	0	0
35 - 40	8.0	1	22	-32,985	8	44	4,521.8	0	0	0.0	0	0
40 - 45	9.0	1	42	-37,108	9	47	5,087.0	0	0	0.0	0	0
45 - 50	10.0	2	66	-41,231	10	56	5,652.3	0	0	0.0	0	0
50 - 55	11.0	3	131	-45,354	7	37	6,217.5	0	0	0.0	0	0
55 - 60	12.0	1	42	-49,477	11	62	6,782.7	0	0	0.0	0	0
60 - 65	13.0	4	174	-53,600	8	46	7,348.0	0	0	0.0	0	0
65 - 70	14.0	4	167	-57,723	0	0	7,913.2	0	0	0.0	0	0
70 - 75	15.0	3	107	-61,846	0	0	8,478.4	0	0	0.0	0	0
75 - 80	16.0	6	240	-65,969	0	0	9,043.6	0	0	0.0	0	0
80 - 85	17.0	4	147	-70,092	0	0	9,608.9	0	0	0.0	0	0
85 - 90	18.0	2	65	-74,215	0	0	10,174.1	0	0	0.0	0	0
90 - 95	19.0	4	150	-78,338	0	0	10,739.3	0	0	0.0	0	0
95 - 100	20.0	0	0	-82,461	0	0	11,304.5	100	8,760	0.0	0	0
Hours Off	0.0	0	4,811	0	0	8,218	0.0	0	0	0.0	0	8,760

Main System 4 FC FAN COIL

Percent Design Load	Cooling Load			Heating Load			Cooling Airflow			Heating Airflow		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	2.4	11	311	-19,658	5	79	1,466.3	0	0	0.0	0	0
5 - 10	4.9	15	410	-39,315	4	60	2,932.7	0	0	0.0	0	0
10 - 15	7.3	12	342	-58,973	5	68	4,399.0	0	0	0.0	0	0
15 - 20	9.8	11	298	-78,631	11	165	5,865.3	0	0	0.0	0	0
20 - 25	12.2	3	83	-98,288	12	170	7,331.7	0	0	0.0	0	0
25 - 30	14.7	5	143	-117,946	13	192	8,798.0	0	0	0.0	0	0
30 - 35	17.1	5	141	-137,603	7	101	10,264.3	0	0	0.0	0	0
35 - 40	19.6	6	165	-157,261	28	402	11,730.7	0	0	0.0	0	0
40 - 45	22.0	5	129	-176,919	14	205	13,197.0	0	0	0.0	0	0
45 - 50	24.5	2	47	-196,576	0	0	14,663.3	0	0	0.0	0	0
50 - 55	26.9	7	195	-216,234	0	0	16,129.7	0	0	0.0	0	0
55 - 60	29.3	6	172	-235,892	0	0	17,596.0	0	0	0.0	0	0
60 - 65	31.8	5	147	-255,549	0	0	19,062.3	0	0	0.0	0	0
65 - 70	34.2	0	0	-275,207	0	0	20,528.7	0	0	0.0	0	0
70 - 75	36.7	2	43	-294,865	0	0	21,995.0	0	0	0.0	0	0
75 - 80	39.1	5	152	-314,522	0	0	23,461.3	0	0	0.0	0	0
80 - 85	41.6	0	0	-334,180	0	0	24,927.7	0	0	0.0	0	0
85 - 90	44.0	0	0	-353,837	0	0	26,394.0	0	0	0.0	0	0
90 - 95	46.5	0	0	-373,495	0	0	27,860.3	0	0	0.0	0	0
95 - 100	48.9	0	0	-393,153	0	0	29,326.6	100	8,760	0.0	0	0
Hours Off	0.0	0	5,982	0	0	7,318	0.0	0	0	0.0	0	8,760



SYSTEM LOAD PROFILE - ALTERNATIVE 1  
 BLDG G101, BASELINE

Main System 5 FC FAN COIL

Percent Design Load	---- Cooling Load ----			----- Heating Load -----			---- Cooling Airflow ----			---- Heating Airflow ----		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	3.8	2	93	-27,686	50	3	2,241.5	0	0	0.0	0	0
5 - 10	7.6	4	173	-55,372	0	0	4,483.1	0	0	0.0	0	0
10 - 15	11.4	9	395	-83,059	50	3	6,724.6	0	0	0.0	0	0
15 - 20	15.2	15	664	-110,745	0	0	8,966.2	0	0	0.0	0	0
20 - 25	18.9	10	459	-138,431	0	0	11,207.7	0	0	0.0	0	0
25 - 30	22.7	13	563	-166,117	0	0	13,449.2	0	0	0.0	0	0
30 - 35	26.5	9	410	-193,804	0	0	15,690.8	0	0	0.0	0	0
35 - 40	30.3	10	432	-221,490	0	0	17,932.3	0	0	0.0	0	0
40 - 45	34.1	6	245	-249,176	0	0	20,173.9	0	0	0.0	0	0
45 - 50	37.9	3	147	-276,862	0	0	22,415.4	0	0	0.0	0	0
50 - 55	41.7	4	173	-304,549	0	0	24,657.0	0	0	0.0	0	0
55 - 60	45.5	5	213	-332,235	0	0	26,898.5	0	0	0.0	0	0
60 - 65	49.3	5	234	-359,921	0	0	29,140.0	0	0	0.0	0	0
65 - 70	53.0	0	20	-387,607	0	0	31,381.6	0	0	0.0	0	0
70 - 75	56.8	0	0	-415,294	0	0	33,623.1	0	0	0.0	0	0
75 - 80	60.6	3	150	-442,980	0	0	35,864.7	0	0	0.0	0	0
80 - 85	64.4	1	45	-470,666	0	0	38,106.2	0	0	0.0	0	0
85 - 90	68.2	0	0	-498,352	0	0	40,347.8	0	0	0.0	0	0
90 - 95	72.0	0	0	-526,039	0	0	42,589.3	0	0	0.0	0	0
95 - 100	75.8	0	0	-553,725	0	0	44,830.8	100	8,760	0.0	0	0
Hours Off	0.0	0	4,344	0	0	8,754	0.0	0	0	0.0	0	8,760

Main System 6 SZ SINGLE ZONE

Percent Design Load	---- Cooling Load ----			----- Heating Load -----			---- Cooling Airflow ----			---- Heating Airflow ----		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	2.1	7	269	-12,472	4	37	1,222.3	0	0	0.0	0	0
5 - 10	4.1	12	442	-24,944	3	29	2,444.7	0	0	0.0	0	0
10 - 15	6.2	6	235	-37,416	9	86	3,667.0	0	0	0.0	0	0
15 - 20	8.2	7	257	-49,888	8	69	4,889.3	0	0	0.0	0	0
20 - 25	10.3	8	290	-62,360	5	47	6,111.7	0	0	0.0	0	0
25 - 30	12.3	7	261	-74,831	5	45	7,334.0	0	0	0.0	0	0
30 - 35	14.4	6	229	-87,303	7	63	8,556.4	0	0	0.0	0	0
35 - 40	16.5	4	141	-99,775	8	75	9,778.7	0	0	0.0	0	0
40 - 45	18.5	10	375	-112,247	7	68	11,001.0	0	0	0.0	0	0
45 - 50	20.6	7	241	-124,719	7	62	12,223.4	0	0	0.0	0	0
50 - 55	22.6	2	60	-137,191	9	82	13,445.7	0	0	0.0	0	0
55 - 60	24.7	3	112	-149,663	6	59	14,668.1	0	0	0.0	0	0
60 - 65	26.8	5	172	-162,135	7	67	15,890.4	0	0	0.0	0	0
65 - 70	28.8	5	172	-174,607	13	116	17,112.7	0	0	0.0	0	0
70 - 75	30.9	2	82	-187,079	1	9	18,335.1	0	0	0.0	0	0
75 - 80	32.9	3	108	-199,550	0	0	19,557.4	0	0	0.0	0	0
80 - 85	35.0	2	65	-212,022	0	0	20,779.7	0	0	0.0	0	0
85 - 90	37.0	3	107	-224,494	0	0	22,002.1	0	0	0.0	0	0
90 - 95	39.1	0	0	-236,966	0	0	23,224.4	0	0	0.0	0	0
95 - 100	41.2	0	0	-249,438	0	0	24,446.7	100	8,760	0.0	0	0
Hours Off	0.0	0	5,142	0	0	7,846	0.0	0	0	0.0	0	8,760

SYSTEM TOTALS LOAD PROFILE - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- SYSTEM LOAD PROFILE -----

System Totals

Percent Design Load	---- Cooling Load ----			----- Heating Load -----			---- Cooling Airflow ----			---- Heating Airflow ----		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	12.2	13	564	-86,196	25	444	7,121.1	0	0	0.0	0	0
5 - 10	24.3	16	725	-172,392	11	188	14,242.2	0	0	0.0	0	0
10 - 15	36.5	12	540	-258,589	24	422	21,363.3	0	0	0.0	0	0
15 - 20	48.6	9	405	-344,785	11	195	28,484.4	0	0	0.0	0	0
20 - 25	60.8	6	280	-430,981	7	122	35,605.5	0	0	0.0	0	0
25 - 30	72.9	8	362	-517,177	10	173	42,726.6	0	0	0.0	0	0
30 - 35	85.1	6	261	-603,373	9	162	49,847.7	0	0	0.0	0	0
35 - 40	97.3	3	115	-689,570	2	33	56,968.8	0	0	0.0	0	0
40 - 45	109.4	4	182	-775,766	0	3	64,089.9	0	0	0.0	0	0
45 - 50	121.6	4	184	-861,962	0	0	71,211.0	0	0	0.0	0	0
50 - 55	133.7	2	89	-948,158	0	0	78,332.1	0	0	0.0	0	0
55 - 60	145.9	3	153	-1,034,355	0	0	85,453.2	0	0	0.0	0	0
60 - 65	158.0	4	171	-1,120,551	0	0	92,574.3	0	0	0.0	0	0
65 - 70	170.2	4	190	-1,206,747	0	0	99,695.4	0	0	0.0	0	0
70 - 75	182.4	0	0	-1,292,943	0	0	106,816.4	0	0	0.0	0	0
75 - 80	194.5	2	88	-1,379,140	0	0	113,937.5	0	0	0.0	0	0
80 - 85	206.7	2	107	-1,465,336	0	0	121,058.6	0	0	0.0	0	0
85 - 90	218.8	0	0	-1,551,532	0	0	128,179.7	0	0	0.0	0	0
90 - 95	231.0	0	0	-1,637,728	0	0	135,300.8	0	0	0.0	0	0
95 - 100	243.1	0	0	-1,723,924	0	0	142,421.9	100	8,760	0.0	0	0
Hours Off	0.0	0	4,344	0	0	7,018	0.0	0	0	0.0	0	8,760

BUILDING COOL-HEAT DEMAND - ALTERNATIVE 1  
 BLDG G101, BASELINE

January		----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB OAWB	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton		
1	33.4 30.4	-608,634 0.0	-213,519 0.0	-113,350 0.0	-521,697 0.0	-521,697 0.0					
2	32.1 29.3	-654,546 0.0	-223,028 0.0	-427,242 0.0	-556,449 0.0	-556,449 0.0					
3	31.7 29.3	-695,731 0.0	-233,030 0.0	-530,660 0.0	-580,041 0.0	-580,041 0.0					
4	31.9 29.5	-720,659 0.0	-233,126 0.0	-539,311 0.0	-590,059 0.0	-590,059 0.0					
5	32.6 30.3	-740,165 0.0	-244,885 0.0	-557,165 0.0	-608,001 0.0	-608,001 0.0					
6	33.6 31.3	-742,302 0.0	-420,524 0.0	-568,386 0.0	-618,968 0.0	-618,968 0.0					
7	35.0 32.6	-728,260 0.0	-546,940 0.0	-546,996 0.0	-595,879 0.0	-595,879 0.0					
8	36.6 34.4	-26,575 0.0	-26,831 0.0	-493,545 0.0	-539,387 0.0	-26,860 0.0					
9	38.5 36.3	0 0.0	0 0.0	-451,673 0.0	-494,803 0.0	0 0.0					
10	40.4 37.7	0 0.0	0 0.0	-398,882 0.0	-437,828 0.0	0 0.0					
11	42.3 38.7	0 0.0	0 0.0	-342,287 0.0	-375,514 0.0	0 0.0					
12	44.2 39.6	0 0.0	0 0.0	-284,118 0.0	-311,537 0.0	0 0.0					
13	45.8 40.5	0 0.0	0 0.0	-232,469 0.0	-254,540 0.0	0 0.0					
14	47.2 41.1	0 0.0	0 0.0	-214,763 0.0	-232,832 0.0	0 0.0					
15	48.2 41.6	0 0.0	0 0.0	-194,672 0.0	-200,983 0.0	0 0.0					
16	48.9 41.8	0 0.0	0 0.0	-161,448 0.0	-161,452 0.0	0 0.0					
17	49.1 41.9	0 0.0	0 0.0	-211,844 0.0	-211,848 0.0	0 0.0					
18	48.7 41.9	0 0.0	0 0.0	-219,611 0.0	-219,611 0.0	0 0.0					
19	47.4 41.7	0 0.0	0 0.0	-236,445 0.0	-236,445 0.0	0 0.0					
20	45.5 40.5	0 0.0	0 0.0	-268,752 0.0	-268,752 0.0	0 0.0					
21	43.1 38.9	0 0.0	0 0.0	-330,964 0.0	-330,964 0.0	0 0.0					
22	40.4 36.7	0 0.0	0 0.0	-381,619 0.0	-381,619 0.0	0 0.0					
23	37.7 34.3	-45,557 0.0	-26,615 0.0	-435,634 0.0	-435,634 0.0	-26,615 0.0					
24	35.3 32.3	-133,899 0.0	-69,737 0.0	-492,085 0.0	-492,085 0.0	-69,737 0.0					

February		----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB OAWB	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton	Htg Btuh Clg Ton		
1	37.5 34.5	-195,956 0.0	-209,716 0.0	-224,337 0.0	-486,246 0.0	-486,246 0.0					
2	36.0 33.0	-338,694 0.0	-231,450 0.0	-480,799 0.0	-528,705 0.0	-528,705 0.0					
3	34.7 31.8	-512,565 0.0	-230,224 0.0	-501,287 0.0	-545,408 0.0	-545,408 0.0					
4	33.6 30.9	-540,990 0.0	-241,400 0.0	-528,579 0.0	-575,596 0.0	-575,596 0.0					
5	32.8 30.1	-557,268 0.0	-250,334 0.0	-550,931 0.0	-599,878 0.0	-599,878 0.0					
6	32.2 29.8	-560,286 0.0	-334,410 0.0	-569,823 0.0	-620,320 0.0	-620,320 0.0					
7	32.1 29.6	-544,984 0.0	-481,617 0.0	-574,551 0.0	-626,324 0.0	-626,324 0.0					
8	32.5 30.3	-4,518 0.0	-35,040 0.0	-503,000 0.0	-551,382 0.0	-35,037 0.0					
9	33.9 31.6	0 0.0	0 0.0	-497,287 0.0	-545,687 0.0	0 0.0					
10	36.0 33.0	0 0.0	0 0.0	-477,910 0.0	-522,862 0.0	0 0.0					
11	38.5 34.8	0 0.0	0 0.0	-441,935 0.0	-481,174 0.0	0 0.0					
12	41.3 36.5	0 0.0	0 0.0	-363,945 0.0	-396,189 0.0	0 0.0					
13	43.8 38.1	0 0.0	0 0.0	-317,106 0.0	-343,866 0.0	0 0.0					
14	45.9 39.5	0 0.0	0 0.0	-283,832 0.0	-305,774 0.0	0 0.0					
15	47.2 40.4	0 0.0	0 0.0	-221,219 0.0	-236,229 0.0	0 0.0					
16	47.7 40.6	0 0.0	0 0.0	-221,306 0.0	-221,301 0.0	0 0.0					
17	47.5 40.2	0 0.0	0 0.0	-218,481 0.0	-218,490 0.0	0 0.0					
18	47.0 39.8	0 0.0	0 0.0	-292,096 0.0	-292,096 0.0	0 0.0					
19	46.2 39.9	0 0.0	0 0.0	-280,674 0.0	-280,674 0.0	0 0.0					
20	45.1 39.7	0 0.0	0 0.0	-303,346 0.0	-303,346 0.0	0 0.0					
21	43.8 39.2	0 0.0	-22,033 0.0	-331,482 0.0	-331,482 0.0	-22,033 0.0					
22	42.3 38.3	0 0.0	-54,909 0.0	-364,190 0.0	-364,190 0.0	-54,909 0.0					
23	40.7 37.2	-53,390 0.0	-62,353 0.0	-414,261 0.0	-414,261 0.0	-62,353 0.0					
24	39.1 35.8	-122,323 0.0	-155,433 0.0	-446,424 0.0	-446,424 0.0	-155,433 0.0					



BUILDING COOL-HEAT DEMAND - ALTERNATIVE 1  
 BLDG G101, BASELINE

May			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	66.6	62.3	0	243.1	0	17.3	0	18.6	0	18.6	0	18.6
2	64.5	60.4	0	198.2	0	13.1	0	13.6	0	13.6	0	13.6
3	62.7	59.1	0	165.2	0	10.0	0	10.1	0	10.1	0	10.1
4	61.2	58.1	0	136.5	0	8.0	0	8.0	0	8.0	0	8.0
5	60.0	57.1	0	115.8	0	6.4	0	6.4	0	6.4	0	6.4
6	59.3	56.6	0	25.6	0	10.5	0	10.6	0	10.6	0	10.6
7	59.0	56.5	0	36.8	0	12.5	0	12.5	0	12.5	0	12.5
8	59.5	56.6	0	109.1	0	45.2	0	13.4	0	13.4	0	46.0
9	60.9	56.6	0	138.1	0	81.5	0	13.9	0	13.9	0	81.4
10	63.0	57.2	0	142.8	0	100.4	0	18.0	0	18.0	0	100.6
11	65.7	58.1	0	149.5	0	104.9	0	19.7	0	19.7	0	104.9
12	68.7	59.8	0	158.2	0	109.0	0	22.6	0	22.6	0	109.0
13	71.7	61.6	0	144.7	0	96.4	0	30.6	0	30.6	0	96.4
14	74.5	63.4	0	181.8	0	130.8	0	40.6	0	40.6	0	130.8
15	76.6	64.8	0	192.5	0	144.7	0	52.0	0	52.0	0	144.8
16	78.0	65.6	0	194.0	0	147.5	0	60.1	0	60.1	0	147.5
17	78.5	65.6	0	162.3	0	124.8	0	61.7	0	61.7	0	124.8
18	78.2	65.8	0	114.7	0	84.8	0	56.8	0	56.8	0	84.8
19	77.5	65.6	0	68.3	0	48.0	0	48.1	0	48.1	0	48.0
20	76.3	66.1	0	60.2	0	45.1	0	45.1	0	45.1	0	45.1
21	74.8	67.2	0	51.2	0	41.1	0	41.1	0	41.1	0	41.1
22	73.0	66.4	0	42.2	0	35.2	0	35.2	0	35.2	0	35.2
23	70.9	65.4	0	34.9	0	28.8	0	28.8	0	28.8	0	28.8
24	68.7	64.0	0	28.1	0	23.7	0	23.7	0	23.7	0	23.7

June			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	73.0	67.9	0	52.2	0	33.8	0	37.5	0	37.5	0	37.5
2	71.2	66.1	0	47.1	0	28.9	0	30.8	0	30.8	0	30.8
3	69.7	65.2	0	42.7	0	24.7	0	25.4	0	25.4	0	25.4
4	68.5	64.3	0	39.7	0	20.6	0	20.9	0	20.9	0	20.9
5	67.8	64.2	0	37.4	0	18.5	0	18.7	0	18.7	0	18.7
6	67.6	64.2	0	56.4	0	25.0	0	25.1	0	25.1	0	25.1
7	68.1	64.8	0	72.3	0	33.3	0	33.8	0	33.8	0	33.8
8	69.4	65.7	0	150.3	0	110.6	0	40.6	0	40.6	0	113.4
9	71.6	66.2	0	184.6	0	143.0	0	46.1	0	46.1	0	142.9
10	74.2	67.2	0	186.3	0	154.4	0	59.8	0	59.8	0	154.4
11	77.2	68.5	0	195.3	0	155.7	0	62.0	0	62.0	0	155.7
12	80.2	70.0	0	204.0	0	163.6	0	70.5	0	70.5	0	163.6
13	82.8	70.8	0	185.5	0	147.7	0	83.8	0	83.8	0	147.7
14	85.0	71.6	0	228.0	0	190.7	0	96.2	0	96.2	0	190.7
15	86.3	72.3	0	235.1	0	200.3	0	105.7	0	105.7	0	200.3
16	86.8	72.1	0	234.4	0	199.5	0	103.9	0	103.9	0	199.5
17	86.6	71.7	0	196.8	0	165.0	0	97.6	0	97.6	0	165.0
18	85.8	71.5	0	145.3	0	121.3	0	92.3	0	92.3	0	121.3
19	84.7	71.2	0	96.2	0	77.3	0	78.8	0	78.8	0	77.3
20	83.2	71.5	0	88.2	0	76.2	0	77.0	0	77.0	0	76.2
21	81.4	71.7	0	79.6	0	68.9	0	69.1	0	69.1	0	68.9
22	79.3	71.4	0	70.4	0	61.1	0	61.1	0	61.1	0	61.1
23	77.2	70.5	0	62.5	0	53.7	0	53.7	0	53.7	0	53.7
24	75.1	69.1	0	56.2	0	45.3	0	45.3	0	45.3	0	45.3

BUILDING COOL-HEAT DEMAND - ALTERNATIVE 1  
 BLDG G101, BASELINE

July		----- Design -----			----- Weekday -----			----- Saturday-----			----- Sunday -----			----- Monday -----						
Hour	OADB	OAWB	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton		
1	72.0	69.3		0	54.1		0	31.8		0	36.8		0	36.8		0	36.8		0	36.8
2	70.5	68.0		0	47.4		0	28.1		0	30.1		0	30.1		0	30.1		0	30.1
3	69.4	67.1		0	42.9		0	24.7		0	25.3		0	25.3		0	25.3		0	25.3
4	68.5	66.4		0	40.2		0	21.8		0	22.0		0	22.0		0	22.0		0	22.0
5	67.9	66.0		0	37.9		0	19.8		0	19.8		0	19.8		0	19.8		0	19.8
6	67.7	65.9		0	52.0		0	24.1		0	24.1		0	24.1		0	24.1		0	24.1
7	68.1	66.3		0	72.6		0	33.2		0	33.4		0	33.4		0	33.4		0	33.4
8	69.1	67.3		0	157.0		0	120.6		0	43.4		0	43.4		0	43.4		0	121.9
9	70.8	68.0		0	184.5		0	147.6		0	49.3		0	49.3		0	49.3		0	147.3
10	72.9	69.1		0	190.3		0	156.8		0	60.5		0	60.5		0	60.5		0	156.9
11	75.2	70.5		0	196.9		0	158.3		0	63.0		0	63.0		0	63.0		0	158.3
12	77.5	71.7		0	204.5		0	164.2		0	70.9		0	70.9		0	70.9		0	164.2
13	79.6	72.7		0	187.1		0	145.0		0	82.0		0	82.0		0	82.0		0	145.0
14	81.3	73.5		0	228.0		0	191.7		0	94.4		0	94.4		0	94.4		0	191.7
15	82.3	73.7		0	235.2		0	199.0		0	103.8		0	103.8		0	103.8		0	199.0
16	82.7	73.5		0	234.3		0	197.6		0	101.2		0	101.2		0	101.2		0	197.6
17	82.5	73.1		0	195.7		0	161.2		0	93.6		0	93.6		0	93.6		0	161.2
18	82.0	72.6		0	141.5		0	116.5		0	88.9		0	88.9		0	88.9		0	116.5
19	81.1	73.2		0	91.0		0	73.5		0	76.4		0	76.4		0	76.4		0	73.5
20	79.9	73.8		0	85.9		0	73.9		0	74.3		0	74.3		0	74.3		0	73.9
21	78.5	73.9		0	77.0		0	70.0		0	70.0		0	70.0		0	70.0		0	70.0
22	76.9	73.1		0	68.4		0	61.6		0	61.7		0	61.7		0	61.7		0	61.6
23	75.2	71.9		0	61.8		0	52.5		0	52.5		0	52.5		0	52.5		0	52.5
24	73.5	70.8		0	55.9		0	45.1		0	45.1		0	45.1		0	45.1		0	45.1

August		----- Design -----			----- Weekday -----			----- Saturday-----			----- Sunday -----			----- Monday -----						
Hour	OADB	OAWB	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton		
1	72.7	70.2		0	58.2		0	33.1		0	39.0		0	39.0		0	39.0		0	39.0
2	71.2	69.0		0	48.0		0	30.8		0	32.8		0	32.8		0	32.8		0	32.8
3	69.9	68.0		0	42.1		0	26.9		0	27.3		0	27.3		0	27.3		0	27.3
4	68.8	67.1		0	38.9		0	23.2		0	23.3		0	23.3		0	23.3		0	23.3
5	68.0	66.6		0	36.6		0	19.8		0	19.9		0	19.9		0	19.9		0	19.9
6	67.5	66.2		0	42.3		0	20.7		0	20.7		0	20.7		0	20.7		0	20.7
7	67.3	66.1		0	69.1		0	29.3		0	29.3		0	29.3		0	29.3		0	29.3
8	67.8	66.5		0	153.3		0	112.3		0	34.7		0	34.7		0	34.7		0	114.9
9	69.1	67.0		0	184.3		0	139.1		0	41.1		0	41.1		0	41.1		0	139.6
10	71.2	67.8		0	188.5		0	144.3		0	49.7		0	49.7		0	49.7		0	144.2
11	73.8	68.7		0	195.2		0	149.9		0	55.1		0	55.1		0	55.1		0	149.9
12	76.5	70.0		0	202.4		0	159.8		0	66.2		0	66.2		0	66.2		0	159.8
13	79.1	71.2		0	182.2		0	144.4		0	80.9		0	80.9		0	80.9		0	144.4
14	81.1	72.6		0	228.2		0	190.6		0	93.0		0	93.0		0	93.0		0	190.6
15	82.5	73.6		0	237.2		0	200.1		0	104.4		0	104.4		0	104.4		0	200.1
16	83.0	73.7		0	235.5		0	192.6		0	95.2		0	95.2		0	95.2		0	192.6
17	82.8	73.5		0	198.5		0	163.6		0	95.0		0	95.0		0	95.0		0	163.6
18	82.3	73.5		0	138.9		0	111.6		0	84.0		0	84.0		0	84.0		0	111.6
19	81.5	73.1		0	91.6		0	72.4		0	75.3		0	75.3		0	75.3		0	72.4
20	80.4	73.7		0	84.7		0	72.9		0	73.3		0	73.3		0	73.3		0	72.9
21	79.1	74.9		0	77.5		0	69.2		0	69.3		0	69.3		0	69.3		0	69.2
22	77.6	73.9		0	69.1		0	63.7		0	63.7		0	63.7		0	63.7		0	63.7
23	76.0	72.7		0	60.9		0	55.4		0	55.4		0	55.4		0	55.4		0	55.4
24	74.3	71.3		0	54.7		0	46.6		0	46.6		0	46.6		0	46.6		0	46.6

BUILDING COOL-HEAT DEMAND - ALTERNATIVE 1  
 BLDG G101, BASELINE

September			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	69.8	66.1	0	40.1	0	22.7	0	25.3	0	25.3	0	25.3
2	68.0	64.5	0	32.2	0	19.4	0	20.6	0	20.6	0	20.6
3	66.3	63.0	0	27.8	0	15.5	0	16.1	0	16.1	0	16.1
4	64.9	61.9	0	24.4	0	12.0	0	12.3	0	12.3	0	12.3
5	63.9	61.3	0	23.2	0	9.2	0	9.3	0	9.3	0	9.3
6	63.2	61.0	0	22.4	0	8.3	0	8.3	0	8.3	0	8.3
7	63.0	60.8	0	44.4	0	15.1	0	15.1	0	15.1	0	15.1
8	63.4	61.4	0	117.6	0	63.0	0	18.7	0	18.7	0	63.4
9	64.7	61.8	0	151.7	0	99.5	0	18.4	0	18.4	0	100.5
10	66.6	62.1	0	161.0	0	108.2	0	20.0	0	20.0	0	108.7
11	69.1	62.9	0	174.9	0	124.4	0	29.6	0	29.6	0	124.7
12	71.8	63.7	0	184.7	0	131.1	0	38.1	0	38.1	0	131.3
13	74.5	65.5	0	165.8	0	116.4	0	49.0	0	49.0	0	116.5
14	77.0	67.1	0	204.0	0	155.8	0	65.0	0	65.0	0	155.9
15	78.9	68.2	0	211.2	0	162.9	0	69.3	0	69.3	0	162.9
16	80.2	68.6	0	209.1	0	168.6	0	72.3	0	72.3	0	168.6
17	80.6	68.5	0	168.6	0	137.6	0	70.1	0	70.1	0	137.6
18	80.4	68.9	0	110.8	0	87.0	0	58.7	0	58.7	0	87.0
19	79.7	70.0	0	76.7	0	57.1	0	58.1	0	58.1	0	57.1
20	78.7	71.2	0	68.1	0	55.7	0	56.1	0	56.1	0	55.7
21	77.3	71.6	0	59.7	0	52.9	0	53.0	0	53.0	0	52.9
22	75.6	70.5	0	51.3	0	47.3	0	47.4	0	47.4	0	47.3
23	73.7	69.4	0	44.4	0	40.4	0	40.4	0	40.4	0	40.4
24	71.8	67.7	0	38.4	0	32.4	0	32.4	0	32.4	0	32.4

October			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	54.8	51.3	0	3.2	0	6.7	0	6.6	0	6.6	0	6.6
2	52.9	49.6	0	1.7	0	5.4	0	5.3	0	5.3	0	5.3
3	51.2	48.2	0	0.9	0	4.4	0	4.4	0	4.4	0	4.4
4	49.8	47.2	0	0.0	0	3.6	0	3.5	0	3.5	0	3.5
5	48.8	46.2	0	0.0	0	2.0	0	1.9	0	1.9	0	1.9
6	48.2	45.7	0	0.0	0	1.5	0	1.5	0	1.5	0	1.5
7	47.9	45.6	0	5.1	0	5.5	0	5.4	0	5.4	0	5.4
8	48.5	46.2	0	24.0	0	14.9	0	7.2	0	7.2	0	14.8
9	50.3	47.3	0	54.2	0	27.3	0	6.9	0	6.9	0	24.4
10	52.9	48.7	0	75.8	0	32.8	0	8.5	0	8.5	0	32.9
11	56.2	49.9	0	108.7	0	46.2	0	10.9	0	10.9	0	35.9
12	59.6	51.5	0	126.6	0	74.5	0	15.7	0	15.7	0	49.0
13	62.9	53.5	0	114.5	0	72.1	0	16.8	0	16.7	0	45.5
14	65.5	55.2	0	143.5	0	102.0	0	17.4	0	17.4	0	78.1
15	67.3	56.3	0	150.4	0	109.5	0	18.5	0	18.5	0	98.9
16	67.9	56.6	0	148.6	0	111.4	0	18.7	0	18.7	0	111.4
17	67.7	56.4	0	109.8	0	82.5	0	14.5	0	14.5	0	82.5
18	67.0	56.6	0	66.8	0	45.7	0	12.8	0	12.8	0	45.7
19	66.0	57.6	0	32.1	0	18.9	0	12.7	0	12.7	0	18.9
20	64.6	57.9	0	24.1	0	16.1	0	12.1	0	12.1	0	16.1
21	62.9	57.3	0	18.1	0	12.9	0	11.2	0	11.2	0	12.9
22	61.0	56.0	0	12.2	0	9.6	0	9.4	0	9.4	0	9.6
23	59.0	54.8	0	7.4	0	8.6	0	8.5	0	8.5	0	8.6
24	56.9	53.0	0	4.4	0	7.7	0	7.7	0	7.7	0	7.7

BUILDING COOL-HEAT DEMAND - ALTERNATIVE 1  
 BLDG G101, BASELINE

November			----- Design -----				----- Weekday -----				----- Saturday-----				----- Sunday -----				----- Monday -----			
Hour	OADB	OAWB	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton
1	48.7	45.7		0		0.0		0		0.0		0		0.0	-116,754		0.0		-128,687		0.0	
2	46.9	44.1		0		0.0		0		0.0		0		0.0	-129,770		0.0		-190,279		0.0	
3	45.5	42.8		-40,246		0.0		0		0.0		0		0.0	-128,072		0.0		-219,816		0.0	
4	44.6	41.9		-176,274		0.0		0		0.0		0		0.0	-149,085		0.0		-311,308		0.0	
5	44.4	42.0		-182,598		0.0		0		0.0		0		0.0	-208,666		0.0		-325,406		0.0	
6	44.8	42.7		-181,046		0.0		0		0.0		0		0.0	-251,400		0.0		-347,205		0.0	
7	45.9	43.9		-167,527		0.0		0		0.0		-19,779		0.0	-231,691		0.0		-329,877		0.0	
8	47.8	46.0		0		0.0		0		0.0		-32,468		0.0	-152,132		0.0		0		0.0	
9	50.2	48.0		0		0.0		0		0.0		-26,416		0.0	-123,708		0.0		0		0.0	
10	52.9	49.9		0		0.0		0		0.0		-16,942		0.0	-82,242		0.0		0		0.0	
11	55.8	51.1		0		0.0		0		0.0		-8,359		0.0	-36,830		0.0		0		0.0	
12	58.5	52.0		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
13	60.9	52.5		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
14	62.8	53.4		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
15	64.0	53.8		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
16	64.4	53.9		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
17	64.1	53.7		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
18	63.2	53.7		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
19	61.8	54.2		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
20	60.0	53.6		0		0.0		0		0.0		0		0.0	0		0.0		0		0.0	
21	57.9	52.7		0		0.0		0		0.0		-4,433		0.0	-4,433		0.0		0		0.0	
22	55.6	51.2		0		0.0		0		0.0		-21,093		0.0	-48,811		0.0		0		0.0	
23	53.2	49.5		0		0.0		0		0.0		-63,794		0.0	-77,035		0.0		0		0.0	
24	50.8	47.6		0		0.0		0		0.0		-90,885		0.0	-90,877		0.0		0		0.0	

December			----- Design -----				----- Weekday -----				----- Saturday-----				----- Sunday -----				----- Monday -----			
Hour	OADB	OAWB	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton	Htg	Btuh	Clg	Ton
1	37.5	35.3		0		0.0		-15,606		0.0		-22,508		0.0	-450,085		0.0		-486,611		0.0	
2	37.1	35.1		0		0.0		-76,828		0.0		-76,824		0.0	-472,380		0.0		-511,037		0.0	
3	37.4	35.5		0		0.0		-185,970		0.0		-143,257		0.0	-486,845		0.0		-526,921		0.0	
4	38.1	36.2		-25,720		0.0		-226,214		0.0		-226,241		0.0	-481,902		0.0		-521,952		0.0	
5	39.3	37.6		-91,762		0.0		-220,698		0.0		-269,550		0.0	-513,555		0.0		-513,536		0.0	
6	40.9	39.2		-257,932		0.0		-214,318		0.0		-325,111		0.0	-499,859		0.0		-499,885		0.0	
7	42.7	41.2		-266,568		0.0		-212,665		0.0		-317,308		0.0	-488,600		0.0		-488,599		0.0	
8	44.7	43.1		-1,260		0.0		0		0.0		-294,067		0.0	-406,180		0.0		0		0.0	
9	46.8	45.3		0		0.0		0		0.0		-318,485		0.0	-346,638		0.0		0		0.0	
10	48.8	47.0		0		0.0		0		0.0		-254,684		0.0	-277,788		0.0		0		0.0	
11	50.7	48.1		0		0.0		0		0.0		-190,578		0.0	-207,926		0.0		0		0.0	
12	52.2	48.8		0		0.0		0		0.0		-130,645		0.0	-142,689		0.0		0		0.0	
13	53.4	49.2		0		0.0		0		0.0		-84,547		0.0	-91,749		0.0		0		0.0	
14	54.1	49.2		0		0.0		0		0.0		-47,349		0.0	-50,408		0.0		0		0.0	
15	54.4	48.9		0		0.0		0		0.0		-31,685		0.0	-31,685		0.0		0		0.0	
16	54.0	48.2		0		0.0		0		0.0		-37,970		0.0	-37,970		0.0		0		0.0	
17	53.0	47.3		0		0.0		0		0.0		-107,060		0.0	-108,055		0.0		0		0.0	
18	51.4	46.3		0		0.0		0		0.0		-126,889		0.0	-130,647		0.0		0		0.0	
19	49.3	45.4		0		0.0		0		0.0		-162,447		0.0	-171,222		0.0		0		0.0	
20	47.0	43.5		0		0.0		0		0.0		-210,331		0.0	-224,364		0.0		0		0.0	
21	44.5	41.5		0		0.0		0		0.0		-275,119		0.0	-294,789		0.0		0		0.0	
22	42.2	39.3		0		0.0		0		0.0		-326,247		0.0	-351,176		0.0		0		0.0	
23	40.1	37.6		0		0.0		0		0.0		-369,415		0.0	-399,359		0.0		0		0.0	
24	38.5	36.2		0		0.0		0		0.0		-405,880		0.0	-439,411		0.0		0		0.0	



MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- M O N T H L Y   E N E R G Y   C O N S U M P T I O N -----

Month	ELEC	DEMAND	GAS	WATER	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	(1000 G1)	On Peak (Thrm/hr)
Jan	144,655	361	1,742	1	9
Feb	131,981	361	1,668	1	8
March	142,834	361	409	0	5
April	128,736	361	6	0	1
May	196,187	607	0	0	0
June	222,154	680	0	0	0
July	218,601	667	0	0	0
Aug	226,866	670	0	0	0
Sept	194,978	633	0	0	0
Oct	172,681	540	0	0	0
Nov	131,660	361	253	0	4
Dec	139,831	361	1,160	1	6
Total	2,051,163	680	5,238	3	9

Building Energy Consumption = 62,609 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 179,357 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----														
Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471	729,764
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1
1	MISC LD													
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ1121S													
	ELEC	0	0	0	0	5198	9148	8958	9095	6178	1915	0	0	40,492
	PK	0.0	0.0	0.0	0.0	33.2	40.3	38.8	38.9	32.7	19.1	0.0	0.0	40.3
1	EQ5200													
	ELEC	0	0	0	0	626	1158	1141	1149	760	183	0	0	5,017
	PK	0.0	0.0	0.0	0.0	3.7	4.5	4.4	4.4	3.9	2.7	0.0	0.0	4.5
1	EQ5001													
	ELEC	0	0	0	0	4008	5256	5431	5431	4599	1569	0	0	26,295
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3
1	EQ5313													
	ELEC	0	0	0	0	165	216	223	223	189	65	0	0	1,081
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
2	EQ1120S													
	ELEC	0	0	0	0	3232	5135	5072	5238	3685	1702	0	0	24,064
	PK	0.0	0.0	0.0	0.0	18.8	22.4	22.0	22.1	19.0	12.0	0.0	0.0	22.4

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, BASELINE

2	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	387	646	642	657	452	159	0	0	2,943
	PK	0.0	0.0	0.0	0.0	2.1	2.5	2.5	2.5	2.2	1.7	0.0	0.0	2.5
2	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	1569	1656	1711	1711	1656	658	0	0	8,961
	PK	0.0	0.0	0.0	0.0	2.3	2.3	2.3	2.3	2.3	2.3	0.0	0.0	2.3
2	EQ5313	CONTROLS												
	ELEC	0	0	0	0	205	216	223	223	216	86	0	0	1,169
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS												
	ELEC	0	0	0	0	6061	10762	10633	10667	7086	1861	0	0	47,069
	PK	0.0	0.0	0.0	0.0	35.4	43.0	41.6	41.6	37.0	24.4	0.0	0.0	43.0
3	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	731	1346	1348	1336	875	180	0	0	5,815
	PK	0.0	0.0	0.0	0.0	4.2	5.1	5.0	5.0	4.5	3.2	0.0	0.0	5.1
3	EQ5313	CONTROLS												
	ELEC	0	0	0	0	163	216	223	223	180	61	0	0	1,067
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
4	EQ1122L	AIR-CLD RECIP >55 TONS												
	ELEC	0	0	0	0	19622	33508	31812	32514	22418	11914	0	0	151,788
	PK	0.0	0.0	0.0	0.0	116.1	151.2	142.8	145.3	125.6	74.1	0.0	0.0	151.2
4	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	2204	4087	3936	3996	2647	976	0	0	17,845
	PK	0.0	0.0	0.0	0.0	14.1	18.1	17.1	17.3	15.3	10.2	0.0	0.0	18.1
4	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	15698	15192	15698	15698	15192	15044	0	0	92,524
	PK	0.0	0.0	0.0	0.0	21.1	21.1	21.1	21.1	21.1	21.1	0.0	0.0	21.1
4	EQ5313	CONTROLS												
	ELEC	0	0	0	0	223	216	223	223	216	214	0	0	1,315
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
1	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	16899	15264	16899	16354	16899	16354	16899	16899	16354	16899	16354	16899	198,974
	PK	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7
2	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	1797	1623	1797	1739	1797	1739	1797	1797	1739	1797	1739	1797	21,156
	PK	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
3	EQ4371	FAN COIL SUPPLY FAN												
	ELEC	2658	2401	2658	2572	2658	2572	2658	2658	2572	2658	2572	2658	31,293
	PK	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
4	EQ4371	FAN COIL SUPPLY FAN												



UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 680.1 (kW)  
 Yearly Time of Peak 15 (hr) 6 (mo)

Hour 15 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percent Of Tot (%)
<b>Cooling Equipment</b>				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	52.3	7.69
2	EQ1120S	AIR-CLD RECIP <20 TONS	27.5	4.04
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	48.4	7.11
4	EQ1122L	AIR-CLD RECIP >55 TONS	190.7	28.03
Sub Total			318.8	46.88
Sub Total			0.0	0.00
<b>Air Moving Equipment</b>				
1	SUMMATION OF FAN ELECTRICAL DEMAND		22.7	3.34
2	SUMMATION OF FAN ELECTRICAL DEMAND		2.4	0.36
3	SUMMATION OF FAN ELECTRICAL DEMAND		3.6	0.53
4	SUMMATION OF FAN ELECTRICAL DEMAND		9.3	1.36
5	SUMMATION OF FAN ELECTRICAL DEMAND		9.6	1.41
Sub Total			47.6	6.99
Sub Total			0.0	0.00
<b>Miscellaneous</b>				
Lights			166.1	24.43
Base Utilities			0.0	0.00
Misc Equipment			147.6	21.70
Sub Total			313.7	46.13
Grand Total			680.1	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, BASELINE

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,551.1	523,832.6	3.1	7.3	638,965.9	5.4
Primary Cooling						
Compressor	263,412.8	0.0	0.0	11.9	2,697,353.0	23.0
Tower/Cond Fans	31,621.0	0.0	0.0	1.4	323,800.0	2.8
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	4,632.0	0.0	0.0	0.2	47,431.8	0.4
Auxiliary						
Supply Fans	416,644.7	0.0	0.0	18.9	4,266,451.0	36.4
Circulation Pumps	157,303.7	0.0	0.0	7.1	1,610,793.6	13.7
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	573,948.4	0.0	0.0	26.0	5,877,245.0	50.1
Lighting	729,764.0	0.0	0.0	33.1	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	19.9	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	2,051,163.1	523,832.6	3.1	100.0	21,555,360.0	181.4

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #1

----- M O N T H L Y   E N E R G Y   C O N S U M P T I O N -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	WATER (1000 G1)	GAS DMND On Peak (Thrm/hr)
Jan	143,472	361	1,092	1	7
Feb	129,940	361	1,022	1	6
March	141,114	361	190	0	3
April	128,629	361	0	0	0
May	194,990	592	0	0	0
June	216,860	658	0	0	0
July	213,780	647	0	0	0
Aug	222,424	651	0	0	0
Sept	192,762	615	0	0	0
Oct	175,877	533	0	0	0
Nov	130,522	361	115	0	3
Dec	138,163	361	633	0	4
Total	2,028,532	658	3,052	2	7

Building Energy Consumption = 60,147 (Btu/Sq Ft/Year)      Floor Area = 120,182 (Sq Ft)  
 Source Energy Consumption = 175,513 (Btu/Sq Ft/Year)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #1

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----

Ref Num	Equip Code	Monthly Consumption												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471	729,764
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1
1	MISC LD													
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ1121S													
	ELEC	0	0	0	0	4915	8372	8286	8481	5807	2193	0	0	38,054
	PK	0.0	0.0	0.0	0.0	30.3	36.8	35.9	35.9	29.9	18.3	0.0	0.0	36.8
1	EQ5200													
	ELEC	0	0	0	0	585	1046	1039	1055	706	206	0	0	4,637
	PK	0.0	0.0	0.0	0.0	3.4	4.1	4.1	4.1	3.6	2.6	0.0	0.0	4.1
1	EQ5001													
	ELEC	0	0	0	0	4300	5256	5431	5431	4818	1606	0	0	26,842
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3
1	EQ5313													
	ELEC	0	0	0	0	177	216	223	223	198	66	0	0	1,103
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
2	EQ1120S													
	ELEC	0	0	0	0	3149	4832	4790	4992	3539	1878	0	0	23,180
	PK	0.0	0.0	0.0	0.0	17.5	20.8	20.6	20.7	17.7	11.6	0.0	0.0	20.8



EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #1

2	EQ5200		CONDENSER FANS											
	ELEC	0	0	0	0	370	600	596	616	428	171	0	0	2,781
	PK	0.0	0.0	0.0	0.0	1.9	2.3	2.3	2.3	2.1	1.6	0.0	0.0	2.3
2	EQ5001		CHILLED WATER PUMP C.V.											
	ELEC	0	0	0	0	1640	1656	1711	1711	1656	842	0	0	9,216
	PK	0.0	0.0	0.0	0.0	2.3	2.3	2.3	2.3	2.3	2.3	0.0	0.0	2.3
2	EQ5313		CONTROLS											
	ELEC	0	0	0	0	214	216	223	223	216	110	0	0	1,202
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
3	EQ1171L		AIR-CLD COND COMP 35-60 TONS											
	ELEC	0	0	0	0	5635	9289	9268	9434	6420	2537	0	0	42,582
	PK	0.0	0.0	0.0	0.0	31.1	37.7	36.7	36.7	32.4	22.2	0.0	0.0	37.7
3	EQ5200		CONDENSER FANS											
	ELEC	0	0	0	0	669	1164	1177	1182	785	229	0	0	5,206
	PK	0.0	0.0	0.0	0.0	3.7	4.5	4.4	4.4	3.9	2.9	0.0	0.0	4.5
3	EQ5313		CONTROLS											
	ELEC	0	0	0	0	175	216	223	223	195	76	0	0	1,109
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
4	EQ1122L		AIR-CLD RECIP >55 TONS											
	ELEC	0	0	0	0	19020	31367	29872	30682	21433	12901	0	0	145,276
	PK	0.0	0.0	0.0	0.0	108.8	141.5	133.9	136.9	117.9	70.9	0.0	0.0	141.5
4	EQ5200		CONDENSER FANS											
	ELEC	0	0	0	0	2126	3824	3691	3768	2524	1046	0	0	16,980
	PK	0.0	0.0	0.0	0.0	13.2	17.0	16.0	16.3	14.3	9.8	0.0	0.0	17.0
4	EQ5001		CHILLED WATER PUMP C.V.											
	ELEC	0	0	0	0	15698	15192	15698	15698	15192	15698	0	0	93,178
	PK	0.0	0.0	0.0	0.0	21.1	21.1	21.1	21.1	21.1	21.1	0.0	0.0	21.1
4	EQ5313		CONTROLS											
	ELEC	0	0	0	0	223	216	223	223	216	223	0	0	1,325
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
1	EQ4003		FC CENTRIF. FAN C.V.											
	ELEC	16899	15264	16899	16354	16899	16354	16899	16899	16354	16899	16354	16899	198,974
	PK	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7
2	EQ4003		FC CENTRIF. FAN C.V.											
	ELEC	1797	1623	1797	1739	1797	1739	1797	1797	1739	1797	1739	1797	21,155
	PK	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
3	EQ4371		FAN COIL SUPPLY FAN											
	ELEC	2658	2401	2658	2572	2658	2572	2658	2658	2572	2658	2572	2658	31,294
	PK	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
4	EQ4371		FAN COIL SUPPLY FAN											



UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
BLDG G101, ECO #1

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 657.9 (kW)  
Yearly Time of Peak 15 (hr) 6 (mo)

Hour 15 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percnt Of Tot (%)
Cooling Equipment				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	48.5	7.37
2	EQ1120S	AIR-CLD RECIP <20 TONS	25.8	3.92
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	42.5	6.46
4	EQ1122L	AIR-CLD RECIP >55 TONS	179.9	27.34
Sub Total			296.7	45.09
Sub Total			0.0	0.00
Air Moving Equipment				
1	SUMMATION OF FAN ELECTRICAL DEMAND		22.7	3.45
2	SUMMATION OF FAN ELECTRICAL DEMAND		2.4	0.37
3	SUMMATION OF FAN ELECTRICAL DEMAND		3.6	0.54
4	SUMMATION OF FAN ELECTRICAL DEMAND		9.3	1.41
5	SUMMATION OF FAN ELECTRICAL DEMAND		9.6	1.46
Sub Total			47.6	7.23
Sub Total			0.0	0.00
Miscellaneous				
Lights			166.1	25.25
Base Utilities			0.0	0.00
Misc Equipment			147.6	22.43
Sub Total			313.7	47.68
Grand Total			657.9	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #1

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	6,736.1	305,157.1	2.1	4.5	390,195.8	3.3
Primary Cooling						
Compressor	249,092.3	0.0	0.0	11.8	2,550,711.3	21.8
Tower/Cond Fans	29,602.4	0.0	0.0	1.4	303,129.0	2.6
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	4,738.8	0.0	0.0	0.2	48,525.4	0.4
Auxiliary						
Supply Fans	416,647.3	0.0	0.0	19.7	4,266,477.5	36.4
Circulation Pumps	152,717.8	0.0	0.0	7.2	1,563,833.9	13.3
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	569,365.1	0.0	0.0	26.9	5,830,311.5	49.7
Lighting	729,764.0	0.0	0.0	34.5	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	20.7	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	2,028,532.6	305,157.1	2.1	100.0	21,093,440.0	177.4

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #2

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	WATER (1000 G1)	GAS DMND On Peak (Thrm/hr)
Jan	143,178	361	1,417	1	8
Feb	130,114	361	1,300	1	7
March	141,196	361	267	0	5
April	128,629	361	0	0	0
May	196,672	599	0	0	0
June	220,702	668	0	0	0
July	217,685	657	0	0	0
Aug	225,859	661	0	0	0
Sept	194,945	624	0	0	0
Oct	175,221	536	0	0	0
Nov	130,386	361	146	0	4
Dec	138,721	361	883	1	6
Total	2,043,306	668	4,012	3	8

Building Energy Consumption = 61,365 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 177,613 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #2

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----															
Ref Num	Equip Code	----- Monthly Consumption -----												Total	
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec		
0	LIGHTS														
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471	729,764	
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	
1	MISC LD														
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234	
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	
2	MISC LD														
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
3	MISC LD														
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
4	MISC LD														
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
5	MISC LD														
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
6	MISC LD														
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
1	EQ1121S														
			AIR-CLD RECIP 20-35 TONS												
	ELEC	0	0	0	0	5230	8941	8840	8949	6153	2095	0	0	40,207	
	PK	0.0	0.0	0.0	0.0	31.8	38.7	37.6	37.7	31.4	18.8	0.0	0.0	38.7	
1	EQ5200														
			CONDENSER FANS												
	ELEC	0	0	0	0	625	1128	1123	1128	753	198	0	0	4,955	
	PK	0.0	0.0	0.0	0.0	3.5	4.3	4.3	4.3	3.8	2.7	0.0	0.0	4.3	
1	EQ5001														
			CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	4300	5256	5431	5431	4818	1730	0	0	26,966	
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3	
1	EQ5313														
			CONTROLS												
	ELEC	0	0	0	0	177	216	223	223	198	71	0	0	1,108	
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3	
2	EQ1120S														
			AIR-CLD RECIP <20 TONS												
	ELEC	0	0	0	0	3241	5117	5054	5236	3693	1735	0	0	24,075	
	PK	0.0	0.0	0.0	0.0	18.6	22.2	21.9	22.1	19.0	12.0	0.0	0.0	22.2	

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #2

2	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	387	643	639	656	452	161	0	0	2,938
	PK	0.0	0.0	0.0	0.0	2.1	2.5	2.5	2.5	2.2	1.7	0.0	0.0	2.5
2	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	1598	1656	1711	1711	1656	658	0	0	8,991
	PK	0.0	0.0	0.0	0.0	2.3	2.3	2.3	2.3	2.3	2.3	0.0	0.0	2.3
2	EQ5313	CONTROLS												
	ELEC	0	0	0	0	208	216	223	223	216	86	0	0	1,173
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS												
	ELEC	0	0	0	0	6062	10762	10633	10668	7088	1862	0	0	47,075
	PK	0.0	0.0	0.0	0.0	35.2	43.0	41.6	41.6	37.0	24.4	0.0	0.0	43.0
3	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	731	1346	1348	1336	875	180	0	0	5,816
	PK	0.0	0.0	0.0	0.0	4.2	5.0	5.0	5.0	4.5	3.2	0.0	0.0	5.0
3	EQ5313	CONTROLS												
	ELEC	0	0	0	0	163	216	223	223	180	61	0	0	1,067
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
4	EQ1122L	AIR-CLD RECIP >55 TONS												
	ELEC	0	0	0	0	19728	32444	31136	31769	22214	13292	0	0	150,583
	PK	0.0	0.0	0.0	0.0	109.7	142.4	135.0	137.9	118.7	71.1	0.0	0.0	142.4
4	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	2204	3955	3852	3904	2613	1075	0	0	17,603
	PK	0.0	0.0	0.0	0.0	13.3	17.1	16.1	16.4	14.4	9.9	0.0	0.0	17.1
4	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	15698	15192	15698	15698	15192	15698	0	0	93,178
	PK	0.0	0.0	0.0	0.0	21.1	21.1	21.1	21.1	21.1	21.1	0.0	0.0	21.1
4	EQ5313	CONTROLS												
	ELEC	0	0	0	0	223	216	223	223	216	223	0	0	1,325
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
1	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	16899	15264	16899	16354	16899	16354	16899	16899	16354	16899	16354	16899	198,974
	PK	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7
2	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	1797	1623	1797	1739	1797	1739	1797	1797	1739	1797	1739	1797	21,155
	PK	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
3	EQ4371	FAN COIL SUPPLY FAN												
	ELEC	2658	2401	2658	2572	2658	2572	2658	2658	2572	2658	2572	2658	31,294
	PK	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
4	EQ4371	FAN COIL SUPPLY FAN												





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
BLDG G101, ECO #2

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 668.4 (kW)  
Yearly Time of Peak 15 (hr) 6 (mo)

Hour 15 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percent Of Tot (%)
Cooling Equipment				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	50.6	7.57
2	EQ1120S	AIR-CLD RECIP <20 TONS	27.3	4.09
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	48.3	7.23
4	EQ1122L	AIR-CLD RECIP >55 TONS	180.9	27.06
Sub Total			307.1	45.95
Sub Total			0.0	0.00
Air Moving Equipment				
1		SUMMATION OF FAN ELECTRICAL DEMAND	22.7	3.40
2		SUMMATION OF FAN ELECTRICAL DEMAND	2.4	0.36
3		SUMMATION OF FAN ELECTRICAL DEMAND	3.6	0.53
4		SUMMATION OF FAN ELECTRICAL DEMAND	9.3	1.39
5		SUMMATION OF FAN ELECTRICAL DEMAND	9.6	1.44
Sub Total			47.6	7.12
Sub Total			0.0	0.00
Miscellaneous				
	Lights		166.1	24.86
	Base Utilities		0.0	0.00
	Misc Equipment		147.6	22.08
Sub Total			313.7	46.94
Grand Total			668.4	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #2

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	6,910.0	401,179.3	2.8	5.8	493,052.7	4.2
Primary Cooling						
Compressor	261,940.2	0.0	0.0	12.1	2,682,274.0	22.9
Tower/Cond Fans	31,311.7	0.0	0.0	1.4	320,632.7	2.7
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	4,672.8	0.0	0.0	0.2	47,849.6	0.4
Auxiliary						
Supply Fans	416,647.3	0.0	0.0	19.3	4,266,477.5	36.4
Circulation Pumps	152,826.3	0.0	0.0	7.1	1,564,945.0	13.3
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	569,473.6	0.0	0.0	26.4	5,831,422.5	49.7
Lighting	729,764.0	0.0	0.0	33.8	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	20.3	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	2,043,306.1	401,179.3	2.8	100.0	21,345,796.0	179.6

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #3

----- M O N T H L Y E N E R G Y C O N S U M P T I O N -----

Month	ELEC	DEMAND	GAS	WATER	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)		On Peak (Thrm/hr)
Jan	144,547	361	1,712	1	9
Feb	131,981	361	1,615	1	7
March	142,217	361	367	0	5
April	128,629	361	0	0	0
May	196,364	606	0	0	0
June	221,874	677	0	0	0
July	218,308	665	0	0	0
Aug	226,582	668	0	0	0
Sept	195,025	632	0	0	0
Oct	172,892	540	0	0	0
Nov	131,580	361	240	0	4
Dec	139,831	361	1,117	1	6
Total	2,049,830	677	5,052	3	9

Building Energy Consumption = 62,416 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 179,079 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #3

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total	
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec		
0	LIGHTS														
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471		729,764
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1		166.1
1	MISC LD														
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469		439,234
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6		147.6
2	MISC LD														
	GAS	0	0	0	0	0	0	0	0	0	0	0	0		0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0
3	MISC LD														
	OIL	0	0	0	0	0	0	0	0	0	0	0	0		0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0
4	MISC LD														
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0		0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0
5	MISC LD														
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0		0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0
6	MISC LD														
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0		0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0
1	EQ1121S														
	ELEC	0	0	0	0	5199	9152	8961	9099	6179	1914	0	0		40,504
	PK	0.0	0.0	0.0	0.0	33.1	40.4	38.9	39.0	32.8	19.2	0.0	0.0		40.4
1	EQ5200														
	ELEC	0	0	0	0	626	1158	1141	1149	760	183	0	0		5,018
	PK	0.0	0.0	0.0	0.0	3.7	4.5	4.4	4.4	3.9	2.7	0.0	0.0		4.5
1	EQ5001														
	ELEC	0	0	0	0	4008	5256	5431	5431	4599	1569	0	0		26,295
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0		7.3
1	EQ5313														
	ELEC	0	0	0	0	165	216	223	223	189	65	0	0		1,081
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0		0.3
2	EQ1120S														
	ELEC	0	0	0	0	3235	5140	5076	5242	3688	1702	0	0		24,084
	PK	0.0	0.0	0.0	0.0	18.8	22.4	22.0	22.2	19.0	12.0	0.0	0.0		22.4

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #3

2	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	387	647	642	657	452	159	0	0	2,943
	PK	0.0	0.0	0.0	0.0	2.1	2.5	2.5	2.5	2.2	1.7	0.0	0.0	2.5
2	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	1569	1656	1711	1711	1656	658	0	0	8,961
	PK	0.0	0.0	0.0	0.0	2.3	2.3	2.3	2.3	2.3	2.3	0.0	0.0	2.3
2	EQ5313	CONTROLS												
	ELEC	0	0	0	0	205	216	223	223	216	86	0	0	1,169
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS												
	ELEC	0	0	0	0	6062	10762	10633	10668	7088	1862	0	0	47,075
	PK	0.0	0.0	0.0	0.0	35.2	43.0	41.6	41.6	37.0	24.4	0.0	0.0	43.0
3	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	731	1346	1348	1336	875	180	0	0	5,816
	PK	0.0	0.0	0.0	0.0	4.2	5.0	5.0	5.0	4.5	3.2	0.0	0.0	5.0
3	EQ5313	CONTROLS												
	ELEC	0	0	0	0	163	216	223	223	180	61	0	0	1,067
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
4	EQ1122L	AIR-CLD RECIP >55 TONS												
	ELEC	0	0	0	0	19778	33249	31542	32253	22455	12109	0	0	151,385
	PK	0.0	0.0	0.0	0.0	113.7	148.8	140.5	143.0	124.1	73.9	0.0	0.0	148.8
4	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	2221	4056	3903	3964	2651	992	0	0	17,787
	PK	0.0	0.0	0.0	0.0	13.8	17.7	16.8	17.1	15.1	10.2	0.0	0.0	17.7
4	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	15698	15192	15698	15698	15192	15044	0	0	92,524
	PK	0.0	0.0	0.0	0.0	21.1	21.1	21.1	21.1	21.1	21.1	0.0	0.0	21.1
4	EQ5313	CONTROLS												
	ELEC	0	0	0	0	223	216	223	223	216	214	0	0	1,315
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
1	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	16899	15264	16899	16354	16899	16354	16899	16899	16354	16899	16354	16899	198,974
	PK	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7
2	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	1797	1623	1797	1739	1797	1739	1797	1797	1739	1797	1739	1797	21,155
	PK	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
3	EQ4371	FAN COIL SUPPLY FAN												
	ELEC	2658	2401	2658	2572	2658	2572	2658	2658	2572	2658	2572	2658	31,294
	PK	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
4	EQ4371	FAN COIL SUPPLY FAN												



UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
 BLDG G101, ECO #3

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 677.4 (kW)  
 Yearly Time of Peak 15 (hr) 6 (mo)  
 Hour 15 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percnt Of Tot (%)
Cooling Equipment				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	52.4	7.73
2	EQ1120S	AIR-CLD RECIP <20 TONS	27.5	4.06
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	48.3	7.13
4	EQ1122L	AIR-CLD RECIP >55 TONS	187.9	27.74
Sub Total			316.1	46.67
Sub Total			0.0	0.00
Air Moving Equipment				
1	SUMMATION OF FAN ELECTRICAL DEMAND		22.7	3.35
2	SUMMATION OF FAN ELECTRICAL DEMAND		2.4	0.36
3	SUMMATION OF FAN ELECTRICAL DEMAND		3.6	0.53
4	SUMMATION OF FAN ELECTRICAL DEMAND		9.3	1.37
5	SUMMATION OF FAN ELECTRICAL DEMAND		9.6	1.42
Sub Total			47.6	7.02
Sub Total			0.0	0.00
Miscellaneous				
Lights			166.1	24.53
Base Utilities			0.0	0.00
Misc Equipment			147.6	21.78
Sub Total			313.7	46.31
Grand Total			677.4	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #3

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,355.6	505,157.9	3.1	7.1	617,306.6	5.3
Primary Cooling						
Compressor	263,047.7	0.0	0.0	12.0	2,693,614.5	23.0
Tower/Cond Fans	31,563.6	0.0	0.0	1.4	323,212.2	2.8
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	4,632.0	0.0	0.0	0.2	47,431.8	0.4
Auxiliary						
Supply Fans	416,647.3	0.0	0.0	19.0	4,266,477.5	36.4
Circulation Pumps	156,586.3	0.0	0.0	7.1	1,603,447.4	13.7
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	573,233.6	0.0	0.0	26.1	5,869,925.0	50.1
Lighting	729,764.0	0.0	0.0	33.2	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	20.0	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	2,049,830.4	505,157.9	3.1	100.0	21,522,058.0	181.1



MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #6

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	WATER	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	(1000 G1)	On Peak (Thrm/hr)
Jan	145,103	361	2,322	1	10
Feb	132,515	361	2,247	1	9
March	143,330	361	649	1	6
April	128,791	365	10	0	2
May	195,258	607	0	0	0
June	222,159	680	0	0	0
July	218,605	667	0	0	0
Aug	226,869	671	0	0	0
Sept	194,981	633	0	0	0
Oct	170,947	540	0	0	0
Nov	132,043	361	440	1	5
Dec	140,306	361	1,655	1	7
Total	2,050,904	680	7,324	5	10

Building Energy Consumption = 64,337 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 181,161 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #6

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----														
Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471	729,764
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1
1	MISC LD													
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ1121S													
			AIR-CLD RECIP 20-35 TONS											
	ELEC	0	0	0	0	4981	9153	8962	9099	6179	1519	0	0	39,893
	PK	0.0	0.0	0.0	0.0	29.6	40.4	38.9	39.0	32.8	19.2	0.0	0.0	40.4
1	EQ5200													
			CONDENSER FANS											
	ELEC	0	0	0	0	609	1158	1141	1149	760	153	0	0	4,971
	PK	0.0	0.0	0.0	0.0	3.7	4.5	4.4	4.4	3.9	2.7	0.0	0.0	4.5
1	EQ5001													
			CHILLED WATER PUMP C.V.											
	ELEC	0	0	0	0	3847	5256	5431	5431	4599	1285	0	0	25,849
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3
1	EQ5313													
			CONTROLS											
	ELEC	0	0	0	0	158	216	223	223	189	53	0	0	1,062
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
2	EQ1120S													
			AIR-CLD RECIP <20 TONS											
	ELEC	0	0	0	0	3047	5140	5076	5242	3688	1095	0	0	23,288
	PK	0.0	0.0	0.0	0.0	18.8	22.4	22.0	22.2	19.0	12.0	0.0	0.0	22.4





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
 BLDG G101, ECO #6

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 680.1 (kW)  
 Yearly Time of Peak 15 (hr) 6 (mo)

Hour 15 Month 6

Eq. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percent Of Tot (%)
Cooling Equipment				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	52.4	7.70
2	EQ1120S	AIR-CLD RECIP <20 TONS	27.5	4.05
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	48.3	7.10
4	EQ1122L	AIR-CLD RECIP >55 TONS	190.6	28.03
Sub Total			318.8	46.88
Sub Total			0.0	0.00
Air Moving Equipment				
1		SUMMATION OF FAN ELECTRICAL DEMAND	22.7	3.34
2		SUMMATION OF FAN ELECTRICAL DEMAND	2.4	0.36
3		SUMMATION OF FAN ELECTRICAL DEMAND	3.6	0.53
4		SUMMATION OF FAN ELECTRICAL DEMAND	9.3	1.36
5		SUMMATION OF FAN ELECTRICAL DEMAND	9.6	1.41
Sub Total			47.6	6.99
Sub Total			0.0	0.00
Miscellaneous				
	Lights		166.1	24.43
	Base Utilities		0.0	0.00
	Misc Equipment		147.6	21.70
Sub Total			313.7	46.13
Grand Total			680.1	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #6

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	9,332.1	732,370.8	5.3	9.9	866,477.4	7.4
Primary Cooling						
Compressor	261,833.2	0.0	0.0	11.6	2,681,178.3	22.9
Tower/Cond Fans	31,497.1	0.0	0.0	1.4	322,531.4	2.8
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	4,547.7	0.0	0.0	0.2	46,568.5	0.4
Auxiliary						
Supply Fans	416,647.3	0.0	0.0	18.4	4,266,477.5	36.4
Circulation Pumps	158,049.8	0.0	0.0	7.0	1,618,433.7	13.8
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	574,697.1	0.0	0.0	25.4	5,884,911.5	50.2
Lighting	729,764.0	0.0	0.0	32.2	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	19.4	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	2,050,905.1	732,370.8	5.3	100.0	21,772,232.0	183.2

^R

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #7

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	WATER	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	(1000 Gl)	On Peak (Thrm/hr)
Jan	131,091	392	1,021	1	13
Feb	118,424	392	905	1	14
March	134,239	388	246	0	11
April	123,129	361	18	0	4
May	188,817	613	0	0	0
June	211,427	679	0	0	0
July	206,155	667	0	0	0
Aug	216,005	670	0	0	0
Sept	186,013	633	0	0	0
Oct	167,093	540	0	0	0
Nov	123,582	388	119	0	8
Dec	127,646	392	595	1	13
Total	1,933,622	679	2,904	3	14

Building Energy Consumption = 57,328 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 167,297 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #7

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471	729,764
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1
1	MISC LD													
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ1121S													
	ELEC	0	0	0	0	5199	9152	8961	9099	6179	1914	0	0	40,504
	PK	0.0	0.0	0.0	0.0	33.1	40.4	38.9	39.0	32.8	19.2	0.0	0.0	40.4
1	EQ5200													
	ELEC	0	0	0	0	626	1158	1141	1149	760	183	0	0	5,018
	PK	0.0	0.0	0.0	0.0	3.7	4.5	4.4	4.4	3.9	2.7	0.0	0.0	4.5
1	EQ5001													
	ELEC	0	0	0	0	4008	5256	5431	5431	4599	1569	0	0	26,295
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3
1	EQ5313													
	ELEC	0	0	0	0	165	216	223	223	189	65	0	0	1,081
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
2	EQ1120S													
	ELEC	0	0	0	0	3235	5140	5076	5242	3688	1702	0	0	24,084
	PK	0.0	0.0	0.0	0.0	18.8	22.4	22.0	22.2	19.0	12.0	0.0	0.0	22.4



EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #7

2	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	387	647	642	657	452	159	0	0	2,943
	PK	0.0	0.0	0.0	0.0	2.1	2.5	2.5	2.5	2.2	1.7	0.0	0.0	2.5
2	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	1569	1656	1711	1711	1656	658	0	0	8,961
	PK	0.0	0.0	0.0	0.0	2.3	2.3	2.3	2.3	2.3	2.3	0.0	0.0	2.3
2	EQ5313	CONTROLS												
	ELEC	0	0	0	0	205	216	223	223	216	86	0	0	1,169
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS												
	ELEC	0	0	0	0	5299	8166	7390	7967	5414	2056	0	0	36,291
	PK	0.0	0.0	0.0	0.0	39.7	43.0	41.6	41.6	37.0	24.4	0.0	0.0	43.0
3	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	568	989	908	954	610	190	0	0	4,219
	PK	0.0	0.0	0.0	0.0	5.0	5.0	5.0	5.0	4.5	3.2	0.0	0.0	5.0
3	EQ5313	CONTROLS												
	ELEC	0	0	0	0	79	79	72	83	72	52	0	0	437
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
4	EQ1122L	AIR-CLD RECIP >55 TONS												
	ELEC	0	0	0	0	18952	31453	29399	30591	21259	11751	0	0	143,406
	PK	0.0	0.0	0.0	0.0	110.0	150.8	142.5	145.0	125.2	73.9	0.0	0.0	150.8
4	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	2117	3821	3617	3739	2489	963	0	0	16,746
	PK	0.0	0.0	0.0	0.0	13.6	17.5	17.1	17.3	15.2	10.2	0.0	0.0	17.5
4	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	15698	15192	15698	15698	15192	15044	0	0	92,524
	PK	0.0	0.0	0.0	0.0	21.1	21.1	21.1	21.1	21.1	21.1	0.0	0.0	21.1
4	EQ5313	CONTROLS												
	ELEC	0	0	0	0	223	216	223	223	216	214	0	0	1,315
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
1	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	16899	15264	16899	16354	16899	16354	16899	16899	16354	16899	16354	16899	198,974
	PK	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7
2	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	609	551	667	580	638	638	580	667	580	638	580	580	7,303
	PK	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
3	EQ4371	FAN COIL SUPPLY FAN												
	ELEC	2658	2401	2658	2572	2658	2572	2658	2658	2572	2658	2572	2658	31,294
	PK	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
4	EQ4371	FAN COIL SUPPLY FAN												



UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
 BLDG G101, ECO #7

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 679.2 (kW)  
 Yearly Time of Peak 15 (hr) 6 (mo)  
 Hour 15 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percent Of Tot (%)
<b>Cooling Equipment</b>				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	52.4	7.71
2	EQ1120S	AIR-CLD RECIP <20 TONS	27.5	4.05
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	48.3	7.11
4	EQ1122L	AIR-CLD RECIP >55 TONS	189.7	27.93
Sub Total			317.9	46.81
Sub Total			0.0	0.00
<b>Air Moving Equipment</b>				
1	SUMMATION OF FAN ELECTRICAL DEMAND		22.7	3.34
2	SUMMATION OF FAN ELECTRICAL DEMAND		2.4	0.36
3	SUMMATION OF FAN ELECTRICAL DEMAND		3.6	0.53
4	SUMMATION OF FAN ELECTRICAL DEMAND		9.3	1.36
5	SUMMATION OF FAN ELECTRICAL DEMAND		9.6	1.41
Sub Total			47.6	7.00
Sub Total			0.0	0.00
<b>Miscellaneous</b>				
Lights			166.1	24.46
Base Utilities			0.0	0.00
Misc Equipment			147.6	21.73
Sub Total			313.7	46.19
Grand Total			679.2	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #7

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	2,537.7	290,369.6	3.1	4.3	331,638.3	2.8
Primary Cooling						
Compressor	244,284.7	0.0	0.0	12.1	2,501,481.0	21.3
Tower/Cond Fans	28,926.5	0.0	0.0	1.4	296,208.3	2.5
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	4,002.0	0.0	0.0	0.2	40,980.6	0.3
Auxiliary						
Supply Fans	349,637.5	0.0	0.0	17.3	3,580,296.2	30.5
Circulation Pumps	135,235.4	0.0	0.0	6.7	1,384,813.6	11.8
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	484,872.9	0.0	0.0	24.0	4,965,109.5	42.3
Lighting	729,764.0	0.0	0.0	36.2	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	21.8	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	1,933,621.6	290,369.6	3.1	100.0	20,105,984.0	169.0

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #12

----- M O N T H L Y E N E R G Y C O N S U M P T I O N -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	WATER (1000 Gl)	GAS DMND On Peak (Thrm/hr)
Jan	130,442	392	822	1	12
Feb	118,332	392	743	1	13
March	133,540	388	130	0	8
April	123,021	361	0	0	0
May	175,694	530	0	0	0
June	194,215	625	0	0	0
July	189,689	610	0	0	0
Aug	197,836	613	0	0	0
Sept	171,863	586	0	0	0
Oct	159,907	489	0	0	0
Nov	123,352	361	73	0	8
Dec	127,415	392	448	1	11
Total	1,845,306	625	2,215	3	13

Building Energy Consumption = 54,247 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 159,169 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #12

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----														
Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471	729,764
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1
1	MISC LD													
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ1121S													
	ELEC	0	0	0	0	4514	8304	8069	8198	5376	1561	0	0	36,022
	PK	0.0	0.0	0.0	0.0	31.7	38.8	37.3	37.4	31.3	18.5	0.0	0.0	38.8
1	EQ5200													
	ELEC	0	0	0	0	550	1052	1029	1038	668	154	0	0	4,491
	PK	0.0	0.0	0.0	0.0	3.5	4.3	4.2	4.3	3.7	2.6	0.0	0.0	4.3
1	EQ5001													
	ELEC	0	0	0	0	3876	5256	5431	5431	4088	1212	0	0	25,295
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3
1	EQ5313													
	ELEC	0	0	0	0	159	216	223	223	168	50	0	0	1,039
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
2	EQ1120S													
	ELEC	0	0	0	0	2916	4767	4683	4847	3328	1555	0	0	22,096
	PK	0.0	0.0	0.0	0.0	18.1	21.7	21.3	21.4	18.4	11.8	0.0	0.0	21.7

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #12

2	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	352	600	592	608	411	147	0	0	2,709
	PK	0.0	0.0	0.0	0.0	2.0	2.4	2.4	2.4	2.2	1.6	0.0	0.0	2.4
2	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	1313	1656	1711	1711	1587	596	0	0	8,574
	PK	0.0	0.0	0.0	0.0	2.3	2.3	2.3	2.3	2.3	2.3	0.0	0.0	2.3
2	EQ5313	CONTROLS												
	ELEC	0	0	0	0	171	216	223	223	207	78	0	0	1,118
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS												
	ELEC	0	0	0	0	1031	3280	2548	2697	1315	0	0	0	10,871
	PK	0.0	0.0	0.0	0.0	14.9	29.4	27.2	27.2	24.8	15.8	0.0	0.0	29.4
3	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	136	407	324	340	169	0	0	0	1,375
	PK	0.0	0.0	0.0	0.0	1.9	3.4	3.3	3.3	3.0	2.1	0.0	0.0	3.4
3	EQ5313	CONTROLS												
	ELEC	0	0	0	0	27	69	56	63	34	0	0	0	248
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
4	EQ1122L	AIR-CLD RECIP >55 TONS												
	ELEC	0	0	0	0	12857	22253	20909	20999	14440	8784	0	0	100,241
	PK	0.0	0.0	0.0	0.0	77.9	118.8	108.8	111.0	97.9	39.5	0.0	0.0	118.8
4	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	1382	2661	2531	2525	1642	689	0	0	11,430
	PK	0.0	0.0	0.0	0.0	9.7	13.6	13.0	13.2	11.9	5.3	0.0	0.0	13.6
4	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	15698	15192	15698	15698	15192	14390	0	0	91,869
	PK	0.0	0.0	0.0	0.0	21.1	21.1	21.1	21.1	21.1	21.1	0.0	0.0	21.1
4	EQ5313	CONTROLS												
	ELEC	0	0	0	0	223	216	223	223	216	205	0	0	1,306
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
1	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	16899	15264	16899	16354	16899	16354	16899	16899	16354	16899	16354	16899	198,974
	PK	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7
2	EQ4003	FC CENTRIF. FAN C.V.												
	ELEC	609	551	667	580	638	638	580	667	580	638	580	580	7,303
	PK	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
3	EQ4371	FAN COIL SUPPLY FAN												
	ELEC	2658	2401	2658	2572	2658	2572	2658	2658	2572	2658	2572	2658	31,294
	PK	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
4	EQ4371	FAN COIL SUPPLY FAN												





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
 BLDG G101, ECO #12

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 625.0 (kW)  
 Yearly Time of Peak 15 (hr) 6 (mo)

Hour 15 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percnt Of Tot (%)
----------------------	------------------------	-----------------------	---------------------------	-------------------------

Cooling Equipment

1	EQ1121S	AIR-CLD RECIP 20-35 TONS	50.6	8.10
2	EQ1120S	AIR-CLD RECIP <20 TONS	26.7	4.28
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	32.6	5.22
4	EQ1122L	AIR-CLD RECIP >55 TONS	153.8	24.60
Sub Total			263.8	42.20
Sub Total			0.0	0.00

Air Moving Equipment

1	SUMMATION OF FAN ELECTRICAL DEMAND		22.7	3.63
2	SUMMATION OF FAN ELECTRICAL DEMAND		2.4	0.39
3	SUMMATION OF FAN ELECTRICAL DEMAND		3.6	0.57
4	SUMMATION OF FAN ELECTRICAL DEMAND		9.3	1.48
5	SUMMATION OF FAN ELECTRICAL DEMAND		9.6	1.53
Sub Total			47.6	7.61
Sub Total			0.0	0.00

Miscellaneous

Lights	166.1	26.58
Base Utilities	0.0	0.00
Misc Equipment	147.6	23.61
Sub Total	313.7	50.19
Grand Total	625.0	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #12

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	2,047.1	221,515.1	2.7	3.5	254,136.7	2.2
Primary Cooling						
Compressor	169,230.7	0.0	0.0	8.9	1,732,926.5	14.8
Tower/Cond Fans	20,005.4	0.0	0.0	1.0	204,855.4	1.7
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	3,712.2	0.0	0.0	0.2	38,013.0	0.3
Auxiliary						
Supply Fans	349,637.5	0.0	0.0	18.3	3,580,296.2	30.5
Circulation Pumps	131,675.5	0.0	0.0	6.9	1,348,360.3	11.5
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	481,313.0	0.0	0.0	25.2	4,928,656.5	42.0
Lighting	729,764.0	0.0	0.0	38.2	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	23.0	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	1,845,306.4	221,515.1	2.7	100.0	19,129,154.0	160.7

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #13

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	WATER	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	(1000 G1)	On Peak (Thrm/hr)
Jan	149,276	361	2,067	1	10
Feb	136,359	361	2,007	1	9
March	147,508	361	521	1	6
April	132,896	361	10	0	2
May	200,914	561	0	0	0
June	225,132	630	0	0	0
July	221,997	623	0	0	0
Aug	230,656	621	0	0	0
Sept	199,198	594	0	0	0
Oct	175,731	512	0	0	0
Nov	135,975	361	319	0	5
Dec	144,562	361	1,413	1	7
Total	2,100,206	630	6,336	5	10

Building Energy Consumption = 64,915 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 184,497 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #13

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----

Ref Num	Equip Code	Monthly Consumption												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	61547	55625	63698	59214	62622	61366	60471	63698	59214	62622	59214	60471	729,764
	PK	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1	166.1
1	MISC LD													
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ1121S													
			AIR-CLD RECIP 20-35 TONS											
	ELEC	0	0	0	0	5199	9152	8961	9099	6179	1914	0	0	40,504
	PK	0.0	0.0	0.0	0.0	33.1	40.4	38.9	39.0	32.8	19.2	0.0	0.0	40.4
1	EQ5200													
			CONDENSER FANS											
	ELEC	0	0	0	0	626	1158	1141	1149	760	183	0	0	5,018
	PK	0.0	0.0	0.0	0.0	3.7	4.5	4.4	4.4	3.9	2.7	0.0	0.0	4.5
1	EQ5001													
			CHILLED WATER PUMP C.V.											
	ELEC	0	0	0	0	4008	5256	5431	5431	4599	1569	0	0	26,295
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3
1	EQ5313													
			CONTROLS											
	ELEC	0	0	0	0	165	216	223	223	189	65	0	0	1,081
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
2	EQ1120S													
			AIR-CLD RECIP <20 TONS											
	ELEC	0	0	0	0	3235	5140	5076	5242	3688	1702	0	0	24,084
	PK	0.0	0.0	0.0	0.0	18.8	22.4	22.0	22.2	19.0	12.0	0.0	0.0	22.4

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #13

2	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	387	647	642	657	452	159	0	0	2,943
	PK	0.0	0.0	0.0	0.0	2.1	2.5	2.5	2.5	2.2	1.7	0.0	0.0	2.5
2	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	1569	1656	1711	1711	1656	658	0	0	8,961
	PK	0.0	0.0	0.0	0.0	2.3	2.3	2.3	2.3	2.3	2.3	0.0	0.0	2.3
2	EQ5313	CONTROLS												
	ELEC	0	0	0	0	205	216	223	223	216	86	0	0	1,169
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS												
	ELEC	0	0	0	0	6062	10762	10633	10668	7088	1862	0	0	47,075
	PK	0.0	0.0	0.0	0.0	35.2	43.0	41.6	41.6	37.0	24.4	0.0	0.0	43.0
3	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	731	1346	1348	1336	875	180	0	0	5,816
	PK	0.0	0.0	0.0	0.0	4.2	5.0	5.0	5.0	4.5	3.2	0.0	0.0	5.0
3	EQ5313	CONTROLS												
	ELEC	0	0	0	0	163	216	223	223	180	61	0	0	1,067
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
4	EQ1122L	AIR-CLD RECIP >55 TONS												
	ELEC	0	0	0	0	13280	22661	21930	22064	14941	7059	0	0	101,935
	PK	0.0	0.0	0.0	0.0	115.8	122.5	116.8	117.0	104.2	61.8	0.0	0.0	122.5
4	EQ5200	CONDENSER FANS												
	ELEC	0	0	0	0	1374	2728	2649	2628	1650	524	0	0	11,552
	PK	0.0	0.0	0.0	0.0	14.0	14.5	14.4	14.4	13.1	7.6	0.0	0.0	14.5
4	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	13082	12660	13082	13082	12660	11774	0	0	76,340
	PK	0.0	0.0	0.0	0.0	21.1	21.1	21.1	21.1	21.1	21.1	0.0	0.0	21.1
4	EQ5313	CONTROLS												
	ELEC	0	0	0	0	186	180	186	186	180	167	0	0	1,085
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3
5	EQ1750	AIR-CLD CTV ICE-CHILL H2O												
	ELEC	4039	3724	4123	3990	14237	17436	16896	17936	14951	11362	3911	4123	116,729
	PK	59.6	59.6	59.6	59.6	140.2	145.5	144.8	144.4	140.2	140.2	140.2	59.6	145.5
5	EQ5205	CONDENSER FANS												
	ELEC	10	9	10	10	14	14	14	15	14	12	10	10	142
	PK	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
5	EQ5001	CHILLED WATER PUMP C.V.												
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	EQ5309	CONTROLS												

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #13

ELEC	124	112	124	120	297	292	299	302	291	300	120	124	2,505
PK	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1 EQ4003	FC CENTRIF. FAN C.V.												
ELEC	16899	15264	16899	16354	16899	16354	16899	16899	16354	16899	16354	16899	198,974
PK	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7	22.7
2 EQ4003	FC CENTRIF. FAN C.V.												
ELEC	1797	1623	1797	1739	1797	1739	1797	1797	1739	1797	1739	1797	21,155
PK	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
3 EQ4371	FAN COIL SUPPLY FAN												
ELEC	2658	2401	2658	2572	2658	2572	2658	2658	2572	2658	2572	2658	31,294
PK	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
4 EQ4371	FAN COIL SUPPLY FAN												
ELEC	6895	6228	6895	6672	6895	6672	6895	6895	6672	6895	6672	6895	81,182
PK	9.3	9.3	9.3	9.3	9.3	9.3	9.3	9.3	9.3	9.3	9.3	9.3	9.3
5 EQ4003	FC CENTRIF. FAN C.V.												
ELEC	7138	6447	7138	6908	7138	6908	7138	7138	6908	7138	6908	7138	84,042
PK	9.6	9.6	9.6	9.6	9.6	9.6	9.6	9.6	9.6	9.6	9.6	9.6	9.6
1 EQ2001	GAS FIRE TUBE HOT WATER												
GAS	890	940	266	6	0	0	0	0	0	0	184	689	2,974
PK	5.7	4.0	2.8	1.4	0.0	0.0	0.0	0.0	0.0	0.0	2.6	3.3	5.7
1 EQ5020	HEAT WATER CIRC. PUMP C.V.												
ELEC	7744	7976	3186	84	0	0	0	0	0	0	2194	5971	27,156
PK	21.1	21.1	21.1	21.1	0.0	0.0	0.0	0.0	0.0	0.0	21.1	21.1	21.1
1 EQ5240	BOILER FORCED DRAFT FAN												
ELEC	1927	1985	793	21	0	0	0	0	0	0	546	1486	6,757
PK	5.3	5.3	5.3	5.3	0.0	0.0	0.0	0.0	0.0	0.0	5.3	5.3	5.3
1 EQ5307	BOILER CONTROLS												
ELEC	183	189	76	2	0	0	0	0	0	0	52	142	644
PK	0.5	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.5	0.5
2 EQ2002	GAS FIRE TUBE STEAM												
GAS	1177	1067	254	4	0	0	0	0	0	0	134	724	3,362
PK	5.4	5.5	3.8	0.4	0.0	0.0	0.0	0.0	0.0	0.0	2.8	4.5	5.5
2 EQ5020	HEAT WATER CIRC. PUMP C.V.												
ELEC	1035	1021	483	28	0	0	0	0	0	0	345	929	3,841
PK	2.3	2.3	2.3	2.3	0.0	0.0	0.0	0.0	0.0	0.0	2.3	2.3	2.3
2 EQ5240	BOILER FORCED DRAFT FAN												
ELEC	265	262	124	7	0	0	0	0	0	0	88	238	985
PK	0.6	0.6	0.6	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.6	0.6	0.6
2 EQ5307	BOILER CONTROLS												
ELEC	225	222	105	6	0	0	0	0	0	0	75	202	835
PK	0.5	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.5	0.5



Trane Air Conditioning Economics  
 By: Trane Customer Direct Service Network

UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
 BLDG G101, ECO #13

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 630.4 (kW)  
 Yearly Time of Peak 12 (hr) 6 (mo)

Hour 12 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percent Of Tot (%)
<b>Cooling Equipment</b>				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	44.3	7.03
2	EQ1120S	AIR-CLD RECIP <20 TONS	24.7	3.92
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	41.6	6.60
4	EQ1122L	AIR-CLD RECIP >55 TONS	158.4	25.13
Sub Total			269.1	42.69
Sub Total			0.0	0.00
<b>Air Moving Equipment</b>				
1		SUMMATION OF FAN ELECTRICAL DEMAND	22.7	3.60
2		SUMMATION OF FAN ELECTRICAL DEMAND	2.4	0.38
3		SUMMATION OF FAN ELECTRICAL DEMAND	3.6	0.57
4		SUMMATION OF FAN ELECTRICAL DEMAND	9.3	1.47
5		SUMMATION OF FAN ELECTRICAL DEMAND	9.6	1.52
Sub Total			47.6	7.55
Sub Total			0.0	0.00
<b>Miscellaneous</b>				
	Lights		166.1	26.36
	Base Utilities		0.0	0.00
	Misc Equipment		147.6	23.41
Sub Total			313.7	49.77
Grand Total			630.4	100.00



COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

----- BUILDING COOLING DEMANDS AND THERMAL STORAGE -----

January

Hour	Design		Design			Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	
	1	42.7	35.4	0.0	0.0	
2	41.8	34.7	0.0	14.9	24.5	751
3	41.1	34.4	0.0	0.0	0.0	743
4	40.6	34.0	0.0	14.9	24.5	751
5	40.4	34.0	0.0	0.0	0.0	743
6	40.8	34.4	0.0	14.9	24.5	751
7	41.6	35.0	0.0	0.0	0.0	743
8	43.2	36.5	0.0	14.9	24.5	751
9	45.5	38.5	0.0	0.0	0.0	751
10	48.1	40.4	0.0	0.0	0.0	751
11	51.0	42.2	0.0	0.0	0.0	751
12	53.8	43.8	0.0	0.0	0.0	751
13	55.9	45.0	0.0	0.0	0.0	743
14	57.3	45.5	0.0	0.0	0.0	736
15	57.8	45.6	0.0	0.0	0.0	729
16	57.3	44.8	0.0	0.0	0.0	721
17	56.1	43.9	0.0	0.0	0.0	721
18	54.2	42.7	0.0	0.0	0.0	721
19	51.9	41.6	0.0	0.0	0.0	721
20	49.6	40.2	0.0	0.0	0.0	721
21	47.7	39.1	0.0	0.0	0.0	721
22	46.0	37.9	0.0	0.0	0.0	721
23	44.6	36.8	0.0	0.0	0.0	721
24	43.6	36.1	0.0	0.0	0.0	721

Hour	Typical		Weekday				Saturday			
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	1	33.4	30.4	0.0	36.8	54.7	751	0.0	43.9	59.6
2	32.1	29.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	31.7	29.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	31.9	29.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	32.6	30.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	33.6	31.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	35.0	32.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	36.6	34.4	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	38.5	36.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	40.4	37.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	42.3	38.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	44.2	39.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	45.8	40.5	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	47.2	41.1	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	48.2	41.6	0.0	0.0	0.0	721	0.0	0.0	0.0	721

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----					----- Saturday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
16	48.9	41.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	49.1	41.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	48.7	41.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	47.4	41.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	45.5	40.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	43.1	38.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	40.4	36.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	37.7	34.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	35.3	32.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
Hour	----- Sunday -----					----- Monday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
1	33.4	30.4	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	32.1	29.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	31.7	29.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	31.9	29.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	32.6	30.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	33.6	31.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	35.0	32.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	36.6	34.4	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	38.5	36.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	40.4	37.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	42.3	38.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	44.2	39.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	45.8	40.5	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	47.2	41.1	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	48.2	41.6	0.0	0.0	0.0	721	0.0	0.0	0.0	721
16	48.9	41.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	49.1	41.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	48.7	41.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	47.4	41.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	45.5	40.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	43.1	38.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	40.4	36.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	37.7	34.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	35.3	32.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

February

Hour	Design		Design			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity
			(Ton)	(Ton)	(kW)	(Ton-Hr)
1	42.8	35.6	0.0	43.9	59.6	751
2	42.0	34.9	0.0	0.0	0.0	743
3	41.4	34.5	0.0	14.9	24.5	751
4	41.0	34.2	0.0	0.0	0.0	743
5	40.8	34.0	0.0	14.9	24.5	751
6	41.1	34.4	0.0	0.0	0.0	743
7	41.9	35.0	0.0	14.9	24.5	751
8	43.3	36.5	0.0	0.0	0.0	743
9	45.3	38.2	0.0	0.0	0.0	743
10	47.7	39.5	0.0	0.0	0.0	743
11	50.3	41.3	0.0	0.0	0.0	743
12	52.8	42.5	0.0	0.0	0.0	743
13	54.7	43.4	0.0	0.0	0.0	736
14	55.9	44.0	0.0	0.0	0.0	729
15	56.4	44.2	0.0	0.0	0.0	721
16	55.9	43.6	0.0	0.0	0.0	714
17	54.8	42.6	0.0	0.0	0.0	714
18	53.1	41.4	0.0	0.0	0.0	714
19	51.1	40.4	0.0	0.0	0.0	714
20	49.1	39.4	0.0	0.0	0.0	714
21	47.4	38.5	0.0	0.0	0.0	714
22	45.8	37.6	0.0	0.0	0.0	714
23	44.5	36.9	0.0	0.0	0.0	714
24	43.6	36.1	0.0	0.0	0.0	714

Hour	Typical		Weekday				Saturday			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
			(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	37.5	34.5	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	36.0	33.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	34.7	31.8	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	33.6	30.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	32.8	30.1	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	32.2	29.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	32.1	29.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	32.5	30.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	33.9	31.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	36.0	33.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	38.5	34.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	41.3	36.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	43.8	38.1	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	45.9	39.5	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	47.2	40.4	0.0	0.0	0.0	721	0.0	0.0	0.0	721

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----						----- Saturday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
16	47.7	40.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	47.5	40.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	47.0	39.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	46.2	39.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	45.1	39.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	43.8	39.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	42.3	38.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	40.7	37.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	39.1	35.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
Hour	----- Sunday -----						----- Monday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
1	37.5	34.5	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	36.0	33.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	34.7	31.8	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	33.6	30.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	32.8	30.1	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	32.2	29.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	32.1	29.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	32.5	30.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	33.9	31.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	36.0	33.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	38.5	34.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	41.3	36.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	43.8	38.1	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	45.9	39.5	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	47.2	40.4	0.0	0.0	0.0	721	0.0	0.0	0.0	721
16	47.7	40.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	47.5	40.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	47.0	39.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	46.2	39.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	45.1	39.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	43.8	39.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	42.3	38.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	40.7	37.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	39.1	35.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

March

Hour	Design		Design			Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	
	1	51.8	42.9	0.0	43.9	
2	50.8	42.1	0.0	0.0	0.0	743
3	50.0	41.8	0.0	14.9	24.5	751
4	49.3	41.1	0.0	0.0	0.0	743
5	49.1	41.1	0.0	14.9	24.5	751
6	49.5	41.6	0.0	0.0	0.0	743
7	50.6	42.7	0.0	14.9	24.5	751
8	52.5	44.3	0.0	0.0	0.0	743
9	55.2	46.4	0.0	0.0	0.0	743
10	58.3	48.5	0.0	0.0	0.0	743
11	61.8	50.3	0.0	0.0	0.0	743
12	65.1	51.9	0.0	0.0	0.0	743
13	67.6	53.4	0.0	0.0	0.0	736
14	69.3	53.9	0.0	0.0	0.0	729
15	69.9	53.8	0.0	0.0	0.0	721
16	69.3	53.1	0.0	0.0	0.0	714
17	67.8	51.8	0.0	0.0	0.0	714
18	65.6	50.2	0.0	0.0	0.0	714
19	62.9	48.9	0.0	0.0	0.0	714
20	60.2	47.7	0.0	0.0	0.0	714
21	57.9	46.5	0.0	0.0	0.0	714
22	55.8	45.3	0.0	0.0	0.0	714
23	54.1	44.4	0.0	0.0	0.0	714
24	52.9	43.7	0.0	0.0	0.0	714

Hour	Typical		Weekday				Saturday			
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	1	45.4	41.6	0.0	43.9	59.6	751	0.0	43.9	59.6
2	43.3	39.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	41.6	38.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	40.6	37.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	40.2	37.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	40.6	37.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	41.6	39.0	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	43.3	40.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	45.4	42.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	47.9	44.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	50.6	45.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	53.3	46.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	55.8	48.5	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	58.0	49.6	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	59.6	50.3	0.0	0.0	0.0	721	0.0	0.0	0.0	721

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----					----- Saturday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
16	60.7	50.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	61.0	50.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	60.7	50.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	59.6	50.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	58.0	50.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	55.8	49.4	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	53.3	47.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	50.6	45.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	47.9	43.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
Hour	----- Sunday -----					----- Monday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
1	45.4	41.6	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	43.3	39.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	41.6	38.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	40.6	37.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	40.2	37.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	40.6	37.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	41.6	39.0	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	43.3	40.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	45.4	42.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	47.9	44.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	50.6	45.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	53.3	46.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	55.8	48.5	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	58.0	49.6	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	59.6	50.3	0.0	0.0	0.0	721	0.0	0.0	0.0	721
16	60.7	50.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	61.0	50.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	60.7	50.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	59.6	50.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	58.0	50.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	55.8	49.4	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	53.3	47.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	50.6	45.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	47.9	43.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

April

Hour	Design		----- Design -----			
	OADB	QAWB	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	62.6	52.5	0.0	43.9	59.6	751
2	61.6	52.1	0.0	0.0	0.0	743
3	60.9	51.6	0.0	14.9	24.5	751
4	60.3	51.2	0.0	0.0	0.0	743
5	60.1	51.3	0.0	14.9	24.5	751
6	60.5	51.9	0.0	0.0	0.0	743
7	61.4	53.0	0.0	14.9	24.5	751
8	63.2	54.5	0.0	0.0	0.0	743
9	65.7	55.8	0.0	0.0	0.0	743
10	68.6	57.1	0.0	0.0	0.0	743
11	71.9	58.6	0.0	0.0	0.0	743
12	75.0	60.3	0.0	0.0	0.0	743
13	77.4	61.5	0.0	0.0	0.0	736
14	78.9	62.2	0.0	0.0	0.0	729
15	79.5	62.5	0.0	0.0	0.0	721
16	78.9	61.8	0.0	0.0	0.0	714
17	77.5	60.3	0.0	0.0	0.0	714
18	75.4	59.1	0.0	0.0	0.0	714
19	72.9	57.3	0.0	0.0	0.0	714
20	70.4	56.5	0.0	0.0	0.0	714
21	68.2	55.7	0.0	0.0	0.0	714
22	66.3	55.0	0.0	0.0	0.0	714
23	64.7	54.0	0.0	0.0	0.0	714
24	63.6	53.2	0.0	0.0	0.0	714

Hour	Typical		----- Weekday -----				----- Saturday -----			
	OADB	QAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	57.7	53.9	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	55.9	52.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	54.2	51.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	52.9	50.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	51.9	49.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	51.2	49.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	51.0	49.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	51.6	49.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	53.3	50.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	55.9	51.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	59.0	53.4	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	62.4	55.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	65.5	57.7	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	68.1	59.4	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	69.8	60.7	0.0	0.0	0.0	721	0.0	0.0	0.0	721

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----						----- Saturday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
16	70.4	60.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	70.2	60.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	69.5	60.1	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	68.5	59.4	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	67.2	59.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	65.5	59.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	63.7	58.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	61.7	57.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	59.7	55.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714

Hour	----- Sunday -----						----- Monday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
1	57.7	53.9	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	55.9	52.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	54.2	51.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	52.9	50.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	51.9	49.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	51.2	49.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	51.0	49.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	51.6	49.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	53.3	50.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	55.9	51.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	59.0	53.4	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	62.4	55.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	65.5	57.7	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	68.1	59.4	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	69.8	60.7	0.0	0.0	0.0	721	0.0	0.0	0.0	721
16	70.4	60.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	70.2	60.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	69.5	60.1	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	68.5	59.4	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	67.2	59.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	65.5	59.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	63.7	58.8	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	61.7	57.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	59.7	55.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714



COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

May

Hour	Design		Design			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	70.8	59.3	0.0	43.9	59.6	751
2	69.8	58.5	0.0	0.0	0.0	743
3	69.0	58.2	0.0	14.9	24.5	751
4	68.4	58.1	0.0	0.0	0.0	743
5	68.2	58.0	0.0	14.9	24.5	751
6	68.6	58.5	0.0	0.0	0.0	743
7	69.6	59.5	0.0	14.9	24.5	751
8	71.3	60.6	0.0	0.0	0.0	743
9	73.9	61.5	0.0	0.0	0.0	743
10	76.8	62.7	0.0	0.0	0.0	743
11	80.1	63.9	0.0	0.0	0.0	743
12	83.2	65.4	0.0	0.0	0.0	743
13	85.6	66.5	81.3	0.0	0.0	655
14	87.1	67.1	105.2	0.0	0.0	543
15	87.7	67.2	112.1	0.0	0.0	425
16	87.1	66.5	111.9	0.0	0.0	309
17	85.8	65.1	0.0	0.0	0.0	309
18	83.6	63.9	0.0	0.0	0.0	309
19	81.1	62.4	0.0	0.0	0.0	309
20	78.6	61.6	0.0	0.0	0.0	309
21	76.4	61.8	0.0	0.0	0.0	309
22	74.5	60.9	0.0	0.0	0.0	309
23	72.9	60.3	0.0	0.0	0.0	309
24	71.7	59.9	0.0	0.0	0.0	309

Hour	Typical		Weekday				Saturday			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	66.6	62.3	0.0	125.0	140.2	431	0.0	125.0	140.2	564
2	64.5	60.4	0.0	125.0	140.2	552	0.0	125.0	140.2	684
3	62.7	59.1	0.0	125.0	140.2	671	0.0	74.3	84.4	751
4	61.2	58.1	0.0	86.3	96.0	751	0.0	0.0	0.0	743
5	60.0	57.1	0.0	0.0	0.0	743	0.0	14.9	24.5	751
6	59.3	56.6	0.0	14.9	24.5	751	0.0	0.0	0.0	743
7	59.0	56.5	0.0	0.0	0.0	743	0.0	14.9	24.5	751
8	59.5	56.6	0.0	14.9	24.5	751	0.0	0.0	0.0	743
9	60.9	56.6	0.0	0.0	0.0	751	0.0	0.0	0.0	743
10	63.0	57.2	0.0	0.0	0.0	751	0.0	0.0	0.0	743
11	65.7	58.1	0.0	0.0	0.0	751	0.0	0.0	0.0	743
12	68.7	59.8	0.0	0.0	0.0	751	0.0	0.0	0.0	743
13	71.7	61.6	50.6	0.0	0.0	693	19.8	0.0	0.0	716
14	74.5	63.4	71.1	0.0	0.0	615	24.1	0.0	0.0	685
15	76.6	64.8	79.7	0.0	0.0	529	32.1	0.0	0.0	646

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	Typical		Weekday				Saturday			
	OADB	OAWB	Cooling Load	Chiller Load	Chiller Demand	Storage Capacity	Cooling Load	Chiller Load	Chiller Demand	Storage Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)
16	78.0	65.6	80.0	0.0	0.0	444	38.1	0.0	0.0	601
17	78.5	65.6	0.0	0.0	0.0	444	0.0	0.0	0.0	601
18	78.2	65.8	0.0	0.0	0.0	444	0.0	0.0	0.0	601
19	77.5	65.6	0.0	0.0	0.0	444	0.0	0.0	0.0	601
20	76.3	66.1	0.0	0.0	0.0	444	0.0	0.0	0.0	601
21	74.8	67.2	0.0	0.0	0.0	444	0.0	0.0	0.0	601
22	73.0	66.4	0.0	0.0	0.0	444	0.0	0.0	0.0	601
23	70.9	65.4	0.0	0.0	0.0	444	0.0	0.0	0.0	601
24	68.7	64.0	0.0	0.0	0.0	444	0.0	0.0	0.0	601

Hour	Typical		Sunday				Monday			
	OADB	OAWB	Cooling Load	Chiller Load	Chiller Demand	Storage Capacity	Cooling Load	Chiller Load	Chiller Demand	Storage Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	66.6	62.3	0.0	125.0	140.2	720	0.0	125.0	140.2	728
2	64.5	60.4	0.0	37.8	55.4	751	0.0	30.7	50.3	751
3	62.7	59.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
4	61.2	58.1	0.0	14.9	24.5	751	0.0	14.9	24.5	751
5	60.0	57.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
6	59.3	56.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
7	59.0	56.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
8	59.5	56.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
9	60.9	56.6	0.0	0.0	0.0	751	0.0	0.0	0.0	751
10	63.0	57.2	0.0	0.0	0.0	751	0.0	0.0	0.0	751
11	65.7	58.1	0.0	0.0	0.0	751	0.0	0.0	0.0	751
12	68.7	59.8	0.0	0.0	0.0	751	0.0	0.0	0.0	751
13	71.7	61.6	19.8	0.0	0.0	724	50.6	0.0	0.0	693
14	74.5	63.4	24.1	0.0	0.0	692	71.1	0.0	0.0	615
15	76.6	64.8	32.1	0.0	0.0	653	79.8	0.0	0.0	529
16	78.0	65.6	38.1	0.0	0.0	609	80.0	0.0	0.0	444
17	78.5	65.6	0.0	0.0	0.0	609	0.0	0.0	0.0	444
18	78.2	65.8	0.0	0.0	0.0	609	0.0	0.0	0.0	444
19	77.5	65.6	0.0	0.0	0.0	609	0.0	0.0	0.0	444
20	76.3	66.1	0.0	0.0	0.0	609	0.0	0.0	0.0	444
21	74.8	67.2	0.0	0.0	0.0	609	0.0	0.0	0.0	444
22	73.0	66.4	0.0	0.0	0.0	609	0.0	0.0	0.0	444
23	70.9	65.4	0.0	0.0	0.0	609	0.0	0.0	0.0	444
24	68.7	64.0	0.0	0.0	0.0	609	0.0	0.0	0.0	444

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

June

Hour	Design		Design			Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	
	1	79.5	66.2	0.0	125.0	
2	78.5	65.3	0.0	125.0	144.3	683
3	77.7	65.1	0.0	74.3	86.3	751
4	77.2	64.8	0.0	0.0	0.0	743
5	77.0	65.1	0.0	14.9	24.9	751
6	77.4	65.6	0.0	0.0	0.0	743
7	78.3	66.5	0.0	14.9	25.1	751
8	80.0	67.7	0.0	0.0	0.0	743
9	82.5	68.3	0.0	0.0	0.0	743
10	85.4	69.5	0.0	0.0	0.0	743
11	88.7	70.8	0.0	0.0	0.0	743
12	91.8	72.2	0.0	0.0	0.0	743
13	94.1	72.6	107.2	0.0	0.0	629
14	95.6	72.9	135.8	0.0	0.0	487
15	96.2	72.9	139.5	0.0	0.0	342
16	95.6	72.0	138.6	0.0	0.0	200
17	94.3	70.8	0.0	0.0	0.0	200
18	92.1	69.7	0.0	0.0	0.0	200
19	89.6	68.3	0.0	0.0	0.0	200
20	87.1	67.7	0.0	0.0	0.0	200
21	85.0	67.5	0.0	0.0	0.0	200
22	83.1	67.3	0.0	0.0	0.0	200
23	81.6	66.8	0.0	0.0	0.0	200
24	80.4	66.3	0.0	0.0	0.0	200

Hour	Typical		Weekday				Saturday			
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	1	73.0	67.9	0.0	125.0	140.2	323	0.0	125.0	140.2
2	71.2	66.1	0.0	125.0	140.2	445	0.0	125.0	140.2	542
3	69.7	65.2	0.0	125.0	140.2	566	0.0	125.0	140.2	661
4	68.5	64.3	0.0	125.0	140.2	685	0.0	96.5	106.6	751
5	67.8	64.2	0.0	72.7	83.0	751	0.0	0.0	0.0	743
6	67.6	64.2	0.0	0.0	0.0	743	0.0	14.9	24.5	751
7	68.1	64.8	0.0	14.9	24.5	751	0.0	0.0	0.0	743
8	69.4	65.7	0.0	0.0	0.0	743	0.0	14.9	24.5	751
9	71.6	66.2	0.0	0.0	0.0	743	0.0	0.0	0.0	751
10	74.2	67.2	0.0	0.0	0.0	743	0.0	0.0	0.0	751
11	77.2	68.5	0.0	0.0	0.0	743	0.0	0.0	0.0	751
12	80.2	70.0	0.0	0.0	0.0	743	0.0	0.0	0.0	751
13	82.8	70.8	81.8	0.0	0.0	654	51.9	0.0	0.0	692
14	85.0	71.6	110.5	0.0	0.0	537	61.0	0.0	0.0	624
15	86.3	72.3	114.9	0.0	0.0	417	66.8	0.0	0.0	551

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	Typical		----- Weekday -----				----- Saturday -----			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
		(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)	
16	86.8	72.1	114.0	0.0	0.0	299	64.4	0.0	0.0	481
17	86.6	71.7	0.0	0.0	0.0	299	0.0	0.0	0.0	481
18	85.8	71.5	0.0	0.0	0.0	299	0.0	0.0	0.0	481
19	84.7	71.2	0.0	0.0	0.0	299	0.0	0.0	0.0	481
20	83.2	71.5	0.0	0.0	0.0	299	0.0	0.0	0.0	481
21	81.4	71.7	0.0	0.0	0.0	299	0.0	0.0	0.0	481
22	79.3	71.4	0.0	0.0	0.0	299	0.0	0.0	0.0	481
23	77.2	70.5	0.0	0.0	0.0	299	0.0	0.0	0.0	481
24	75.1	69.1	0.0	0.0	0.0	299	0.0	0.0	0.0	481

Hour	Typical		----- Sunday -----				----- Monday -----			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
		(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)	
1	73.0	67.9	0.0	125.0	140.2	601	0.0	125.0	140.2	594
2	71.2	66.1	0.0	125.0	140.2	720	0.0	125.0	140.2	713
3	69.7	65.2	0.0	38.3	55.7	751	0.0	45.3	60.6	751
4	68.5	64.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	67.8	64.2	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	67.6	64.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	68.1	64.8	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	69.4	65.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	71.6	66.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	74.2	67.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	77.2	68.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	80.2	70.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	82.8	70.8	51.9	0.0	0.0	684	81.8	0.0	0.0	654
14	85.0	71.6	61.0	0.0	0.0	616	110.5	0.0	0.0	537
15	86.3	72.3	66.8	0.0	0.0	543	114.9	0.0	0.0	417
16	86.8	72.1	64.4	0.0	0.0	473	114.0	0.0	0.0	299
17	86.6	71.7	0.0	0.0	0.0	473	0.0	0.0	0.0	299
18	85.8	71.5	0.0	0.0	0.0	473	0.0	0.0	0.0	299
19	84.7	71.2	0.0	0.0	0.0	473	0.0	0.0	0.0	299
20	83.2	71.5	0.0	0.0	0.0	473	0.0	0.0	0.0	299
21	81.4	71.7	0.0	0.0	0.0	473	0.0	0.0	0.0	299
22	79.3	71.4	0.0	0.0	0.0	473	0.0	0.0	0.0	299
23	77.2	70.5	0.0	0.0	0.0	473	0.0	0.0	0.0	299
24	75.1	69.1	0.0	0.0	0.0	473	0.0	0.0	0.0	299

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

--- BUILDING COOLING DEMANDS AND THERMAL STORAGE ---

July

Hour	Design		Design			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	78.9	67.7	0.0	125.0	144.8	421
2	78.2	67.2	0.0	125.0	143.9	542
3	77.6	66.8	0.0	125.0	143.3	661
4	77.1	66.6	0.0	96.5	108.5	751
5	77.0	66.6	0.0	0.0	0.0	743
6	77.3	66.9	0.0	14.9	24.9	751
7	78.0	67.6	0.0	0.0	0.0	743
8	79.4	68.8	0.0	14.9	25.4	751
9	81.3	69.6	0.0	0.0	0.0	751
10	83.6	70.7	0.0	0.0	0.0	751
11	86.1	72.2	0.0	0.0	0.0	751
12	88.5	73.3	0.0	0.0	0.0	751
13	90.3	74.0	108.1	0.0	0.0	635
14	91.5	74.3	135.0	0.0	0.0	494
15	92.0	74.0	139.0	0.0	0.0	350
16	91.5	73.2	138.3	0.0	0.0	208
17	90.5	72.1	0.0	0.0	0.0	208
18	88.8	70.8	0.0	0.0	0.0	208
19	86.9	70.4	0.0	0.0	0.0	208
20	84.9	70.2	0.0	0.0	0.0	208
21	83.3	70.0	0.0	0.0	0.0	208
22	81.8	69.4	0.0	0.0	0.0	208
23	80.6	68.7	0.0	0.0	0.0	208
24	79.7	68.4	0.0	0.0	0.0	208

Hour	Typical		Weekday				Saturday			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	72.0	69.3	0.0	125.0	140.2	331	0.0	125.0	140.2	432
2	70.5	68.0	0.0	125.0	140.2	453	0.0	125.0	140.2	553
3	69.4	67.1	0.0	125.0	140.2	573	0.0	125.0	140.2	673
4	68.5	66.4	0.0	125.0	140.2	693	0.0	85.1	94.8	751
5	67.9	66.0	0.0	65.3	76.4	751	0.0	0.0	0.0	743
6	67.7	65.9	0.0	0.0	0.0	743	0.0	14.9	24.5	751
7	68.1	66.3	0.0	14.9	24.5	751	0.0	0.0	0.0	743
8	69.1	67.3	0.0	0.0	0.0	743	0.0	14.9	24.5	751
9	70.8	68.0	0.0	0.0	0.0	743	0.0	0.0	0.0	751
10	72.9	69.1	0.0	0.0	0.0	743	0.0	0.0	0.0	751
11	75.2	70.5	0.0	0.0	0.0	743	0.0	0.0	0.0	751
12	77.5	71.7	0.0	0.0	0.0	743	0.0	0.0	0.0	751
13	79.6	72.7	77.9	0.0	0.0	658	49.4	0.0	0.0	694
14	81.3	73.5	108.2	0.0	0.0	543	57.4	0.0	0.0	630
15	82.3	73.7	112.0	0.0	0.0	426	63.8	0.0	0.0	560

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----						----- Saturday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	
	OADB (F)	OAWB (F)									
16	82.7	73.5	111.0	0.0	0.0	311	61.2	0.0	0.0	493	
17	82.5	73.1	0.0	0.0	0.0	311	0.0	0.0	0.0	493	
18	82.0	72.6	0.0	0.0	0.0	311	0.0	0.0	0.0	493	
19	81.1	73.2	0.0	0.0	0.0	311	0.0	0.0	0.0	493	
20	79.9	73.8	0.0	0.0	0.0	311	0.0	0.0	0.0	493	
21	78.5	73.9	0.0	0.0	0.0	311	0.0	0.0	0.0	493	
22	76.9	73.1	0.0	0.0	0.0	311	0.0	0.0	0.0	493	
23	75.2	71.9	0.0	0.0	0.0	311	0.0	0.0	0.0	493	
24	73.5	70.8	0.0	0.0	0.0	311	0.0	0.0	0.0	493	

Hour	----- Sunday -----						----- Monday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	
	OADB (F)	OAWB (F)									
1	72.0	69.3	0.0	125.0	140.2	613	0.0	125.0	140.2	606	
2	70.5	68.0	0.0	125.0	140.2	732	0.0	125.0	140.2	725	
3	69.4	67.1	0.0	26.6	43.5	751	0.0	33.6	52.6	751	
4	68.5	66.4	0.0	0.0	0.0	743	0.0	0.0	0.0	743	
5	67.9	66.0	0.0	14.9	24.5	751	0.0	14.9	24.5	751	
6	67.7	65.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743	
7	68.1	66.3	0.0	14.9	24.5	751	0.0	14.9	24.5	751	
8	69.1	67.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743	
9	70.8	68.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743	
10	72.9	69.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743	
11	75.2	70.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743	
12	77.5	71.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743	
13	79.6	72.7	49.4	0.0	0.0	687	77.9	0.0	0.0	658	
14	81.3	73.5	57.4	0.0	0.0	622	108.2	0.0	0.0	543	
15	82.3	73.7	63.8	0.0	0.0	552	112.0	0.0	0.0	426	
16	82.7	73.5	61.2	0.0	0.0	486	111.0	0.0	0.0	311	
17	82.5	73.1	0.0	0.0	0.0	486	0.0	0.0	0.0	311	
18	82.0	72.6	0.0	0.0	0.0	486	0.0	0.0	0.0	311	
19	81.1	73.2	0.0	0.0	0.0	486	0.0	0.0	0.0	311	
20	79.9	73.8	0.0	0.0	0.0	486	0.0	0.0	0.0	311	
21	78.5	73.9	0.0	0.0	0.0	486	0.0	0.0	0.0	311	
22	76.9	73.1	0.0	0.0	0.0	486	0.0	0.0	0.0	311	
23	75.2	71.9	0.0	0.0	0.0	486	0.0	0.0	0.0	311	
24	73.5	70.8	0.0	0.0	0.0	486	0.0	0.0	0.0	311	

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

August

Hour	Design		Design			Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	
	1	78.6	67.6	0.0	125.0	
2	77.9	67.2	0.0	125.0	143.6	553
3	77.2	66.9	0.0	125.0	142.8	673
4	76.8	66.6	0.0	85.1	96.2	751
5	76.6	66.7	0.0	0.0	0.0	743
6	76.9	67.1	0.0	14.9	24.8	751
7	77.7	67.8	0.0	0.0	0.0	743
8	79.1	69.0	0.0	14.9	25.3	751
9	81.2	70.0	0.0	0.0	0.0	751
10	83.5	70.9	0.0	0.0	0.0	751
11	86.2	71.8	0.0	0.0	0.0	751
12	88.7	72.7	0.0	0.0	0.0	751
13	90.6	73.2	105.8	0.0	0.0	638
14	91.8	73.8	136.3	0.0	0.0	495
15	92.3	74.0	141.1	0.0	0.0	349
16	91.8	73.3	139.5	0.0	0.0	206
17	90.7	72.4	0.0	0.0	0.0	206
18	89.0	71.4	0.0	0.0	0.0	206
19	87.0	70.1	0.0	0.0	0.0	206
20	84.9	69.8	0.0	0.0	0.0	206
21	83.2	70.3	0.0	0.0	0.0	206
22	81.6	69.3	0.0	0.0	0.0	206
23	80.4	68.5	0.0	0.0	0.0	206
24	79.4	67.9	0.0	0.0	0.0	206

Hour	Typical		Weekday				Saturday			
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	1	72.7	70.2	0.0	125.0	140.2	329	0.0	125.0	140.2
2	71.2	69.0	0.0	125.0	140.2	451	0.0	125.0	140.2	548
3	69.9	68.0	0.0	125.0	140.2	571	0.0	125.0	140.2	667
4	68.8	67.1	0.0	125.0	140.2	690	0.0	90.5	100.3	751
5	68.0	66.6	0.0	67.5	78.3	751	0.0	0.0	0.0	743
6	67.5	66.2	0.0	0.0	0.0	743	0.0	14.9	24.5	751
7	67.3	66.1	0.0	14.9	24.5	751	0.0	0.0	0.0	743
8	67.8	66.5	0.0	0.0	0.0	743	0.0	14.9	24.5	751
9	69.1	67.0	0.0	0.0	0.0	743	0.0	0.0	0.0	751
10	71.2	67.8	0.0	0.0	0.0	743	0.0	0.0	0.0	751
11	73.8	68.7	0.0	0.0	0.0	743	0.0	0.0	0.0	751
12	76.5	70.0	0.0	0.0	0.0	743	0.0	0.0	0.0	751
13	79.1	71.2	80.4	0.0	0.0	656	51.1	0.0	0.0	692
14	81.1	72.6	110.7	0.0	0.0	538	59.3	0.0	0.0	626
15	82.5	73.6	115.9	0.0	0.0	417	67.0	0.0	0.0	553

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----						----- Saturday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
16	83.0	73.7	108.0	0.0	0.0	305	57.5	0.0	0.0	490
17	82.8	73.5	0.0	0.0	0.0	305	0.0	0.0	0.0	490
18	82.3	73.5	0.0	0.0	0.0	305	0.0	0.0	0.0	490
19	81.5	73.1	0.0	0.0	0.0	305	0.0	0.0	0.0	490
20	80.4	73.7	0.0	0.0	0.0	305	0.0	0.0	0.0	490
21	79.1	74.9	0.0	0.0	0.0	305	0.0	0.0	0.0	490
22	77.6	73.9	0.0	0.0	0.0	305	0.0	0.0	0.0	490
23	76.0	72.7	0.0	0.0	0.0	305	0.0	0.0	0.0	490
24	74.3	71.3	0.0	0.0	0.0	305	0.0	0.0	0.0	490

Hour	----- Sunday -----						----- Monday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
1	72.7	70.2	0.0	125.0	140.2	610	0.0	125.0	140.2	603
2	71.2	69.0	0.0	125.0	140.2	729	0.0	125.0	140.2	722
3	69.9	68.0	0.0	29.5	48.2	751	0.0	36.5	54.5	751
4	68.8	67.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	68.0	66.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	67.5	66.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	67.3	66.1	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	67.8	66.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	69.1	67.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	71.2	67.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	73.8	68.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	76.5	70.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	79.1	71.2	51.1	0.0	0.0	685	80.4	0.0	0.0	656
14	81.1	72.6	59.3	0.0	0.0	619	110.7	0.0	0.0	538
15	82.5	73.6	67.0	0.0	0.0	546	115.9	0.0	0.0	417
16	83.0	73.7	57.5	0.0	0.0	483	108.0	0.0	0.0	305
17	82.8	73.5	0.0	0.0	0.0	483	0.0	0.0	0.0	305
18	82.3	73.5	0.0	0.0	0.0	483	0.0	0.0	0.0	305
19	81.5	73.1	0.0	0.0	0.0	483	0.0	0.0	0.0	305
20	80.4	73.7	0.0	0.0	0.0	483	0.0	0.0	0.0	305
21	79.1	74.9	0.0	0.0	0.0	483	0.0	0.0	0.0	305
22	77.6	73.9	0.0	0.0	0.0	483	0.0	0.0	0.0	305
23	76.0	72.7	0.0	0.0	0.0	483	0.0	0.0	0.0	305
24	74.3	71.3	0.0	0.0	0.0	483	0.0	0.0	0.0	305



COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

September

Hour	----- Design -----					
	Design		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)				
1	74.6	63.1	0.0	125.0	140.2	427
2	73.7	62.4	0.0	125.0	140.2	548
3	73.0	61.9	0.0	125.0	140.2	667
4	72.4	61.7	0.0	90.5	100.3	751
5	72.3	61.8	0.0	0.0	0.0	743
6	72.6	62.5	0.0	14.9	24.5	751
7	73.5	63.2	0.0	0.0	0.0	743
8	75.1	64.8	0.0	14.9	24.5	751
9	77.4	65.9	0.0	0.0	0.0	751
10	80.0	66.8	0.0	0.0	0.0	751
11	83.0	67.8	0.0	0.0	0.0	751
12	85.8	68.5	0.0	0.0	0.0	751
13	87.9	69.7	96.9	0.0	0.0	647
14	89.3	70.2	121.5	0.0	0.0	519
15	89.9	70.1	124.9	0.0	0.0	389
16	89.3	69.1	122.7	0.0	0.0	262
17	88.1	67.8	0.0	0.0	0.0	262
18	86.2	66.8	0.0	0.0	0.0	262
19	83.9	66.5	0.0	0.0	0.0	262
20	81.6	66.3	0.0	0.0	0.0	262
21	79.7	66.1	0.0	0.0	0.0	262
22	77.9	65.0	0.0	0.0	0.0	262
23	76.5	64.4	0.0	0.0	0.0	262
24	75.4	63.6	0.0	0.0	0.0	262

Hour	----- Weekday -----						----- Saturday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
1	69.8	66.1	0.0	125.0	140.2	384	0.0	125.0	140.2	500
2	68.0	64.5	0.0	125.0	140.2	505	0.0	125.0	140.2	620
3	66.3	63.0	0.0	125.0	140.2	625	0.0	125.0	140.2	739
4	64.9	61.9	0.0	125.0	140.2	744	0.0	19.4	31.8	751
5	63.9	61.3	0.0	14.3	23.4	751	0.0	0.0	0.0	743
6	63.2	61.0	0.0	0.0	0.0	743	0.0	14.9	24.5	751
7	63.0	60.8	0.0	14.9	24.5	751	0.0	0.0	0.0	743
8	63.4	61.4	0.0	0.0	0.0	743	0.0	14.9	24.5	751
9	64.7	61.8	0.0	0.0	0.0	743	0.0	0.0	0.0	751
10	66.6	62.1	0.0	0.0	0.0	743	0.0	0.0	0.0	751
11	69.1	62.9	0.0	0.0	0.0	743	0.0	0.0	0.0	751
12	71.8	63.7	0.0	0.0	0.0	743	0.0	0.0	0.0	751
13	74.5	65.5	64.1	0.0	0.0	672	30.2	0.0	0.0	713
14	77.0	67.1	89.3	0.0	0.0	576	42.8	0.0	0.0	663
15	78.9	68.2	91.7	0.0	0.0	478	44.2	0.0	0.0	612

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----					----- Saturday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	QAWB (F)								
16	80.2	68.6	94.7	0.0	0.0	379	44.8	0.0	0.0	562
17	80.6	68.5	0.0	0.0	0.0	379	0.0	0.0	0.0	562
18	80.4	68.9	0.0	0.0	0.0	379	0.0	0.0	0.0	562
19	79.7	70.0	0.0	0.0	0.0	379	0.0	0.0	0.0	562
20	78.7	71.2	0.0	0.0	0.0	379	0.0	0.0	0.0	562
21	77.3	71.6	0.0	0.0	0.0	379	0.0	0.0	0.0	562
22	75.6	70.5	0.0	0.0	0.0	379	0.0	0.0	0.0	562
23	73.7	69.4	0.0	0.0	0.0	379	0.0	0.0	0.0	562
24	71.8	67.7	0.0	0.0	0.0	379	0.0	0.0	0.0	562

Hour	----- Sunday -----					----- Monday -----				
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	QAWB (F)								
1	69.8	66.1	0.0	125.0	140.2	681	0.0	125.0	140.2	681
2	68.0	64.5	0.0	76.9	86.8	751	0.0	76.9	86.8	751
3	66.3	63.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
4	64.9	61.9	0.0	14.9	24.5	751	0.0	14.9	24.5	751
5	63.9	61.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
6	63.2	61.0	0.0	14.9	24.5	751	0.0	14.9	24.5	751
7	63.0	60.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
8	63.4	61.4	0.0	14.9	24.5	751	0.0	14.9	24.5	751
9	64.7	61.8	0.0	0.0	0.0	751	0.0	0.0	0.0	751
10	66.6	62.1	0.0	0.0	0.0	751	0.0	0.0	0.0	751
11	69.1	62.9	0.0	0.0	0.0	751	0.0	0.0	0.0	751
12	71.8	63.7	0.0	0.0	0.0	751	0.0	0.0	0.0	751
13	74.5	65.5	30.2	0.0	0.0	713	64.1	0.0	0.0	679
14	77.0	67.1	42.8	0.0	0.0	663	89.4	0.0	0.0	583
15	78.9	68.2	44.2	0.0	0.0	612	91.7	0.0	0.0	486
16	80.2	68.6	44.8	0.0	0.0	562	94.7	0.0	0.0	386
17	80.6	68.5	0.0	0.0	0.0	562	0.0	0.0	0.0	386
18	80.4	68.9	0.0	0.0	0.0	562	0.0	0.0	0.0	386
19	79.7	70.0	0.0	0.0	0.0	562	0.0	0.0	0.0	386
20	78.7	71.2	0.0	0.0	0.0	562	0.0	0.0	0.0	386
21	77.3	71.6	0.0	0.0	0.0	562	0.0	0.0	0.0	386
22	75.6	70.5	0.0	0.0	0.0	562	0.0	0.0	0.0	386
23	73.7	69.4	0.0	0.0	0.0	562	0.0	0.0	0.0	386
24	71.8	67.7	0.0	0.0	0.0	562	0.0	0.0	0.0	386

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

October

Hour	----- Design -----					
	Design		Cooling	Chiller	Chiller	Storage
	OADB (F)	OAWB (F)	Load (Ton)	Load (Ton)	Demand (kW)	Capacity (Ton-Hr)
1	59.5	50.0	0.0	125.0	140.2	507
2	58.5	49.3	1.7	125.0	140.2	625
3	57.7	48.8	0.9	125.0	140.2	743
4	57.1	48.5	0.0	15.1	24.6	751
5	56.9	48.3	0.0	0.0	0.0	743
6	57.3	48.7	0.0	14.9	24.5	751
7	58.3	49.7	0.0	0.0	0.0	743
8	60.1	51.3	0.0	14.9	24.5	751
9	62.7	52.9	0.0	0.0	0.0	751
10	65.7	54.4	0.0	0.0	0.0	751
11	69.1	55.5	0.0	0.0	0.0	751
12	72.3	56.7	0.0	0.0	0.0	751
13	74.7	57.8	67.3	0.0	0.0	676
14	76.3	58.6	83.3	0.0	0.0	586
15	76.9	58.7	86.8	0.0	0.0	493
16	76.3	58.0	84.2	0.0	0.0	404
17	74.9	57.0	0.0	0.0	0.0	404
18	72.7	56.0	0.0	0.0	0.0	404
19	70.1	55.5	0.0	0.0	0.0	404
20	67.5	54.7	0.0	0.0	0.0	404
21	65.3	53.6	0.0	0.0	0.0	404
22	63.3	52.4	0.0	0.0	0.0	404
23	61.7	51.5	0.0	0.0	0.0	404
24	60.5	50.7	0.0	0.0	0.0	404

Hour	----- Weekday -----						----- Saturday -----			
	Typical		Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	OADB (F)	OAWB (F)	Load (Ton)	Load (Ton)	Demand (kW)	Capacity (Ton-Hr)	Load (Ton)	Load (Ton)	Demand (kW)	Capacity (Ton-Hr)
1	54.8	51.3	0.0	125.0	140.2	525	0.0	125.0	140.2	616
2	52.9	49.6	0.0	125.0	140.2	645	0.0	125.0	140.2	734
3	51.2	48.2	0.0	112.4	124.6	751	0.0	23.9	39.2	751
4	49.8	47.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	48.8	46.2	2.0	16.9	27.7	751	1.9	16.9	27.6	751
6	48.2	45.7	1.5	0.0	0.0	742	1.5	0.0	0.0	742
7	47.9	45.6	0.0	16.5	27.0	751	0.0	16.4	26.8	751
8	48.5	46.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	50.3	47.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	52.9	48.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	56.2	49.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	59.6	51.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	62.9	53.5	40.3	0.0	0.0	696	16.8	0.0	0.0	719
14	65.5	55.2	57.8	0.0	0.0	631	17.4	0.0	0.0	695
15	67.3	56.3	61.7	0.0	0.0	563	18.5	0.0	0.0	669

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----						----- Saturday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	QAWB (F)								
16	67.9	56.6	61.9	0.0	0.0	496	18.7	0.0	0.0	644
17	67.7	56.4	0.0	0.0	0.0	496	0.0	0.0	0.0	644
18	67.0	56.6	0.0	0.0	0.0	496	0.0	0.0	0.0	644
19	66.0	57.6	0.0	0.0	0.0	496	0.0	0.0	0.0	644
20	64.6	57.9	0.0	0.0	0.0	496	0.0	0.0	0.0	644
21	62.9	57.3	0.0	0.0	0.0	496	0.0	0.0	0.0	644
22	61.0	56.0	0.0	0.0	0.0	496	0.0	0.0	0.0	644
23	59.0	54.8	0.0	0.0	0.0	496	0.0	0.0	0.0	644
24	56.9	53.0	0.0	0.0	0.0	496	0.0	0.0	0.0	644

Hour	----- Sunday -----						----- Monday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	QAWB (F)								
1	54.8	51.3	0.0	113.6	126.1	751	0.0	113.6	126.1	751
2	52.9	49.6	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	51.2	48.2	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	49.8	47.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	48.8	46.2	1.9	16.9	27.6	751	1.9	16.9	27.6	751
6	48.2	45.7	1.5	0.0	0.0	742	1.5	0.0	0.0	742
7	47.9	45.6	0.0	16.4	26.8	751	0.0	16.4	26.8	751
8	48.5	46.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	50.3	47.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	52.9	48.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	56.2	49.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	59.6	51.5	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	62.9	53.5	16.7	0.0	0.0	719	24.9	0.0	0.0	711
14	65.5	55.2	17.4	0.0	0.0	695	50.7	0.0	0.0	653
15	67.3	56.3	18.5	0.0	0.0	669	58.2	0.0	0.0	589
16	67.9	56.6	18.7	0.0	0.0	644	61.9	0.0	0.0	521
17	67.7	56.4	0.0	0.0	0.0	644	0.0	0.0	0.0	521
18	67.0	56.6	0.0	0.0	0.0	644	0.0	0.0	0.0	521
19	66.0	57.6	0.0	0.0	0.0	644	0.0	0.0	0.0	521
20	64.6	57.9	0.0	0.0	0.0	644	0.0	0.0	0.0	521
21	62.9	57.3	0.0	0.0	0.0	644	0.0	0.0	0.0	521
22	61.0	56.0	0.0	0.0	0.0	644	0.0	0.0	0.0	521
23	59.0	54.8	0.0	0.0	0.0	644	0.0	0.0	0.0	521
24	56.9	53.0	0.0	0.0	0.0	644	0.0	0.0	0.0	521

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

November

Hour	Design		Design			Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	
	1	56.0	47.2	0.0	125.0	
2	55.0	46.4	0.0	116.9	130.1	751
3	54.2	45.8	0.0	0.0	0.0	743
4	53.6	45.2	0.0	14.9	24.5	751
5	53.4	45.3	0.0	0.0	0.0	743
6	53.8	45.9	0.0	14.9	24.5	751
7	54.8	46.9	0.0	0.0	0.0	743
8	56.6	48.7	0.0	14.9	24.5	751
9	59.2	50.6	0.0	0.0	0.0	751
10	62.2	52.6	0.0	0.0	0.0	751
11	65.6	54.1	0.0	0.0	0.0	751
12	68.8	55.3	0.0	0.0	0.0	751
13	71.2	55.7	0.0	0.0	0.0	743
14	72.8	56.3	0.0	0.0	0.0	736
15	73.4	56.2	0.0	0.0	0.0	729
16	72.8	55.6	0.0	0.0	0.0	721
17	71.4	54.6	0.0	0.0	0.0	721
18	69.2	53.6	0.0	0.0	0.0	721
19	66.6	53.0	0.0	0.0	0.0	721
20	64.0	51.7	0.0	0.0	0.0	721
21	61.8	50.7	0.0	0.0	0.0	721
22	59.8	49.6	0.0	0.0	0.0	721
23	58.2	48.7	0.0	0.0	0.0	721
24	57.0	48.0	0.0	0.0	0.0	721

Hour	Typical		Weekday				Saturday			
	OADB (F)	OAWB (F)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	1	48.7	45.7	0.0	36.8	54.7	751	0.0	43.9	59.6
2	46.9	44.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	45.5	42.8	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	44.6	41.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	44.4	42.0	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	44.8	42.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	45.9	43.9	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	47.8	46.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	50.2	48.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	52.9	49.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	55.8	51.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	58.5	52.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	60.9	52.5	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	62.8	53.4	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	64.0	53.8	0.0	0.0	0.0	721	0.0	0.0	0.0	721

Trane Air Conditioning Economics  
 By: Trane Customer Direct Service Network

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	----- Weekday -----						----- Saturday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
16	64.4	53.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	64.1	53.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	63.2	53.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	61.8	54.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	60.0	53.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	57.9	52.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	55.6	51.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	53.2	49.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	50.8	47.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714
Hour	----- Sunday -----						----- Monday -----			
	Typical		Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)	Cooling Load (Ton)	Chiller Load (Ton)	Chiller Demand (kW)	Storage Capacity (Ton-Hr)
	OADB (F)	OAWB (F)								
1	48.7	45.7	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	46.9	44.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	45.5	42.8	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	44.6	41.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	44.4	42.0	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	44.8	42.7	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	45.9	43.9	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	47.8	46.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	50.2	48.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	52.9	49.9	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	55.8	51.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	58.5	52.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	60.9	52.5	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	62.8	53.4	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	64.0	53.8	0.0	0.0	0.0	721	0.0	0.0	0.0	721
16	64.4	53.9	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	64.1	53.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	63.2	53.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	61.8	54.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	60.0	53.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	57.9	52.7	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	55.6	51.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	53.2	49.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	50.8	47.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

---- BUILDING COOLING DEMANDS AND THERMAL STORAGE ----

December

Hour	Design		Design			
	OADB	OAWB	Cooling Load	Chiller Load	Chiller Demand	Storage Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	48.2	40.8	0.0	43.9	59.6	751
2	47.3	40.2	0.0	0.0	0.0	743
3	46.6	39.7	0.0	14.9	24.5	751
4	46.1	39.3	0.0	0.0	0.0	743
5	45.9	39.4	0.0	14.9	24.5	751
6	46.3	39.7	0.0	0.0	0.0	743
7	47.1	40.6	0.0	14.9	24.5	751
8	48.7	42.0	0.0	0.0	0.0	743
9	50.9	44.0	0.0	0.0	0.0	743
10	53.5	46.1	0.0	0.0	0.0	743
11	56.5	48.0	0.0	0.0	0.0	743
12	59.2	49.7	0.0	0.0	0.0	743
13	61.3	50.8	0.0	0.0	0.0	736
14	62.7	51.4	0.0	0.0	0.0	729
15	63.2	51.4	0.0	0.0	0.0	721
16	62.7	50.7	0.0	0.0	0.0	714
17	61.5	49.7	0.0	0.0	0.0	714
18	59.6	48.5	0.0	0.0	0.0	714
19	57.3	47.6	0.0	0.0	0.0	714
20	55.1	45.9	0.0	0.0	0.0	714
21	53.2	44.6	0.0	0.0	0.0	714
22	51.5	43.1	0.0	0.0	0.0	714
23	50.1	42.2	0.0	0.0	0.0	714
24	49.0	41.5	0.0	0.0	0.0	714

Hour	Typical		Weekday				Saturday			
	OADB	OAWB	Cooling Load	Chiller Load	Chiller Demand	Storage Capacity	Cooling Load	Chiller Load	Chiller Demand	Storage Capacity
	(F)	(F)	(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)
1	37.5	35.3	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	37.1	35.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	37.4	35.5	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	38.1	36.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	39.3	37.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	40.9	39.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	42.7	41.2	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	44.7	43.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	46.8	45.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	48.8	47.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	50.7	48.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	52.2	48.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	53.4	49.2	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	54.1	49.2	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	54.4	48.9	0.0	0.0	0.0	721	0.0	0.0	0.0	721

COLD THERMAL STORAGE - ALTERNATIVE 1  
 BLDG G101, ECO #13

Hour	Typical		----- Weekday -----				----- Saturday -----			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
		(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)	
16	54.0	48.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	53.0	47.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	51.4	46.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	49.3	45.4	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	47.0	43.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	44.5	41.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	42.2	39.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	40.1	37.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	38.5	36.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714

Hour	Typical		----- Sunday -----				----- Monday -----			
	OADB	OAWB	Cooling	Chiller	Chiller	Storage	Cooling	Chiller	Chiller	Storage
	(F)	(F)	Load	Load	Demand	Capacity	Load	Load	Demand	Capacity
		(Ton)	(Ton)	(kW)	(Ton-Hr)	(Ton)	(Ton)	(kW)	(Ton-Hr)	
1	37.5	35.3	0.0	43.9	59.6	751	0.0	43.9	59.6	751
2	37.1	35.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
3	37.4	35.5	0.0	14.9	24.5	751	0.0	14.9	24.5	751
4	38.1	36.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
5	39.3	37.6	0.0	14.9	24.5	751	0.0	14.9	24.5	751
6	40.9	39.2	0.0	0.0	0.0	743	0.0	0.0	0.0	743
7	42.7	41.2	0.0	14.9	24.5	751	0.0	14.9	24.5	751
8	44.7	43.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
9	46.8	45.3	0.0	0.0	0.0	743	0.0	0.0	0.0	743
10	48.8	47.0	0.0	0.0	0.0	743	0.0	0.0	0.0	743
11	50.7	48.1	0.0	0.0	0.0	743	0.0	0.0	0.0	743
12	52.2	48.8	0.0	0.0	0.0	743	0.0	0.0	0.0	743
13	53.4	49.2	0.0	0.0	0.0	736	0.0	0.0	0.0	736
14	54.1	49.2	0.0	0.0	0.0	729	0.0	0.0	0.0	729
15	54.4	48.9	0.0	0.0	0.0	721	0.0	0.0	0.0	721
16	54.0	48.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714
17	53.0	47.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
18	51.4	46.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
19	49.3	45.4	0.0	0.0	0.0	714	0.0	0.0	0.0	714
20	47.0	43.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
21	44.5	41.5	0.0	0.0	0.0	714	0.0	0.0	0.0	714
22	42.2	39.3	0.0	0.0	0.0	714	0.0	0.0	0.0	714
23	40.1	37.6	0.0	0.0	0.0	714	0.0	0.0	0.0	714
24	38.5	36.2	0.0	0.0	0.0	714	0.0	0.0	0.0	714



CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #13

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	9,266.2	633,624.6	5.1	8.5	761,859.0	6.5
Primary Cooling						
Compressor	330,325.6	0.0	0.0	14.5	3,382,541.8	28.8
Tower/Cond Fans	25,471.3	0.0	0.0	1.1	260,826.2	2.2
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	6,906.9	0.0	0.0	0.3	70,726.8	0.6
Auxiliary						
Supply Fans	416,647.3	0.0	0.0	18.2	4,266,477.5	36.4
Circulation Pumps	142,592.0	0.0	0.0	6.2	1,460,145.0	12.5
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	559,239.2	0.0	0.0	24.5	5,726,622.5	48.8
Lighting	729,764.0	0.0	0.0	31.9	7,472,800.5	62.2
Receptacle	439,233.8	0.0	0.0	19.2	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	2,100,206.8	633,624.6	5.1	100.0	22,173,140.0	186.6

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #15

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	WATER (1000 G1)	GAS DMND On Peak (Thrm/hr)
Jan	135,443	335	1,875	1	9
Feb	123,834	335	1,817	1	9
March	132,657	335	455	0	5
April	119,262	335	8	0	2
May	183,212	571	0	0	0
June	208,984	643	0	0	0
July	205,681	631	0	0	0
Aug	213,267	634	0	0	0
Sept	182,522	597	0	0	0
Oct	157,871	506	0	0	0
Nov	122,315	335	272	0	4
Dec	130,746	335	1,226	1	6
Total	1,915,794	643	5,653	3	9

Building Energy Consumption = 59,110 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 168,186 (Btu/Sq Ft/Year)

Floor Area = 120,182 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 BLDG G101, ECO #15

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----

Ref Num	Equip Code	Monthly Consumption												Total	
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec		
0	LIGHTS														
	ELEC	51699	46725	53507	49740	52603	51547	50796	53507	49740	52603	49740	50796	613,004	
	PK	139.6	139.6	139.6	139.6	139.6	139.6	139.6	139.6	139.6	139.6	139.6	139.6	139.6	
1	MISC LD														
	ELEC	36778	33261	39395	35169	38086	37787	35469	39395	35169	38086	35169	35469	439,234	
	PK	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	147.6	
2	MISC LD														
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
3	MISC LD														
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
4	MISC LD														
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
5	MISC LD														
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
6	MISC LD														
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0	
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
1	EQ1121S														
	ELEC	0	0	0	0	5070	8988	8807	8930	6044	1807	0	0	39,645	
	PK	0.0	0.0	0.0	0.0	32.5	39.7	38.2	38.3	32.1	18.7	0.0	0.0	39.7	
1	EQ5200														
	ELEC	0	0	0	0	611	1138	1123	1130	745	173	0	0	4,920	
	PK	0.0	0.0	0.0	0.0	3.6	4.4	4.3	4.3	3.8	2.7	0.0	0.0	4.4	
1	EQ5001														
	ELEC	0	0	0	0	4008	5256	5431	5431	4599	1409	0	0	26,134	
	PK	0.0	0.0	0.0	0.0	7.3	7.3	7.3	7.3	7.3	7.3	0.0	0.0	7.3	
1	EQ5313														
	ELEC	0	0	0	0	165	216	223	223	189	58	0	0	1,074	
	PK	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.3	0.3	0.0	0.0	0.3	
2	EQ1120S														
	ELEC	0	0	0	0	3021	4885	4837	4981	3476	1545	0	0	22,744	
	PK	0.0	0.0	0.0	0.0	17.8	21.3	20.9	21.1	17.9	11.2	0.0	0.0	21.3	





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
 BLDG G101, ECO #15

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 642.9 (kW)  
 Yearly Time of Peak 15 (hr) 6 (mo)

Hour 15 Month 6

Eqp. Ref. Num.	Equipment Code Name	Equipment Description	Utility Demand (kW)	Percent Of Tot (%)
Cooling Equipment				
1	EQ1121S	AIR-CLD RECIP 20-35 TONS	51.6	8.02
2	EQ1120S	AIR-CLD RECIP <20 TONS	26.3	4.09
3	EQ1171L	AIR-CLD COND COMP 35-60 TONS	46.6	7.24
4	EQ1122L	AIR-CLD RECIP >55 TONS	183.8	28.59
Sub Total			308.3	47.95
Sub Total			0.0	0.00
Air Moving Equipment				
1		SUMMATION OF FAN ELECTRICAL DEMAND	22.7	3.53
2		SUMMATION OF FAN ELECTRICAL DEMAND	2.4	0.38
3		SUMMATION OF FAN ELECTRICAL DEMAND	3.6	0.56
4		SUMMATION OF FAN ELECTRICAL DEMAND	9.3	1.44
5		SUMMATION OF FAN ELECTRICAL DEMAND	9.6	1.49
Sub Total			47.6	7.40
Sub Total			0.0	0.00
Miscellaneous				
	Lights		139.6	21.71
	Base Utilities		0.0	0.00
	Misc Equipment		147.6	22.95
Sub Total			287.1	44.66
Grand Total			642.9	100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 BLDG G101, ECO #15

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 120,182  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	WATER (1000 gal)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	9,020.2	565,330.4	3.3	8.4	687,451.2	5.9
Primary Cooling						
Compressor	246,723.9	0.0	0.0	11.9	2,526,459.0	21.5
Tower/Cond Fans	29,749.0	0.0	0.0	1.4	304,630.8	2.6
Condenser Pump	0.0	0.0	0.0	0.0	0.0	0.0
Other Accessories	4,594.5	0.0	0.0	0.2	47,047.8	0.4
Auxiliary						
Supply Fans	416,647.3	0.0	0.0	20.0	4,266,477.5	36.4
Circulation Pumps	156,820.4	0.0	0.0	7.5	1,605,844.5	13.7
Base Utilities	0.0	0.0	0.0	0.0	0.0	0.0
Subtotal	573,467.6	0.0	0.0	27.6	5,872,322.0	50.1
Lighting	613,004.4	0.0	0.0	29.5	6,277,180.0	52.2
Receptacle	439,233.8	0.0	0.0	21.1	4,497,765.0	37.4
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0	0.0
Totals	1,915,793.6	565,330.4	3.3	100.0	20,212,856.0	170.1

BUILDING 207



# EMC ENGINEERS, INC.

PROJECT: FORT McPHERSON & FORT GILLEM ESOS STUDY  
 LOCATION: FORT McPHERSON  
 ECO: Computer Simulation Summary

EMC PROJECT:  
 DATE: 04/21/92  
 FILE: G207ECO  
 PREPARED BY:  
 CHECKED BY:

#3105.000  
 04/21/92  
 G207ECO  
 DENNIS JONES

CLIENT CONTRACT NO: DACA21-91-C-0097  
 CLIENT PROJECT ENG: TERRY SEABROOK

Bldg: G207

Area: 298,599 ft<sup>2</sup>

Run Description	Heating Gas Use (kBtu/yr)	Heating Electric Use (kWh/yr)	Cooling Electric Use (kWh/yr)	Fan Electric Use (kWh/yr)	Pump Electric Use (1) (kWh/yr)	Lighting Electric Use (kWh/yr)	Recept. Electric Use (kWh/yr)	Total Electric Use (kWh/yr)	Peak Electric Demand (kW)	Total Gas Use (MBtu/yr)	Total Energy Use (MBtu/yr)
Baseline	6,317,652	8,200	0	155,220	0	295,749	0	459,169	0	6,318	7,885
Wall Insulation	6,241,559	8,200	0	152,300	0	295,749	0	456,249	0	6,242	7,799
Savings (Loss)	76,093	0	0	2,920	0	0	0	2,920	0	76	86
Roof Insulation	2,208,442	6,937	0	47,943	0	295,749	0	350,629	0	2,208	3,405
Savings (Loss)	4,109,210	1,263	0	107,277	0	0	0	108,540	0	4,109	4,480
Insulated Glass	6,287,502	8,200	0	154,555	0	295,749	0	458,504	0	6,288	7,852
Savings (Loss)	30,150	0	0	665	0	0	0	665	0	30	32
Weatherstripping and Caulk	6,310,442	8,200	0	155,042	0	295,749	0	458,991	0	6,310	7,877
Savings (Loss)	7,210	0	0	178	0	0	0	178	0	7	8
Destratification Fans	5,806,827	7,984	0	219,168	0	295,749	0	522,901	0	5,807	7,591
Savings (Loss)	510,825	216	0	(63,948)	0	0	0	(63,732)	0	511	293
Radiant Heaters	6,010,785	7,794	0	0	0	295,749	0	303,543	0	6,011	7,047
Savings (Loss)	306,867	406	0	155,220	0	0	0	155,626	0	307	838
Loading Dock Seals	5,981,313	8,085	0	146,557	0	295,749	0	450,391	0	5,981	7,518
Savings (Loss)	336,339	115	0	8,663	0	0	0	8,778	0	336	366
Lighting Controls	6,532,542	8,239	0	149,773	0	159,705	0	317,717	0	6,533	7,617
Savings (Loss)	(214,890)	(39)	0	5,447	0	136,044	0	141,452	0	(215)	268
Continuous Boiler Operation	8,905,955	11,988	0	232,830	0	295,749	0	540,567	0	8,906	10,751
Savings (Loss)	(2,588,303)	(3,788)	0	(77,610)	0	0	0	(81,398)	0	(2,588)	(2,866)

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

ROOF & WALL INSULATION (ECO-1)

ADD 0-10 TO WALL DRIVIT"  
R-15.46 U = 0.065

ADD R-19 BATT'S TO ROOF  
R-20.93 U = 0.048

INSULATED GLASS (ECO-2)

LOWER LEVEL

SC = 0.38  
U = 0.51

WEATHER STRIPPING & CALC (ECO-3)

SPECIFIC INFILTRATION IS 1.53  $\frac{\text{cfm}}{\text{in}^2}$

		EXIST	NEW	EXIST	NEW
		$\frac{\text{in}^3}{\text{hr}}$	$\frac{\text{in}^3}{\text{hr}}$	CFM	CFM
(12) OH DOORS	10' x 11'	0.320	0.215	646	434
1952 $\text{ft}^2$	GLASS	0.052	0.026	155	78
"	WINDOW FRAME	0.093	0.019	298	57
1320 $\text{ft}^2$	DOOR	0.093	0.019	188	38
				1267	607
				SAVE	660 $\frac{\text{cfm}}{\text{hr}}$

$\text{at } 2,988,000 \text{ ft}^3 = 0.0133 \text{ ach}$   
NEW  $1.0 - 0.0133 = \boxed{0.987 \text{ ACH}}$

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE 6207

ECO 9

DEHUMIDIFICATION FANS ECO-10 ✓

MEASURED 58°F AT CEILING  
65.4°F AT FLOOR

DRIP UPPER ZONE FROM 68°F TO 65°F

RADIANT HEATERS ECO-14 ✓

SEPARATE CALCULATION

LOADING DOCK SEALS ECO-14 ✓


ASSUME 5 TRUCKS AT BLDG

DOORS 10' W x 11' H → PERIM = 44 ft<sup>2</sup>

ASSUME 6" CRACK WITH TRUCK → 22 ft<sup>2</sup>/DOOR

TOTAL LEAK AREA = 110 ft<sup>2</sup> = 15,840 in<sup>2</sup> = L

$Q = L \sqrt{A_{0.1} + B_{0.1}^2}$

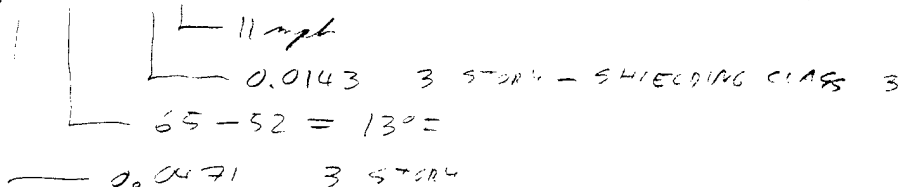

$Q = L \times 1.53 \text{ cfm/in}^2 = 24,244 \text{ cfm}$

VOLUME = 20' x 844' x 177' = 2,988,000 ft<sup>3</sup> } 0.49 ACH

LIGHTING CONTROLS ECO-15 ✓

54% OF EXISTING x 106,817 = 57,676 W

24 HR BOILER OPERATION ECO-17


<HTG>

BLDG.# 207  
ECO 10

### AIR STRATIFICATION

LOCATION	<u>NORTH END</u>	REQ. TEMP.	_____
TEMP. AT TSTAT	_____	SOURCE	<u>UNIT HEATER</u>
TEMP. AT CEILING	<u>68 F</u>	OPP. HOURS	_____ TO _____
TEMP. AT FLOOR	<u>65.4 F</u>	T'STAT	<u>GAS FIRE</u>

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

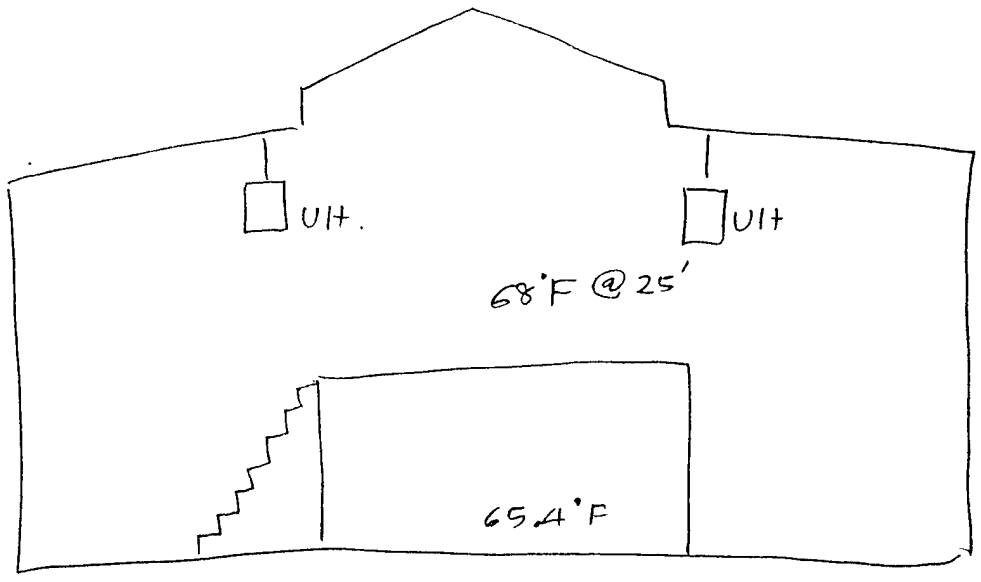

COMMENTS: BAY 7  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

# E M C ENGINEERS, INC.

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE 6-2-7

TRACE - 500 INCH

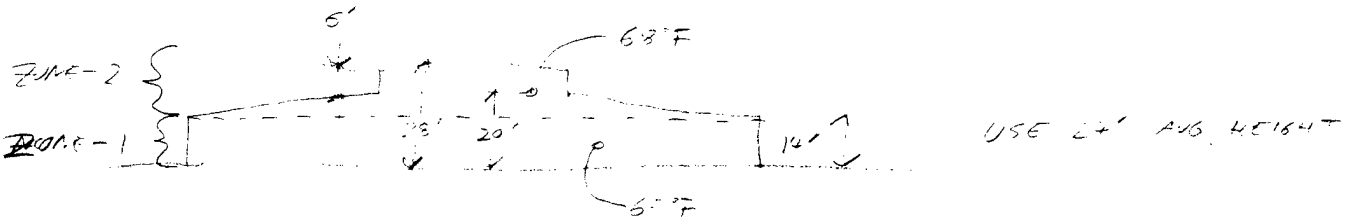

ROOF




- OUTER FILM 0.25
- BU ROOFING 0.33
- 1" GYP FIBER CONC 0.65
- INNER FILM 0.75

1.93

U = 0.518



WALLS



- OUTER FILM 0.25
- 12" BRICK 4.44
- INNER FILM 0.75

5.44

U = 0.184

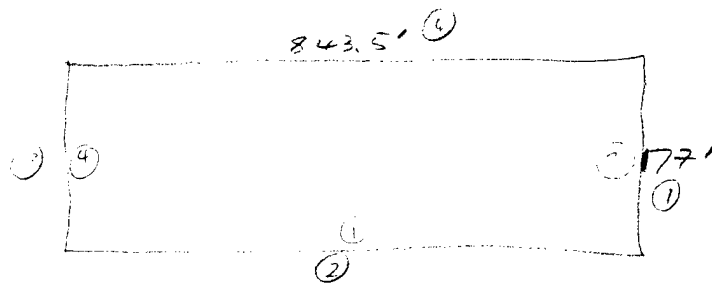

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE 1/8" = 1'-0"

LOWER WINDOWS

(20)	5' x 4'	480	}	704 <del>sq</del> ft <sup>2</sup>	NORTH & SOUTH
(14)	4' x 4'	224			
(10)	5' x 4'	240	}	272 <del>sq</del> ft <sup>2</sup>	EAST & WEST
(2)	4' x 4'	32			

SINGLE PANE - METAL FRAME U = 1.23  
SC = 1.0

CLEARSTORE WINDOWS

GREEN CORRUGATED FIBERGLASS  
OVER CLEAR GLASS

DOUBLE GLAZED

U = 0.49

SC = 0.20

2' x 8' x 3' NORTH & SOUTH

LIGHTS

(46) 8' - 2 LAMP FLUORESCENTS PER BAY (7) @ 210 WATTS

$46 \times 7 \times 210 / 1000 = 67.6 \text{ kW}$

0 - Job Information

Project: FORT MCPHERSON & GILLEM EEAP #3105.000  
 Location: ATLANTA, GA  
 Client: COE - DACA21-9-C-0097  
 Program User: DENNIS JONES  
 Comments: BUILDING 207 - FORT GILLEM - BASELINE

-----CARD 08-- Climatic Information -----

Weather Code	Summer Clearness Number	Winter Clearness Number	Summer Design Dry Bulb	Summer Design Wet Bulb	Winter Design Dry Bulb	Building Orientation	Summer Ground Reflect	Winter Ground Reflect
ATLANTA								

----- Load Section Alternative #1 -----

---- Load Alternative ----

Number	Description
1	G207 - BASELINE

-----CARD 20-- General Room Parameters -----

Room Number	Zone Reference Number	Room Descrip	Floor Length	Floor Width	Const Type	Plenum Height	Acoustic Ceiling Resistance	Floor to Ceiling Height	Duplicate Floors Multiplier	Duplicate Rooms per Zone	Perimeter Depth
1	1	LOWER LEVEL	843.5	177	2	0		14			
2	2	UPPER LEVEL	843.5	177	1	0		7			

-----CARD 21-- Thermostat Parameters -----

Room Number	Cooling Room Design DB	Room Design RH	Cooling T'stat Driftpoint	Cooling T'stat Schedule	Heating Room Design DB	Heating T'stat Driftpoint	Heating T'stat Schedule	T'stat Location Flag	Mass / No. Hrs Average	Carpet On Floor
1					65		HTG65			NO
2					65		HTG68			NO

-----CARD 22-- Roof Parameters -----

Room Number	Roof Number	Equal to Floor?	Roof Length	Roof Width	Roof U-Value	Const Type	Roof Direction	Roof Tilt	Roof Alpha
2	1	YES			0.518	47	0	90	0.45

## -----CARD 24-- Wall Parameters -----

Room Number	Wall Number	Wall Length	Wall Height	Wall			Wall Direction	Wall Tilt	Wall Alpha	Ground
				U-Value	Constuc Type	Reflectance Multiplier				
1	1	177	14	0.184	72		0		0.68	
1	2	843.5	14	0.184	72		90		0.68	
1	3	177.5	14	0.184	72		180		0.68	
1	4	843.5	14	0.184	72		270		0.68	
2	1	843.5	6	0.184	72		270		0.68	
2	2	843.5	6	0.184	72		90		0.68	
2	3	177	10	0.184	72		0		0.68	
2	4	177	10	0.184	72		180		0.68	

## -----CARD 25-- Wall/Glass Parameters -----

Room Number	Wall Number	Glass Length	Glass Width	Pct Glass		Shading Coefficient	External Shading Type	Internal Shading Type	Percent Solar Ret. Air	Percent Visible Transmittance	Inside Visible Reflectance
				or No. of Windows	Glass U-Value						
1	1	704	1	1	1.2	1					
1	2	272	1	1	1.2	1					
1	3	704	1	1	1.2	1.00					
1	4	272	1	1	1.2	1.00	3				
2	1	844	6	1	0.49	0.20					
2	2	844	6	1	0.49	0.20					

## -----CARD 26-- Schedules -----

Room Number	People	Lights	Ventilation	Infiltration	Reheat Minimum	Cooling Fans	Heating Fan	Auxiliary Fan	Room Exhaust	Daylighting Controls
M1	PPL1	LGT1		AVAIL		4T08	4T08		ON	

## -----CARD 27-- People and Lights -----

Room Number	People Value	People Units	People Sensible	People Latent	Lighting Value	Lighting Units	Lighting		Percent Lights to Ret. Air	--- Daylighting ---	
							Fixture Type	Ballast Factor		Reference Point 1	Reference Point 2
1	30	PEOPLE	250	200							
2					106807	WATTS	SUSFLUOR	1			

## -----CARD 29-- Room Airflows -----

Room Number	-----Ventilation-----				-----Infiltration-----				--Reheat Minimum--	
	-----Cooling-----		-----Heating-----		-----Cooling-----		-----Heating-----		Value	Units
1	Value	Units	Value	Units	Value	Units	Value	Units		
					1.0	ACH-HR	1.0	ACH-HR		



```

-----CARD 29--- Room Airflows -----
-----Ventilation-----     -----Infiltration-----
Room   ----Cooling-----     ----Heating-----     ----Cooling-----     ----Heating-----     --Reheat Minimum--
Number Value   Units   Value   Units   Value   Units   Value   Units   Value   Units
2      0.5     ACH-HR  0.5     ACH-HR  0.5     ACH-HR  0.5     ACH-HR  Value   Units
    
```

```

-----CARD 32-- Exposed Floor Parameters-----
Exposed -----Slab-----     -----Exposed Floor-----
Room   Floor Perimeter Loss      Floor Floor Const Temp Cooling Heating Adjacent
Number Number Length Coefficient Area   U-Value Type Flag    Temp Temp Room No
1      1     2041   0.63
    
```

```

-----CARD 33-- External Shading -----
-----OVERHANG-----     -----VERTICAL FINS-----
Shading Glass Above Projection Glass Projection Left      Right      Adjacent
Type Height Glass Out     Width Left Out      Right    Out      Projection Building
3      4     5     12
    
```

----- System Section Alternative #1 -----

```

-----CARD 39-- System Alternative -----
Number Description
1      G207 - BASELINE
    
```

```

-----CARD 40--- System Type -----
-----OPTIONAL VENTILATION SYSTEM-----
System Ventil Fan
Set System Deck Cooling Heating Cooling Heating Static
Number Type Location SADBvh SADBvh Schedule Schedule Pressure
1      FC
    
```

```

-----CARD 41-- Zone Assignment -----
System
Set Ref #1 Ref #2 Ref #3 Ref #4 Ref #5 Ref #6
Number Begin End Begin End Begin End Begin End Begin End Begin End
1      1      2
    
```

## -----CARD 42--- Fan SP and Duct Parameters-----

System	Cool	Heat	Return	Mn Exh	Aux	Rm Exh	Cool	Return	Supply	Supply	Return
Set	Fan	Fan	Fan	Fan	Fan	Fan	Fan Mtr	Fan Mtr	Duct	Duct	Air
Number	SP	SP	SP	SP	SP	SP	Loc	Loc	Ht Gn	Loc	Path
1	0.3	0.3									

## -----CARD 43-- Airflow Design Temperatures -----

System	Minimum	Maximum	Minimum	Maximum	Minimum	Maximum	Minimum	Maximum	Minimum	Design
Set	Cooling	Cooling	Heating	Heating	Cooling	Cooling	Preheat	Preheat	Room	Ht Rec
Number	SADB	SADB	SADB	SADB	Lv DB	Lv DB	Lv DB	Lv DB	RH	Diff
1			130	130						

## -----CARD 44-- System Options -----

System	Econ	Econ	Max Pct	Direct	Indirect	1st Stage	----- Exhaust Air Heat Recovery -----				
Set	Type	On	Outside	Evap	Evap	Evap	Fan	--- Effectiveness ---	--- Control Method ---		
Number	Flag	Point	Air	Cooling	Cooling	Cooling	Cycling	System	Room	System	Room
1	NONE										

## -----CARD 45--- Equipment Schedules -----

System	Main		Direct	Indirect	Auxiliary	Main	Main		Auxiliary
Set	Cooling		Evap	Evap	Cooling	Heating	Preheat	Reheat	Mech. Heating
Number	Coil	Economizer	Coil	Coil	Coil	Coil	Coil	Coil	Humidity Coil
1	OFF	OFF				4T08			

## -----CARD 46--- EMS/BAS Schedules -----

System	Discrim	Night	Optimum	Optimum	-----DUTY CYCLING-----			System HR	Room HR
Set	Control	Purge	Start	Stop	On Period	Pattern	Maximum	Exhaust	Exhaust
Number	Schedule	Schedule	Schedule	Schedule	Schedule	Length	Off Time	Schedule	Schedule
1									

## -----CARD 49-- Heating Capacity Overrides -----

System	---MAIN HEATING---	-----PREHEAT-----	-----REHEAT-----	--HUMIDIFICATION--	---AUX HEATING---	
Set	Capacity	Capacity	Capacity	Capacity	Capacity	
Number	Value	Units	Value	Units	Value	Units
1	3000	MBH				

## ----- Equipment Section Alternative #1 -----

## -----CARD 59-- Equipment Description / TOD Schedules -----

Alternative	Elec Consump	Elec Demand	Demand	
Number	Time of Day	Time of Day	Limit	Alternative Description
	Schedule	Schedule	Max KW	



-----CARD 65-- Heating Load Assignment -----  
 Load All Coil  
 Assignment Loads To -Group 1- -Group 2- -Group 3- -Group 4- -Group 5- -Group 6- -Group 7- -Group 8- -Group 9-  
 Reference Heating Ref Begin End Begin End Begin End Begin End Begin End Begin End Begin End Begin End  
 1 1 1 1

-----CARD 67-- Heating Equipment Parameters -----  
 Heat Equip Number HW Pmp Energy Seq Switch Demand  
 Ref Code Of Full Ld Cap'y Rate Order over Hot Misc. Limit  
 Number Name Units Value Units Value Units Value Units Number Control Strg Acc. Cogen Number  
 1 EQ2001 1 1.5 HP 3000 MBH 80 PCTEFF

-----CARD 69-- Fan Equipment Parameters -----  
 System  
 Set Cooling Heating Return Exhaust Auxiliary Room Optional  
 Number Fan Fan Fan Fan Supply Exhaust Ventilation  
 1 EQ4003 EQ4003

Utility Description Reference Table  
-----

Schedules:

4T08  
4T08 (Utility file not found)  
AVAIL AVAILABLE (100%)  
HTG65 (Utility file not found)  
HTG68 HEATING ONLY (T-STAT AT 68)  
LGT1  
OFF ALWAYS OFF  
ON AVAILABLE (100%)  
PPL1

System:

FC FAN COIL

Heating:

EQ2001 GAS FIRE TUBE HOT WATER

Fan:

EQ4003 (Utility file not found)

Schedule Name: 4T08

Project:

Location:

Client:

Program User:

Comments: NOV THRU APRIL - 4 AM TO 8 PM

Starting Month: NOV Ending Month: APR

Starting Day Type: DSGN Ending Day Type: SUN

Hour Util Percent

Hour	Util	Percent
0		0
4		100
20		0
24		

File Name: AVAIL  
Project: AVAILABLE (100)  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: HTG  
Starting Day Type: DSGN Ending Day Type: SUN

Hour	Util	Percent
0		100
24		

Schedule Name: HTG68  
Project: HEATING ONLY (T-STAT AT 68)  
Location:  
Client:  
Program User:  
Comments: HEATING ONLY SCHEDULE - T-STAT

Starting Month: JAN Ending Month: MAY  
Starting Day Type: DSGM Ending Day Type: SUN

Hour Temperature  
-----  
0 68  
24

Starting Month: JUN Ending Month: SEP  
Starting Day Type: DSGM Ending Day Type: SUN

Hour Temperature  
-----  
0 35  
24

Starting Month: OCT Ending Month: DEC  
Starting Day Type: DSGM Ending Day Type: SUN

Hour Temperature  
-----  
0 68  
24



Module Name: LGT1  
Project:  
Location:  
Client:  
Program User:  
Comments: OFFICE LIGHTING

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: WKDY

Hour	Util Percent
0	5
7	80
8	100
12	80
13	100
16	80
17	40
18	5
24	

Starting Month: JAN Ending Month: DEC  
Starting Day Type: SAT Ending Day Type: SUN

Hour	Util Percent
0	5
24	

Schedule Name: OFF  
Project: ALWAYS OFF  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: HTG  
Starting Day Type: DSGN Ending Day Type: SUN

Hour	Util	Percent
0		0
24		

Source Name: ON  
Project: AVAILABLE (100)  
Location:  
Client:  
Program User:  
Comments:

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGN Ending Day Type: SUN

Hour	Util	Percent
0		100
24		

Schedule Name: PPL1  
Project:  
Location:  
Client:  
Program User: D JONES  
Comments: OFFICE PEOPLE SCHEDULE

Starting Month: JAN Ending Month: DEC  
Starting Day Type: DSGM Ending Day Type: WKDY

Hour	Util	Percent
0		0
7		50
8		100
11		80
12		40
13		80
14		100
16		70
17		30
18		0
24		

Starting Month: JAN Ending Month: DEC  
Starting Day Type: SAT Ending Day Type: SUN

Hour	Util	Percent
0		0
24		

\*\*\*\*\*  
\*\*\*\*\*  
\*\*  
\*\* TRACE 600 ANALYSIS \*\*  
\*\*  
\*\* by \*\*  
\*\*  
\*\*\*\*\*  
\*\*\*\*\*

FORT MCPHERSON & GILLEM EEAP #3105.000  
ATLANTA, GA  
COE - DACA21-9-C-0097  
DENNIS JONES  
BUILDING 207 - FORT GILLEM - BASELINE

Weather File Code: ATLANTA.  
Location:  
Latitude: 33.0 (deg)  
Longitude: 84.0 (deg)  
Time Zone: 6  
Elevation: 1,005 (ft)  
Barometric Pressure: 28.8 (in. Hg)

Summer Clearness Number: 0.90  
Winter Clearness Number: 0.90  
Summer Design Dry Bulb: 92 (F)  
Summer Design Wet Bulb: 74 (F)  
Winter Design Dry Bulb: 22 (F)  
Summer Ground Relectance: 0.20  
Winter Ground Relectance: 0.20

Air Density: 0.0731 (Lbm/cuft)  
Air Specific Heat: 0.2444 (Btu/lbm/F)  
Density-Specific Heat Prod: 1.0727 (Btu-min./hr/cuft/F)  
Latent Heat Factor: 4,721.8 (Btu-min./hr/cuft)  
Enthalpy Factor: 4.3883 (Lb-min./hr/cuft)

Design Simulation Period: June To November  
System Simulation Period: January To December  
Cooling Load Methodology: TETD/Time Averaging

Time/Date Program was Run: 6:57:34 3/20/92  
Dataset Name: G207 .TM

AIRFLOW - ALTERNATIVE 1  
 G207 - BASELINE

----- SYSTEM SUMMARY -----  
 (Design Airflow Quantities)

System Number	System Type	Main					Auxil. Supply	Room Exhaust
		Outside Airflow (Cfm)	Cooling Airflow (Cfm)	Heating Airflow (Cfm)	Return Airflow (Cfm)	Exhaust Airflow (Cfm)	Supply Airflow (Cfm)	Exhaust Airflow (Cfm)
1	FC	0	417,430	417,430	460,976	43,546	0	0
Totals		0	417,430	417,430	460,976	43,546	0	0

CAPACITY - ALTERNATIVE 1  
 G207 - BASELINE

----- SYSTEM SUMMARY -----  
 (Design Capacity Quantities)

System Number	System Type	Cooling					Heating							
		Main Sys. Capacity (Tons)	Aux. Sys. Capacity (Tons)	Opt. Capacity (Tons)	Vent Capacity (Tons)	Cooling Totals (Tons)	Main Sys. Capacity (Btuh)	Aux. Sys. Capacity (Btuh)	Preheat Capacity (Btuh)	Reheat Capacity (Btuh)	Humidif. Capacity (Btuh)	Opt. Capacity (Btuh)	Vent Capacity (Btuh)	Heating Totals (Btuh)
1	FC	563.7	0.0	0.0	0.0	563.7	-3,000,000	0	0	0	0	0	0	-3,000,000
Totals		563.7	0.0	0.0	0.0	563.7	-3,000,000	0	0	0	0	0	0	-3,000,000

The building peaked at hour 14 month 6 with a capacity of 563.7 tons

ENGINEERING CHECKS - ALTERNATIVE 1  
 G207 - BASELINE

----- ENGINEERING CHECKS -----

System Number	Main/Auxiliary	System Type	Percent Outside Air	Cooling				Heating		Floor Area Sq Ft
				Cfm/ Sq Ft	Cfm/ Ton	Sq Ft /Ton	Btuh/ Sq Ft	Cfm/ Sq Ft	Btuh/ Sq Ft	
1	Main	FC	0.00	1.40	740.5	529.7	22.65	1.40	-10.05	298,599

em 1 Block FC - FAN COIL

\*\*\*\*\* COOLING COIL PEAK \*\*\*\*\* CLG SPACE PEAK \*\*\*\*\* HEATING COIL PEAK \*\*\*\*\*

Peaked at Time ==>	Mo/Hr: 6/14	*	Mo/Hr: 6/14	*	Mo/Hr: 13/ 1							
Outside Air ==>	OADB/WB/HR: 96/ 73/ 91.0	*	OADB: 96	*	OADB: 22							
	Space	Ret. Air	Ret. Air	Net	Percnt	*	Space	Percnt	*	Space Peak	Coil Peak	Percnt
	Sens.+Lat.	Sensible	Latent	Total	Of Tot	*	Sensible	Of Tot	*	Space Sens	Tot Sens	Of Tot
	(Btuh)	(Btuh)	(Btuh)	(Btuh)	(%)	*	(Btuh)	(%)	*	(Btuh)	(Btuh)	(%)
Envelope Loads												
Skylite Solr	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Skylite Cond	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Roof Cond	4,122,070	0		4,122,070	60.94	*	4,122,070	67.47	*	-3,325,497	-3,325,497	11.43
Glass Solar	243,936	0		243,936	3.61	*	234,176	3.83	*	0	0	0.00
Glass Cond	150,425	0		150,425	2.22	*	151,830	2.49	*	-334,165	-334,165	1.15
Wall Cond	219,637	0		219,637	3.25	*	244,625	4.00	*	-238,697	-238,697	0.82
Partition	0			0	0.00	*	0	0.00	*	0	0	0.00
Exposed Floor	0			0	0.00	*	0	0.00	*	-55,291	-55,291	0.19
Infiltration	1,652,943			1,652,943	24.44	*	984,659	16.12	*	-2,008,554	-2,008,554	6.90
Sub Total==>	6,389,010	0		6,389,010	94.45	*	5,737,360	93.91	*	-5,962,204	-5,962,204	20.49
Internal Loads												
Lights	364,532	0		364,532	5.39	*	364,532	5.97	*	0	0	0.00
People	10,800			10,800	0.16	*	7,500	0.12	*	0	0	0.00
Misc	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Sub Total==>	375,332	0	0	375,332	5.55	*	372,032	6.09	*	0	0	0.00
Ceiling Load	0	0		0	0.00	*	0	0.00	*	0	0	0.00
Outside Air	0	0	0	0	0.00	*	0	0.00	*	0	0	0.00
Fan Heat				0	0.00	*		0.00	*		0	0.00
Ret. Fan Heat		0		0	0.00	*		0.00	*		0	0.00
Duct Heat Pkup		0		0	0.00	*		0.00	*		0	0.00
OV/UNDR Sizing	0			0	0.00	*	0	0.00	*	-23,142,764	-23,142,764	79.51
Exhaust Heat		0	0	0	0.00	*		0.00	*		0	0.00
Terminal Bypass		0	0	0	-0.00	*		0.00	*		0	0.00
Grand Total==>	6,764,342	0	0	6,764,342	100.00	*	6,109,393	100.00	*	-29,104,968	-29,104,968	100.00

-----COOLING COIL SELECTION-----										-----AREAS-----		
Total Capacity	Sens Cap.	Coil Airfl	Entering DB/WB/HR			Leaving DB/WB/HR			Gross Total	Glass (sf)	(%)	
(Tons)	(Mbh)	(cfm)	Deg F	Deg F	Grains	Deg F	Deg F	Grains	Floor			
Main Clg	563.7	6,764.3	75.1	62.7	68.7	61.2	57.3	66.7	Part	298,599		
Aux Clg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	ExFlr	0		
Opt Vent	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Roof	2,041		
Totals	563.7	6,764.3							Wall	149,300	0 0	
										42,243	12,074 29	

-----HEATING COIL SELECTION-----				-----AIRFLOWS (cfm)-----			--ENGINEERING CHECKS--			--TEMPERATURES (F)---		
Capacity	Coil Airfl	Ent	Lvg	Type	Cooling	Heating	Clg % OA		Type	Clg	Htg	
(Mbh)	(cfm)	Deg F	Deg F	Vent			Clg Cfm/Sqft	0.0				
Main Htg	-3,000.0	417,430	123.3	130.0	Infil	43,546	43,546	1.40	SADB	61.4	130.0	
Aux Htg	0.0	0	0.0	0.0	Supply	417,430	417,430	740.52	Plenum	75.0	65.0	
Preheat	-0.0	417,430	65.0	61.2	Mincfm	0	0	529.72	Return	75.0	65.0	
Reheat	0.0	0	0.0	0.0	Return	417,430	417,430	22.65	Ret/OA	75.0	65.0	
Humidif	0.0	0	0.0	0.0	Exhaust	0	0	No. People	Runarnd	75.0	65.0	
	0.0	0	0.0	0.0	Rm Exh	0	0	Htg % OA	Fn MtrTD	0.0	0.0	
	-3,000.0				Auxil	0	0	Htg Cfm/Sqft	Fn BldTD	0.0	0.0	
								-10.05	Fn Frict	0.1	0.1	

HEATING LOADS AT COIL PEAK - ALTERNATIVE 1  
 G207 - BASELINE

----- AIR FLOW HEATING LOADS -----  
 (At time of Coil Peak)

Room Number	Description	--- Ventilation ---		---- Op. Vent. ----		----- Reheat -----		----- Humidif. -----		Total (Btuh)
		Airflow (Cfm)	Sensible (Btuh)	Airflow (Cfm)	Sensible (Btuh)	Airflow (Cfm)	Sensible (Btuh)	Airflow (Cfm)	Latent (Btuh)	
1	LOWER LEVEL	0	0	0	0	0	0	0	0	0
Zone 1	Total/Ave.	0	0	0	0	0	0	0	0	0
Zone 1	Block	0	0	0	0	0	0	0	0	0
2	UPPER LEVEL	0	0	0	0	0	0	0	0	0
Zone 2	Total/Ave.	0	0	0	0	0	0	0	0	0
Zone 2	Block	0	0	0	0	0	0	0	0	0
System 1	Total/Ave.	0	0	0	0	0	0	0	0	0
System 1	Block	0	0	0	0	0	0	0	0	0

HEATING AIRFLOW HEAT GAIN/LOSS - ALTERNATIVE 1  
 G207 - BASELINE

----- AIR FLOW HEAT GAIN AND LOSS -----  
 (At time of Coil Peak)

Room Number	Description	----- Heating -----										
		Supply Fan Heat (Btuh)	Return Fan Heat (Btuh)	System Exhaust Heat Loss (Btuh)	Total (Btuh)	System Exhaust (Cfm)	Room Exhaust (Cfm)	Ducted (Cfm)	Plenum (Cfm)	Run Around (Cfm)	Corridr (Cfm)	System Return (Cfm)
1	LOWER LEVEL	0	0	0	0	0	0	53,304	0	0	0	53,304
Zone 1	Total/Ave.	0	0	0	0	0	0	53,304	0	0	0	53,304
Zone 1	Block	0	0	0	0	0	0	53,304	0	0	0	53,304
2	UPPER LEVEL	0	0	0	0	0	0	364,127	0	0	0	364,127
Zone 2	Total/Ave.	0	0	0	0	0	0	364,127	0	0	0	364,127
Zone 2	Block	0	0	0	0	0	0	364,127	0	0	0	364,127
System 1	Total/Ave.	0	0	0	0	0	0	417,430	0	0	0	417,430
System 1	Block	0	0	0	0	0	0	417,430	0	0	0	417,430



ROOM PSYCHROMETRICS - ALTERNATIVE 1  
 - BASELINE

----- PSYCHROMETRIC STATE POINTS -----

Room 1

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	75.0	64.3	56.7	76.6	30.0	
Main System						
Return Air Heat Pickup						0.0
Return Fan						0.0
Return Air	75.0	64.3	56.7	76.6	30.0	
Outdoor Air	92.3	74.4	44.2	105.0	38.7	
Return/Outdoor Air Mix	75.0	64.3	56.7	76.6	30.0	
Blow through Fan						0.1
Entering Coil	75.1	64.3	56.5	76.6	30.0	
Leaving Coil	54.9	53.6	92.5	61.9	22.8	
Draw Through Fan						0.0
Duct Frictional Heat						0.1
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	55.0	53.7	92.2	61.9	22.8	
Supply Air	55.0	53.7	92.2	61.9	22.8	
Percent Outside Air		0.00	(%)			
sensible Heat Ratio (SHR)		0.672				
Percent Supply Air Bypassing Coil		0.00	(%)			
Coil Airflow		53,304	(Cfm)			

\*\*\*\*\*  
 \* THE PSYCHROMETRIC LOOP DID NOT CLOSE \*  
 \* SUPPLY AIR TEMPERATURE RESET \*  
 \*\*\*\*\*

ROOM PSYCHROMETRICS - ALTERNATIVE 1  
 G207 - BASELINE

----- PSYCHROMETRIC STATE POINTS -----

Room 2

	Dry Bulb (F)	Wet Bulb (F)	Relat. Humid. (%)	Humid. Ratio (GR)	Enthalpy (Btu/Lb)	Temp. Diff. (F)
Space	75.0	62.4	50.0	67.5	28.5	
<b>Main System</b>						
Return Air Heat Pickup						0.0
Return Fan						0.0
Return Air	75.0	62.4	50.0	67.5	28.5	
Outdoor Air	95.6	73.0	34.7	91.0	37.3	
Return/Outdoor Air Mix	75.0	62.4	50.0	67.5	28.5	
Blow through Fan						0.1
Entering Coil	75.1	62.4	49.9	67.5	28.6	
Leaving Coil	62.2	57.8	77.4	67.3	25.4	
Draw Through Fan						0.0
Duct Frictional Heat						0.1
Supply Duct Heat Gain						0.0
Cold Deck Supply Air	62.3	57.8	77.1	67.3	25.4	
Supply Air	62.3	57.8	77.1	67.3	25.4	
Percent Outside Air		0.00	(%)			
Sensible Heat Ratio (SHR)		0.973				
Percent Supply Air Bypassing Coil		0.00	(%)			
Coil Airflow		364,127	(Cfm)			

BUILDING U-VALUES - ALTERNATIVE 1  
 - BASELINE

----- B U I L D I N G U - V A L U E S -----

Room Number	Description	Room U-Values (Btu/hr/sqft/F)									Room Mass (lb/sqft)	Room Capac. (Btu/sqft/F)
		Part.	ExFlr	Summr Skylt	Wintr Skylt	Roof	Summr Windo	Wintr Windo	Wall	Ceil.		
1	LOWER LEVEL	0.000	0.630	0.000	0.000	0.000	1.200	1.333	0.184	0.000	14.3	2.77
Zone 1	Total/Ave.	0.000	0.630	0.000	0.000	0.000	1.200	1.333	0.184	0.000	14.3	2.77
2	UPPER LEVEL	0.000	0.000	0.000	0.000	0.518	0.490	0.511	0.184	0.000	13.5	5.81
Zone 2	Total/Ave.	0.000	0.000	0.000	0.000	0.518	0.490	0.511	0.184	0.000	13.5	5.81
System 1	Total/Ave.	0.000	0.630	0.000	0.000	0.518	0.605	0.644	0.184	0.000	13.9	4.29
Building		0.000	0.630	0.000	0.000	0.518	0.605	0.644	0.184	0.000	13.9	4.29

BUILDING AREAS - ALTERNATIVE 1  
 G207 - BASELINE

----- B U I L D I N G A R E A S -----

Room Number	Description	Number of Duplicate		Floor Area/Dupl Room (sqft)	Total Floor Area (sqft)	Partition Area (sqft)	Exposed Floor Area (sqft)	Skylight Area (sqft)	Skl /Rf (%)	Net Roof Area (sqft)	Window Area (sqft)	Win /Wl (%)	Net Wall Area (sqft)
		1	LOWER LEVEL	1	1	149,300	149,300	0	2,041	0	0	0	1,952
Zone 1	Total/Ave.				149,300	0	2,041	0	0	0	1,952	7	26,629
2	UPPER LEVEL	1	1	149,300	149,300	0	0	0	0	149,300	10,122	74	3,540
Zone 2	Total/Ave.				149,300	0	0	0	0	149,300	10,122	74	3,540
System 1	Total/Ave.				298,599	0	2,041	0	0	149,300	12,074	29	30,169
Building					298,599	0	2,041	0	0	149,300	12,074	29	30,169

ASHRAE 90 ANALYSIS - ALTERNATIVE 1  
 G207 - BASELINE

----- A S H R A E 9 0 A N A L Y S I S -----

Overall Roof U-Value = 0.518 (Btu/Hr/Sq Ft/F)  
 Overall Wall U-Value = 0.304 (Btu/Hr/Sq Ft/F)  
 Overall Building U-Value = 0.471 (Btu/Hr/Sq Ft/F)

Roof Overall Thermal Transfer Value (OTTvr) = 47.78 (Btu/Hr/Sq Ft)  
 Wall Overall Thermal Transfer Value (OTTvw) = 20.59 (Btu/Hr/Sq Ft)

;

SYSTEM LOAD PROFILE - ALTERNATIVE 1  
 G207 - BASELINE

Main System 1 FC FAN COIL

Percent Design Load	---- Cooling Load ----			----- Heating Load -----			---- Cooling Airflow ----			---- Heating Airflow ----		
	Cap. (Ton)	Hours (%)	Hours	Capacity (Btuh)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours	Cap. (Cfm)	Hours (%)	Hours
0 - 5	28.2	0	0	-150,000	7	158	20,871.5	0	0	0.0	0	0
5 - 10	56.4	0	0	-300,000	2	54	41,743.0	0	0	0.0	0	0
10 - 15	84.6	0	0	-450,000	9	225	62,614.5	0	0	0.0	0	0
15 - 20	112.7	0	0	-600,000	2	46	83,486.0	0	0	0.0	0	0
20 - 25	140.9	0	0	-750,000	2	44	104,357.5	0	0	0.0	0	0
25 - 30	169.1	0	0	-900,000	0	0	125,229.0	0	0	0.0	0	0
30 - 35	197.3	0	0	-1,050,000	3	83	146,100.5	0	0	0.0	0	0
35 - 40	225.5	0	0	-1,200,000	1	28	166,972.1	0	0	0.0	0	0
40 - 45	253.7	0	0	-1,350,000	3	67	187,843.6	0	0	0.0	0	0
45 - 50	281.8	0	0	-1,500,000	2	50	208,715.1	0	0	0.0	0	0
50 - 55	310.0	0	0	-1,650,000	2	51	229,586.6	0	0	0.0	0	0
55 - 60	338.2	0	0	-1,800,000	1	25	250,458.1	0	0	0.0	0	0
60 - 65	366.4	0	0	-1,950,000	1	30	271,329.6	0	0	0.0	0	0
65 - 70	394.6	0	0	-2,100,000	2	51	292,201.1	0	0	0.0	0	0
70 - 75	422.8	0	0	-2,250,000	2	50	313,072.7	0	0	0.0	0	0
75 - 80	451.0	0	0	-2,400,001	1	21	333,944.2	0	0	0.0	0	0
80 - 85	479.1	0	0	-2,550,000	4	90	354,815.7	0	0	0.0	0	0
85 - 90	507.3	0	0	-2,700,001	4	93	375,687.2	0	0	0.0	0	0
90 - 95	535.5	0	0	-2,850,000	1	24	396,558.7	0	0	0.0	0	0
95 - 100	563.7	0	0	-3,000,000	51	1,219	417,430.2	100	2,896	0.0	0	0
Hours Off	0.0	0	8,760	0	0	6,351	0.0	0	5,864	0.0	0	8,760

LOADING COOL-HEAT DEMAND - ALTERNATIVE 1  
 - BASELINE

January			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	33.4	30.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	32.1	29.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	31.7	29.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	31.9	29.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	32.6	30.3	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
6	33.6	31.3	-3,000,001	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
7	35.0	32.6	-3,000,001	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
8	36.6	34.4	-3,000,000	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
9	38.5	36.3	-3,000,000	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,001	0.0
10	40.4	37.7	-3,000,000	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,001	0.0	-2,999,999	0.0
11	42.3	38.7	-3,000,000	0.0	-3,000,000	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,000	0.0
12	44.2	39.6	-1,671,055	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
13	45.8	40.5	-390,510	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
14	47.2	41.1	-392,342	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
15	48.2	41.6	-390,206	0.0	-1,099,761	0.0	-3,000,000	0.0	-3,000,000	0.0	-1,311,497	0.0
16	48.9	41.8	-385,015	0.0	-1,029,321	0.0	-1,588,414	0.0	-1,588,414	0.0	-1,029,321	0.0
17	49.1	41.9	-383,084	0.0	-1,573,079	0.0	-1,846,474	0.0	-1,846,474	0.0	-1,573,079	0.0
18	48.7	41.9	-383,084	0.0	-2,046,448	0.0	-2,174,039	0.0	-2,174,039	0.0	-2,046,448	0.0
19	47.4	41.7	-2,010,847	0.0	-2,405,937	0.0	-2,405,937	0.0	-2,405,937	0.0	-2,405,937	0.0
20	45.5	40.5	-2,344,434	0.0	-2,558,474	0.0	-2,558,474	0.0	-2,558,474	0.0	-2,558,474	0.0
21	43.1	38.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	40.4	36.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	37.7	34.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	35.3	32.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

February			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	37.5	34.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	36.0	33.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	34.7	31.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	33.6	30.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	32.8	30.1	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
6	32.2	29.8	-3,000,001	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
7	32.1	29.6	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
8	32.5	30.3	-3,000,001	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,001	0.0	-2,999,999	0.0
9	33.9	31.6	-2,999,999	0.0	-2,999,999	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,001	0.0
10	36.0	33.0	-3,000,000	0.0	-3,000,001	0.0	-2,999,999	0.0	-2,999,999	0.0	-3,000,001	0.0
11	38.5	34.8	-3,000,000	0.0	-3,000,000	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,000	0.0
12	41.3	36.5	-2,178,139	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
13	43.8	38.1	-394,747	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
14	45.9	39.5	-396,207	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
15	47.2	40.4	-393,782	0.0	-1,323,369	0.0	-3,000,000	0.0	-3,000,000	0.0	-1,400,536	0.0
16	47.7	40.6	-387,556	0.0	-976,724	0.0	-1,609,438	0.0	-1,609,438	0.0	-976,724	0.0
17	47.5	40.2	-383,084	0.0	-1,377,560	0.0	-1,650,955	0.0	-1,650,955	0.0	-1,377,560	0.0
18	47.0	39.8	-383,084	0.0	-2,095,758	0.0	-2,223,348	0.0	-2,223,348	0.0	-2,095,758	0.0
19	46.2	39.9	-574,013	0.0	-2,435,463	0.0	-2,435,463	0.0	-2,435,463	0.0	-2,435,463	0.0
20	45.1	39.7	-2,426,448	0.0	-2,591,217	0.0	-2,591,217	0.0	-2,591,217	0.0	-2,591,217	0.0
21	43.8	39.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	42.3	38.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	40.7	37.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	39.1	35.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0



LOADING COOL-HEAT DEMAND - ALTERNATIVE 1  
 - BASELINE

May			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
	Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh
1	66.6	62.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	64.5	60.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	62.7	59.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	61.2	58.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	60.0	57.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
6	59.3	56.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
7	59.0	56.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
8	59.5	56.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
9	60.9	56.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
10	63.0	57.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
11	65.7	58.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
12	68.7	59.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
13	71.7	61.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
14	74.5	63.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
15	76.6	64.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
16	78.0	65.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
17	78.5	65.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
18	78.2	65.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
19	77.5	65.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
20	76.3	66.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
21	74.8	67.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	73.0	66.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	70.9	65.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	68.7	64.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

June			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
	Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh
1	73.0	67.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	71.2	66.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	69.7	65.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	68.5	64.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	67.8	64.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
6	67.6	64.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
7	68.1	64.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
8	69.4	65.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
9	71.6	66.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
10	74.2	67.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
11	77.2	68.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
12	80.2	70.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
13	82.8	70.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
14	85.0	71.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
15	86.3	72.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
16	86.8	72.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
17	86.6	71.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
18	85.8	71.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
19	84.7	71.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
20	83.2	71.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
21	81.4	71.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	79.3	71.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	77.2	70.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	75.1	69.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

BUILDING COOL-HEAT DEMAND - ALTERNATIVE 1  
 G207 - BASELINE

July			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	72.0	69.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	70.5	68.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	69.4	67.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	68.5	66.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	67.9	66.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
6	67.7	65.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
7	68.1	66.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
8	69.1	67.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
9	70.8	68.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
10	72.9	69.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
11	75.2	70.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
12	77.5	71.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
13	79.6	72.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
14	81.3	73.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
15	82.3	73.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
16	82.7	73.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
17	82.5	73.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
18	82.0	72.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
19	81.1	73.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
20	79.9	73.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
21	78.5	73.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	76.9	73.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	75.2	71.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	73.5	70.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

August			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB	OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	72.7	70.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	71.2	69.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	69.9	68.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	68.8	67.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	68.0	66.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
6	67.5	66.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
7	67.3	66.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
8	67.8	66.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
9	69.1	67.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
10	71.2	67.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
11	73.8	68.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
12	76.5	70.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
13	79.1	71.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
14	81.1	72.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
15	82.5	73.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
16	83.0	73.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
17	82.8	73.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
18	82.3	73.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
19	81.5	73.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
20	80.4	73.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
21	79.1	74.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	77.6	73.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	76.0	72.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	74.3	71.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0



LOADING COOL-HEAT DEMAND - ALTERNATIVE 1  
 - BASELINE

September			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	QADB	QAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	69.8	66.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	68.0	64.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	66.3	63.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	64.9	61.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	63.9	61.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
6	63.2	61.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
7	63.0	60.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
8	63.4	61.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
9	64.7	61.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
10	66.6	62.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
11	69.1	62.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
12	71.8	63.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
13	74.5	65.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
14	77.0	67.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
15	78.9	68.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
16	80.2	68.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
17	80.6	68.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
18	80.4	68.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
19	79.7	70.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
20	78.7	71.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
21	77.3	71.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	75.6	70.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	73.7	69.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	71.8	67.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

October			----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	QADB	QAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	54.8	51.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	52.9	49.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	51.2	48.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	49.8	47.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	48.8	46.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
6	48.2	45.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
7	47.9	45.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
8	48.5	46.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
9	50.3	47.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
10	52.9	48.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
11	56.2	49.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
12	59.6	51.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
13	62.9	53.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
14	65.5	55.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
15	67.3	56.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
16	67.9	56.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
17	67.7	56.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
18	67.0	56.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
19	66.0	57.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
20	64.6	57.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
21	62.9	57.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	61.0	56.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	59.0	54.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	56.9	53.0	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

BUILDING COOL-HEAT DEMAND - ALTERNATIVE 1  
 G207 - BASELINE

November		----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	48.7 45.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	46.9 44.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	45.5 42.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	44.6 41.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	44.4 42.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,001	0.0	-3,000,001	0.0	-3,000,001	0.0
6	44.8 42.7	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
7	45.9 43.9	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
8	47.8 46.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
9	50.2 48.0	-2,814,831	0.0	-2,961,015	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
10	52.9 49.9	-388,778	0.0	-2,267,478	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
11	55.8 51.1	-395,912	0.0	-32,391	0.0	-2,598,462	0.0	-2,598,462	0.0	-1,447,584	0.0
12	58.5 52.0	-133,777	0.0	0	0.0	-384,338	0.0	-384,338	0.0	-388,012	0.0
13	60.9 52.5	-20,096	0.0	0	0.0	0	0.0	0	0.0	0	0.0
14	62.8 53.4	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
15	64.0 53.8	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
16	64.4 53.9	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
17	64.1 53.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
18	63.2 53.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
19	61.8 54.2	0	0.0	0	0.0	-474,221	0.0	-474,221	0.0	0	0.0
20	60.0 53.6	0	0.0	-58,062	0.0	-901,728	0.0	-901,728	0.0	-86,890	0.0
21	57.9 52.7	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	55.6 51.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	53.2 49.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	50.8 47.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

December		----- Design -----		----- Weekday -----		----- Saturday-----		----- Sunday -----		----- Monday -----	
Hour	OADB OAWB	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton	Htg Btuh	Clg Ton
1	37.5 35.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
2	37.1 35.1	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
3	37.4 35.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
4	38.1 36.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
5	39.3 37.6	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
6	40.9 39.2	-2,999,999	0.0	-3,000,001	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
7	42.7 41.2	-3,000,000	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
8	44.7 43.1	-3,000,000	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0	-2,999,999	0.0
9	46.8 45.3	-3,000,000	0.0	-3,000,000	0.0	-2,999,999	0.0	-2,999,999	0.0	-3,000,001	0.0
10	48.8 47.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
11	50.7 48.1	-2,096,926	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
12	52.2 48.8	-390,730	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0	-3,000,000	0.0
13	53.4 49.2	-393,308	0.0	-659,574	0.0	-2,803,254	0.0	-2,803,254	0.0	-1,267,444	0.0
14	54.1 49.2	-394,881	0.0	-384,877	0.0	-558,911	0.0	-558,911	0.0	-384,877	0.0
15	54.4 48.9	-391,496	0.0	-383,253	0.0	-697,244	0.0	-697,244	0.0	-383,253	0.0
16	54.0 48.2	-384,937	0.0	-583,874	0.0	-1,101,573	0.0	-1,101,573	0.0	-583,874	0.0
17	53.0 47.3	-272,044	0.0	-1,313,488	0.0	-1,586,892	0.0	-1,586,892	0.0	-1,313,488	0.0
18	51.4 46.3	-224,380	0.0	-1,860,370	0.0	-1,987,960	0.0	-1,987,960	0.0	-1,860,370	0.0
19	49.3 45.4	-334,305	0.0	-2,151,766	0.0	-2,151,766	0.0	-2,151,766	0.0	-2,151,766	0.0
20	47.0 43.5	-1,633,814	0.0	-2,401,953	0.0	-2,401,953	0.0	-2,401,953	0.0	-2,401,953	0.0
21	44.5 41.5	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
22	42.2 39.3	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
23	40.1 37.6	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0
24	38.5 36.2	0	0.0	0	0.0	0	0.0	0	0.0	0	0.0

BUILDING TEMPERATURE PROFILES - ALTERNATIVE 1  
 BASELINE

----- BUILDING TEMPERATURE PROFILES -----

Temperature ----- Room Number -----  
 Range 1 2  
 (F)

Max. Temp. 85.8 103.2  
 Mo./Hr. 7 19 6 18  
 Day Type 1 1

----- Number of Hours -----

Above 100 0 0  
 95 - 100 0 0  
 90 - 95 0 336  
 85 - 90 0 679  
 80 - 85 1,610 1,053  
 75 - 80 1,193 1,124  
 70 - 75 903 939  
 65 - 70 1,360 2,056  
 60 - 65 2,100 1,034  
 55 - 60 1,267 850  
 50 - 55 327 585  
 Low 50 0 104

Min. Temp. 53.0 48.2  
 Mo./Hr. 2 6 1 4  
 Day Type 5 3

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
G207 - BASELINE

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	On Peak (Thrm/hr)
Jan	53,781	165	16,144	38
Feb	48,608	165	14,588	38
March	55,757	165	8,987	38
April	50,125	165	2,617	38
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	50,569	165	7,255	38
Dec	52,793	165	13,585	38
Total	462,663	165	63,177	38

Building Energy Consumption = 26,446 (Btu/Sq Ft/Year)  
Source Energy Consumption = 38,138 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 - BASELINE

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	26585	24012	26585	25727	0	0	0	0	0	0	25727	26585	155,220
	PK	53.6	53.6	53.6	53.6	0.0	0.0	0.0	0.0	0.0	0.0	53.6	53.6	53.6
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
				GAS FIRE TUBE HOT WATER										
	GAS	16144	14588	8987	2617	0	0	0	0	0	0	7255	13585	63,177
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
				HEAT WATER CIRC. PUMP C.V.										
	ELEC	740	668	740	237	0	0	0	0	0	0	370	740	3,494
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0	1.5	1.5	1.5
1	EQ5240													
				BOILER FORCED DRAFT FAN										
	ELEC	1488	1344	1488	477	0	0	0	0	0	0	744	1488	7,029
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - BASELINE

----- UTILITY PEAK CHECKSUMS -----

Utility ELECTRIC DEMAND

Peak Value 165.4 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.02

Sub Total 5.0 3.02

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 53.6 32.41

Sub Total 53.6 32.41

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 64.58

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 64.58

Grand Total 165.4 100.00



CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 - BASELINE

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,200.5	6,317,652.5	80.4	6,734,134.0	23.1
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	155,220.0	0.0	6.7	1,589,456.1	5.5
Circulation Pumps	3,494.4	0.0	0.2	35,782.3	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	158,714.3	0.0	6.9	1,625,238.5	5.6
Lighting	295,748.6	0.0	12.8	3,028,472.3	10.1
Receptacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	462,663.4	6,317,652.5	100.0	11,387,845.0	38.8

t

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 G207 - WALL INSULATION

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	On Peak (Thrm/hr)
Jan	53,281	164	15,930	38
Feb	48,156	164	14,392	38
March	55,257	164	8,951	38
April	49,641	164	2,617	38
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	50,085	164	7,172	38
Dec	52,293	164	13,353	38
Total	459,743	164	62,416	38

Building Energy Consumption = 26,158 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 37,769 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 G207 - WALL INSULATION

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOYH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	26085	23560	26085	25243	0	0	0	0	0	0	25243	26085	152,300
	PK	52.6	52.6	52.6	52.6	0.0	0.0	0.0	0.0	0.0	0.0	52.6	52.6	52.6
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
				GAS FIRE TUBE HOT WATER										
	GAS	15930	14392	8951	2617	0	0	0	0	0	0	7172	13353	62,416
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
				HEAT WATER CIRC. PUMP C.V.										
	ELEC	740	668	740	237	0	0	0	0	0	0	370	740	3,494
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0	1.5	1.5	1.5
1	EQ5240													
				BOILER FORCED DRAFT FAN										
	ELEC	1488	1344	1488	477	0	0	0	0	0	0	744	1488	7,029
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
G207 - WALL INSULATION

1	EQ5307	BOILER CONTROLS												
	ELEC	248	224	248	80	0	0	0	0	0	0	124	248	1,172
	PK	0.5	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.5	0.5

UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - WALL INSULATION

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 164.4 (kW)

Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.04

Sub Total 5.0 3.04

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 52.6 31.99

Sub Total 52.6 31.99

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 64.97

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 64.97

Grand Total 164.4 100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 G207 - WALL INSULATION

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- E N E R G Y U S E S U M M A R Y -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,200.5	6,241,558.5	80.3	6,654,035.0	22.8
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	152,300.0	0.0	6.7	1,559,555.4	5.4
Circulation Pumps	3,494.4	0.0	0.2	35,782.3	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	155,794.3	0.0	6.8	1,595,337.8	5.5
Lighting	295,748.6	0.0	12.9	3,028,472.3	10.1
Receptacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	459,743.4	6,241,558.5	100.0	11,277,845.0	38.5

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 G207 - ROOF INSULATION

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	On Peak (Thrm/hr)
Jan	35,407	128	6,496	38
Feb	32,013	128	6,603	38
March	36,610	128	2,643	38
April	31,705	128	49	16
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	32,499	128	1,419	38
Dec	34,320	128	4,875	38
Total	353,584	128	22,084	38

Building Energy Consumption = 11,437 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 19,911 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 G207 - ROOF INSULATION

----- E Q U I P M E N T   E N E R G Y   C O N S U M P T I O N -----

Ref Num	Equip Code	Monthly Consumption												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTW2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
	ELEC			FC CENTRIF. FAN C.V.										
	PK	8211	7417	8211	7946	0	0	0	0	0	0	7946	8211	47,943
		16.6	16.6	16.6	16.6	0.0	0.0	0.0	0.0	0.0	0.0	16.6	16.6	16.6
1	EQ4003													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
	GAS	6496	6603	2643	49	0	0	0	0	0	0	1419	4875	22,084
	PK	37.5	37.5	37.5	15.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
	ELEC	740	668	509	46	0	0	0	0	0	0	283	710	2,956
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0	1.5	1.5	1.5
1	EQ5240													
	ELEC	1488	1344	1023	93	0	0	0	0	0	0	570	1428	5,946
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0



EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
G207 - ROOF INSULATION

1	EQ5307														
	ELEC	248	224	170	15	0	0	0	0	0	0	95	238		991
	PK	0.5	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.5		0.5

Trane Air Conditioning Economics  
By: Trane Customer Direct Service Network

UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - ROOF INSULATION

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 128.4 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.89

Sub Total 5.0 3.89

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 16.6 12.90

Sub Total 16.6 12.90

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 83.21

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 83.21

Grand Total 128.4 100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 G207 - ROOF INSULATION

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	6,937.0	2,208,441.5	65.4	2,395,710.2	8.2
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	47,942.7	0.0	4.8	490,934.5	1.7
Circulation Pumps	2,956.0	0.0	0.3	30,269.1	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	50,898.7	0.0	5.1	521,203.6	1.8
Lighting	295,748.6	0.0	29.6	3,028,472.3	10.1
Receptacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	353,584.3	2,208,441.5	100.0	5,945,386.5	20.2

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
G207 - INSULATED GLASS

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	GAS DMND On Peak (Thrm/hr)
Jan	53,667	165	16,093	38
Feb	48,505	165	14,541	38
March	55,643	165	8,912	38
April	50,015	165	2,605	38
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	50,459	165	7,198	38
Dec	52,679	165	13,527	38
Total	461,999	165	62,875	38

Building Energy Consumption = 26,337 (Btu/Sq Ft/Year)  
Source Energy Consumption = 38,009 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 - INSULATED GLASS

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
	ELEC	26471	23909	26471	25617	0	0	0	0	0	0	25617	26471	154,556
	PK	53.4	53.4	53.4	53.4	0.0	0.0	0.0	0.0	0.0	0.0	53.4	53.4	53.4
1	EQ4003													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
	GAS	16093	14541	8912	2605	0	0	0	0	0	0	7198	13527	62,875
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
	ELEC	740	668	740	237	0	0	0	0	0	0	370	740	3,494
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0	1.5	1.5	1.5
1	EQ5240													
	ELEC	1488	1344	1488	477	0	0	0	0	0	0	744	1488	7,029
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - INSULATED GLASS

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 165.2 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.02

Sub Total 5.0 3.02

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 53.4 32.31

Sub Total 53.4 32.31

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 64.67

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 64.67

Grand Total 165.2 100.00



CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 - INSULATED GLASS

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,200.5	6,287,502.0	80.3	6,702,396.5	23.0
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	154,555.8	0.0	6.7	1,582,654.9	5.4
Circulation Pumps	3,494.4	0.0	0.2	35,782.3	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	158,050.1	0.0	6.9	1,618,437.1	5.6
Lighting	295,748.6	0.0	12.8	3,028,472.3	10.1
Spectacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	461,999.2	6,287,502.0	100.0	11,349,306.0	38.7

†

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
G207 - WEATHERSTRIP AND CAULK

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	GAS DMND On Peak (Thrm/hr)
Jan	53,750	165	16,131	38
Feb	48,581	165	14,575	38
March	55,726	165	8,969	38
April	50,095	165	2,614	38
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	50,540	165	7,246	38
Dec	52,762	165	13,569	38
Total	462,485	165	63,104	38

Building Energy Consumption = 26,420 (Btu/Sq Ft/Year)  
Source Energy Consumption = 38,106 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 - WEATHERSTRIP AND CAULK

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	26554	23984	26554	25697	0	0	0	0	0	0	25697	26554	155,041
	PK	53.5	53.5	53.5	53.5	0.0	0.0	0.0	0.0	0.0	0.0	53.5	53.5	53.5
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
				GAS FIRE TUBE HOT WATER										
	GAS	16131	14575	8969	2614	0	0	0	0	0	0	7246	13569	63,104
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
				HEAT WATER CIRC. PUMP C.V.										
	ELEC	740	668	740	237	0	0	0	0	0	0	370	740	3,494
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0	1.5	1.5	1.5
1	EQ5240													
				BOILER FORCED DRAFT FAN										
	ELEC	1488	1344	1488	477	0	0	0	0	0	0	744	1488	7,029
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - WEATHERSTRIP AND CAULK

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 165.3 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.02

Sub Total 5.0 3.02

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 53.5 32.38

Sub Total 53.5 32.38

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 64.60

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 64.60

Grand Total 165.3 100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 - WEATHERSTRIP AND CAULK

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,200.5	6,310,442.0	80.3	6,726,544.0	23.1
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	155,041.5	0.0	6.7	1,587,628.2	5.4
Circulation Pumps	3,494.4	0.0	0.2	35,782.3	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	158,535.8	0.0	6.9	1,623,410.6	5.6
Lighting	295,748.6	0.0	12.8	3,028,472.3	10.1
Receptacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	462,484.9	6,310,442.0	100.0	11,378,427.0	38.8

t

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 G207 - DESTRATIFICATION FANS

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Therm)	On Peak (Thrm/hr)
Jan	53,781	165	15,169	38
Feb	48,608	165	13,708	38
March	55,757	165	8,329	38
April	49,965	165	1,826	38
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	50,420	165	6,496	38
Dec	52,793	165	12,541	38
Total	462,354	165	58,068	38

Building Energy Consumption = 24,732 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 36,326 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)



EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 - DESTRATIFICATION FANS

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	26585	24012	26585	25727	0	0	0	0	0	25727	26585		155,220
	PK	53.6	53.6	53.6	53.6	0.0	0.0	0.0	0.0	0.0	53.6	53.6		53.6
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0		0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0
1	EQ2001													
				GAS FIRE TUBE HOT WATER										
	GAS	15169	13708	8329	1826	0	0	0	0	0	6496	12541		58,068
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	37.5	37.5		37.5
1	EQ5020													
				HEAT WATER CIRC. PUMP C.V.										
	ELEC	740	668	740	189	0	0	0	0	0	325	740		3,402
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	1.5	1.5		1.5
1	EQ5240													
				BOILER FORCED DRAFT FAN										
	ELEC	1488	1344	1488	381	0	0	0	0	0	654	1488		6,843
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0		3.0





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - DESTRATIFICATION FANS

----- UTILITY PEAK CHECKSUMS -----

Utility ELECTRIC DEMAND

Peak Value 165.4 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.02

Sub Total 5.0 3.02

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 53.6 32.41

Sub Total 53.6 32.41

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 64.58

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 64.58

Grand Total 165.4 100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 - DESTRATIFICATION FANS

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	7,983.5	5,806,826.5	79.0	6,194,200.5	21.3
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	155,220.0	0.0	7.2	1,589,456.1	5.5
Circulation Pumps	3,401.9	0.0	0.2	34,835.5	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	158,621.9	0.0	7.3	1,624,291.6	5.6
Lighting	295,748.6	0.0	13.7	3,028,472.3	10.1
Receptacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	462,353.9	5,806,826.5	100.0	10,846,964.0	37.0

†

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
G207 - LOADING DOCK SEALS

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	GAS DMND On Peak (Thrm/hr)
Jan	52,297	162	15,406	38
Feb	47,268	162	13,930	38
March	54,233	162	8,365	38
April	48,644	157	2,571	38
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	49,053	162	6,761	38
Dec	51,309	162	12,780	38
Total	453,835	162	59,813	38

Building Energy Consumption = 25,219 (Btu/Sq Ft/Year)  
Source Energy Consumption = 36,649 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 G... LOADING DOCK SEALS

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
	ELEC	25101	22672	25101	24291	0	0	0	0	0	0	24291	25101	146,557
	PK	50.6	50.6	50.6	50.6	0.0	0.0	0.0	0.0	0.0	0.0	50.6	50.6	50.6
1	EQ4003													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
	GAS	15406	13930	8365	2571	0	0	0	0	0	0	6761	12780	59,813
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
	ELEC	740	668	728	224	0	0	0	0	0	0	346	740	3,445
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0	1.5	1.5	1.5
1	EQ5240													
	ELEC	1488	1344	1464	450	0	0	0	0	0	0	696	1488	6,930
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0







UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - LOADING DOCK SEALS

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 162.4 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.07

Sub Total 5.0 3.07

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 50.6 31.16

Sub Total 50.6 31.16

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 65.77

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 65.77

Grand Total 162.4 100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 - LOADING DOCK SEALS

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,085.0	5,981,312.5	79.8	6,378,909.0	21.9
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	146,556.5	0.0	6.6	1,500,742.1	5.2
Circulation Pumps	3,445.1	0.0	0.2	35,278.3	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	150,001.7	0.0	6.8	1,536,020.5	5.3
Lighting	295,748.6	0.0	13.4	3,028,472.3	10.1
Fixture	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	453,835.2	5,981,312.5	100.0	10,943,402.0	37.3

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 G207 - REDUCED LIGHTS

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC	DEMAND	GAS	GAS DMND
	On Peak (kWh)	On Peak (kW)	On Peak (Thrm)	On Peak (Thrm/hr)
Jan	41,477	114	16,590	38
Feb	37,480	114	14,990	38
March	42,544	114	9,260	38
April	38,339	114	2,801	38
May	13,883	58	0	0
June	13,813	58	0	0
July	12,816	58	0	0
Aug	14,416	58	0	0
Sept	12,746	58	0	0
Oct	13,883	58	0	0
Nov	38,888	114	7,627	38
Dec	40,943	114	14,058	38
Total	321,228	114	65,325	38

Building Energy Consumption = 25,549 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 34,045 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 - REDUCED LIGHTS

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	13349	12074	14416	12746	13883	13813	12816	14416	12746	13883	12746	12816	159,705
	PK	57.7	57.7	57.7	57.7	57.7	57.7	57.7	57.7	57.7	57.7	57.7	57.7	57.7
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	25652	23169	25652	24824	0	0	0	0	0	0	24824	25652	149,773
	PK	51.7	51.7	51.7	51.7	0.0	0.0	0.0	0.0	0.0	0.0	51.7	51.7	51.7
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
				GAS FIRE TUBE HOT WATER										
	GAS	16590	14990	9260	2801	0	0	0	0	0	0	7627	14058	65,325
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
				HEAT WATER CIRC. PUMP C.V.										
	ELEC	740	668	740	230	0	0	0	0	0	0	394	740	3,511
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0	1.5	1.5	1.5
1	EQ5240													
				BOILER FORCED DRAFT FAN										
	ELEC	1488	1344	1488	462	0	0	0	0	0	0	792	1488	7,062
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0



EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
REDUCED LIGHTS

ELEC	248	224	248	77	0	0	0	0	0	0	132	248	1,177
PK	0.5	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.5	0.5

UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - REDUCED LIGHTS

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 114.4 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 4.36

Sub Total 5.0 4.36

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 51.7 45.21

Sub Total 51.7 45.21

Sub Total 0.0 0.00

Miscellaneous

Lights 57.7 50.42

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 57.7 50.42

Grand Total 114.4 100.00



CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 - REDUCED LIGHTS

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	8,239.0	6,532,541.5	86.0	6,960,727.0	23.9
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	149,773.1	0.0	6.7	1,533,680.0	5.3
Circulation Pumps	3,510.8	0.0	0.2	35,950.3	0.1
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	153,283.9	0.0	6.9	1,569,630.4	5.4
Lighting	159,704.8	0.0	7.1	1,635,380.9	5.5
Spectacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	321,227.7	6,532,541.5	100.0	10,165,738.0	34.8

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
 G207 - CONTINUOUS BOILER OPERATION

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	GAS DMND On Peak (Thrm/hr)
Jan	68,311	165	22,920	38
Feb	61,732	165	20,717	38
March	69,553	165	13,004	38
April	63,198	165	2,638	23
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	64,541	165	10,332	38
Dec	67,308	165	19,450	38
Total	545,674	165	89,060	38

Building Energy Consumption = 36,063 (Btu/Sq Ft/Year)  
 Source Energy Consumption = 50,109 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)

EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 - CONTINUOUS BOILER OPERATION

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	----- Monthly Consumption -----												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	39877	36018	39877	38591	0	0	0	0	0	38591	39877		232,830
	PK	53.6	53.6	53.6	53.6	0.0	0.0	0.0	0.0	0.0	53.6	53.6		53.6
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0		0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0
1	EQ2001													
				GAS FIRE TUBE HOT WATER										
	GAS	22920	20717	13004	2638	0	0	0	0	0	10332	19450		89,060
	PK	37.5	37.5	37.5	23.3	0.0	0.0	0.0	0.0	0.0	37.5	37.5		37.5
1	EQ5020													
				HEAT WATER CIRC. PUMP C.V.										
	ELEC	1110	1002	890	300	0	0	0	0	0	701	1105		5,108
	PK	1.5	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	1.5	1.5		1.5
1	EQ5240													
				BOILER FORCED DRAFT FAN										
	ELEC	2232	2016	1791	603	0	0	0	0	0	1410	2223		10,275
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0		3.0





UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - CONTINUOUS BOILER OPERATION

----- U T I L I T Y P E A K C H E C K S U M S -----

Utility ELECTRIC DEMAND

Peak Value 165.4 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 5.0 3.02

Sub Total 5.0 3.02

Air Moving Equipment

1 SUMMATION OF FAN ELECTRICAL DEMAND 53.6 32.41

Sub Total 53.6 32.41

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 64.58

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 64.58

Grand Total 165.4 100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 CONTINUOUS BOILER OPERATION

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	11,987.5	8,905,955.0	83.1	9,497,442.0	32.6
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	232,829.7	0.0	7.4	2,384,181.7	8.2
Circulation Pumps	5,108.1	0.0	0.2	52,306.7	0.2
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	237,937.8	0.0	7.5	2,436,488.3	8.4
Lighting	295,748.6	0.0	9.4	3,028,472.3	10.1
Refrigeration	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	545,673.8	8,905,955.0	100.0	14,962,402.0	51.1

†

MONTHLY ENERGY CONSUMPTION - ALTERNATIVE 1  
G207 - RADIANT HEATERS

----- MONTHLY ENERGY CONSUMPTION -----

Month	ELEC On Peak (kWh)	DEMAND On Peak (kW)	GAS On Peak (Therm)	GAS DMND On Peak (Thrm/hr)
Jan	26,456	110	15,662	38
Feb	23,928	110	14,157	38
March	28,282	110	8,427	38
April	24,059	110	2,155	38
May	25,708	107	0	0
June	25,580	107	0	0
July	23,733	107	0	0
Aug	26,696	107	0	0
Sept	23,604	107	0	0
Oct	25,708	107	0	0
Nov	24,318	110	6,641	38
Dec	25,469	110	13,066	38
Total	303,543	110	60,108	38

Building Energy Consumption = 23,599 (Btu/Sq Ft/Year)  
Source Energy Consumption = 31,599 (Btu/Sq Ft/Year)

Floor Area = 298,599 (Sq Ft)



EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
 - RADIANT HEATERS

----- EQUIPMENT ENERGY CONSUMPTION -----

Ref Num	Equip Code	Monthly Consumption												Total
		Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec	
0	LIGHTS													
	ELEC	24720	22360	26696	23604	25708	25580	23733	26696	23604	25708	23604	23733	295,749
	PK	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8	106.8
1	MISC LD													
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2	MISC LD													
	GAS	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	MISC LD													
	OIL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	MISC LD													
	P STEAM	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	MISC LD													
	P HOTH2O	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	MISC LD													
	P CHILL	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ4003													
				FC CENTRIF. FAN C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ2001													
				GAS FIRE TUBE HOT WATER										
	GAS	15662	14157	8427	2155	0	0	0	0	0	0	6641	13066	60,108
	PK	37.5	37.5	37.5	37.5	0.0	0.0	0.0	0.0	0.0	0.0	37.5	37.5	37.5
1	EQ5020													
				HEAT WATER CIRC. PUMP C.V.										
	ELEC	0	0	0	0	0	0	0	0	0	0	0	0	0
	PK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1	EQ5240													
				BOILER FORCED DRAFT FAN										
	ELEC	1488	1344	1359	390	0	0	0	0	0	0	612	1488	6,681
	PK	3.0	3.0	3.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0	3.0



EQUIPMENT ENERGY CONSUMPTION - ALTERNATIVE 1  
- RADIANT HEATERS

ELEC	248	224	226	65	0	0	0	0	0	0	102	248	1,113
PK	0.5	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.5	0.5

UTILITY PEAK CHECKSUMS - ALTERNATIVE 1  
G207 - RADIANT HEATERS

----- UTILITY PEAK CHECKSUMS -----

Utility ELECTRIC DEMAND

Peak Value 110.3 (kW)  
Yearly Time of Peak 9 (hr) 1 (mo)

Hour 9 Month 1

Sub Total 0.0 0.00

Heating Equipment

1 EQ2001 GAS FIRE TUBE HOT WATER 3.5 3.17

Sub Total 3.5 3.17

Sub Total 0.0 0.00

Sub Total 0.0 0.00

Miscellaneous

Lights 106.8 96.83

Base Utilities 0.0 0.00

Misc Equipment 0.0 0.00

Sub Total 106.8 96.83

Grand Total 110.3 100.00

CALIFORNIA TITLE 24 COMPLIANCE - ALTERNATIVE 1  
 7 - RADIANT HEATERS

----- CALIFORNIA TITLE 24 COMPLIANCE REPORT -----

Weather Name ..... ATLANTA.  
 Gross Conditioned Floor Area (sqft)..... 298,599  
 ACM Multiplier ..... 1.025

----- ENERGY USE SUMMARY -----

	ELEC (kWh/yr)	GAS (kBtu/yr)	PERCENT OF TOTAL ENERGY (%)	TOTAL SOURCE ENERGY (kBtu/yr)	ADJUSTED UNIT SOURCE ENERGY (kBtu/yr-sf)
Primary Heating	7,794.5	6,010,785.0	85.7	6,406,958.0	22.0
Primary Cooling					
Compressor	0.0	0.0	0.0	0.0	0.0
Tower/Cond Fans	0.0	0.0	0.0	0.0	0.0
Condenser Pump	0.0	0.0	0.0	0.0	0.0
Other Accessories	0.0	0.0	0.0	0.0	0.0
Auxiliary					
Supply Fans	0.0	0.0	0.0	0.0	0.0
Circulation Pumps	0.0	0.0	0.0	0.0	0.0
Base Utilities	0.0	0.0	0.0	0.0	0.0
Subtotal	0.0	0.0	0.0	0.0	0.0
Lighting	295,748.6	0.0	14.3	3,028,472.3	10.1
Receptacle	0.0	0.0	0.0	0.0	0.0
Domestic Hot Water	0.0	0.0	0.0	0.0	0.0
Cogeneration	0.0	0.0	0.0	0.0	0.0
Totals	303,543.1	6,010,785.0	100.0	9,435,430.0	32.1

‡

APPENDIX F  
FIELD SURVEY DATA



A Division of OMEGA ENGINEERING, Inc.

One Omega Circle  
Pureland Industrial Park  
P.O. Box 336  
Bridgeport, NJ 08014  
(609) 467-4200

C E R T I F I C A T E   O F   C A L I B R A T I O N

f o r

EMC ENGINEERS  
1950 SPECTRUM CIRCLE  
SUITE 312  
MARIETTA, GA 30067

Cust PO# 62584                      Model# HH-23  
Omega WO# 202992981                Serial# T-54474

C A L - 3

OMEGA Process Controls Inc certifies that the above instrumentation has been calibrated to meet or exceed the published specifications. This calibration was performed using instrumentation and standards that are traceable to the United States National Institute of Standards and Technology, and is in compliance with MIL-STD-45662A.

Readings Observed in: Fahrenheit

STANDARD	AS RECEIVED	FINAL CAL
32	32.5	32.0
900	900.8	900.4
1800	1800.4	1800.0

TEST EQUIPMENT

Fluke 8860A Digit Multimeter, S/N 3335023  
Analogic AN-3100 DC Standard, S/N 7904379  
Gen Res RDS63-A Dec Resistor, S/N 591  
Omega TRC-III Ice Point Cell, S/N 003

NIST(NBS)

245516  
245516  
241457  
241457

TEST CONDITIONS

Temp: 23C      Rel Hum: 26%

CERTIFIED BY  
John L. Howard

Instrumentation Supervisor

BUILDING 101



EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/2/92

BLDG.# 101  
 ECO 1

WALL & ROOF INSULATION

AREAS IN SQ. FEET	NORTH	SOUTH	EAST	WEST
WALLS				
WINDOWS				
OVERHEAD DOORS				
PERSONNEL DOORS				

SKETCH WALL CROSS-SECTION	COMPONENTS
	1. OUTSIDE AIR FILM 2. _____ 3. _____ 4. _____ 5. _____ 6. _____ 7. INSIDE AIR FILM

SKETCH ROOF CROSS-SECTION	COMPONENTS
	1. OUTSIDE AIR FILM 2. _____ 3. _____ 4. _____ 5. _____ 6. _____ 7. INSIDE AIR FILM

PERSONNEL DOOR TYPE _____	BASEMENT [ ] SLAB [ ] CRAWL SPACE [ ]
OVERHEAD DOOR TYPE _____	

COMMENTS: 2<sup>nd</sup> & 3<sup>rd</sup> floor have R-19 6 1/4" INSULATION ABOVE DROP CEILING.

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB  
PROJ.#  
SHEET NO.  
CALCULATED BY:  
CHECKED BY:  
DATE

Ft. McPherson/Ft. Gillem Energy Study  
EMC # 3105.000

OF  
JW  
12/92

BLDG.# 5101  
ECO 1

PIPE INSULATION

LOCATION	PIPE DIAMETER	PIPE LENGTH	FLUID TYPE	FLUID TEMP.	AIR TEMP.	INSULATION TYPE	INSULATION THICKNESS	INSULATION CONDITION
WEST BASEMENT MECH. ROOM	2 1"		STEAM			1" FIBERGLASS	1"	EXCEL
11	4"		DTW S/R			2" FIBERGLASS	2"	FAIR
11	2"		HW S/R			FIBERGLASS	1"	EXCEL
11	1"		CONDENSATE SUPPLY & RETURN			FIBERGLASS	1"	EXCEL
11	3"		CHW S/R			1" 2"	2"	EXCEL

COMMENTS: BOILER STACKS WELL INSULATED. ALL PIPE INSULATION AVERAGES VERY GOOD.

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. OF

CALCULATED BY: JW

CHECKED BY: 1/2/92  
DATE:

BLDG.# 101  
ECO 2

WINDOWS SURVEY

WINDOW NO.	SINGLE/DOUBLE PANE	TYPE - SLIDING FIXED, CASEMENT	FRAME MAT'L	ORIENTATION	GLASS SHADING	WINDOW COVER	DIMENSIONS (INCH)
	SINGLE	CASEMENT	METAL	S	NONE	BLINDS SHADE	39 42 X 84

COMMENTS:

BLDG.# 101  
ECO 3

WEATHERSTRIPING AND CAULKING

	DOOR/ WINDOW	CONDITION OF W.S./CAULK	INFILTRATION	ORIENTATION	DIMENSIONS (INCH)	#
①	D	NONE	<del>LOW</del> HIGH	SOUTH	39x84	1
	W	<del>LOW</del> SEALE <sup>D</sup> PAINT	LOW	SOUTH	48x84	
②	D	NONE	VERY HIGH	SW	60x84	1
③	D	POOR	HIGH	MAIN EAST ENTRANCE	60x84	3
④	W	<del>NONE</del> SEALE <sup>D</sup> PAINT	MED	1 <sup>ST</sup> EAST INFO. ADMIN. DIV	48x84	
	D	NONE	MED	<del>LOW</del> 1 <sup>ST</sup> NW	60x84	1
	<del>W</del>					

COMMENTS:  
 ① DOOR HAS 1/2" AIR GAP ON BOTTOM  
 WINDOW IN DEPUTY COMMANDER (2-112) HAS FAULTY LOCK ON EAST WALL CAUSING HIGH INFILTRATION. ② DOUBLE DOOR DOES NOT SHUT COMPLETELY LEAVING 1/4"-1/2" AIR GAP IN MIDDLE AND TOP.  
 ③ FRONT DOORS HAVE VESTIBULE BUT NEITHER OUTSIDE NOR INTERNAL DOORS ARE SEALED CAUSING HIGH INFILTRATION. ALL 3 INTERNAL DOORS HAVE 1/2" AIR GAP ON BOTTOM. ④ TWO WINDOWS IN THIS ROOM ARE SPRUNG OPEN AND HAVE BEEN TAPED SHUT. THIS IS THE CASE IN MANY OTHER ROOMS HOWEVER, NO ONE HAS TAPED THEM UP.

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/2/92

BLDG.# 101  
ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
WEST BASEMENT MECH. ROOM	150°F
1 <sup>st</sup> floor WEST MEN'S ROOM	141°F
PROBLEMS:	

**COMMENTS:**

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-7-92

BLDG.# 101

MOTORS

MOTOR #	1	HP	2	PH	3	RPM	1735
MODEL #	PVL 145 PT DR7026V	VOLTS	208/460	AMPS	6/3		
SERIAL #		PRESENT HR.	0	TO	2400		
MFG	Marathon Electric	REQUIRED HR.		TO			
FRAME	145P	EFF.					
DESCRIPTION	AHU 1	COMMENTS	4 <sup>th</sup> FLOOR				
MOTOR #	2	HP	7 1/2	PH	3	RPM	1745
MODEL #	6808959904	VOLTS	200	AMPS	24.4		
SERIAL #		PRESENT HR.	0	TO	2400		
MFG	WESTINGHOUSE	REQUIRED HR.		TO			
FRAME	213T	EFF.					
DESCRIPTION	AHU 2	COMMENTS					
MOTOR #	3	HP	5	PH	3	RPM	1730
MODEL #	3N6598	VOLTS	208/460	AMPS	15/2.3		
SERIAL #		PRESENT HR.	0	TO	2400		
MFG	GAYTON TRIVOLT	REQUIRED HR.		TO			
FRAME	K184T	EFF.	62.5%				
DESCRIPTION	AHU - 3	COMMENTS					

BLDG.# 101  
ECO 5 4<sup>th</sup> FLOOR

MOTORS

MOTOR #	HP	2	PH	3	RPM	1735
MODEL #	PVL145TTDR7026DC	VOLTS	208	AMPS	6	
SERIAL #		PRESENT HR.		TO		
MFG	MARATHON	REQUIRED HR.		TO		
FRAME	145 T	EFF.	82.5			
DESCRIPTION	AHU 1 (4 <sup>th</sup> FLOOR)					
COMMENTS						

MOTOR #	HP		PH		RPM	
MODEL #		VOLTS		AMPS		
SERIAL #		PRESENT HR.		TO		
MFG		REQUIRED HR.		TO		
FRAME		EFF.				
DESCRIPTION						
COMMENTS						

MOTOR #	HP	5	PH	3	RPM	1730
MODEL #	3N659	VOLTS	200	AMPS	15	
SERIAL #		PRESENT HR.		TO		
MFG	DAYTON	REQUIRED HR.		TO		
FRAME	K184T	EFF.				
DESCRIPTION	AHU-3 (4 <sup>th</sup> FLOOR)					
COMMENTS						

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-7-92

BLDG.# 101  
ECO 5

MOTORS

MOTOR #	<del>4-331260-03</del> <sup>4</sup>	HP	1.0	PH	3	RPM	1745
MODEL #	8-331260-03	VOLTS	200-208	AMPS	3.8		
SERIAL #		PRESENT HR.		TO			
MFG	CENTURY	REQUIRED HR.		TO			
FRAME	L143T	EFF.					
DESCRIPTION	AHU-4	COMMENTS	SUMMER TIME				
MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.		TO			
MFG		REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION		COMMENTS					
MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.		TO			
MFG		REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION		COMMENTS					



EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
DATE: 1/2/92

BLDG.# 101  
ECO 5

MOTORS

MOTOR #	1	HP	1/4	PH	1	RPM	1725
MODEL #		VOLTS	115	AMPS	5		
SERIAL #	317P 216	PRESENT HR.	0	TO	2400		
MFG	WESTINGHOUSE FEDERAL PUMP CORP.	REQUIRED HR.		TO			
FRAME	S856L	EFF.					
DESCRIPTION	DHW CIR.	COMMENTS	TEMP CONTROL SET @ 160°F				
MOTOR #	2	HP	10	PH	3	RPM	1745
MODEL #	JVK215TTDR7343D-F1W	VOLTS	208	AMPS	29		
SERIAL #		PRESENT HR.	0	TO	2400		
MFG	MARATHON	REQUIRED HR.		TO			
FRAME	215 JM	EFF.					
DESCRIPTION	CWP	COMMENTS					
MOTOR #	3	HP	10	PH	3	RPM	1745
MODEL #	JVK215TTDR7343DF1W	VOLTS	208	AMPS	29		
SERIAL #		PRESENT HR.	0	TO	2400		
MFG	MARATHON	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	CWP	COMMENTS					

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: \_\_\_\_\_  
 CHECKED BY: \_\_\_\_\_  
 DATE: \_\_\_\_\_

BLDG.# 101  
 ECO 5 \_\_\_\_\_

**MOTORS**

MOTOR #	<u>4</u>	HP	<u>30</u>	PH	<u>3</u>	RPM	<u>1765</u>
MODEL #	<u>FM 286TSTD R7361CBWF2</u>		VOLTS	<u>200</u>	AMPS	<u>85</u>	
SERIAL #	_____		PRESENT HR.	<u>0</u>	TO	<u>2400</u>	
MFG	<u>MARATHON</u>		REQUIRED HR.	_____	TO	_____	
FRAME	<u>286TS</u>		EFF.	_____			
DESCRIPTION	<u>HWP #1</u>		COMMENTS	<u>RUNNING.</u>			
MOTOR #	<u>5</u>	HP	<u>30</u>	PH	<u>3</u>	RPM	<u>17</u>
MODEL #	<u>FM 286TSTD R7361CBWF2</u>		VOLTS	_____	AMPS	_____	
SERIAL #	_____		PRESENT HR.	_____	TO	_____	
MFG	<u>MARATHON</u>		REQUIRED HR.	_____	TO	_____	
FRAME	<u>286TS</u>		EFF.	_____			
DESCRIPTION	<u>HWP #2</u>		COMMENTS	<u>NOT RUNNING.</u>			
MOTOR #	<u>6</u>	HP	<u>1/3</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>555JXDYD-2680</u>		VOLTS	<u>115</u>	AMPS	<u>6.2</u>	
SERIAL #	_____		PRESENT HR.	_____	TO	_____	
MFG	<u>EMERSON</u>		REQUIRED HR.	_____	TO	_____	
FRAME	_____		EFF.	_____			
DESCRIPTION	<u>HWP # 3</u>		COMMENTS	<u>NEW ADDITION</u> <u>NO MOTOR TO PUMP COUPLING</u>			

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/2/92

BLDG.# 101  
ECO 5

**10+ HP MOTORS**  
\*MEASURED\*

MOTOR#	<u>CHW # 1 (NORTH)</u>	PHASE A	PHASE B	PHASE C
LOCATION	_____	<u>3.8</u>		
MFG	<u>MARATHON</u>	<u>9.7</u>		
MODEL #	<u>JVK215TTDR73430-F1W</u>	<u>4.3</u>		
SERIAL #	_____	<u>75.1</u>		
FRAME	<u>215JM</u>			
HP	<u>10</u>	<u>205</u>	<u>203</u>	
RPM	<u>1745</u>	<u>16</u>	<u>15.7</u>	
PRESENT	_____ TO _____			
REQ HR.	_____ TO _____			
		PH 3 VLTs. 208 Amps 29		

MOTOR #	<u>CHWP # 2 (SOUTH)</u>	PHASE A	PHASE B	PHASE C
LOCATION	_____	<u>4.1</u>		
MFG	<u>MARATHON</u>	<u>5.9</u>		
MODEL #	<u>JVK215TTDR73430F1W</u>	<u>4.3</u>		
SERIAL #	_____	<u>72.3</u>		
FRAME	_____	<u>204</u>	<u>204</u>	
HP	<u>10</u>	<u>16.7</u>	<u>16.8</u>	
RPM	<u>1745</u>			
PRESENT	_____ TO _____			
REQ HR.	_____ TO _____			
		VLTs 208 Amps 29 PH 3		
COMMENTS	_____			
	_____			
	_____			

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
DATE: \_\_\_\_\_

BLDG.# 101  
ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
65B	6	4	34	F	ON	N	N	1	<del>Y</del>
65C	8	4	34	F	OFF	Y	N	0	N
65D	12	4	34	F	ON	Y	N	1	N
76	1	4	34	F	OFF	Y	N	1	N
86	<del>3</del>	2	<del>34</del>	F	ON	Y	Y	1	Y
88A	1	4	34	F	ON	Y	Y	1	Y
88B	1	2	34	F	ON	Y	N	1	Y
77	8	4	34	F	ON	Y	Y	1	Y
85	1	2	34	F	OFF	Y	Y	1	N
88	1	2	8'	T	ON	Y	Y	1	Y
	1	2	4'	T	ON				
87	1	2	34	T	ON	Y	Y	1	Y
	2	2	34	T	ON				
78	4	4	34	T	OFF	Y	Y	2	N
79	2	4	34	T	ON	N	Y	0	Y
80	5	4	34	F	ON	Y	Y	1	N
81	1	4	34	T	OFF	Y	Y	1	N
82	1	4	34	T	OFF	Y	Y	1	N
84	1	4	34	T	OFF	Y	Y	1	N
83	8	4	34	F	OFF	Y	Y	1	N

DELANP

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

JW

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: CS  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-7-92

BLDG.# 101  
 EC0 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
218	17	4	34	F	ON	Y	N	2	N
220	12	2 <sup>8</sup>		F	ON	Y	N	2	Y
222	1	4	34	F	ON	Y	N	1	Y
223	1	2	34	F	ON	Y	N	1	Y
225	18	4	34	F	<del>ON</del> OFF	Y	N	<del>2</del> 4	N
227	10	4	34	F	ON	Y	N	1	N
228	16	4	34	F	ON	Y	N	3	N
229	3	4	34	F	ON	Y	N	1	Y
230	2	2	34	F	OFF	Y	N	1	N
232	1	4	34	F	OFF	Y	N	1	N
236	4	4	34	F	ON	Y	N	1	N

# OF EXIT SIGNS - NI

COMMENTS: \_\_\_\_\_

JW

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-7-92

BLDG.# 101  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
336	3	4	34	F	ON	Y	N	1	<del>Y</del>
339	5	4	34	F	ON	Y	N	1	N
341	2	4	34	F	ON	Y	<del>N</del>	w/ 1/2 340 <del>4</del>	Y
343	2	4	34	F	ON	Y	N	1	N
342	4	4	34	F	ON	Y	Y	1	N
345	3	4	34	F	ON	N	Y	0	Y
<hr/>									
201	64	4	34	F	ON	Y	N	12	N
204	3	4	34	F	ON	Y	N	1	N
207	3	4	34	F	ON	Y	<del>N</del>	1	N
209	3	4	34	F	ON	Y	N	1	N
210	2	2	34	F	ON	Y	N	1	Y
211	2	4	34	F	ON	Y	N	1	Y
212	1	4	34	F	ON	N	N	0	Y
213	11	4	34	F	ON	Y	N	3	Y
214	14	4	34	F	ON	Y	N	3	N
215	2	4	34	F	ON	N	N	0	Y
216	4	4	34	F	OFF	Y	Y	1	N

# OF EXIT SIGNS - NI

COMMENTS: \_\_\_\_\_

JW

BLDG.# 101  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
	4	2 <sup>(4)</sup>	40	F	ON	Y	N	WORK W/ OTHERS	N
433	2	1	60	I	OFF	Y	N	1	N
301	1	4	34	F	OFF	Y	N	1	N
303	1	4	34	F	ON	Y	Y	1	Y
305	2	4	34	F	OFF	Y	Y	1	N
309	16	4	34	F	ON	Y	N	2	<del>N</del>
311	1	4	34	F	ON	Y	<del>N</del> <sup>N</sup>	1	Y
312	3	4	34	F	ON	Y	N	1	N
316	6	4	34	F	ON	Y	Y	1	Y
317	5	4	34	F	ON	Y	N	1	N
<del>320</del> 320	1	2	34	F	ON	Y	Y	1	Y
322	1	4	34	F	OFF	Y	N	1	N
324	1	2 <sup>8'</sup>		F	OFF	N	N	—	N
328	1	2 <sup>8'</sup>		F	OFF	N	N	$\frac{PULL=O}{OUT}$	N
330	<del>68</del>	4	34	F	ON	Y	N	<del>17</del>	N
332	2	4	34	F	ON	Y	Y	1	Y
334	1	2	34	F	OFF	Y	N	1	N

# OF EXIT SIGNS - NI IIII

COMMENTS: \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-7-92

BLDG.# 101  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
401	25	4	34	F	ON	Y	N	6	N
	1	2 <sup>(u)</sup>	40	F	ON	Y	N	1	N
403	2	4	34	F	ON	Y	N	1	Y
405	3	4	34	F	OFF	Y	Y	1	N
407	1	1	75	I	OFF	Y	N	1	N
409	7	4	34	F	ON	Y	N	1	N
411	5	2 <sup>(u)</sup>	40	F	ON	Y	N	2	<del>Y</del> N
413	2	4	34	F	ON	Y	N	1	Y
414	4	4	34	F	OFF	Y	<del>Y</del>	1	N
415									
416	3	4	34	F	OFF	Y	Y	1	N
417									
419	2	1	60	I	OFF	Y	N	1	N
422	3	4	34	F	ON	Y	N	1	Y
423	2	2 <sup>8'</sup>		F	OFF	COULD NOT FIND	<del>Y</del>		N
425	1	2 <sup>6'</sup>		F	OFF	Y	N	1	N
427	2	4	34	F	ON	Y	Y	1	Y
429	47	4	34	F	ON	Y	N	12	N

# OF EXIT SIGNS - 111

COMMENTS: \_\_\_\_\_

JW



**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/7/92

BLDG.# 101  
 EC0 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
252	6	4	34	F	ON	Y	N	3	Y
253	1	2-U		F	OFF	Y	N	1	N
254	1	1	60	I	OFF	Y	N	1	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

JW

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/7/92

BLDG.# 101  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
233	2	4	34	F	OFF	Y	Y	1	NO
234	9	4	34	F	ON	Y	N	2	N
235	3	4	34	F	ON	Y	N	1	N
237	16	4		F	ON	Y	N	2	N
238	4	4	34	F	ON	Y	N	1	Y
239	5	4		F	ON	Y	N	2	Y
240	1	4		F	ON	Y	N	1	Y
241	1	2U		F	OFF	Y	N	1	N
242	1	4		F	ON	Y	N	1	Y
243	2	4		F	ON	Y	N	1	Y
244	1	2U		F	ON	Y	N	1	Y
245	1	1	60	I	OFF	Y	N	1	N
246	3	4		F	ON	Y	N	1	N
247	3	4		F	ON	Y	N	1	N
248	4	4		F	ON	Y	N	1	Y
249	3	4		F	ON	Y	N	1	N
250	8	4		F	ON	Y	N	2	N
251	5	4	34	F	ON	Y	N	1	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

JW

BLDG.# 101  
 EC0 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
333	9	4	34	F	ON	Y	N	3	N
335	2	2	34	F	ON	Y	N	1	Y
337	5	4	34	F	ON	Y	N	1	N
338	2	4		F	ON	Y	Y	1	N
340	3	4		F	ON	Y	<del>N</del>	$\frac{1w}{2}$ 341	Y
344	2	4		F	ON	N	N	0	Y
200	5	4		F	ON	Y	N	1	N
202	3	4		F	ON	Y	Y	1	Y
203	3	4		F	ON	Y	Y	1	Y
205	3	4		F	ON	Y	Y	1	Y
delamp 206	5	4		F	ON	Y	Y	1	N
	<del>15</del>	<del>4</del>		<del>F</del>	<del>ON</del>	<del>Y</del>	<del>N</del>	<del>4</del>	<del>N</del>
217	2	4		F	OFF	Y	Y	1	N
219	63	4	34	F	ON	Y	N	8	N
221	1	1	60	I	OFF	Y	N	1	N
224	4	4	34	F	ON	Y	N	1	N
226	8	4	34	F	ON	Y	N	2	N
230	7	4	34	F	ON	Y	N	2	N

# OF EXIT SIGNS - 11

COMMENTS: \_\_\_\_\_

*JW*

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/7/92

BLDG.# 101  
 ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
300	5	4	34	F	ON	Y	N	2	N
302	6	4		F	ON	Y	N	1	N
<del>304</del>	2	2	34	F	ON	Y	Y	1	Y
306	9	4	34	F	ON	Y	N	2	N
307	2	4	34	F	ON	Y	Y	1	Y
308	98	4	34	F	ON	Y	N	8	<del>N</del>
310	2	4		F	ON	Y	Y	1	N
3104	10	4		F	ON	Y	N	2	N
<del>313</del>	<del>6</del>	4	34	F	ON	Y	Y	1	Y
318	2	4	34	F	ON	Y	<del>Y</del>	1	Y
319	OCCUPIED								
<del>321</del>	1	4		F	ON	Y	<del>N</del>	1	Y
323	85	4	34	F	ON	Y	N	10	N
325	3	4		F	OFF	Y	Y	1	N
326	2	4		F	ON	Y	Y	1	Y
327	2	4		F	ON	Y	Y	1	Y
329	2	4		F	ON	Y	Y	1	N
331	4	4		F	ON	Y	<del>Y</del>	1	N

321

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

JW

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/7/92

BLDG.# 101  
ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
400	6	2	8'	F	ON	Y	N	2	N
400	2	4	34	F	ON	Y	N	1	N
402	10	4		F	ON	Y	N	2	N
406	2	4		F	<del>OFF</del>	Y	Y	1	N
404	2	4		F	ON	Y	Y	1	N
408	$\frac{2}{1}$	$\frac{2}{2}$	$\frac{8'}{34}$	F	OFF	Y	N	1	N
410	8	4		F	ON	Y	N	1	N
412	<del>4</del> 8	4		F	ON	Y	N	5	N
418	LOCKED								
420	4	4		F	ON	Y	Y	1	Y
421	3	2	34	F	ON	Y	N	1	Y
424	1	1	200	I	OFF	N <sup>SCREW</sup> IN	<del>Y</del>	0	N
426	5	4		F	ON	Y	N	1	N
428	$\frac{2}{3}$	$\frac{4}{2-4}$	$\frac{34}{}$	F	OFF	Y	Y	1	N
430	4	4		F	ON	Y	Y	1	N
431	3	2	34	F	ON	Y	N	1	N
432	3	2	34	F	ON	Y	N	1	N

# OF EXIT SIGNS - 1111

COMMENTS: \_\_\_\_\_

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/3/92

BLDG.# 101  
 EC0 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
39	1	1	150	I	ON	Y	Y	1	Y
25	1	4	34	F	ON	Y	Y	1	Y
24	18	4	34	F	ON	Y	NO	7	NO
26	06	4	34	F	ON	Y	Y	1	NO
23	7/1	4/4	34/20	F	ON	Y	Y	1	NO
22	9	4	34	F	ON	Y	NO	1	NO
al 46	4	4	34	F	ON	Y	Y	1	NO
46A	1	1	150	I	ON	Y	Y	1	Y

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_ JW

BLDG.# 101  
 ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
75	8	4	34	F	ON	Y	NO	1	NO
74	8	4	34	F	ON	Y	NO	1	NO
74-A	1	4	34	F	OFF	Y	YES	1	NO
73-A	1	4	34	F	OFF	Y	YES	1	NO
73	10	4	34	F	ON	Y	NO	1	NO
72	4	4	34	F	OFF	Y	NO	1	NO
71	12	4	34	F	ON	Y	NO	1	NO
HALL-1	8	4	34	F	ON	Y	NO	2	NO
67	2	2	8'	F	OFF	Y	NO	1	NO
70	2	4	34	F	ON	Y	NO	1	NO
69	3	4	34	F	ON	Y	YES	1	NO
61	6	4	34	F	ON	Y	NO	2	NO
68	1	2	8'	F	ON	Y	NO	1	NO
59	1	1	150	I	OFF	Y	NO	1	NO
59	2	2	34	F	OFF	Y	NO	1	NO
60	2	4	34	F	OFF	Y	NO	1	NO
27	20	4	34	F	ON	Y	NO	2	NO
58	6	4	34	F	ON	Y	NO	1	NO

delamp

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

*JW*

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: J W  
CHECKED BY: \_\_\_\_\_  
DATE: 1/3/92

BLDG.# 101  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
57A	1	4	20	F	OFF	Y	NO	1	NO
57	1	2	34	F	OFF	Y	NO	1	NO
56	2	4	34	F	OFF	Y	NO	1	NO
54	3	4	34	F	ON	Y	NO	1	NO
55	3	4	34	F	OFF	Y	YES	1	NO
53	4	4	20	F	ON	Y	YES	1	NO
53A	SAME	↑↑							
53B	3	4	34	F	ON	Y	YES	1	YES
51	2	4	34	F	ON	Y	NO	1	YES
52	1	4	34	F	ON	NO	YES	0	NO
50	3	4	34	F	ON	NO	YES	0	YES
49	3	4	34	F	ON	YES	NO	1	YES
48	12	4	34	F	ON	YES	NO	2	YES
47	6	4	34	F	OFF	Y	Y	1	NO
45	2	2	8/34	F	OFF	Y	YES	1	NO
42	4	4	34	F	ON	Y	YES	1	NO
44-43	1	1	150	I	ON	Y	NO	1	YES
34	4	4	34	F	ON	Y	YES	1	NO

dl  
dl  
dl

44

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

JW



BLDG.# 101  
 EC0 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
71	12	4	34	F	0	Y	N	1	N
68	1	2	8' TUBE	F	0	Y	Y	1	Y
61	8	24	34	F	0	Y	<del>Y</del> N	2	N
50	2	4	34	F	OFF	Y	Y	1	N
59	1	1	150	INC	0	Y	Y	1	N
59/60	2	2	34	F	0	Y	Y	1	N
21	20	1	34	F	0	Y	N	1	N
21	10	1	34	F	OFF	Y	N	1	<del>N</del>
40	2	1	34	F	0	Y	Y	1	Y
41	1	4	34	F	0	Y	Y	1	Y
27	12	1	34	F	0	Y	<del>Y</del> N	1	Y
27A	2	2	34	F	0	Y	N	1	<del>N</del>
28	3	2	34	F	0	Y	N	1	Y

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

JW

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: \_\_\_\_\_  
 CHECKED BY: \_\_\_\_\_  
 DATE: \_\_\_\_\_

BLDG.# 101  
 ECO 15

**LIGHTING**

De lamp

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
8	8	2	TUBE	FL	OFF	Y	N	1	N
2A	4	4	34	FL	ON	N	Y	0	Y
2C	4	4	34	FL	ON	<del>Y</del>	Y	0	Y
2B	3	4	34	FL	ON	N	Y	0	Y
5A	2	4	34	FL	ON	Y	Y	1	N
5B	2	4	34	FL	ON	Y	Y	1	N
6	4	4	34	FL	ON	Y	Y	1	Y
3A	5	4	34	FL	ON	Y	Y	1	N
3B	1	4	34	FL	ON	Y	Y	1	Y
19	3	2	TUBE	FL	ON	Y	Y	1	Y
13	52	1	HAL.	HAL ACORN 2V-75W	OFF	SPECIAL LIGHT CONTROLS			
4	3	2	8'	FL	OFF	Y	N	1	N
20	1	2	34	FL	ON	Y	N	1	Y
16	1	2	34	FL	ON	Y	Y	1	Y
15	2	4	34	FL	ON	Y	Y	1	Y
14A	1	4	34	FL	OFF	Y	N	1	N
14B	2	4	34	FL	OFF	Y	N	1	N
65A	3	4	34	FL	OFF	N	Y	0	Y

# OF EXIT SIGNS - 11

COMMENTS: \_\_\_\_\_

JW

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

FL. Gillem  
BLDG. 101

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

MECH. ROOM

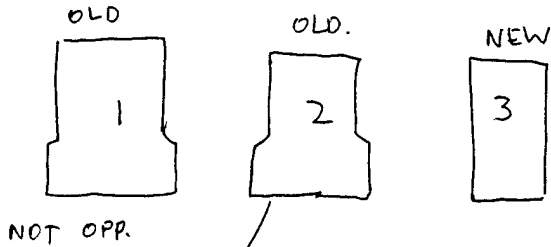


BURNER  
DUNHAM-BUSH INC  
MOD. C-240-GO-K  
ASSEM # 149132-015  
N.GAS  
5250 MBTUH  
SER 7806-C78862

1 PACIFIC STEEL BOILER CORP.

2 RAY HUSKY PACKAGED BOILER  
NUMBER 125EP ; 1963  
A-5666  
HEATING SURFACE 625 FL2

3 BRUNHAM CORP.

BOILER# FF-505  
SERIAL# 7581959  
OUTPUT 786 MBH  
STEAM SQ.FL 2457  
STEAM MBH 589.6  
STEAM 15 PSI

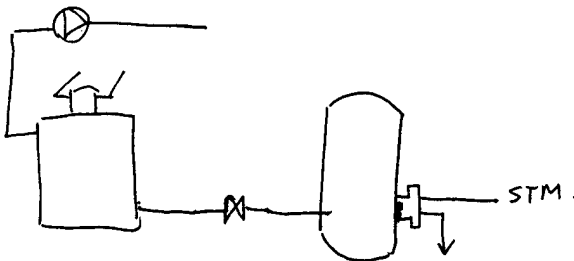

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

WINDOW TROUBLE SPOTS  
BLDG 101

JOB \_\_\_\_\_  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY JW DATE 1/2/92  
CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
SCALE \_\_\_\_\_

- 2<sup>nd</sup> FLOOR SOUTH - COMMANDING GENERAL'S OFFICE WINDOW ON SOUTH WALL IS CRACKED BUT LOW INFILTRATION 2 WINDOW ON EAST WALL ~~HAS~~ HAVE HIGH INFILTRATION, ONE WITH BROKEN FRAME, ~~OTHER~~ OTHER FRAME OK BUT NEEDS SEAL.
- 2<sup>nd</sup> FLOOR ~~SOUTH~~ SOUTH WEST END OF HALLWAY WINDOW IS JAMMED OPEN DUE TO BROKEN LATCH CAUSING 2" AIR GAP.

BUILDING IS VERY DRAFTY

TEMPERATURES




1<sup>st</sup> FLOOR, MAIN ENTRANCE ⇒ ~~66~~ 70°F  
1<sup>st</sup> FLOOR, NORTH ⇒ 69°F  
1<sup>st</sup> SOUTH ⇒ 72.5°F  
OA TEMP - RAINY AT 1:00pm ⇒ ~~56~~ 56°F at 62° RH

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 101

JOB \_\_\_\_\_  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY KC DATE 1/3/92  
 CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
 SCALE \_\_\_\_\_

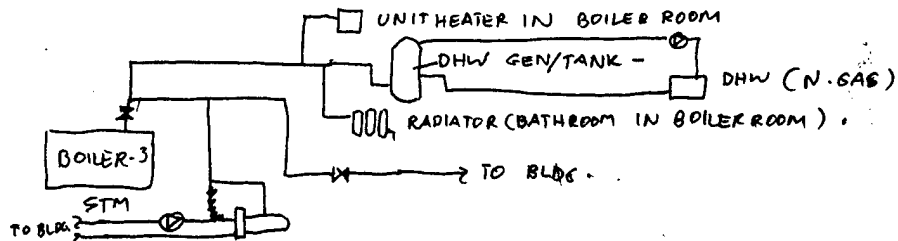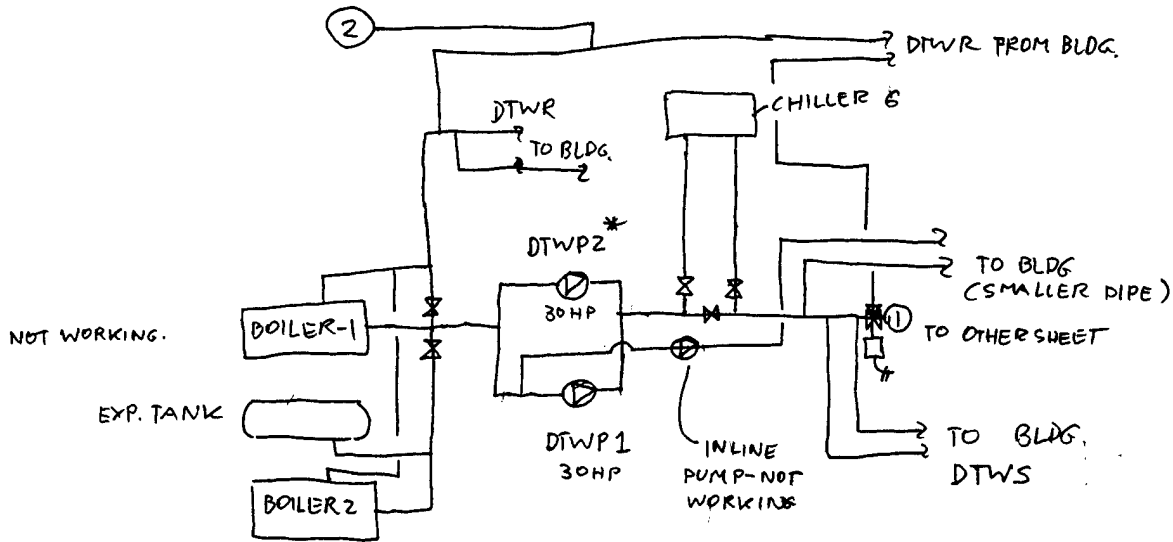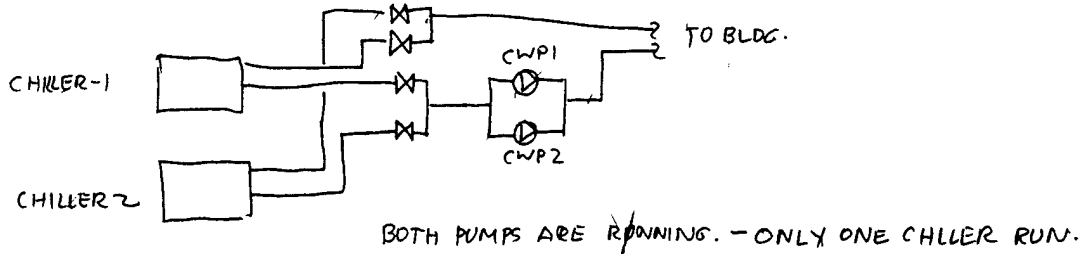

\* ACCORDING TO OPERATOR PUMP VIBERATES WHEN RUN - MANUALLY SWITCH BETWEEN THE 2 PUMPS.

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BWS 101


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1/3/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

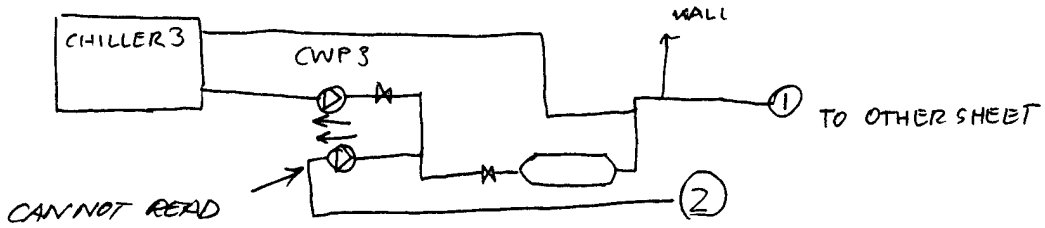

CWP-3 GE 1750 RPM  
208V 3 HP 3Ø 10.6A  
CANNOT READ MOD # "OLD"

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

Fl. Gillem  
BLDG. 101


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

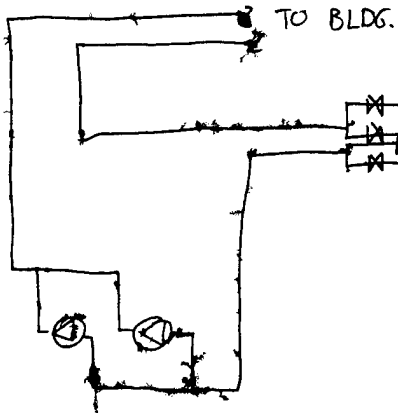

CHILLER  
PAD MOUNT

CARRIER

MOD 3061 5400  
SER RD96703

COMP 1 200V 85.8 REA 34.5-URA  
1 " 124.4

FAN MOTOR

200V 1.0 5.0 HP  
200V 4.6 0.38 HP

MOD 306B045400  
SER P096709

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

*Fl. Gillem  
Building 101*


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-7-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

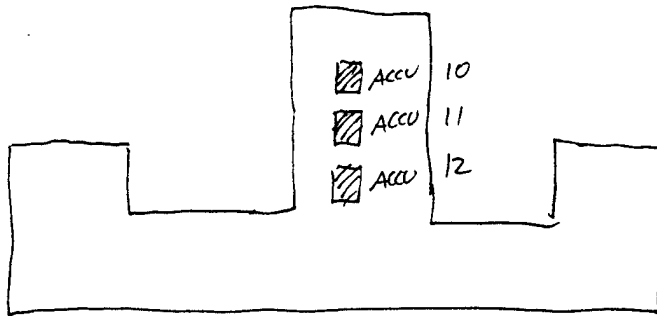

ACCU-12 TRANE  
AMERICAN STANDARD INC.

MOD.# TTA09DA300AA  
SER# E23197815  
COMP. 28.7A 208V 3 $\phi$   
COND. FAN  
3.8A 208V 1 $\phi$   
230

ROOF TOP BLDG 101

ACCU-11 TRANE  
AMERICAN STANDARD INC.

MOD# TTA120B300AB  
SER# E24197948  
COMP. 2-19.2A 208/230V 3 $\phi$   
COND. FAN  
1-7.7A 208/230V 1 $\phi$

ACCU-10 TRANE

MOD# TTA180B300AA  
SER# E19198827  
COMP. 2-24.1A 208/230V 3 $\phi$   
COND FAN  
2-3.8A 208/230V 1 $\phi$



**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY CEL DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

101

RUNS 24 HRS FOR COMP. ROOM  
CHW PUMP - 1

MOTOR, MARATHON 1

MODEL UVI 182TDR7026 DFL

FRAME 182T

3  $\phi$

208V 9.4A

1760 RPM

3HP

81.5 EFF

77.7 PF

CHW PUMP - 2 SAME, OFF (BACKUP)

PUMP TALC MODEL - EM 150B

72 GPM

55 FT HD

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 101


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1/3/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

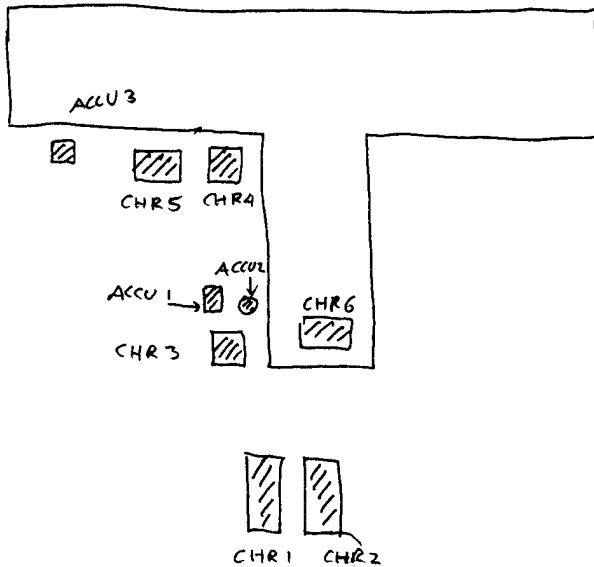

CHILLER 4 - SNYDER GENERAL  
 MOD. ALR040C  
 SER 5UB0176600  
 COMP 1 20HP 63 RLA 208V 3Ø  
 1 25 HP 77 RLA 208V 3Ø  
 COND FAN  
 4 1HP 4 FLA 208V 3Ø

CHILLER 5 CARRIER  
 MOD 30GB070530  
 SER. T698036  
 COMP. 2 208V 3Ø 119 RLA  
 1 240V 3Ø 76 RLA  
 COND. FAN  
 6 208V 3Ø 6.6 A 1.75HP

ACCU-3 <sup>GW</sup> BOHN A/C & R DIVISION  
 MOD DVS0102B  
 SER BJK8122  
 208V 3Ø 2 FAN @ 1/2 HP. 2.4A  
 (217) 446-3710

ACCU-1 CARRIER  
 MOD 38AE-014-500  
 SER Z981585  
 COMP. 1 208V 3Ø 49.3A  
 COND. FAN 2 1 208/230V 1Ø 3.7A  
 1 208/230V 1Ø 4.3A

ACCU-2 CARRIER  
 MOD 38T8048510  
 SER. 2389E10366  
 COMP 208/230V 3Ø 17.6A  
 FAN 208/230V 1Ø 1.6A.

CHILLER-3 TRANE  
 MOD CGAA-4006-FA-LA  
 SER L6H17172  
 TYPE NO. 561-0061  
 COMP. 1 200-208V 3Ø 144A  
 COND 3 200-208V 3Ø 6A 1HP  
 VAR SPD FAN MTR 1 1Ø 6.7A 1HP.

CHILLER 6 CARRIER  
 MOD 30GB175600  
 SER T296253  
 COMP 4 460V 3Ø 52.1A  
 4 460V 3Ø 52.1A  
 COND FAN 6 460V 3Ø 3A 1.75HP  
 6 " \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

CARRIER


SERVE FIRST FLOOR

MOD. 40RR-012-550

SER. T981150

230V 3 $\phi$  6.3A.

COOLING ONLY (DX)



CARRIER (small)

SER 4489H05305

240V 1 $\phi$  0.5HP 1.8A.

COOLING ONLY (DX)

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_


SCALE \_\_\_\_\_

DATA AIRE INC.

AHU 1ST FLOOR NEXT TO DATA AIRE

MCQUAY SER 3UB00102-06

HAS OA/RA DAMPER FIXED POSITION ALL WE HAVE TO DO IS  
OA DAMPER IN CLOSED POSITION  
ADD CONTROL, MOTOR NOT ACCESSABLE

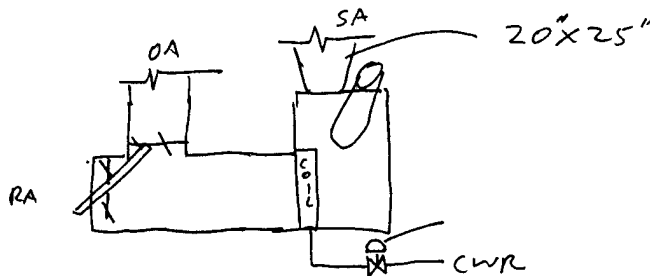

- PNEUMATIC CONTROL
- WITH TIME CLOCK WORKING.
- MODULATE VALVE FROM RETURN AIR.

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_


CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

FORTH FLOOR

AHU 1

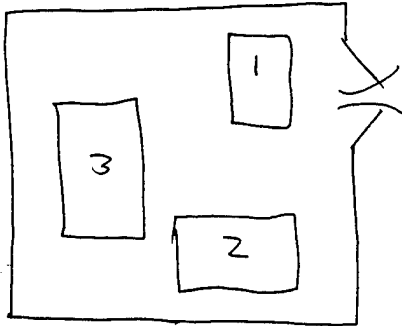


MARATHON

MOD. PVL145TTDR7026DC  
SET

FRAME 145T

208V 6A 3Ø 1735RPM

82.5 % eff 2HP.

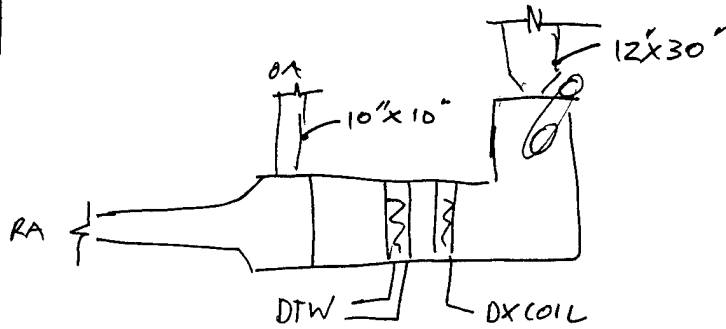

HAS OA DAMPER ACTUATOR (ELEC.)

AHU 2

BUILDING 102

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/7/92

BLDG.# 102  
ECO 4

DOMESTIC HOT WATER

FAUCET LOCATION	WATER TEMPERATURE
MEN'S ROOM SOUTHSIDE	128°F
AIR TEMP AT 1:30pm ⇒ 74°F	
AIR TEMP IN SHOP AREA ⇒ 79°F	
AIR TEMP IN WOOD SHOP ⇒	
WOODSHOP SINK	138°F
PROBLEMS:	

COMMENTS: HW PIPES MUST BE VERY RUSTY

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/7/92

BLDG.# 102  
 ECO 5

**MOTORS**

MOTOR #	<u>CONDENSATE PUMPS 1 &amp; 2</u>	HP	<u>3/4</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	_____	VOLTS	<u>208/406</u>	AMPS	<u>5.6/2.8</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>LOUIS ALLIS</u>	REQUIRED HR.	_____	TO	_____		
FRAME	<u>225YE</u>	EFF.	_____				
DESCRIPTION	_____	COMMENTS	<u>LOCATED IN WOOD SHOP</u>				
<u>TYPE:OS</u>		<u>CLASS:N</u>		<u>MOTOR NO.:41728A</u>			
MOTOR #	<u>EXHAUST FAN #1</u>	HP	<u>1/2</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>5K454C</u>	VOLTS	<u>115</u>	AMPS	<u>8.2</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>DAYTON</u>	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	<u>LOCATED IN WOOD SHOP</u>				
MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				



**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: kc  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-7-92

BLDG.# 1021  
 ECO 5 Ft-Gillem

**MOTORS**

MOTOR #	_____	HP	<u>1</u>	PH	<u>3</u>	RPM	<u>1800</u>
MODEL #	<u>6410 453</u>	VOLTS	<u>208V</u>	AMPS	<u>3</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>BALDOR</u>	REQUIRED HR.	_____	TO	_____		
FRAME	<u>182</u>	EFF.	_____				
DESCRIPTION	<u>AHU 1 &amp; AHU 2</u>		COMMENTS	<u>T'STAT CONTROL</u>			

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____		COMMENTS	_____			

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____		COMMENTS	_____			

BLDG.# 102  
ECO 5

*Ft. Gillem*

**MOTORS**

MOTOR #	<u>1</u>	HP	<u>3/4</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>6N624A</u>	VOLTS	<u>115</u>	AMPS	<u>12</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>DAYTON</u>	REQUIRED HR.				TO	
FRAME	<u>56</u>	EFF.					
DESCRIPTION	<u>EXHAUST FAN #1</u>		COMMENTS <u>NOT RUNNING.</u>				
	<u>IN SHOP AREA.</u>						
MOTOR #	<u>2</u>	HP	<u>1/4</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #		VOLTS	<u>115</u>	AMPS	<u>4.5</u>		
SERIAL #		PRESENT HR.				TO	
MFG		REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>UNIT HEATER #1</u>		COMMENTS <u>RUNNING.</u>				
	<u>STM</u>						
MOTOR #	<u>3</u>	HP	<u>1/2</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #		VOLTS	<u>230</u>	AMPS	<u>3.3</u>		
SERIAL #	<u>1178920-B</u>	PRESENT HR.				TO	
MFG	<u>WESTINGHOUSE</u>	REQUIRED HR.				TO	
FRAME	<u>D56</u>	EFF.					
DESCRIPTION	<u>UNIT HEATER #2</u>		COMMENTS <u>NOT RUNNING.</u>				
	<u>STM</u>						

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KG  
CHECKED BY: \_\_\_\_\_  
DATE: 1-7-92

Ft. Gillem

BLDG.# 102  
ECO 5

MOTORS


MOTOR #	<u>4</u>	HP	<u>1/6</u>	PH	<u>1</u>	RPM	
MODEL #		VOLTS	<u>115V</u>	AMPS			
SERIAL #		PRESENT HR.				TO	
MFG		REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>UNIT HEATER 3 &amp; 4</u>		COMMENTS <u>NO NAME PLATE</u>				
	<u>STEAM COIL.</u>		<u>T'STAT CONTROL</u>				
MOTOR #	<u>5</u>	HP	<u>1/4</u>	PH	<u>1</u>	RPM	
MODEL #		VOLTS	<u>115V</u>	AMPS			
SERIAL #		PRESENT HR.				TO	
MFG	<u>TRANE</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>UNIT HEATER 5 &amp; 6, 7</u>		COMMENTS <u>T'STAT CONTROL</u>				
MOTOR #	<u>6</u>	HP	<u>1/2</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>5K45AC</u>	VOLTS	<u>115</u>	AMPS	<u>8.2</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>DAYTON</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>EXH. FAN 3 &amp; 5, 6</u>		COMMENTS <u>NOT RUNNING</u>				
			<u>ONLY SUMMER</u>				

BLDG. # 102  
 ECO 10 Fl. Gillem

**AIR STRATIFICATION**

LOCATION	<u>WELDING SHOP</u>	REQ. TEMP.	_____
TEMP. AT TSTAT	_____	SOURCE	_____
TEMP. AT CEILING	<u>74.2 F</u>	OPP. HOURS	<u>7:00</u> TO <u>4:00</u>
TEMP. AT FLOOR	<u>73 F</u>		

SKETCH ROOM – DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

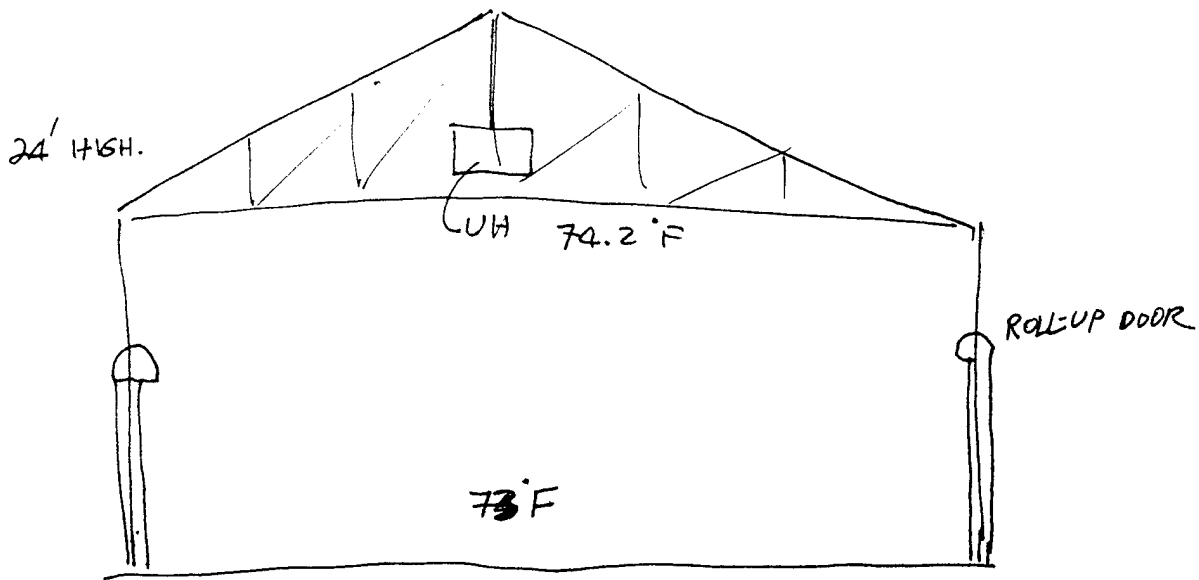

COMMENTS:

\_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY


JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KC  
CHECKED BY: \_\_\_\_\_  
DATE: 1-7-92

BLDG.# 102  
ECO 10

### AIR STRATIFICATION

LOCATION	<u>WOODSHOP</u>	REQ. TEMP.	_____
TEMP. AT TSTAT	_____	SOURCE	<u>UNIT HEATER</u>
TEMP. AT CEILING	<u>76</u>	OPP. HOURS	<u>7:30</u> TO <u>4:00</u>
TEMP. AT FLOOR	<u>73.5</u>		

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

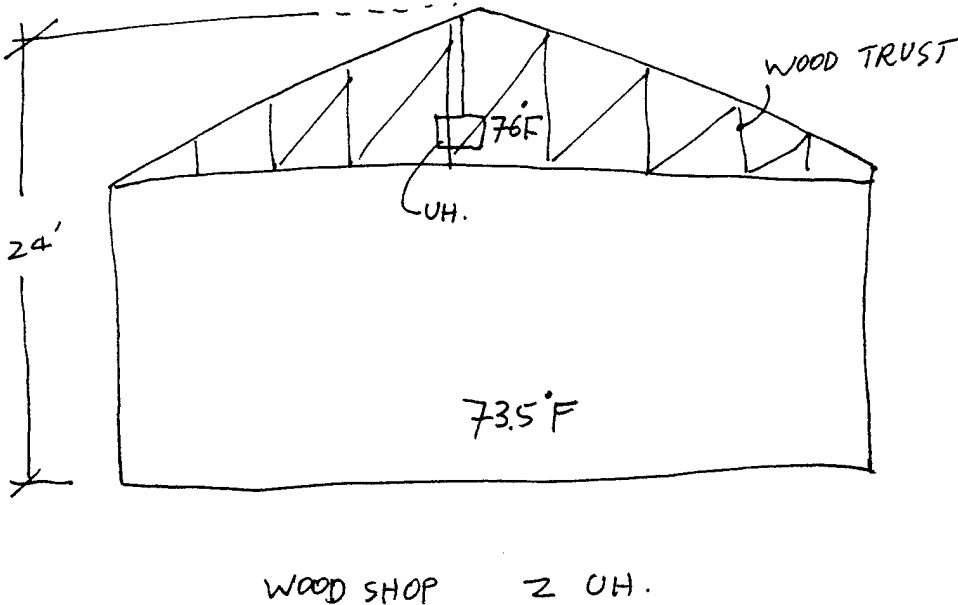

COMMENTS: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 102

JOB \_\_\_\_\_  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY JW DATE 1/7/92  
CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
SCALE \_\_\_\_\_

AC UNIT # 1 (WEST) <sup>SOUTH</sup>  
CARRIER MOD# 38AEO12500  
S# R295693  
COMPRESSOR (1) 208V 3 $\phi$  60Hz 43.6 RLA  
170 LRA  
R-22  
FANS (2) 208V 4FLA

AC UNIT # 2 (EAST) <sup>SOUTH</sup>  
CARRIER MOD# 38AEO12500  
S# R295692

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY WCL DATE 1-7-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

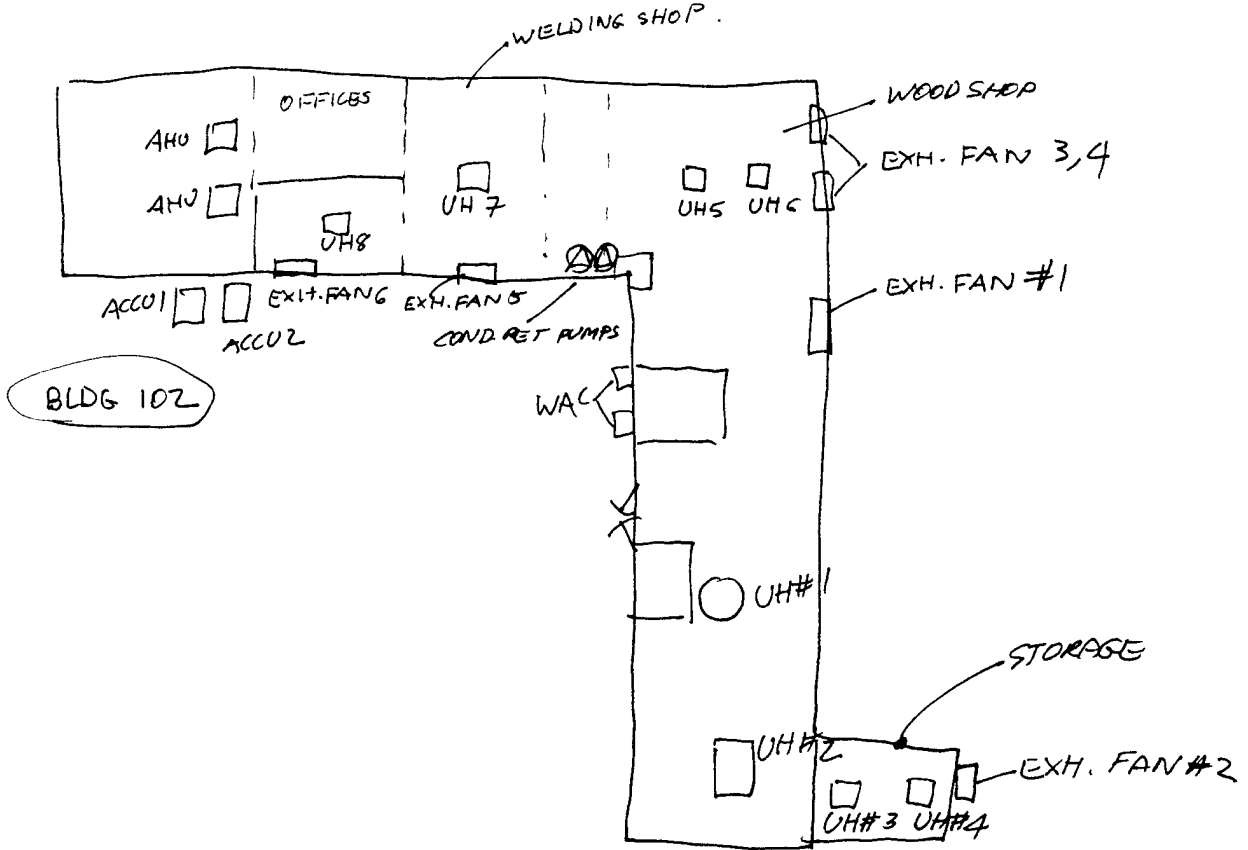

BUILDING 103





**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Enrgy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: \_\_\_\_\_  
 CHECKED BY: \_\_\_\_\_  
 DATE: \_\_\_\_\_

BLDG.# 103  
 ECO 5

**MOTORS**

MOTOR #	<u>10</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>6-342912-13</u>	VOLTS	<u>200</u>	AMPS	<u>9.6</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>CENTURY</u>	REQUIRED HR.	<u>0</u>	TO	<u>2400</u>		
FRAME	<u>S182T</u>	EFF.					
DESCRIPTION	<u>A1W</u>	COMMENTS					

MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG		REQUIRED HR.	<u>0</u>	TO	<u>2400</u>		
FRAME		EFF.					
DESCRIPTION	<u>ROOF TOP - 1</u>	COMMENTS	<u>NO ACCESS</u>				
<u>SERIES TELEPHONE EQUIP. ROOM</u>							

MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG		REQUIRED HR.	<u>0</u>	TO	<u>2400</u>		
FRAME		EFF.					
DESCRIPTION	<u>ROOF TOP - 2</u>	COMMENTS	<u>NO ACCESS</u>				
<u>SERIES TELEPHONE EQUIP. ROOM</u>							

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/2/91

BLDG.# 103  
ECO 15

1<sup>st</sup> FLOOR  
FIRE STATION  
LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
1	2	4	34	FLOUR	ON	YES	YES	1	YES
2	4	2	34	F	OFF	YES	NO	2	NO
3	2	2	<del>34</del>	F	ON	YES	NO	1	YES
4	1	2	34	F	OFF	YES	NO	1	NO
5A	1	1	150	I	OFF	YES	<del>NO</del> YES	1	NO
5B	1	1	150	I	"	"	NO	1	NO
6	2	4	34	F	OFF	YES	YES	1	NO
7	1	1	150	I	ON	YES	NO	1	YES
8	5	2	8' <del>foot</del>	F	ON	YES	NO	4	YES
9	<del>5</del>	2	34	F	OFF	YES	NO	2	NO
10	1	1	100	I	ON	YES	NO	1	NO
10	1	2	34	F	ON	"	NO	1	NO
12	2	2	<del>40</del>	F	OFF	YES	NO	1	NO
13	1	1	40	F	OFF	YES	NO	1	YES
14	1	2	8'	F	ON	YES	YES	1	YES

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_



**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY JFE DATE 1/2/92

SCALE \_\_\_\_\_

103 |

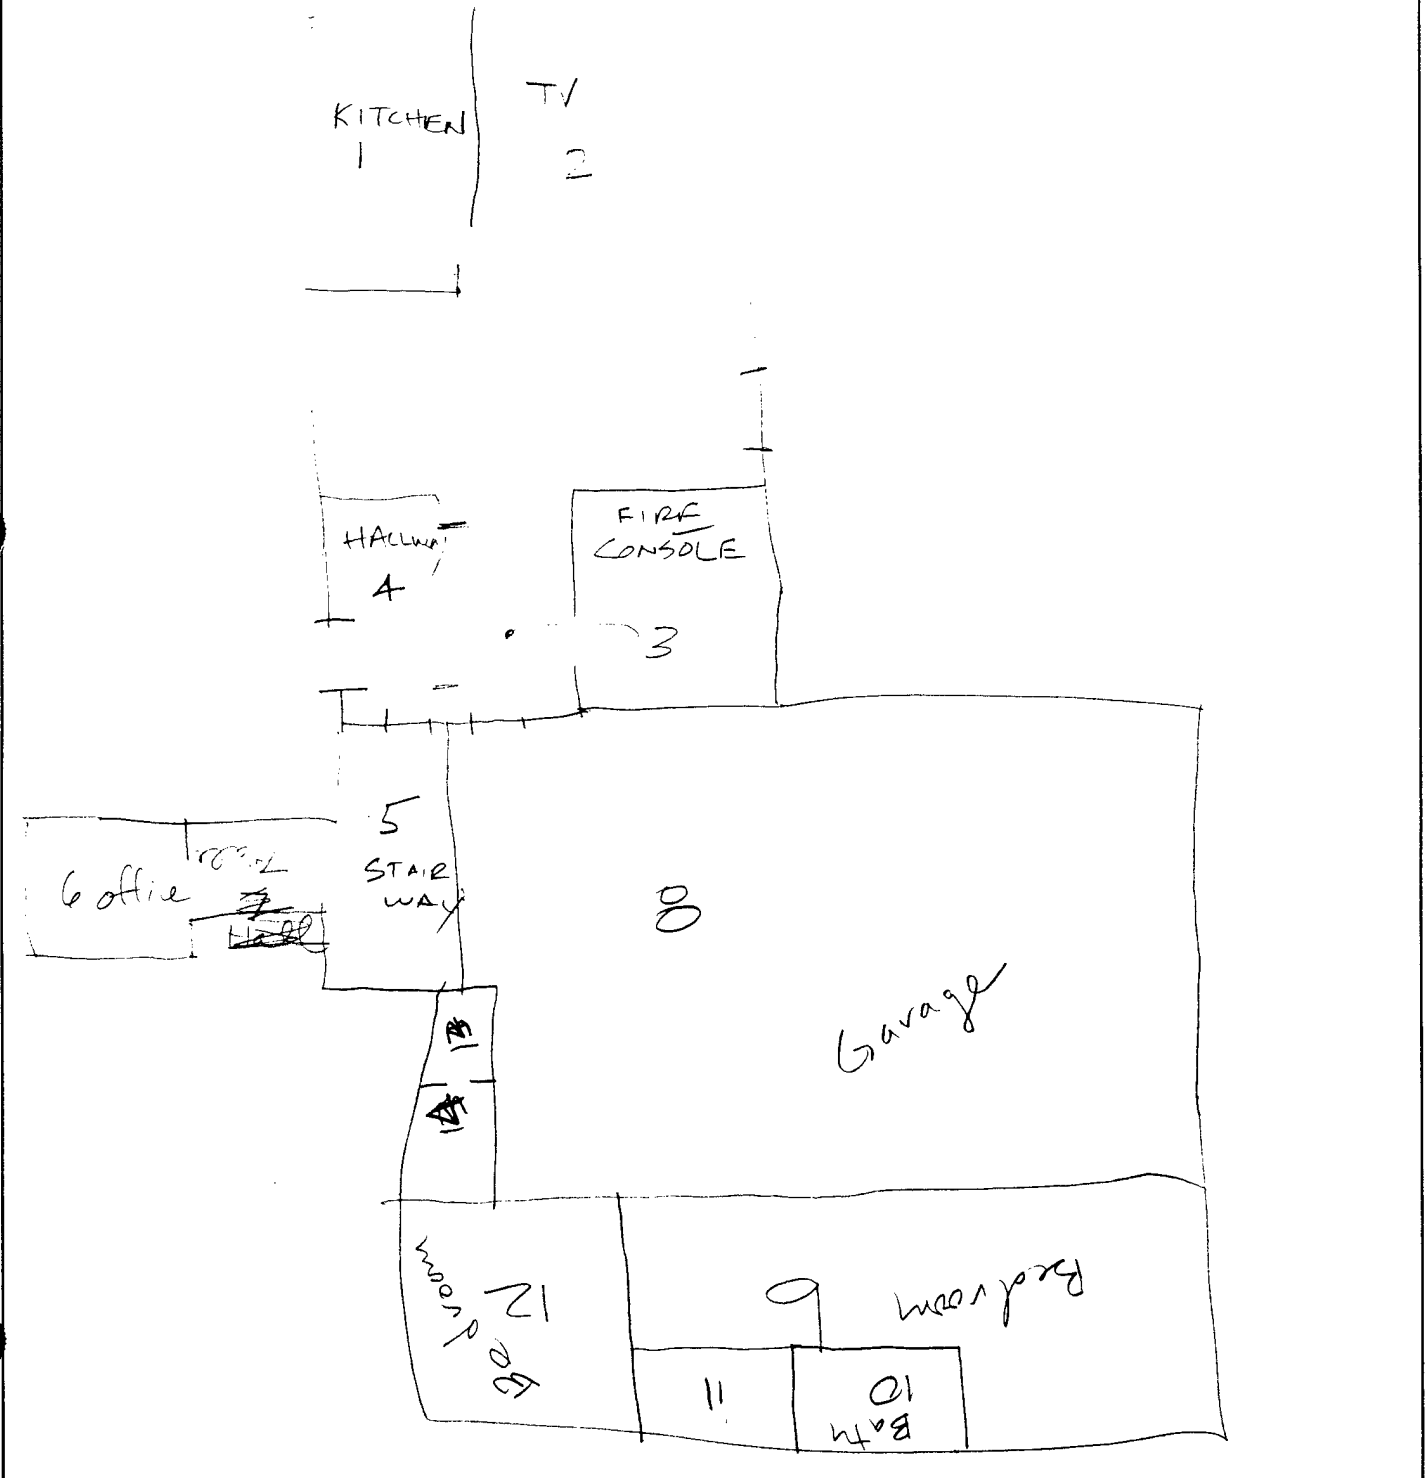

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY CPA DATE 1/2/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

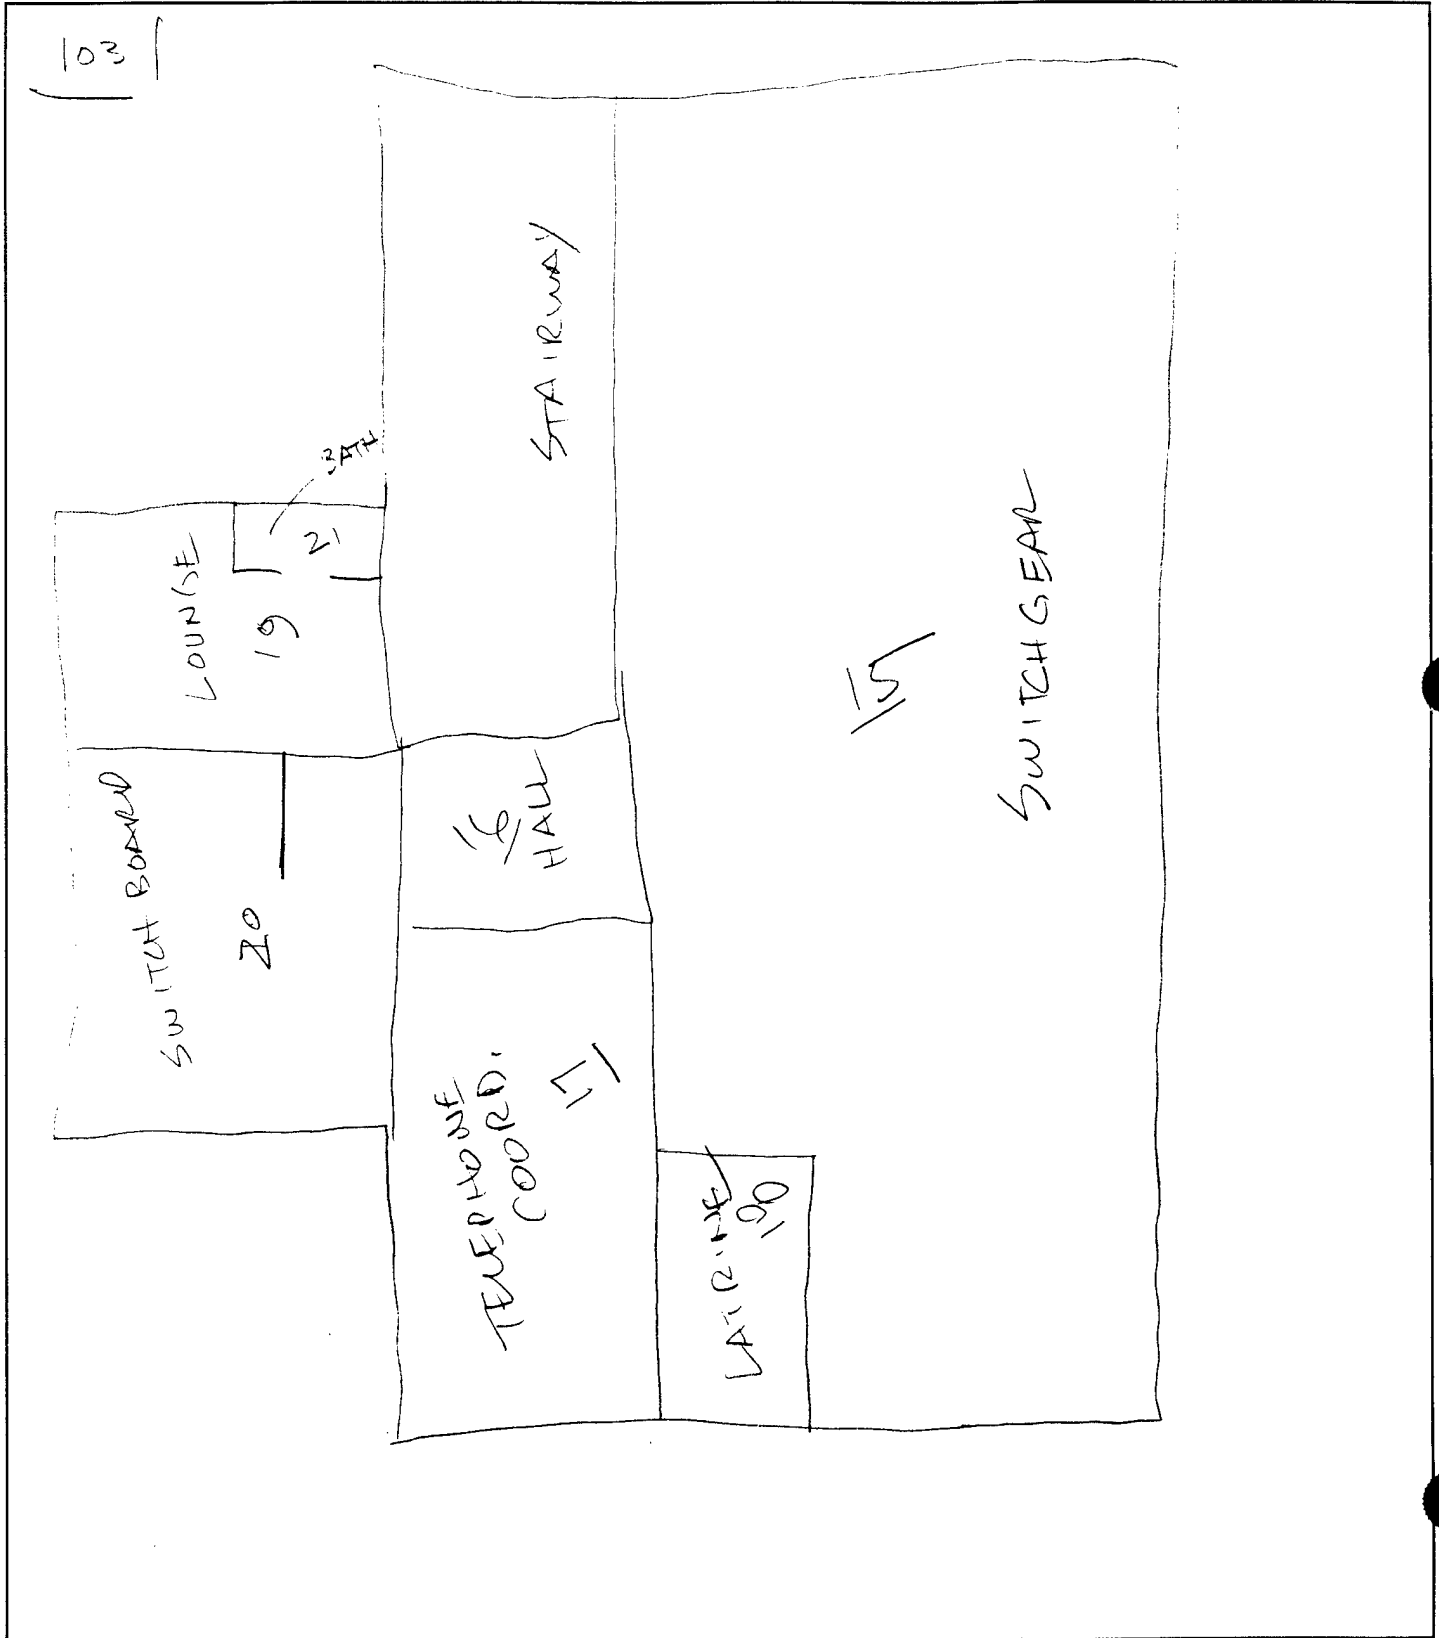

BUILDING 133





EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KC  
CHECKED BY: \_\_\_\_\_  
DATE: 1/2/92

BLDG.# A 133  
ECO 5

MOTORS

MOTOR #	<u>1</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	<u>1735</u>
MODEL #	<u>SBDP</u>	VOLTS	<u>200</u>	AMPS	<u>11.4</u>		
SERIAL #	<u>7110N</u>	PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>WESTINGHOUSE</u>	REQUIRED HR.		TO			
FRAME	<u>182T</u>	EFF.					
DESCRIPTION	<u>AHU FAN (UPSTAIR)<sup>#1</sup></u>		COMMENTS <u>SECOND FLOOR</u>				
MOTOR #	<u>2</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	<u>1735</u>
MODEL #	<u>SBDP</u>	VOLTS	<u>200</u>	AMPS	<u>11.4</u>		
SERIAL #	<u>7110 1</u>	PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>WESTINGHOUSE</u>	REQUIRED HR.		TO			
FRAME	<u>182T</u>	EFF.					
DESCRIPTION	<u>AHU FAN (UPSTAIR)<sup>#2</sup></u>		COMMENTS <u>SECOND FLOOR</u>				
MOTOR #	<u>3</u>	HP	<u>1.5</u>	PH	<u>1</u>	RPM	<u>3450</u>
MODEL #	<u>8-113851-23</u>	VOLTS	<u>230</u>	AMPS	<u>8</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>SOULD</u>	REQUIRED HR.		TO			
FRAME	<u>L56</u>	EFF.					
DESCRIPTION	<u>AHU FAN (DOWN STAIR)<sup>#3</sup></u>		COMMENTS <u>CONTROL OFF T'STAT</u>				

BLDG.# \_\_\_\_\_  
ECO 5

MOTORS

MOTOR #	<u>4</u>	HP	<u>?</u>	PH	_____	RPM	_____
MODEL #	<u>G-H1201-20 M</u>	VOLTS	<u>115</u>	AMPS	<u>?</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>CARRIER, COMFORTMAKER</u>	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	<u>AHU BOTTOM FLOOR #4</u>	COMMENTS	<u>NOT ACC.</u>				

MOTOR #	<u>5</u>	HP	<u>1/8</u>	PH	<u>1</u>	RPM	_____
MODEL #	<u>UHQA-0810B</u>	VOLTS	<u>115-240</u>	AMPS	<u>2 0.8</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>RUUD</u>	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	<u>AHU #5</u>	COMMENTS	<u>HOME TYPE UNIT</u>				

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

133

• ACCU-1 SERIES \_\_\_\_\_

RUUD AIR CONDITIONER

MODEL UACC-056CAS

SER NO. 4147M2890 9117

208V 3  $\phi$  60 Hz

20.5A

est. 5 TON

• ACCU-2 & 3 NO NAMEPLATE SERIES WALK IN COOLERS

• ACCU-4 OFF SERIES CARRIER

est 10 ton


MODEL 38AE 016 500

SER 239 OF 18891

COMP 1, 208V, ~~63.6A~~ 63.6A, 3  $\phi$

FAN 1, 208V, 3.7A 1  $\phi$

2, 208V, 4.3A 1  $\phi$

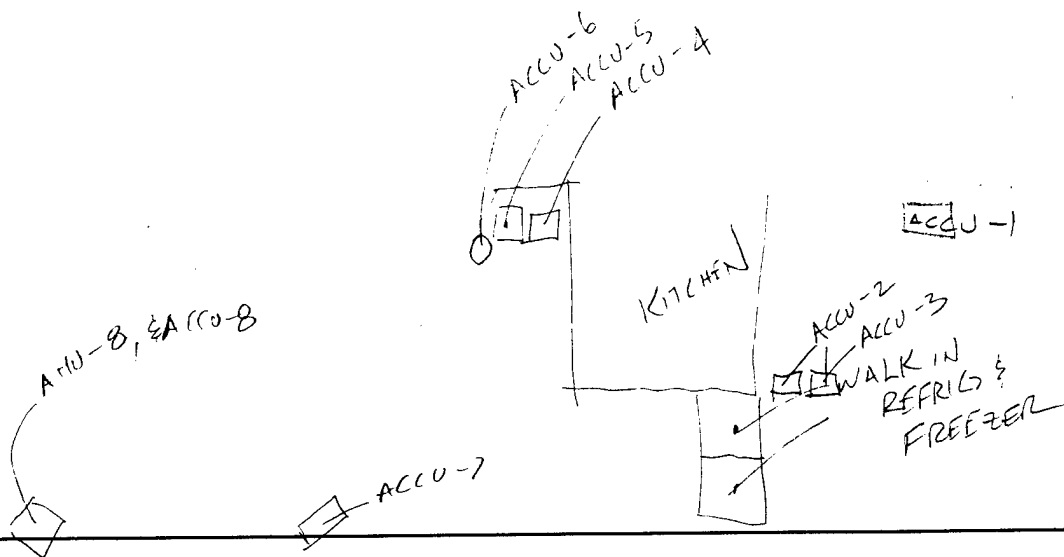

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

133

ACCU-6 REFRIG \_\_\_\_\_

OFF  
CLIMATE CONTROL

MODEL A-R 801060-25

SFR 0135810-432-0034

COMP 230V, 17.5A, 3 $\phi$

FAN 230V, 2.5A, 1 $\phi$

ACCU-7 (OFF) STOPS \_\_\_\_\_

ROOM AIR CONDITIONER

MODEL UPFA 018VAS

SER NO 429 A M 3588 1365

208V, 10.5A, 1 $\phi$

AHU-8 & ACCU-8 (RUNNING)

TRAKE, FORCED AIR FURNACE w/ ACCU

MODEL BYC 024H 1L0AA

TYPE 168-740-1-A

60,000 BTU IN NGAS

1 COMP - 11.8A, 208V, 1 $\phi$

1 COND FAN - 1.7A, 208V, 1 $\phi$ , 1/4 HP

1 EVAP FAN - 2.5A, 208V, 1 $\phi$ , 1/4 HP

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY FE DATE 1/2/97

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

133

GAS FIRED WATER HEATERS

-1, AG SMPL

MODEL BT 65 930A, 50 GAL  
N. GAS FIRED  
50,000 BTU/hr INPUT  
+ 5.5 GAL/hr

-2, AG SMPL

MODEL BT 270 830, 100 GAL  
N. GAS FIRED  
270,000 BTU/hr INPUT  
22.4 GAL/hr

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 133

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/2/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

TEMPERATURES

NORTH EAST WING HALL  $\Rightarrow$  62°F

DINING HALL  $\Rightarrow$  69°F at 2:00 pm

BUILDING 207

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/3/92

BLDG.# 207  
 ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
SOUTH (BAY 1) <del>FAUCET</del> FAUCET	142°F
BAY-3 MEN'S	142°F
BAY-7 BREAKROOM	125°F

**PROBLEMS:**

**COMMENTS:**

---



---



---



---



---



BLDG.# 207  
ECO 5

MOTORS

MOTOR #	<u>1</u>	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____	_____	
SERIAL #	_____	PRESENT HR.	_____	T' STAT CONTROL		TO	_____
MFG	<u>SINGER</u>	REQUIRED HR.	_____	TO	_____	_____	
FRAME	_____	EFF.	_____	_____			
DESCRIPTION	<u>FURNACE SOUTH END, (AHU-1)</u>		COMMENTS <u>NOT ACCESSABLE - HOME TYPE</u>				

MOTOR #	<u>2, 3, 5, 6, 7</u>	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____	_____	
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	
MFG	_____	REQUIRED HR.	_____	TO	_____	_____	
FRAME	<u>KEFF</u>	EFF.	<u>8</u>	_____			
DESCRIPTION	<u>UNIT HEATER</u>		COMMENTS _____				
<u>SOUTH END WAREHOUSE</u>							

MOTOR #	<u>8</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>1740</u>
MODEL #	<u>TK184TDR7627ACL</u>	VOLTS	<u>200</u>	AMPS	<u>14.8</u>	_____	
SERIAL #	_____	PRESENT HR.	<u>0</u>	TO	<u>2400</u>	_____	
MFG	<u>MARATHON</u>	REQUIRED HR.	<u>7:30</u>	TO	<u>4:30</u>	_____	
FRAME	<u>184T</u>	EFF.	<u>85.5</u>	_____			
DESCRIPTION	<u>AHU2 SERVE OFFICES</u>		COMMENTS <u>MW &amp; DX COIL</u>				
<u>SOUTH END</u>							

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
DATE: \_\_\_\_\_

BLDG.# 207  
ECO 5

MOTORS

MOTOR #	<u>12</u> <u>0T00504</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>1720</u>
MODEL #		VOLTS	<u>208-230</u>	AMPS	<u>14-12.9</u>		
SERIAL #	<u>U54052620</u>	PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>AC SMITH</u>	REQUIRED HR.	<u>7:00</u>	TO	<u>4:30</u>		
FRAME	<u>184T</u>	EFF.					
DESCRIPTION	<u>AHU3 SOUTH OFFICE</u>	COMMENTS	<u>IN MECH ROOM WITH ANOTHER AHU.</u>				

MOTOR #	<u>13</u> <u>3N558A</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>1730</u>
MODEL #		VOLTS	<u>208-230</u>	AMPS	<u>14.2-13.4</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>DAYTON</u>	REQUIRED HR.	<u>7:00</u>	TO	<u>4:30</u>		
FRAME	<u>K184T</u>	EFF.					
DESCRIPTION	<u>AHU4 SOUTH OFFICE</u>	COMMENTS	<u>KVAR 1.3</u> <u>IN MECH ROOM WITH ONE ABOVE</u>				

MOTOR #	<u>14</u>	HP	<u>1</u>	PH		RPM	<u>1725</u>
MODEL #	<u>186277-01</u>	VOLTS	<u>230</u>	AMPS			
SERIAL #		PRESENT HR.		TO			
MFG	<u>CENTURY</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>COMPUTER ROOM</u>	COMMENTS	<u>SOUTH END</u>				

BLDG.# 207  
 ECO 5

**MOTORS**

MOTOR #	<u>9</u>	HP	<u>1/8</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	_____	VOLTS	<u>115</u>	AMPS	<u>2.4</u>	_____	_____
SERIAL #	_____	PRESENT HR.	<u>0</u>	TO	<u>2400</u>	_____	_____
MFG	<u>BELL GOSSETT</u>	REQUIRED HR.	<u>7:30</u>	TO	<u>4:00</u>	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>HW PUMP</u>		COMMENTS _____				
	<u>BOILET TO AHU COIL.</u>						


MOTOR #	<u>10</u>	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	_____	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>ACCU FOR AHU</u>		COMMENTS _____				
	<u>MOTOR # 8</u>						

MOTOR #	<u>11</u>	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	<u>DAYTON</u>	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>ELECTRIC HEATER &amp; BLOWER</u>		COMMENTS <u>VERY SMALL</u>				

BLDG.# 207  
ECO 10

AIR STRATIFICATION

LOCATION	<u>STORAGE</u>	REQ. TEMP.	_____
TEMP. AT TSTAT	_____	SOURCE	_____
TEMP. AT CEILING	_____	OPP. HOURS	_____ TO _____
TEMP. AT FLOOR	<u>60°F</u>		

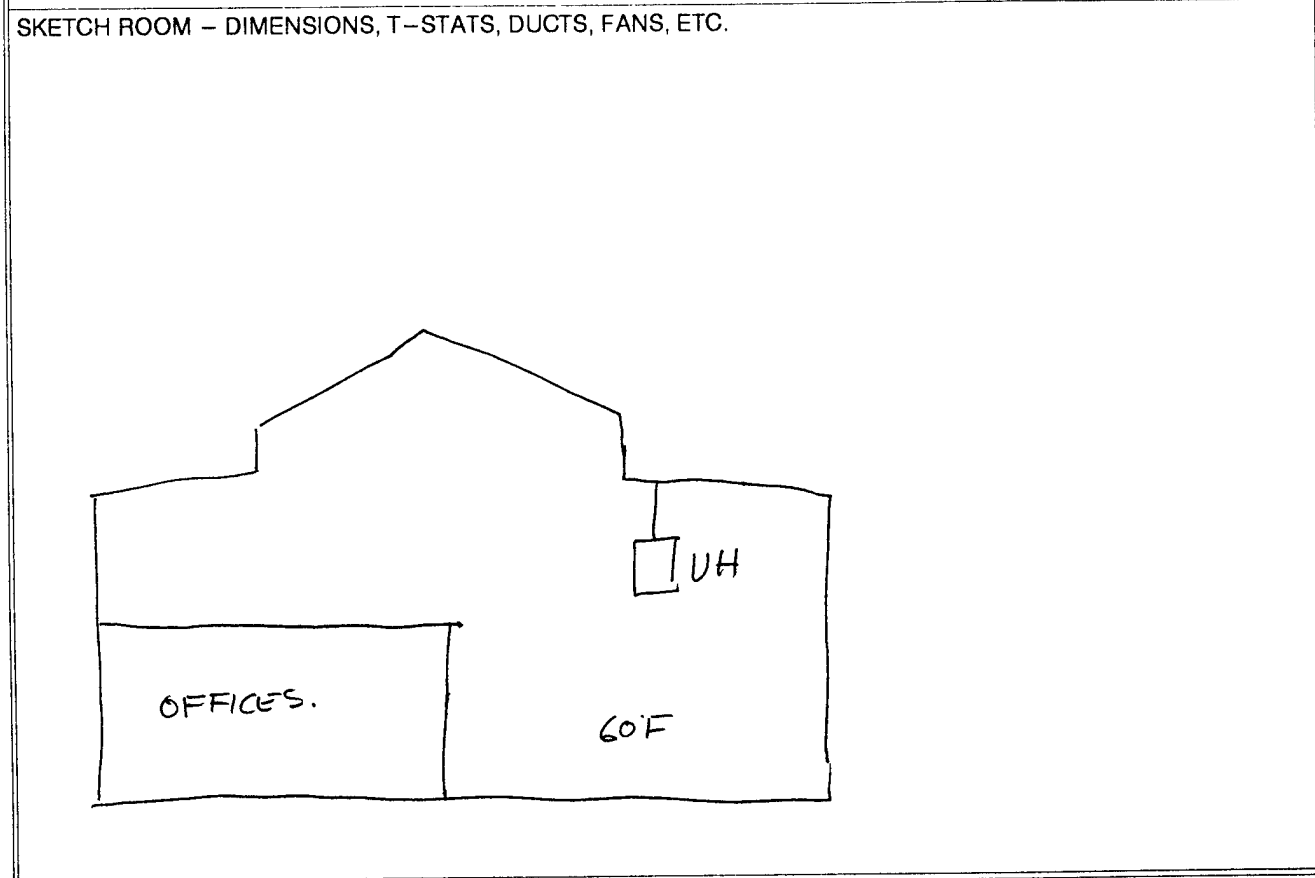

COMMENTS: COMPUTER & SUPPLIES STORAGE  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_


BLDG.#  
ECO 10

207

### AIR STRATIFICATION

LOCATION	<u>NORTH END</u>	REQ. TEMP.	_____
TEMP. AT TSTAT	_____	SOURCE	<u>UNIT HEATER</u>
TEMP. AT CEILING	<u>68° F</u>	OPP. HOURS	_____ TO _____
TEMP. AT FLOOR	<u>65.4° F</u>	T' STAT	<u>GAS FIRE</u>

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

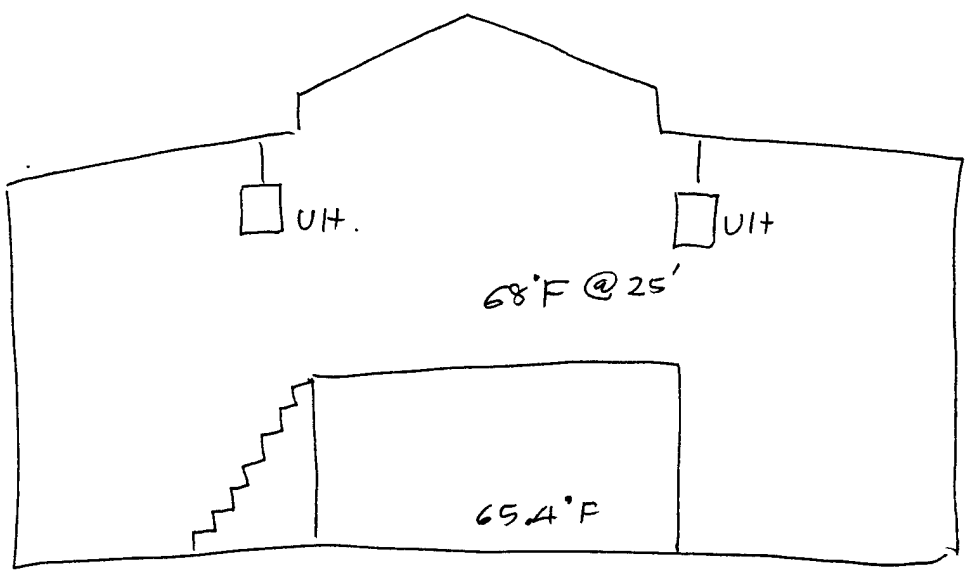

COMMENTS:

BAY 7

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

KC

1/3/92


BLDG.#  
ECO 10

207

AIR STRATIFICATION

LOCATION 207 SOUTHEAST REQ. TEMP. \_\_\_\_\_  
TEMP. AT TSTAT \_\_\_\_\_ SOURCE \_\_\_\_\_  
TEMP. AT CEILING \_\_\_\_\_ OPP. HOURS 7:30 TO 4:30  
TEMP. AT FLOOR \_\_\_\_\_

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

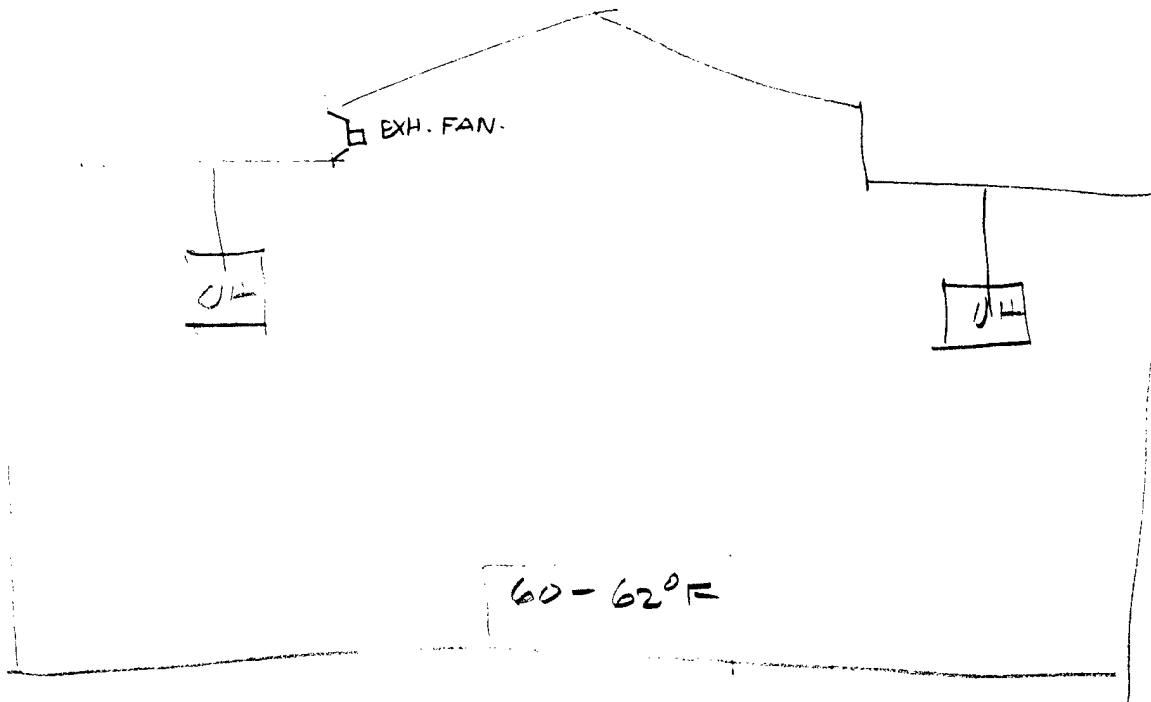

COMMENTS: FOOD STORAGE

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/6/92

BLDG.# 207  
EC0 15

### LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
BAY 4	45	2	8'	F	ON	Y	NO		Y
BAY 5	45	2	8'	F	ON	Y	NO		Y
130	15	1	60	I	OFF	Y	N		N
131	1								

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB: Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.#: EMC # 3105.000  
 SHEET NO.: \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/3/91

BLDG.# 207  
 ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
54	SAME AS	AS	53						
55	2	4	34	F	OFF	Y	Y	1	NO
56	88	2	34	F	ON	Y	NO	<del>8</del>	NO
57	6	4	34	F	ON	Y	<del>NO</del> Y	1	Y
58	6	4	34	F	ON	Y	Y	1	Y
59	3	4	34	F	OFF	Y	Y	1	NO
60	90	2	34	F	ON	Y	N	<del>8</del>	N
61	3	2	34	F	OFF	Y	Y	1	NO
62	3	4	34	F	ON	Y	<del>NO</del>	1	Y
63	3	2	34	F	ON	Y	N	1	NO
64	$\frac{1}{2}$	$\frac{1}{20}$	$\frac{100}{34}$	$\frac{I}{F}$	ON	Y	N	1	NO
65	2	2	8'	F	OFF	Y	N	1	NO
66	1	2	8'	F	ON	Y	N	1	YES
67	1	1	60	I	ON	Y	Y	1	YES

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_



BLDG.# 207  
 ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
36	4	4	34	F	ON	Y	Y	1	Y
37	<i>locked</i>								
38	35	2	8'	F	ON	Y	NO	Breakers	Y
39	6	4	34	F	ON	Y	NO	1	NO
40	6	4	34	F	ON	Y	NO	1	NO
41	66	2	8'	F	ON	Y	NO	2	Y
42	40	2	8'	F	ON	Y	NO	?	Y
43	1	2	34	F	ON	Y	<del>NO</del>	1	Y
44	6	4	34	F	OFF	Y	Y	1	NO
① 45	<del>2</del> <sup>21</sup>	2	34	F	ON	Y	NO	1	NO
46	4	4	34	F	OFF	Y	Y	1	NO
47	3	4	34	F	OFF	Y	Y	1	NO
48	2	4	34	F	OFF	Y	Y	1	NO
49	2	4	34	F	ON	Y	Y	1	YES
50	4	4	34	F	ON	Y	Y	1	Y
51	4	4	34	F	ON	Y	Y	1	NO
52	2	4	34	F	ON	Y	Y	1	Y
53	6	4	34	F	ON	Y	N	1	Y

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: ① 4 corner lights are emergency

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/3/92

BLDG.# 207  
ECO 15

**LIGHTING**

dl  
dl

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
18									
19	2	4	34	F	ON	Y	<del>NO</del>	1	NO
20	2	4	34	F	ON	Y	Y	1	YES
21	6	2-u	?	F	ON	Y	Y	1	NO
22	6	2-u		F	ON	Y	Y	1	Y
23	↑	↑							
24	<del>6</del>	4	34	F	ON	Y	<del>NO</del>	1	N
25	8	4	34	F	ON	Y	Y	2	Y
26	3	4	<del>34</del>	F	ON	Y	NO	1	NO
27	$\frac{6}{2}$	$\frac{4}{2-u}$	$\frac{34}{}$	F	ON	Y	NO	2	NO
28	6	2-u		F	ON	Y	Y	1	<del>NO</del>
29	14	4	34	F	ON	Y	NO	3 <del>2</del>	NO
30	$\frac{2}{1}$	$\frac{4}{2-u}$	$\frac{34}{}$	F	ON	Y	Y	1	NO
31	$\frac{2}{2}$	$\frac{4}{2-u}$	$\frac{34}{}$	F	OFF	Y	Y	1	NO
32	$\frac{2}{2}$	$\frac{4}{2-u}$	$\frac{34}{}$	F	ON	Y	NO	1	<del>Y</del>
33	6	4	34	F	ON	Y	NO	1	NO
34	2	<del>4</del>	34	F	ON	Y	Y	1	Y
35	2	2	8'	F	OFF	Y	Y	1	NO

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/3/92

BLDG.# 207  
 ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
1	10	4	34	F	ON	Y	NO	2	NO
2	2	4	34	F	ON	Y	YES	1	YES
<del>3</del> 3	1	2	8'	F	OFF	Y	<del>NO</del>	1	NO
4	SAME	↑↑							
5	15	2	8'	F	ON	Y	NO	(3) BREAKERS	NO
6	4	4	34	F	<del>ON</del>	Y	Y	1	YES
7	43	2	8'	F	ON	Y	NO	BREAKERS	<del>NO</del> YES
8	2	2	8'	F	ON	Y	NO	1	NO
9	<del>3</del> 3	<del>4</del> 4	34	F	ON	Y	NO	1	NO
10	1	1	34	F	ON	Y	NO	1	Y
11	4	2	34	F	OFF	Y	YES	1	NO
12	5	4	34	F	ON	Y	Y	1	NO
13	6	4	34	F	ON	Y	Y	1	NO
14A	2	4	34	F	ON	Y	N	1	NO
14B	4	4	34	F	ON	Y	N	1	NO
15	6	4	34	F	ON	Y	N	1	NO
16	7	4	34	F	ON	Y	N	1	NO
17	4	2-U	?	F	OFF	Y	Y	1	NO

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

207

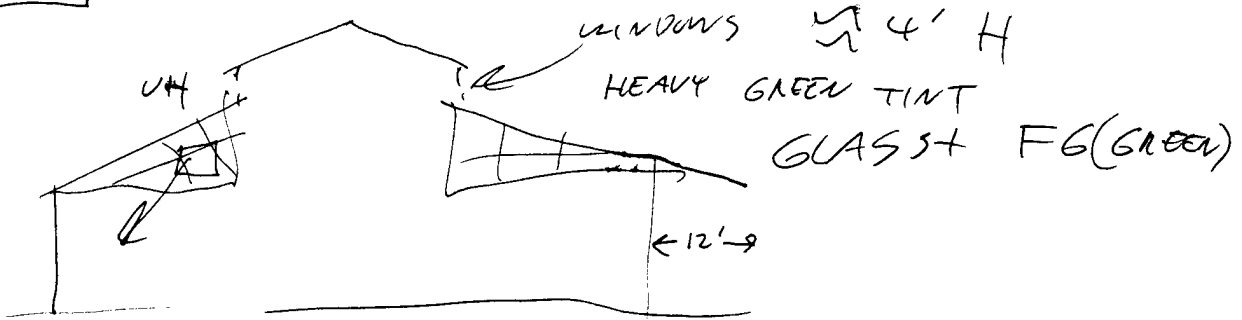

SINGLE PANE GLASS @ 8'x8'

1" CRACK UNDER STEEL MAIN DOORS

1/2" LI PERMEABLE GAUGE DOORS (SLIDING) 10'x10'

CEMENT ROOF (NO INSUL)

WALL DOUBLE BRICK

STEEL FRAME CONSTRUCTION

TRUCK DOOR LEFT OPEN WITH V/H RUNNING

WALLS 3 @ LAYERS BRICK NO AIR SPACE

BUILDING 213



EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-6-92

BLDG.# 213  
ECO 5

MOTORS

MOTOR #	<u>10</u>	HP	<u>7.5</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>6-330771-03</u>	VOLTS	<u>230/460</u>	AMPS	<u>21/10.5</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>GOULD</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>HEATING SUPPLY #2</u>		COMMENTS	<u>WINTER ONLY</u> <u>NOT RUNNING</u>			
MOTOR #	<u>13</u>	HP	<u>3.0</u>	PH	<u>3</u>	RPM	<u>3450</u>
MODEL #	<u>8-350378-01</u>	VOLTS	<u>200 230/460</u>	AMPS	<u>9.0-8.6/4.3</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>CENTURY</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>CONDENSATE PUMP #1</u>		COMMENTS	<u>FLOAT SWITCH</u>			
MOTOR #	<u>14</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	<u>3450</u>
MODEL #	<u>8-350378-01</u>	VOLTS	<u>200-230/460</u>	AMPS	<u>9.0-8.6/4.3</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>CENTURY</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>CONDENSATE PUMP #2</u>		COMMENTS	<u>FLOAT SWITCH</u>			

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KL  
CHECKED BY: \_\_\_\_\_  
DATE: 1-6-92

BLDG.# 213  
ECO 5

MOTORS

MOTOR #	<u>12</u>	HP	<u>10</u>	PH	<u>3</u>	RPM	<u>1745</u>
MODEL #	<u>MK 215TTDR 7026HTW</u>	VOLTS	<u>208-230</u>	AMPS	<u>26.6</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>MARATHON</u>	REQUIRED HR.	_____	TO	_____		
FRAME	<u>215T</u>	EFF.	<u>86.5</u>				
DESCRIPTION	<u>CWP RETURN 2</u>	COMMENTS	<u>SUMMER ONLY</u> <u>* CAN NOT TAKE READING.</u>				

MOTOR #	<u>11</u>	HP	<u>10</u>	PH	<u>3</u>	RPM	<u>1745</u>
MODEL #	<u>MK 215TTDR 7026HTW</u>	VOLTS	<u>208-230</u>	AMPS	<u>26.6</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>MARATHON</u>	REQUIRED HR.	_____	TO	_____		
FRAME	<u>215T</u>	EFF.	<u>86.5</u>				
DESCRIPTION	<u>CWP 1</u>	COMMENTS	<u>SUMMER ONLY</u> <u>* CANNOT TAKE READING.</u>				

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				



BLDG.# 213  
ECO 5

**MOTORS**

MOTOR #	<u>18</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	_____
MODEL #	<u>BWV180B300BA</u>	VOLTS	<u>200-230</u>	AMPS	<u>9</u>		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	<u>American Standard</u>	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	<u>AHU #1</u>	COMMENTS	<u>Room 128</u>				

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	<u>AHU</u>	COMMENTS	_____				

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: CS  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-6-92

BLDG.# 213  
 ECO 5

**MOTORS**

MOTOR #	<u>4</u>	HP	<u>2</u>	PH	<u>3</u>	RPM	<u>1740</u>
MODEL #	<u>8-337207-1</u>	VOLTS	<u>208/416</u>	AMPS	<u>7/3.5</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>Gould</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>CWP #3</u>	COMMENTS	<u>ONLY IN SUMMER</u>				

MOTOR #	<u>5</u>	HP	<u>15</u>	PH	<u>3</u>	RPM	<u>1755</u>
MODEL #	<u>F-1713-02-234</u>	VOLTS	<u>200</u>	AMPS	<u>49</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>U.S. Electric Motor</u>	REQUIRED HR.	<u>7:30</u>	TO	<u>4:30</u>		
FRAME	<u>254 T</u>	EFF.	<u>87.5</u>				
DESCRIPTION	<u>AHU Supply #2</u>	COMMENTS					
	<u>KVAR 3.2</u>						
	<u>KVA 5.5</u>						
	<u>PF 81.4</u>						
	<u>KW 4.5</u>						
			<u>VOLT 208</u>		<u>205</u>		
			<u>AMP 27.7</u>		<u>26.7</u>		

MOTOR #	<u>6</u>	HP	<u>3/4</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>M-270 A</u>	VOLTS	<u>115</u>	AMPS	<u>10.8</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>LELAND-FARRADAY</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>Return #1</u>	COMMENTS					

BLDG.# 213  
ECO 5

MOTORS

MOTOR #	<u>1</u>	HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.			<u>0</u>	TO	<u>2400</u>
MFG	<u>CARRIER</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>AHU - CARRIER #4</u>		COMMENTS <u>CANNOT READ NAMEPLATE</u> <u>SECTION 6 SELF CONTAIN WITH COMPRESSOR @ BOTTOM</u>				
MOTOR #	<u>2</u>	HP	<u>0.5</u>	PH	<u>1</u>	RPM	
MODEL #	<u>50EEO24-331-MD2</u>	VOLTS	<u>208/230</u>	AMPS	<u>4.6</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>CARRIER</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>AHU - PAD MOUNT #5</u>		COMMENTS				
MOTOR #	<u>3</u>	HP	<u>1</u>	PH	<u>3</u>	RPM	<u>1740</u>
MODEL #	<u>3-339206-1</u>	VOLTS	<u>208</u>	AMPS	<u>3.75</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>GOULD</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>HWP #3</u>		COMMENTS <u>ONLY IN WINTER</u>				

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-6-92

BLDG.# 213  
ECO 5

MOTORS

MOTOR #	15	HP	1/12	PH	1	RPM	1725
MODEL #	M09181 1-89	VOLTS	115	AMPS	1.75		
SERIAL #		PRESENT HR.				TO	
MFG	Bell Gossett	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	HWP #1	COMMENTS	Room 128				
MOTOR #	16	HP	1/12	PH		RPM	1725
MODEL #	M091811-89	VOLTS	115	AMPS	1.75		
SERIAL #		PRESENT HR.				TO	
MFG	Bell Gossett	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	HWP #2	COMMENTS	Room 128				
MOTOR #	17	HP	2	PH	3	RPM	
MODEL #	BTE120B400GA	VOLTS	200-230	AMPS	6.6		
SERIAL #	#	PRESENT HR.				TO	
MFG	Trane	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	AHU #3	COMMENTS	Room 128				

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-6-92

BLDG.# 213  
ECO 5

MOTORS

MOTOR #	<u>7</u>	HP	<u>3/4</u>	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	_____	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>Return #2</u>		COMMENTS <u>Could not read</u>				

MOTOR #	<u>8</u>	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	<u>120</u>	AMPS	_____	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	_____	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>FCU 1-6</u>		COMMENTS <u>CEILING MOUNT UNIT</u> <u>T/STAT CONTROL</u>				

MOTOR #	<u>9</u>	HP	<u>7.5</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>6-330771-03</u>	VOLTS	<u>230/460</u>	AMPS	<u>21/10.5</u>	_____	_____
SERIAL #	_____	PRESENT HR.	<u>0</u>	TO	<u>2400</u>	_____	_____
MFG	<u>GOULD</u>	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>HEATING SUPPLY</u> <u>#1</u>		COMMENTS <u>WINTER ONLY</u> <u>RUNNING</u>				

BLDG.# 213  
ECO 5

MOTORS

MOTOR #	<u>AHU-2</u>	HP	<u>7.5</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>6-330771-03</u>	VOLTS	<u>230/460</u>	AMPS	<u>21/10.5</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>Century</u>	REQUIRED HR.		TO			
FRAME	<u>21T</u>	EFF.	<u>82.9</u>	PF	<u>80.7</u>		
DESCRIPTION		COMMENTS					
MOTOR #	<u>AHU 8</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>6-322465-03</u>	VOLTS	<u>230/460</u>	AMPS	<u>14.4/7.2</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>Century</u>	REQUIRED HR.		TO			
FRAME	<u>S184T</u>	EFF.	<u>81.6</u>	PF	<u>79.7</u>		
DESCRIPTION	<u>Fire Range</u>	COMMENTS					
MOTOR #	<u>AHU-1</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>1745</u>
MODEL #	<u>EK184AL 217C</u>	VOLTS	<u>230/460</u>	AMPS	<u>14.2/7.1</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>GE</u>	REQUIRED HR.		TO			
FRAME	<u>184T</u>	EFF.	<u>—</u>				
DESCRIPTION		COMMENTS			<u>Service factor 1.15</u>		

BLDG.# 213  
 ECO 15

**LIGHTING**

EAL #	ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
7	1	8	2		F	ON		N	1	N
24	1A	4	4		F	ON		N	1	N
24	1B	8	2		F	ON		N	1	N
8	2	3	2		F	ON		Y	1	N
12	3	3	2		F	ON		Y	1	N
11	4	2	4		F	ON		Y	1	N
	5	A								
reception	6	A								
	7	12	4		F	ON		N	2	N
	8	2	4		F	ON		N	1	N
	9	3	4		F	ON		N	1	N
13	10	5	4		F	ON		N	1	X
	11	6	2		F	ON		N	1	N
	12	6	2		F	ON		N	1	N
17	13	6	4		F	ON		N	1	N
21	14	3	4		F	ON		N	1	N
23	15	2	1	40	I	OFF		N	1	N
19	16	1	1	34	F	OFF	Y	Y	1	N.

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/3/92

BLDG.# 213  
ECO 15

LIGHTING

Actual Room	ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
2022	17E18	SAME AS		14-15						
67	19	11	4		F	ON	Y	N	2	N
70	20	2	2		F	ON	Y	N	1	N
77	21	4/9	1	150/34	I/F	ON	Y	N	1	Y
71	22	2	2		F	ON	Y	N	1	Y
72	23	2	2		F	ON	Y	<del>N</del> Y	1	Y
73	24	2	4		F	ON	Y	Y	1	Y
75	24	8	4		F	ON	Y	N	1	Y
74	26	2	2		F	ON	Y	Y	1	Y
76	27	19	2		F	ON	Y	N	1	Y
PHOTO LAB	28	14	2		F	ON	Y	N	2	N
93	29	4	4		F	OFF		<del>N</del>	1	N
96	30	1	4		F	OFF		N	1	N
97	31	1								
MICRO-PHOTO	32	1	4		F	OFF		N	1	N
98	33	2	4		F	OFF		N	1	N
100	34	16	4		F	ON		N	4	N
EXIT	35*	1	1	10	I	OFF		N	1	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \* GUN ROOM





**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/3/92

BLDG.# 213  
ECO 15

**LIGHTING**

*Adm  
Room*

*HEM  
MIX*

*91*

*79*

*78*

*108*

*107*

*109*

*110*

*106*

*104*

*102*

*101*

*105*

*64*

*59*

*Footwear  
Room*

*Laser  
Room*

*Auto  
Room*

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
<del>39</del>	1	4		F	ON		N	1	N
40	2	4		F	ON		N	1	N
41	2	4		F	ON		N	1	N
42	3	4		F	ON		N	2	N
43	4	4		F	ON		N	2	N
44	2	4		F	ON		Y	1	N
45	2	4		F	OFF		N	1	
46	3	4		F	ON		N	1	
47	2	4		F	ON		N	1	N
48	↑				ON		N	1	N
49	A				ON		N	1	N
50	1	2		F	ON		N	1	N
51	2	4		F	ON		Y	1	<del>Y</del>
52	20	4		F	ON		N		NO
53	5	4		F	OFF		N	1	NO
54	3	4		F	OFF		N	1	N
55	3	4		F	OFF		N	1	N
56	6	LOW PRESS. SODIUM		I	OFF		N	1	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-6-92

BLDG.# 213  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
110	3	4	34	F	ON	Y	N	1	Y
	3	2 <sup>(u)</sup>	40	F	ON	Y	N	1	Y
113	4	2 <sup>(u)</sup>	40	F	OFF	Y	Y	1	N
114	4	2 <sup>(u)</sup>	40	F	ON	Y	Y	1	N
116	4	2 <sup>(u)</sup>	40	F	ON	Y	N	1	N
117	20	4	34	F	ON	Y	N	2	Y
	8	2 <sup>(u)</sup>	40	F	ON	Y	N	2	Y
119	3	2 <sup>8'</sup>		F	ON	Y	N	1	N
121	9	4	34	F	ON	Y	N	1	N
122	6	2 <sup>(u)</sup>	40	F	ON	Y	N	1	N
123	21	2 <sup>8'</sup>		F	ON	Y	N	5	N
125	2	4	34	F	ON	Y	N	1	<del>Y</del> Y
	1	2 <sup>(u)</sup>	40	F	OFF	Y	N	1	Y
127	3	4	34	F	ON	Y	N	1	Y
	1	2 <sup>(u)</sup>	40	F	OFF	Y	N	1	Y
128	3	2 <sup>8'</sup>		F	<del>ON</del> OFF	Y	N	1	N
129	5	2 <sup>8'</sup>		F	ON	Y	N	6	Y
	12	1	60	I	ON	Y	N	6	Y

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study

PROJ.# EMC # 3105.000

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY: JW

CHECKED BY: \_\_\_\_\_

DATE: 1/6/92

BLDG.# 213  
ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
103	3	4	34	F	ON	Y	Y	1	Y
104	2	4	34	F	ON	Y	Y	1	N
102	4	4		F	ON	Y	N	1	Y
105	2	4		F	ON	Y	Y	1	N
<del>108</del>	12	4		F	ON	Y	N	2	N
109	6	4		F	OFF	Y	N	2	N
110	10	2		F	OFF	Y	N	1	N
112	10	4		F	ON	Y	N	2	N
115	14/2	4/2u	34/2	F	ON	<del>N</del> Y	N	2	N
118	4	2-u		F	ON	Y	Y	1	N
120	9	4	34	F	ON	Y	N	2	N
124	14	4	34	F	ON	Y	N	1	N
126	1	2u		F	OFF	Y	N	1	N
129	32	4	34	F	ON	Y	N		N
<del>130</del>									

# OF EXIT SIGNS - 2

COMMENTS: \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1/6/92

BLDG.# 213  
ECO 15

LIGHTING

ACTUAL ROOM

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
58	4	2 <sup>(A)</sup>	34	F	ON	Y	N	1	Y
56 59	4	4	34	F	ON	Y	N	1	N
55 60	2	4	34	F	ON	Y	N	1	N
CLEAN UP 61	2	4	34	F	ON	Y	N	1	Y
<del>52</del> 62	4	4	34	F	ON	Y	N	1	N
52 63	2	4	34	F	ON	Y	N	1	Y
51 64	<del>2</del> 16	4	34	F	ON	Y	N	3	N
65	2	4	34	F	ON	Y	Y	1	Y
66	2	4	34	F	ON	Y	Y	1	N
45 69	2	4	34	F	ON	Y	Y	1	N
48 <del>70</del>	<del>2</del> 4	4	34	F	ON	Y	N	2	N
	22	1	20 <sup>3'</sup>	F	ON	Y	N	2	N
42 74	28	4	34	F	ON	Y	N	1	N
	6	1	30 <sup>30"</sup>	F	ON	Y	N	1	N
79	4	4	34	F	ON	Y	Y	1	N
27 80	<del>2</del> 13	4	34	F	ON	Y	N	2	N
30 85	2	4	34	F	ON	Y	Y	1	N
86	1	2 <sup>(A)</sup>	34	F	OFF	Y	N	1	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: NOTE: BAY 5 HAS 58. SKW LIGHTING

BLDG.# 213  
EC0 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
34 88	4	4	34	F	ON	Y	N	1	Y
37 90	6	4	34	F	OFF	Y	N	1	N
38 92	6	4	34	F	ON	Y	Y	1	N
	<del>8</del>	<del>4</del>	<del>34</del>						
	<del>2</del>	<del>2</del>	<del>34</del>						
39 93	2	2 <sup>(w)</sup>	34	F	ON	Y	Y	1	Y
94	235*	2	34	F	ON	Y	N		N
95	4	4	34	F	ON	Y	Y	1	Y
96	1	1	60	I	ON	Y	Y	1	Y
97	5	4	34	F	ON	Y	N	2	Y
98	7	1	75	I	OFF	Y	N	1	N
99	12	4	34	F	ON	Y	N	5	N
	1	2 <sup>(w)</sup>	40	F	OFF	Y	N	2	N
100	1	2 <sup>(w)</sup>	34	F	OFF	Y	N	1	N
101	1	1	60	I	OFF	Y	N	1	N
102	4	4	34	F	ON	Y	N	2	Y
106	10	4	34	F	ON	Y	N	2	N
107	2	4	34	F	ON	Y	N	1	Y

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \* Half of the possible lights are on  
approx. 200 lights off

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study

PROJ.# EMC # 3105.000

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY: JW

CHECKED BY: \_\_\_\_\_

DATE: 1/3/92

BLDG.# 213  
ECO 15

**LIGHTING**

ACTUAL ROOM	ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
66	57	2	4	34	F	OFF	Y	N	1	N
46	67	3	4	34	F	ON	Y	N	1	Y
47	68	2	4	34	F	ON	Y	Y	1	Y
	71	2	4		F	ON	Y	N	1	N
	72	2	4		F	OFF	Y	N	1	N
	73	1	4		F	OFF	Y	N	1	N
41	75	14	4		F	ON	Y	N	2	N
39	76	23	4		F	ON	Y	N	2	N
	77	2	4		F	OFF	Y	Y	1	N
32	78	6	4		F	<del>ON</del>	Y	<del>Y</del>	2	Y
26	81	2	4		F	ON	Y	Y	1	Y
25	82	2	4		F	OFF	Y	Y	1	NO
28	83	2	4		F	ON	Y	Y	1	NO
29	84	3	4		F	ON	Y	Y	1	NO
33	87	3	4		F	ON	Y	N	1	N
35	89	2	4		F	OFF	Y	Y	1	N
	90	5	4		F	ON	Y	N	1	N
36	91	2	4		F	OFF	Y	Y	1	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Bldg 213

Air Comp

7.5 HP 3 $\phi$  1730 Rpm

Model # BL-75-18-213T WEG - Brazil

230/460V 20/10 Amps

eff —

Heat Pump

Carrier Tech 2000

Model #: 38YHC24300

230V 1 $\phi$  60 Hz 13.7 RLA 61 LRA - Compressor

230V 1 $\phi$  9 FLA - Fan

Heat Pump 2

Hussmann 208V

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Plg 263

- 1 Air Handler - Inst Room
- 2 Air Handler - Chemistry Dvr
- 3 Air Handler - Serology
- 4 Air Handler - Latent Prints
- 5 Air Handler - Supply - Section Front of Building
- 6) Air Handler - Photo Rooms
- ✓ 7 Air Handler - Questions + Documents
- 8) Air Handler - Fire Arms

Hot Water (Chilled water <sup>Draw</sup> ~~Flow~~ through  
single zone



**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

C10 BLDG # 213

JOB \_\_\_\_\_  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY JW DATE 1/30/92  
CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
SCALE \_\_\_\_\_

MOTORS

AHU # 3  
GOULD - CENTURY MOTORS 1745 RPM 60 Hz 3 $\phi$   
PART # 6-322465-03 5 HP 14.4 / 7.2 Amp  
FM # S184T TYPE: SC ~~40A~~ 230/460V

AHU # 4 GOULD 5 HP  
PART # 6-322465-03

AHU # 6 & 7  
SAME

AHU # 5 ~~WAS~~ INACCESSIBLE MOTOR  
APPROX 5 HP

NOTE: UNIT HAS A SEVERE LEAK PROBLEM ORIGINATING FROM CHW PNEUMATIC VALVE. HAS BEEN LEAKING FOR SOME TIME BECAUSE PIPE IS RUSTING BADLY ON OUTSIDE.

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 213

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/6/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

BAY 4 CHILLER (SOUTH)

TSE (TECHNICAL SYSTEMS, INCORPORATED)

R-22 S#8775 M#CAZCM12

460V 60Hz 3 $\phi$

4 COMPRESSORS AT 67.5 RLA	283 LRA
44.3	214
67.5	283
44.3	214

12 FANS AT 1HP each  
2.3 FLA

SOUTH END BOILER ROOM:

CONDENSATE TANK SHOULD BE INSULATED.

APPROX 5' DIA. X 10' LONG

RM 128 MECH ROOM:

HW PIPES NEED TO BE INSULATED. 2" PIPE

BAY 2, COMPUTER STORAGE ROOM HAS INADEQUATE LIGHTING. THE OCCUPIERS HAVE INSTALLED THEIR OWN FLOURESCENT LIGHTS & THE OLD INCANDESCENT LIGHTS ARE A SAFETY HAZZARD BECAUSE OLD ~~LIGHTING~~ WIRE.

BUILDING 214



**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-9-92

BLDG.# 214 G  
 ECO 5 \_\_\_\_\_

**MOTORS**

MOTOR #	<u>3</u>	HP	<u>1/6</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>M10293 183</u>	VOLTS	<u>115V</u>	AMPS	<u>2.4</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>B G</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>DHW CIRC. PUMP.</u>		COMMENTS <u>PRESSURE CONTROL.</u>				
MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.				TO	
MFG		REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION			COMMENTS				
MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.				TO	
MFG		REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION			COMMENTS				

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KCC  
CHECKED BY: \_\_\_\_\_  
DATE: 1-9-92

BLDG.# 214 G  
ECO 5

**10+ HP MOTORS**  
**\*MEASURED\***

MOTOR#	PHASE A	PHASE B	PHASE C
MOTOR# <u>1</u>			
DESCRIPTION <u>HWP</u> VOLTS	<u>472</u>	<u>471</u>	
MFG <u>US ELECTRIC MOTORS</u> AMPS	<u>16</u>	<u>14.3</u>	
MODEL # <u>B046/NO9N19/R037F</u> KVAR	<u>7.3</u>		
SERIAL # _____ KVA	<u>12.4</u>		
FRAME <u>254JP</u> KW	<u>10</u>		
HP <u>15</u> RPM <u>1765</u> PF	<u>80.7</u>		
VOLT <u>230 / 460</u>			
AMPS <u>39.2 / 19.6</u>	PRESENT	<u>0 TO 2400</u>	
EFF. <u>89.5</u>	REQ HR.	<u>TO</u>	
COMMENTS <u>HW PUMP.</u>			


MOTOR#	PHASE A	PHASE B	PHASE C
MOTOR# <u>2</u>			
DESCRIPTION <u>AHU</u> VOLTS	<u>474</u>	<u>475</u>	
MFG <u>CENTURY</u> AMPS	<u>25.9</u>	<u>25.7</u>	
MODEL # <u>6313482-02</u> KVAR	<u>15.6</u>		
SERIAL # _____ KVA	<u>22.1</u>		
FRAME <u>324T</u> KW	<u>14.9</u>		
HP <u>40</u> RPM <u>1765</u> PF	<u>69.5</u>		
VOLT <u>460</u>			
AMPS <u>49</u>	PRESENT	<u>0 TO 2400</u>	
EFF. <u>89.3</u>	REQ HR.	<u>TO</u>	
COMMENTS <u>AHU HW / DX</u>			

BLDG.# 2146  
ECO 10

**AIR STRATIFICATION**

LOCATION	<u>BAY 7</u>	REQ. TEMP.	
TEMP. AT TSTAT		SOURCE	<u>UH</u>
TEMP. AT CEILING	<u>73.7° F</u>	OPP. HOURS	<u>0700 TO 2400</u>
TEMP. AT FLOOR	<u>70.3° F</u>		

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

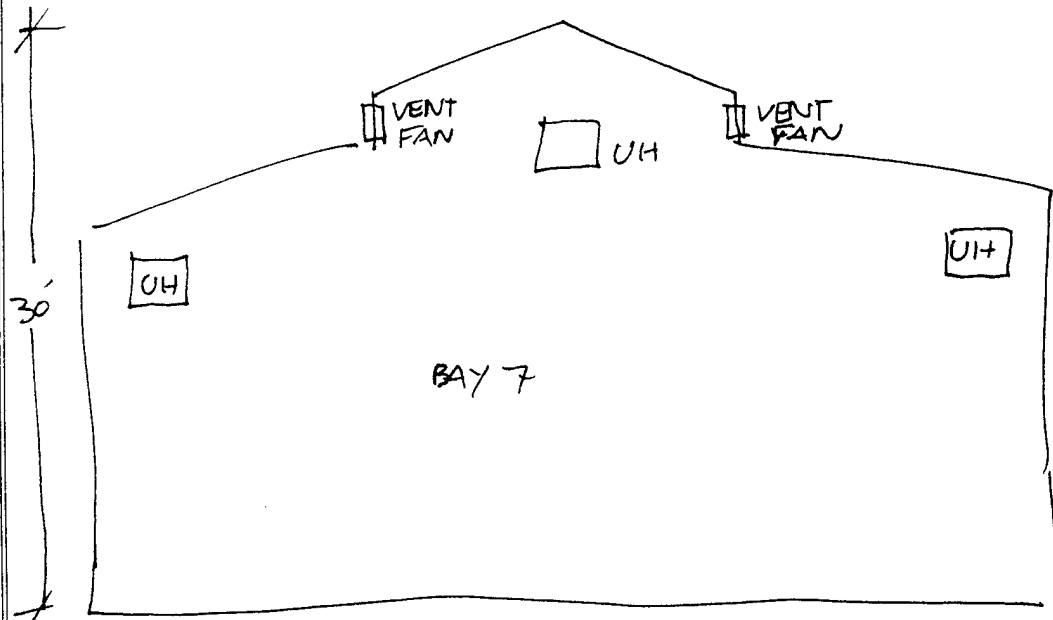

COMMENTS:

---



---



---



---

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB  
PROJ.#  
SHEET NO.  
CALCULATED BY:  
CHECKED BY:  
DATE:


Ft. McPherson/Ft. Gillem Energy Study  
EMC # 3105.000  
OF  
KC  
1-9-92

BLDG.# 214 G  
ECO 10

### AIR STRATIFICATION

LOCATION	<u>BAY G</u>	REQ. TEMP.	
TEMP. AT TSTAT		SOURCE	<u>UH</u>
TEMP. AT CEILING	<u>75 F</u>	OPP. HOURS	<u>0700 TO 12400</u>
TEMP. AT FLOOR	<u>72.3 F</u>		

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

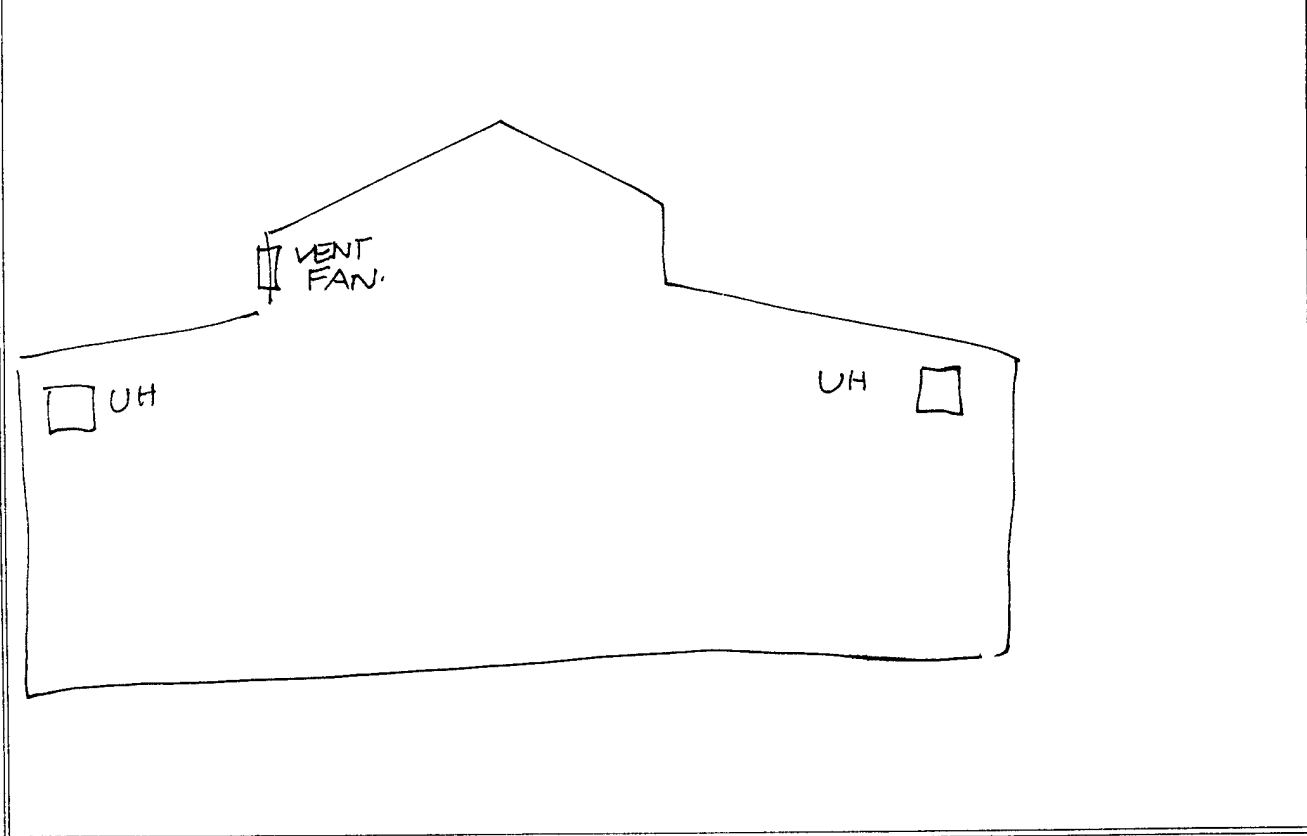

COMMENTS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_




BLDG.#  
ECO 10

2146

AIR STRATIFICATION

LOCATION	BAY 4	REQ. TEMP.	
TEMP. AT TSTAT		SOURCE	UH (HW COIL)
TEMP. AT CEILING	70.7	OPP. HOURS	TO
TEMP. AT FLOOR	70.1		T' STAT CONTROL

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

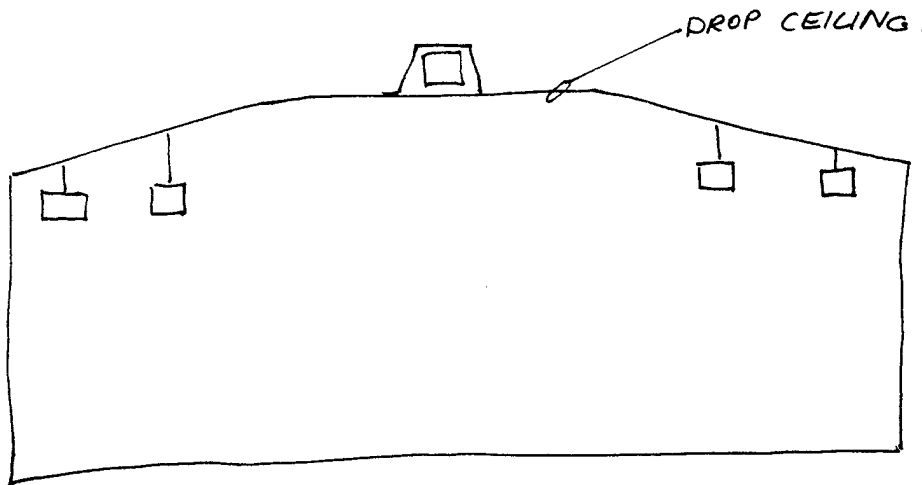

COMMENTS:

UAS BLOW DOWN

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 214G.


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-9-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

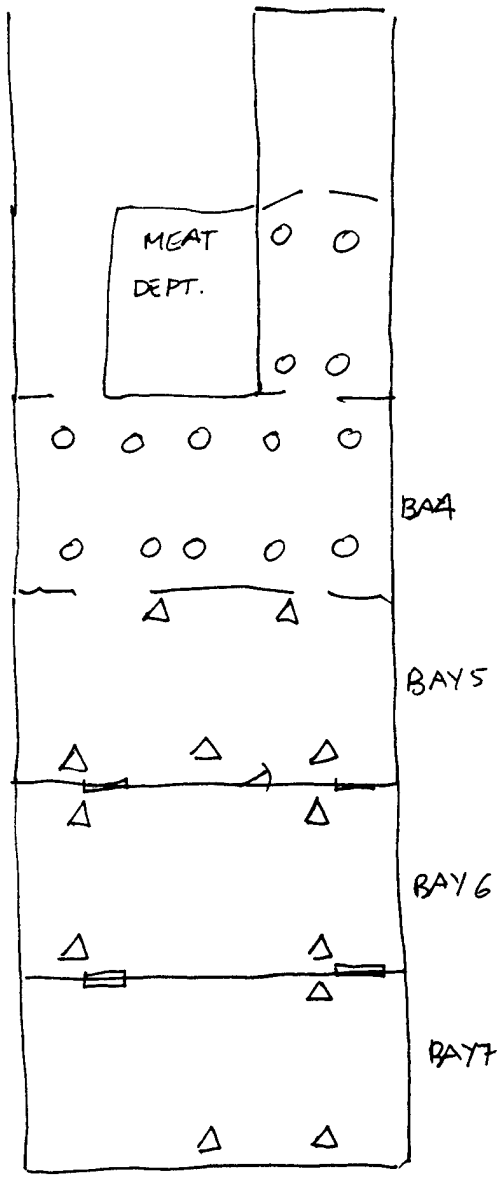

○ - UH. HW COIL

△ - GAS FIRED UH.

TRANE  
 MOD. # GPNC02ZADB10000  
 INPUT 225,000 BTU/H  
 OUTPUT 173,250 BTU/H  
 275 W  
 THERMAL EFF. 77%  
 FAN (1)  
 SHELLEK-GLOBE CORP.  
 MOD. # H001A4456E 1140 RPM  
 115V AA 1Ø 1/4 HP


**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 214

JOB \_\_\_\_\_  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY JW DATE 1/9/92  
 CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
 SCALE \_\_\_\_\_

NA

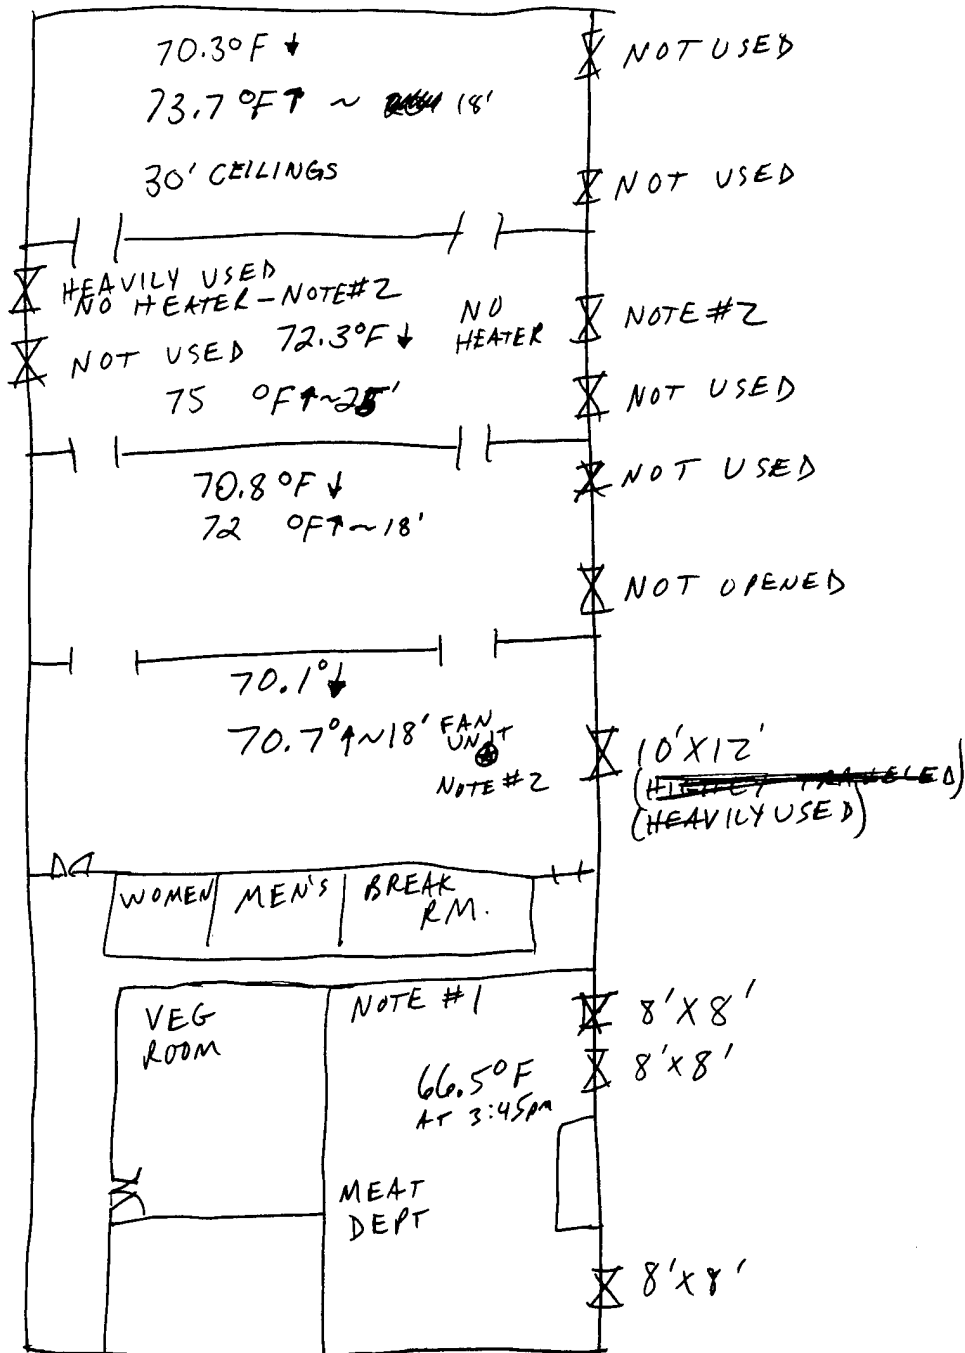

COMMISSARY ↓ ↑ WAREHOUSE

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 214

JOB \_\_\_\_\_  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY JW DATE 1/9/92  
CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
SCALE \_\_\_\_\_

NOTES

- 1) ALL MEAT DEPT. DOORS ARE OPEN FROM 7:00 - 12:00 ON THURS. & ~~FRIDAY~~ WEDNESDAY. GOOD PLACE FOR INFRARED HEATERS IN FRONT OF 3 BAY DOORS.
- 2) NEEDS INFRARED HEATER

BUILDING 308

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/7/92

BLDG.# 308  
ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
MEN'S RM. NORTH	140°F
MEN'S RM. S.E.	131°F

PROBLEMS:

COMMENTS:

---

---

---

---

---

---

---

---

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: RC  
CHECKED BY: \_\_\_\_\_  
DATE: 1-8-92

BLDG.# 308 G  
ECO 5

MOTORS

MOTOR #	<u>4</u>	HP	<u>1/12</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>M091812-87</u>	VOLTS	<u>115</u>	AMPS	<u>1.75</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>BGE</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION		COMMENTS					
MOTOR #	<u>5</u>	HP	<u>2</u>	PH	<u>3</u>	RPM	
MODEL #	<u>40RR<sup>C</sup>1230</u>	VOLTS	<u>230</u>	AMPS	<u>6.2</u>		
SERIAL #	<u>C693171</u>	PRESENT HR.		TO			
MFG	<u>CARRIER</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>AHV 2</u>	COMMENTS	<u>T'STAT</u>				
MOTOR #	<u>6</u>	HP	<u>3/4</u>	PH	<u>1</u>	RPM	
MODEL #	<u>40V0006300</u>	VOLTS	<u>230</u>	AMPS	<u>5.5</u>		
SERIAL #	<u>G483578</u>	PRESENT HR.		TO			
MFG	<u>CARRIER</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>AHV 3</u>	COMMENTS	<u>NEXT TO AHV 2</u>				

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-8-92

BLDG.# 308 G  
 ECO 5 WAREHOUSE

**MOTORS**

MOTOR #	<u>1</u>	HP	<u>1/3</u>	PH	<u>1</u>	RPM	<u>1140</u>
MODEL #	<u>5K442C</u>	VOLTS	<u>115</u>	AMPS	<u>8</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>DAYTON</u>	REQUIRED HR.	<u>7:00</u>	TO	<u>3:45</u>		
FRAME		EFF.					
DESCRIPTION	<u>FUEL OIL PUMP</u>	COMMENTS					
MOTOR #	<u>2</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	<u>3450</u>
MODEL #	<u>1303172102</u>	VOLTS	<u>208</u>	AMPS	<u>8.2</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>FRANKLIN ELEC.</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>COND. PUMP (2)</u>	COMMENTS					
MOTOR #	<u>3</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>6-342912-12</u>	VOLTS	<u>200 230</u>	AMPS	<u>9.6 10.4</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>CENTURY CARRIER</u>	REQUIRED HR.		TO			
FRAME	<u>S182T</u>	EFF.					
DESCRIPTION	<u>AHU DX</u>	COMMENTS					



**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-8-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

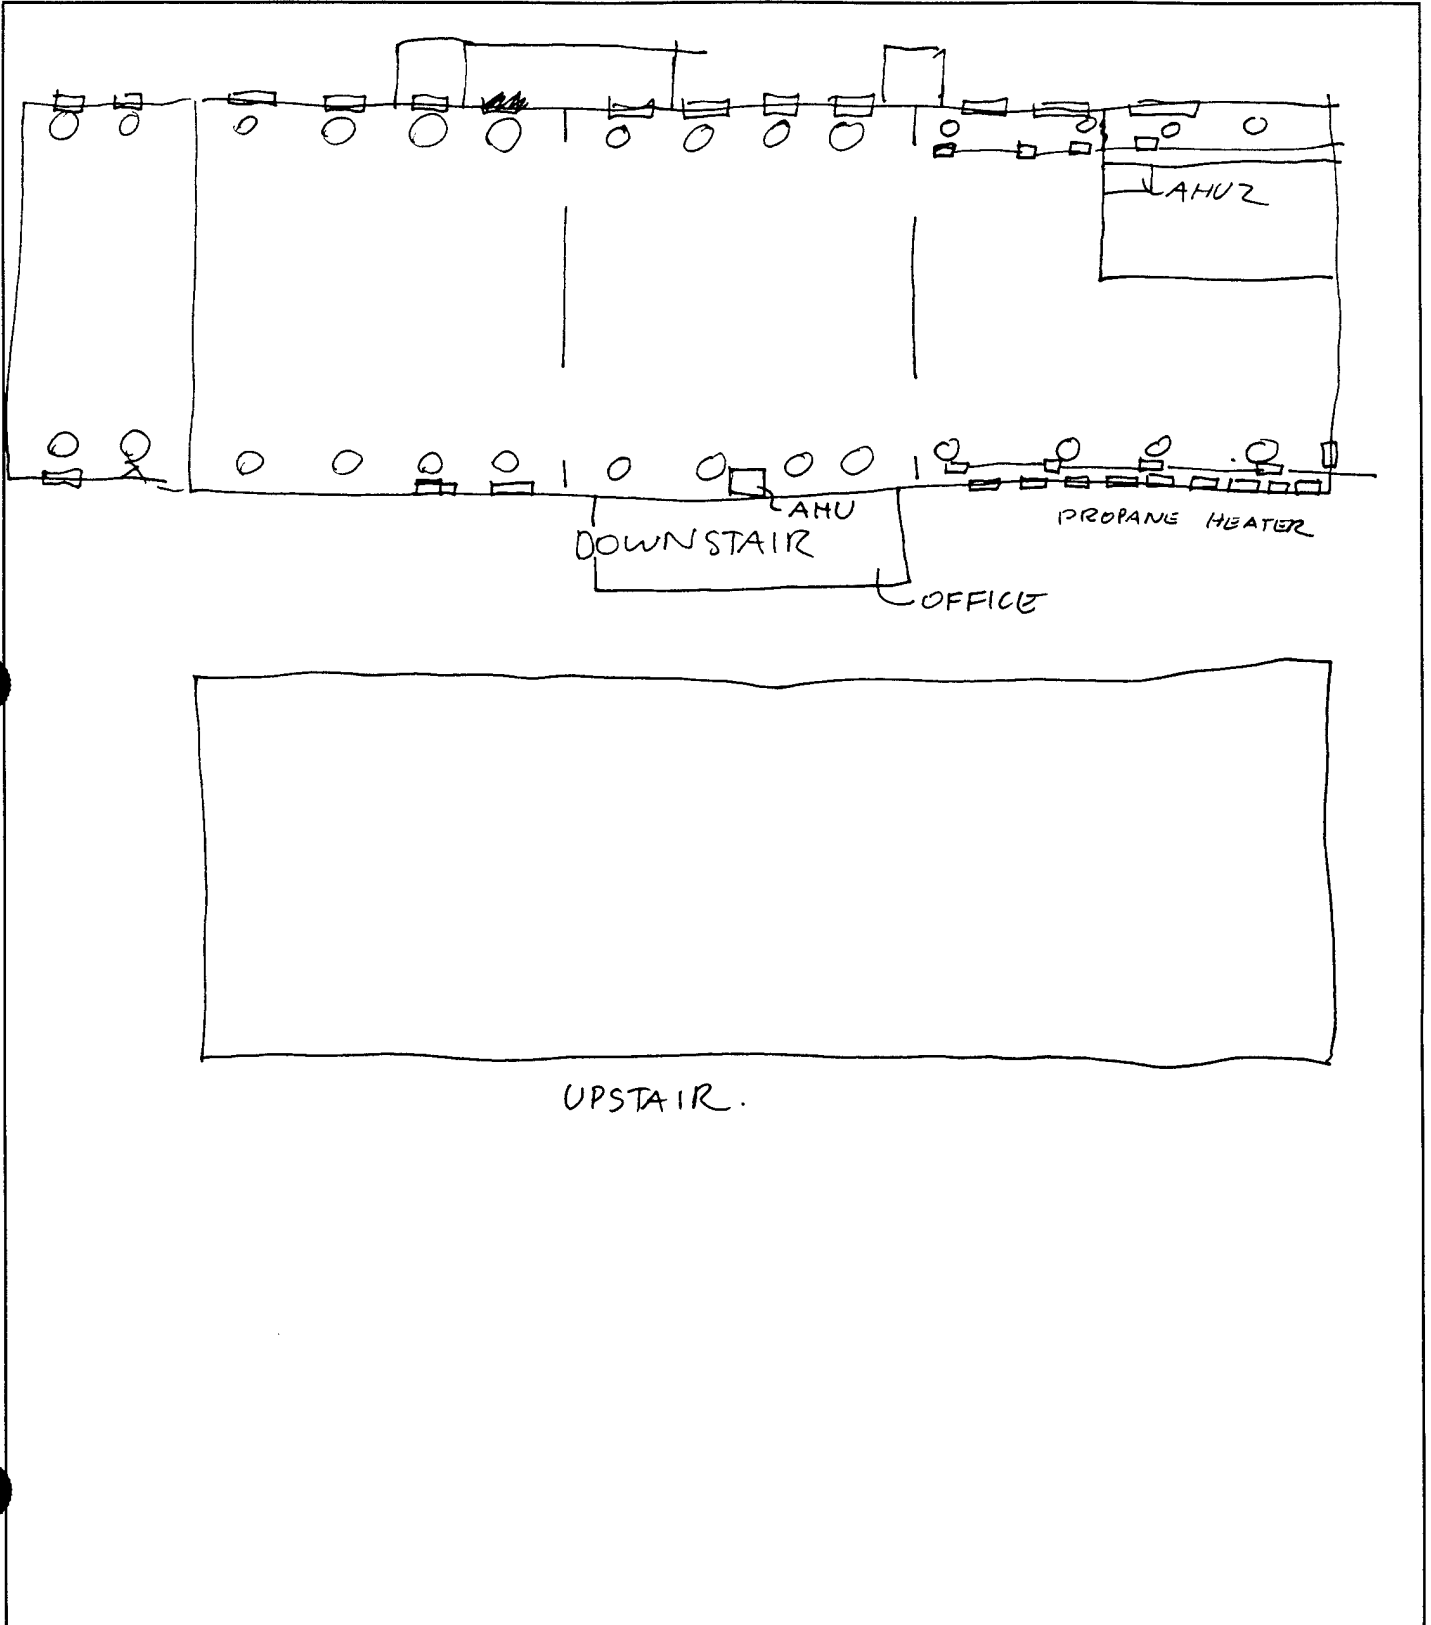

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 308 G

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-8-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

NEED INSULATE HW PIPE 2"  $\approx$  20'

BUILDING 400

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/7/92

BLDG.# 400  
 ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
NORTH EAST MEN'S LOCKER RM. SHOWER	96°F
PAINT ROOM ( <del>NORTH</del> WEST) SINK	91.5°F
SOUTH WEST WALL SINK	103.5°F
SOUTH EAST WALL SINK	110°F
PROBLEMS:	

**COMMENTS:**

---



---



---



---



---

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-8-92

BLDG.# 400 G  
 ECO 5 \_\_\_\_\_

**MOTORS**

MOTOR #	<u>4</u>	HP	<u>1 1/2</u>	PH	<u>3</u>	RPM	<u>1620</u>
MODEL #	_____	VOLTS	<u>208</u>	AMPS	<u>5.1</u>	_____	_____
SERIAL #	<u>ZC-11888</u>	PRESENT HR.	_____	TO	_____	_____	_____
MFG	<u>MASTER</u>	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	<u>4710RC</u>	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>HANGER DOOR <sup>1+2</sup> MOTORS (2) COMMENTS APPROXIMATE 20 TIMES/DAY</u>						
MOTOR #	<u>5</u>	HP	<u>1/4</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>5K5478</u>	VOLTS	<u>115</u>	AMPS	<u>4.9</u>	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	<u>DAYTON</u>	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>EXH. FAN IN ELEC. SHOP COMMENTS ON/OFF SWITCH. (NEVER RUN)</u>						
MOTOR #	<u>6</u>	HP	<u>1/12</u>	PH	_____	RPM	_____
MODEL #	_____	VOLTS	<u>115</u>	AMPS	_____	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	<u>TRANE</u>	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>UNIT HEATER 3, 4 COMMENTS T' STAT CONTROL - STM COIL</u>						

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KC  
CHECKED BY: \_\_\_\_\_  
DATE: 1-8-92

BLDG.# 400 (GILLEM)  
ECO 5

MOTORS

MOTOR #	<u>1</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>3K132AX20446X</u>	VOLTS	<u>200-230</u>	AMPS	<u>9-8.8</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>GE</u>	REQUIRED HR.				TO	
FRAME	<u>182T</u>	EFF.	<u>84</u>				
DESCRIPTION	<u>AHU #2 UPSTAIR IN DOL</u>	COMMENTS	<u>T' STAT CONTROL</u>				
	<u>HEAT @ 70°F</u>						
	<u>COOL @ 80°F</u>						
MOTOR #	<u>2</u>	HP	<u>1/2</u>	PH	<u>1</u>	RPM	
MODEL #		VOLTS	<u>115</u>	AMPS			
SERIAL #		PRESENT HR.				TO	
MFG		REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>UH #1 MEN ROOM</u>	COMMENTS	<u>STM COIL</u>				
MOTOR #	<u>3</u>	HP	<u>1/4</u>	PH		RPM	
MODEL #		VOLTS	<u>115 V</u>	AMPS			
SERIAL #		PRESENT HR.				TO	
MFG	<u>BEACON MORRIS</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>UH #2 MEN ROOM</u>	COMMENTS	<u>STM COIL</u>				

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-8-92

BLDG.# 400 G  
 ECO 5

**MOTORS**

MOTOR #	<u>7</u>	HP	<u>10</u>	PH	<u>3</u>	RPM	<u>1735</u>
MODEL #	<u>SC-324-JA3-3</u>	VOLTS	<u>220</u>	AMPS	<u>26</u>		
SERIAL #	<u>10AF39516</u>	PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>CENTURY</u>	REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>#1 AHU OVER BODYSHOP HEATING ONLY STM.</u>		COMMENTS	<u>VERY OLD SEE 10HP MOTOR FORM.</u>			
MOTOR #	<u>8</u>	HP	<u>2</u>	PH	<u>3</u>	RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.		TO			
MFG		REQUIRED HR.		TO			
FRAME		EFF.					
DESCRIPTION	<u>EXH. FAN #2</u>		COMMENTS	<u>CAN NOT GET UP THERE "OLD"</u>			
MOTOR #	<u>9</u>	HP	<u>7.5</u>	PH	<u>3</u>	RPM	<u>3500</u>
MODEL #	<u>G-357330-40</u>	VOLTS	<u>200</u>	AMPS	<u>21</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>CENTURY</u>	REQUIRED HR.		TO			
FRAME	<u>M184T</u>	EFF.	<u>85.5</u>				
DESCRIPTION	<u>COND. POMP. (2) 1/2</u>		COMMENTS	<u>FLOAT SWITCHES RUN FOR 3 MIN. EVERY 4 MIN.</u>			

BLDG.# 400 G  
 ECO 5

**MOTORS**

MOTOR #	<u>10</u>	HP	<u>1/2</u>	PH	_____	RPM	_____
MODEL #	_____	VOLTS	<u>115V</u>	AMPS	_____	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	<u>BELL &amp; GOSSETT</u>	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<u>HW CIRC. PUMP</u>		COMMENTS	<u>NO NAME PLATE</u>			
MOTOR #	<u>11</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	<u>1150</u>
MODEL #	<u>115938/A</u>	VOLTS	<u>220</u>	AMPS	<u>8.4</u>	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	<u>WESTING HOUSE</u>	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<sup>1+2</sup> <u>CIRC. FAN UPSTAIR (2)</u>	COMMENTS	<u>MANUAL S/S SW. NOT RUNNING.</u>				
MOTOR #	_____	HP	<u>1/12</u>	PH	_____	RPM	_____
MODEL #	_____	VOLTS	<u>115V</u>	AMPS	_____	_____	_____
SERIAL #	_____	PRESENT HR.	_____	TO	_____	_____	_____
MFG	_____	REQUIRED HR.	_____	TO	_____	_____	_____
FRAME	_____	EFF.	_____	_____	_____	_____	_____
DESCRIPTION	<sup>344</sup> <u>CIRC. FAN DOWNSTAIR (2)</u>	COMMENTS	<u>NO NAME PLATE</u>				



**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KL  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-8-92

BLDG.# 400 G  
 ECO 5

**10+ HP MOTORS**  
 \*MEASURED\*

MOTOR#		PHASE A	PHASE B	PHASE C
MOTOR#	<u>7</u>			
DESCRIPTION	<u>AHU UPSTAIR</u>	<u>206</u>	<u>203</u>	
MFG	<u>CENTURY</u>	<u>21</u>	<u>20.6</u>	
MODEL #	<u>SC-324-JA3-3</u>	<u>.1</u>		
SERIAL #	<u>10AF39516</u>	<u>4.3</u>		
FRAME		<u>4.2</u>		
HP	<u>10</u> RPM <u>1735</u>	<u>100%</u>		
VOLT	<u>220</u>			
AMPS	<u>26</u>	PRESENT	<u>0 TO 2400</u>	
EFF.		REQ HR.	<u>700 TO 1600</u>	
COMMENTS	_____			


MOTOR#		PHASE A	PHASE B	PHASE C
MOTOR#	_____			
DESCRIPTION	_____			
MFG	_____			
MODEL #	_____			
SERIAL #	_____			
FRAME	_____			
HP	_____ RPM _____			
VOLT	_____			
AMPS	_____	PRESENT	TO _____	
EFF.	_____	REQ HR.	TO _____	
COMMENTS	_____			

BLDG.# 400 G  
ECO 10

**AIR STRATIFICATION**

LOCATION	<u>ABOUT MIDDLE OF BLDG</u>	REQ. TEMP.	_____
TEMP. AT TSTAT	_____	SOURCE	<u>VH</u>
TEMP. AT CEILING	<u>74.1 °F</u>	OPP. HOURS	_____ TO _____
TEMP. AT FLOOR	<u>68 °F</u>		

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

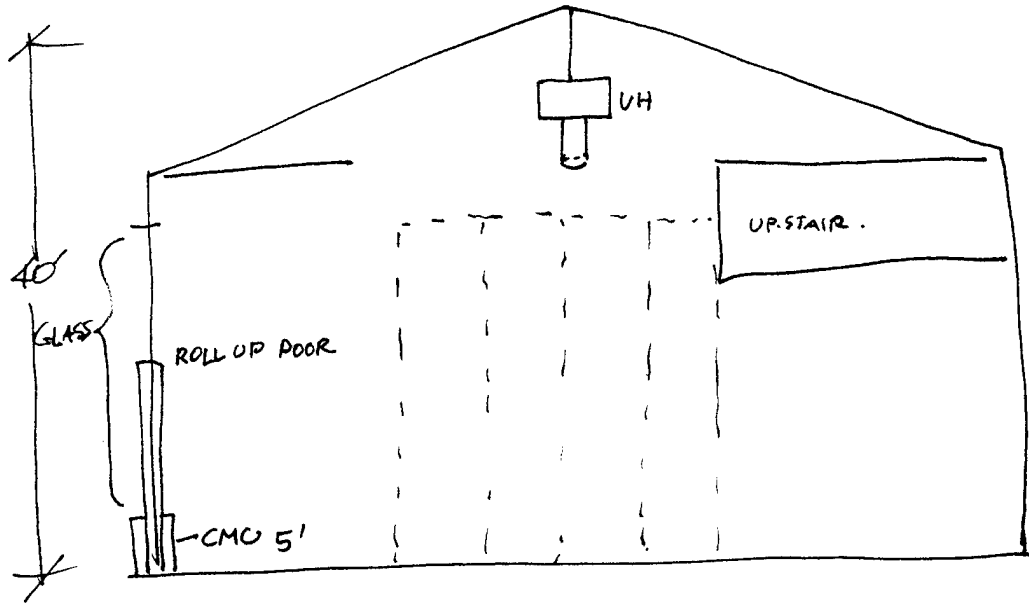

COMMENTS: NO MAJOR HEAT PROBLEM. 2 BIG SLIDING DOORS @ BOTH  
END OF BLDG. ROLL UP DOOR ON SID OF BLDG

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-8-92

BLDG.# 400  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
1	51	2	34	F	ON	Y	N	6	N
2	6	2	34	F	ON	Y	Y	Circuit Breaker	Y
3	6	2	34	F	ON	Y	Y	"	Y
4	3	4	34	F	OFF	Y	Y	1	N
5	1	2	34	F	ON	Y	N	1	Y
6	1	2	34	F	ON	Y	N	1	Y
7	2	1	34	F	OFF	Y	N	1	N
8	2	2	34	F	ON	Y	N	2	Y
9	24	2 <sup>5'</sup>	Bigger tubes 90	F	ON		N	3	N
10	15	2 <sup>8'</sup>		F	ON	Y	N	2	N
11	2	2 <sup>8'</sup>		F	ON	Y	Y	1	Y
12	4	2 <sup>8'</sup>		F	ON	Y	N	1	Y
<del>13</del>	<del>36</del>	<del>2<sup>8'</sup></del>		<del>F</del>	<del>ON</del>	<del>Y</del>	<del>N</del>	<del>1</del>	<del>Y</del>
14	36	1	250 High pressure sod.		ON	Y	N	5	N
15	16	2	40	F	ON	Y	N	3	Y
16	11	2 <sup>5'</sup>	90	F	ON	Y	N	3	Y
17	25	1	150	I	ON	Y	N	2	N
18	6	2	34	F	ON	Y	N	1	N

27 burned out tubes)

150W

# OF EXIT SIGNS - 11

COMMENTS: \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB: Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.#: EMC # 3105.000  
 SHEET NO.: \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: CS  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-8-91

BLDG.# 400  
EC0 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
12	7	1	200	I	ON	Y	N	1	Y
13	31	1	200	I	ON	Y	N	1	Y
	2	1	200	I	OFF	Y	N	1	N
	2	1	200	I	OFF	Y	N	1	N
<del>14</del>									

# OF EXIT SIGNS -- \_\_\_\_\_

COMMENTS: \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-8-92

BLDG.# 400  
EC0 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
19	5	2 <sup>8'</sup>		F	ON	Y	N	1	N
17	18	2 <sup>8'</sup>		F	ON	Y	N	2	N
	4	2 <sup>5'</sup>	90	F	ON	Y	N	2	N
20	1	2 <sup>8'</sup>		F	ON	Y	Y	1/2	Y
	1	2	34	F	ON	Y	N	1/2	Y
21	2	4	34	F	ON	Y	Y	1	N
22	2	2	34	F	OFF	Y	N	1	N
23	2	2	34	F	ON	Y	N	1	Y
24	4	2	34	F	OFF	Y	Y	1	<del>1/2</del> N
25	1	2 <sup>5'</sup>	90	F	OFF	Y	N	1	N
	1	2	34	F	OFF	Y	N	1	N
26	20	<del>2</del> <sup>2</sup>	<del>34</del> <sup>40</sup>	F	ON	Y	N	3	Y
27	64	<del>2</del> <sup>2</sup>	<del>34</del> <sup>40</sup>	F	ON	Y	N	8	N
28	15	2	34	F	OFF	Y	N	2	N
29	65	2	34	F	OFF	Y	N	9	N
	51	1	200	I	OFF	Y	N	1	N
30	34	2	<del>34</del> <sup>40</sup>	F	ON	Y	N	2	Y
12	2	1	200	I	OFF	Y	N	1	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

16  
31  
27  
10

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-8-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

BLDG 400 G

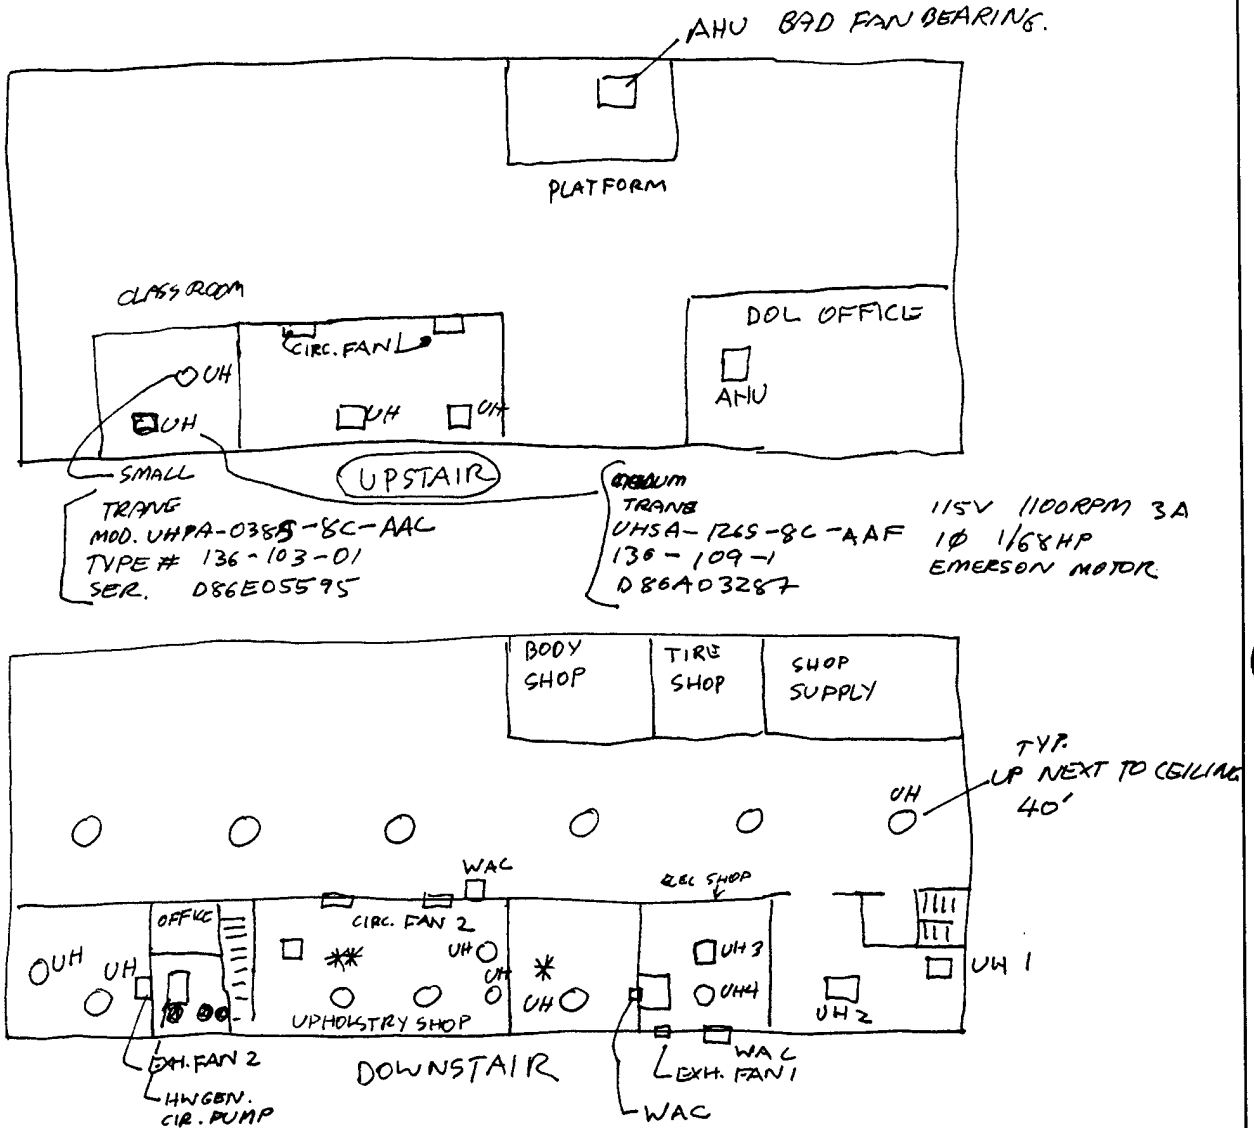

\* BULBS BURN OUT NO REPLACEMENT OLD FIXTURE, 4' FLOR. BIGGER DIA. THAN ORDINARY, 50% OUT.

\*\* UPHOLSTERY SHOP COLD DRAFT UH NOT ABLE TO KEEP UP

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 400

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/7/92


CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

C = COMPUTER

24  
14  
---  
96  
24  
336

A  
N

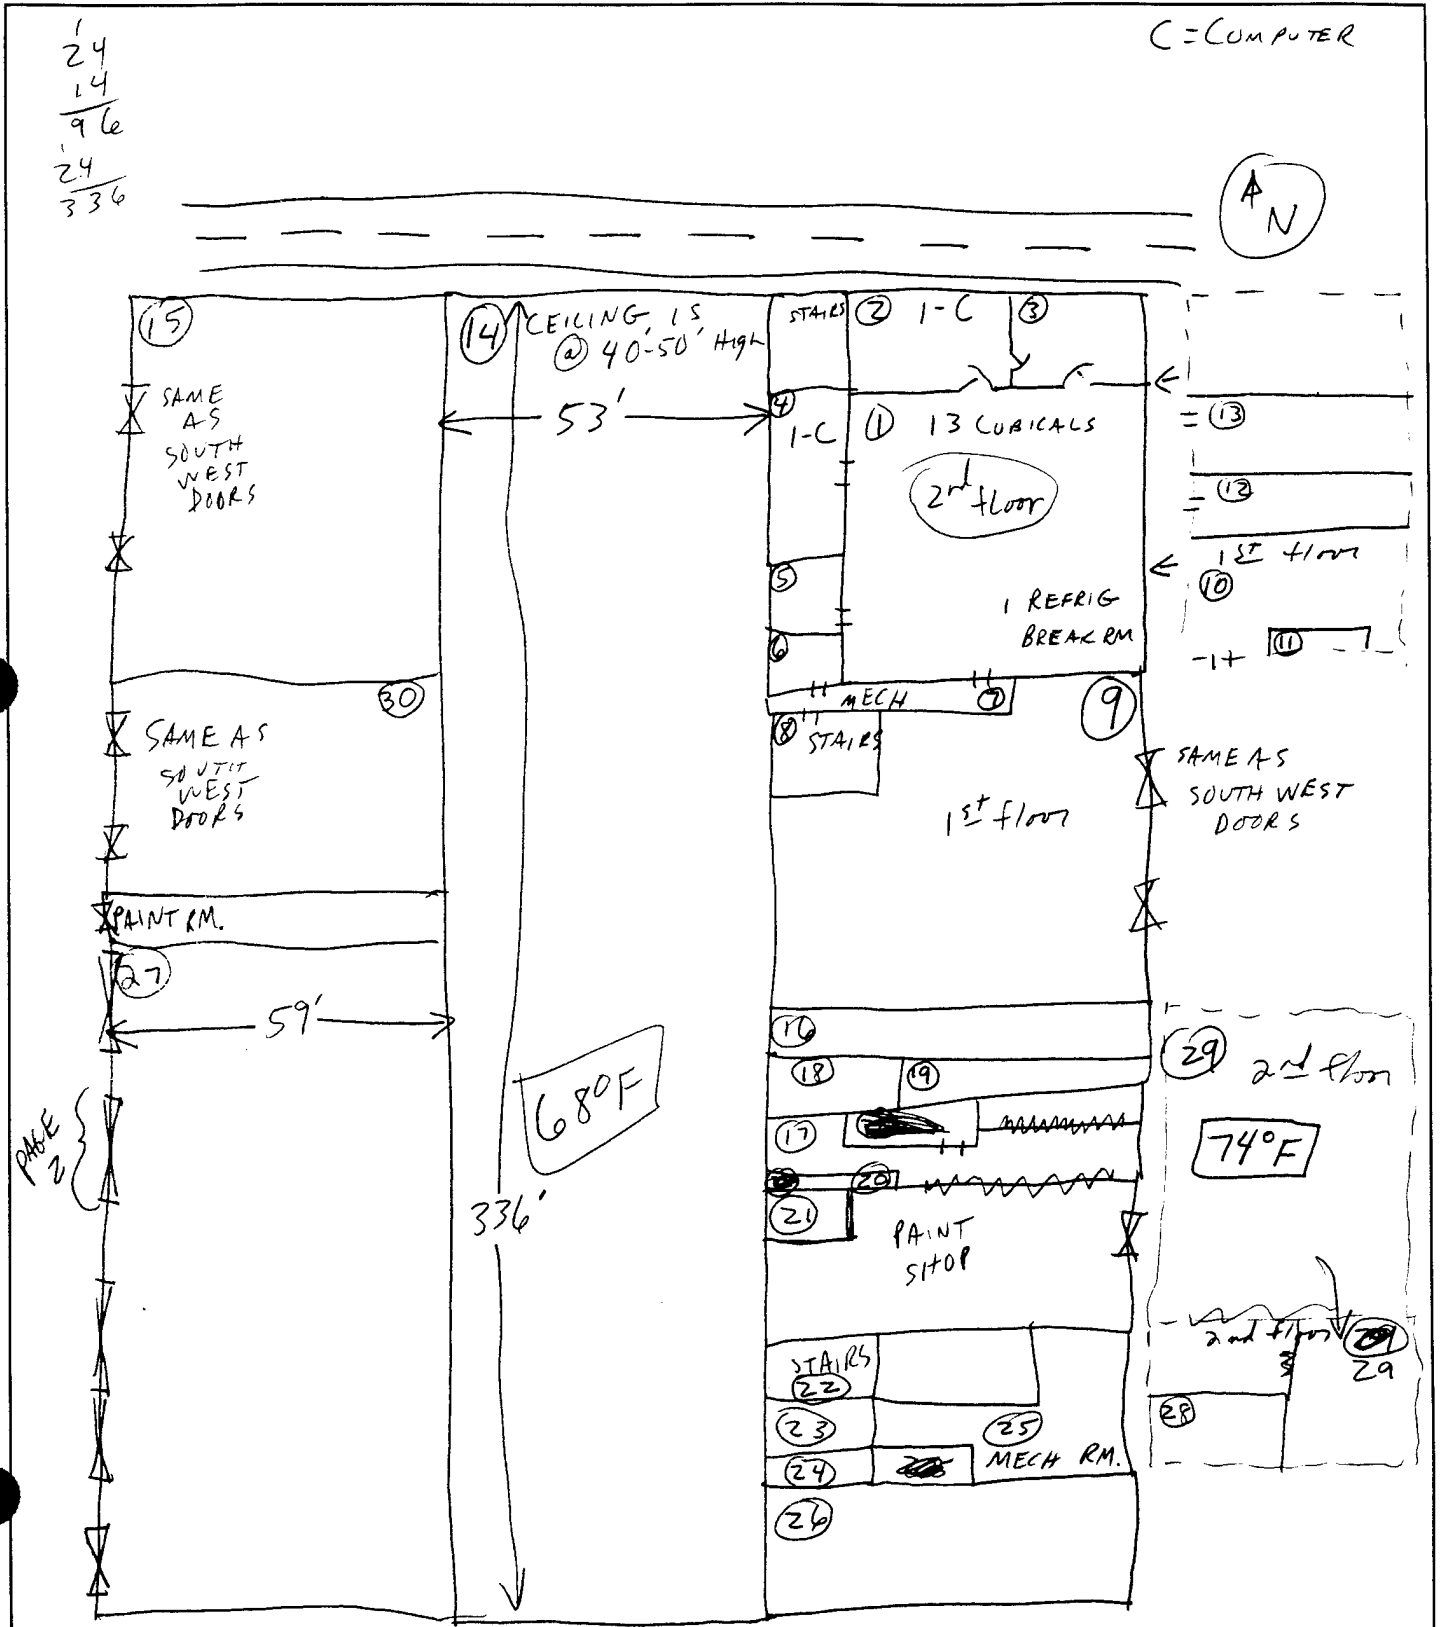

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG. 400G

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-8-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

TOP VIEW

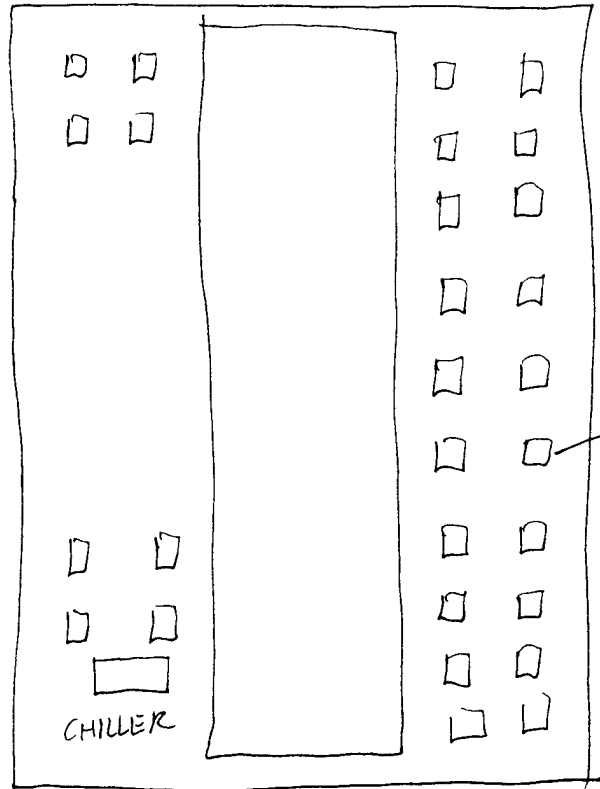

TYP.  
EVAP. COOLER

EVAP. COOLER

PHOENIX MANUFACTURE INC.  
P.O. BOX 20663  
PHOENIX, AZ 85036

MOD. # DMA400    1/4 HP    115V    6.9A    60HZ  
# DMA800    1/4 HP    115V    8.8A    60HZ

CHILLER (DX)

TRANE

MOD# BTA1500500MA  
SER# S28198720

COMP. (2) 27 A 200V 3Ø  
COND. (4) 3.8 A 200V 1Ø



**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 400

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/8/92


CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_



PAGE 2

WEST WALL

BAY DOORS ⇒ TYP. OF \_\_\_\_\_

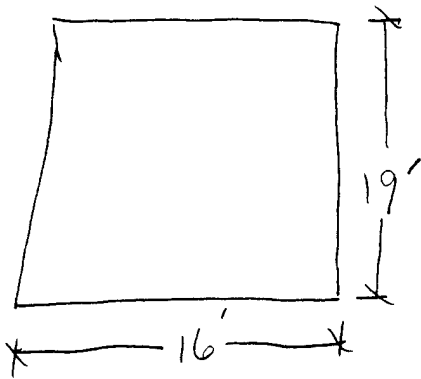

SOUTH EAST BAY DOOR (1)

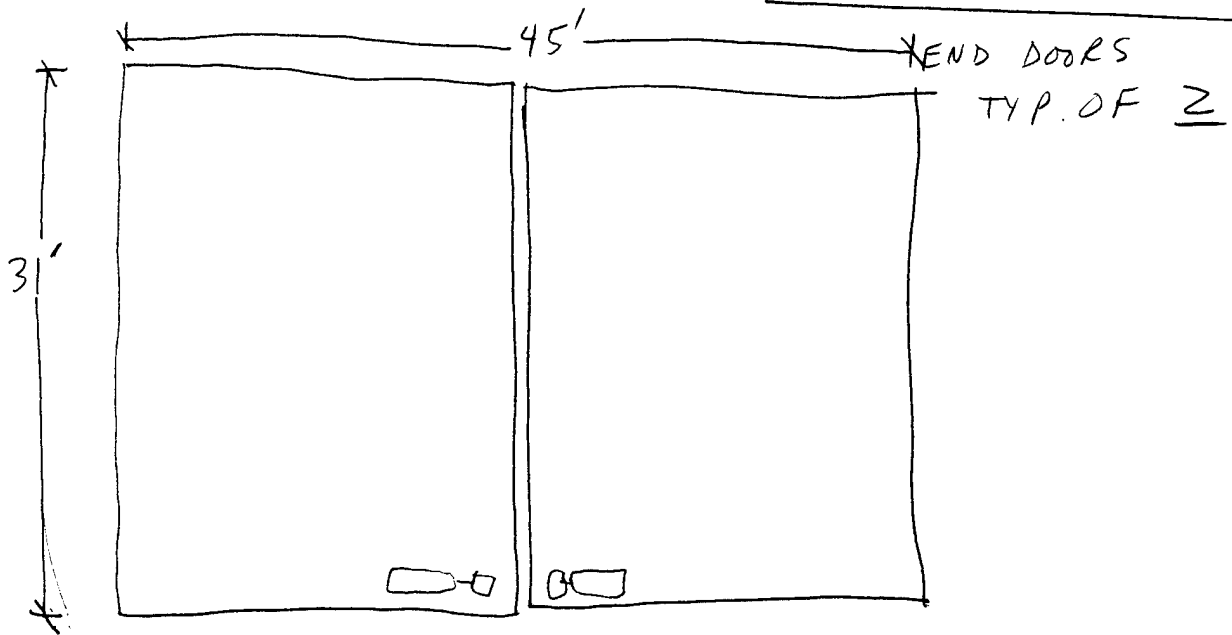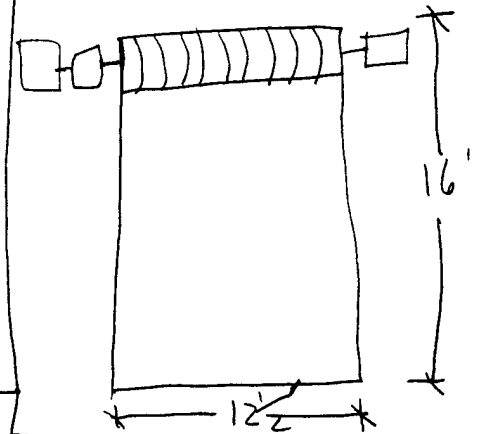

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 400

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/7/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

ECO-14

HEATING SUPPLY SOURCE:

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 400

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/8/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

BAY DOOR IN FURNITURE SHOP  $\Rightarrow$  12' X 16'  
THIS DOOR IS BROKEN & MUST BE PROPPED OPEN IN SUMMER  
FOR VENTILATION. NEEDS TO BE REPLACED.

BUILDING 401

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-8-92

BLDG.# 401  
ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
Bathroom in office downstairs	No hot water 76°F
Showers upstairs	108°F

**PROBLEMS:**

**COMMENTS:**

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 6-8-92

BLDG.# 4016  
 ECO 5 \_\_\_\_\_

**MOTORS**

MOTOR #	<u>1</u>	HP	<u>1/2</u>	PH	<u>3</u>	RPM	<u>1740</u>
MODEL #	<u>GN 45TTDR 7342AA</u>	VOLTS	<u>208</u>	AMPS	<u>55</u>		
SERIAL #		PRESENT HR.	<u>7:00</u>	TO	<u>1530</u>		
MFG	<u>MARATHON</u>	REQUIRED HR.		TO			
FRAME	<u>145TCV</u>	EFF.					
DESCRIPTION	<u>COND. PUMP (2)</u>	COMMENTS	<u>FLOAT SWITCH</u>				
MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				
MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				


BLDG.#  
ECO 10

401

AIR STRATIFICATION

LOCATION	SHOP	REQ. TEMP.	
TEMP. AT TSTAT		SOURCE	UH
TEMP. AT CEILING	75' F	OPP. HOURS	7:00 TO 1530
TEMP. AT FLOOR	65' F		

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

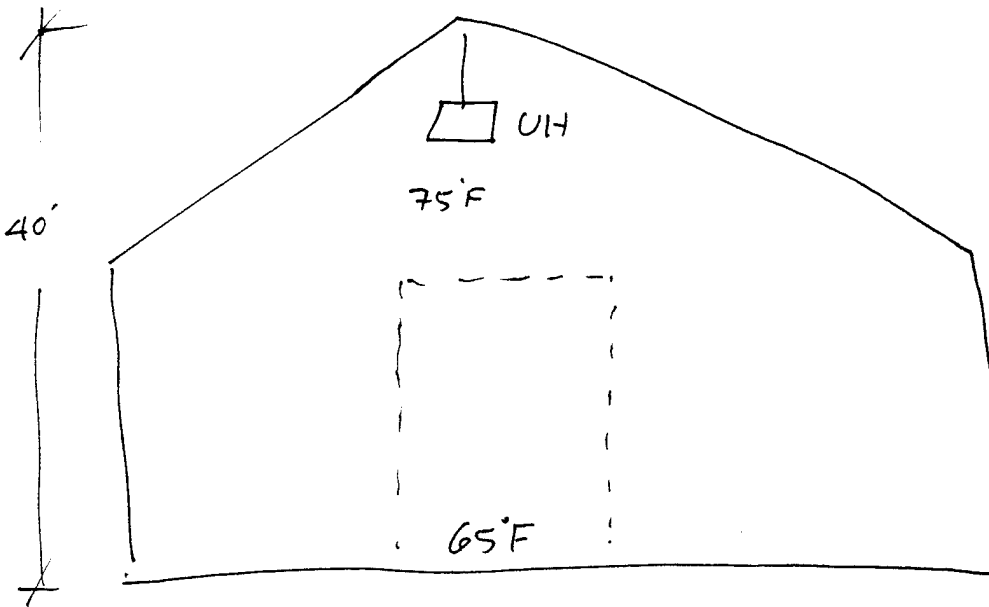

COMMENTS:

THE OVERHEAD DOOR IS OPEN DURING SURVEY

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB: Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.#: EMC # 3105.000  
 SHEET NO.: \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: CS  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-8-92

BLDG.# 401  
 ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
1	11	2	34	F	ON	Y	N	3	N
	1	2 <sup>8'</sup>		F	ON	Y	N		N
2	2	1	100	I	OFF	Y	N	2	N
3	1	1	100	I	OFF	Y	N	1	N
4	<del>26</del>	1	Low press. sod.		ON	Y	N	8	N
	24	1	200	I	ON	Y	N	59	N
5	8	2	34	F	ON	Y	N	13	Y
6	3	1	75	I	ON	Y	N	2	Y
7	4	1	75	I	ON	Y	N	1	N
8	2	1	100	I	ON	Y	N	1	Y
9	6	1	100	I	ON	Y	N	1	N
10	4	1	100	I	OFF	Y	N	1	N
11	4	1	75	I	OFF	Y	N	1	N
12	6	2	34	F	ON	Y	N	1	Y
13	14	2 <sup>8'</sup>		F	ON	Y	N	3	N
14	38	2	34	F	ON	Y	N	4	N
	617	1	100	I	OFF	Do not use			N
15	38	2	34	F	OFF	Y	N	4	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_



EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-8-92

BLDG.# 401  
EC0 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
	12	1	100	I	OFF	Do	not use	old paint Room	
16	20	2 <sup>8'</sup>		F	ON	Y	N	4	N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-8-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

BLDG 401G.

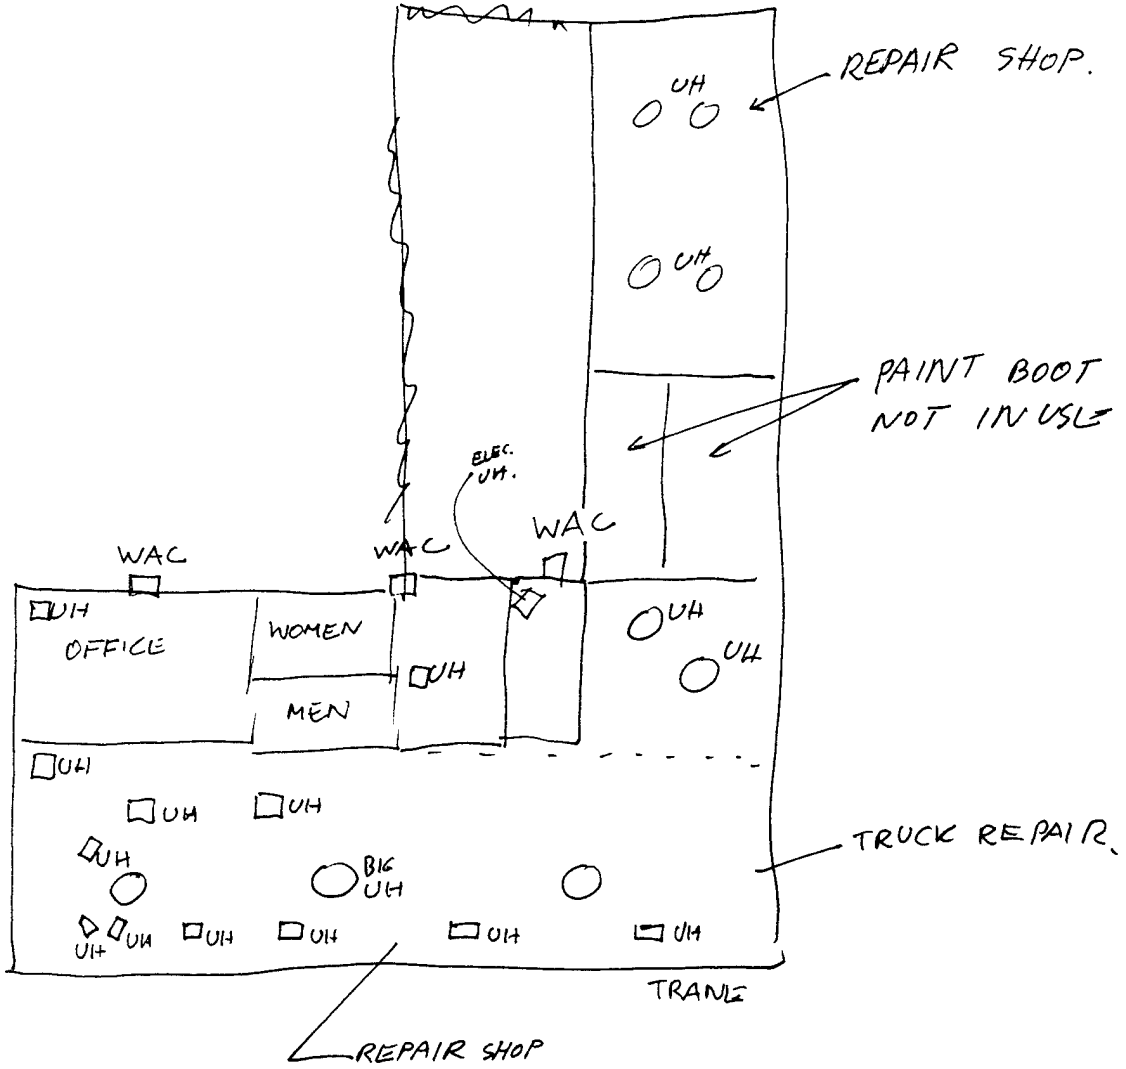


**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 401

JOB \_\_\_\_\_  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY JW DATE 1/7/92  
CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
SCALE \_\_\_\_\_

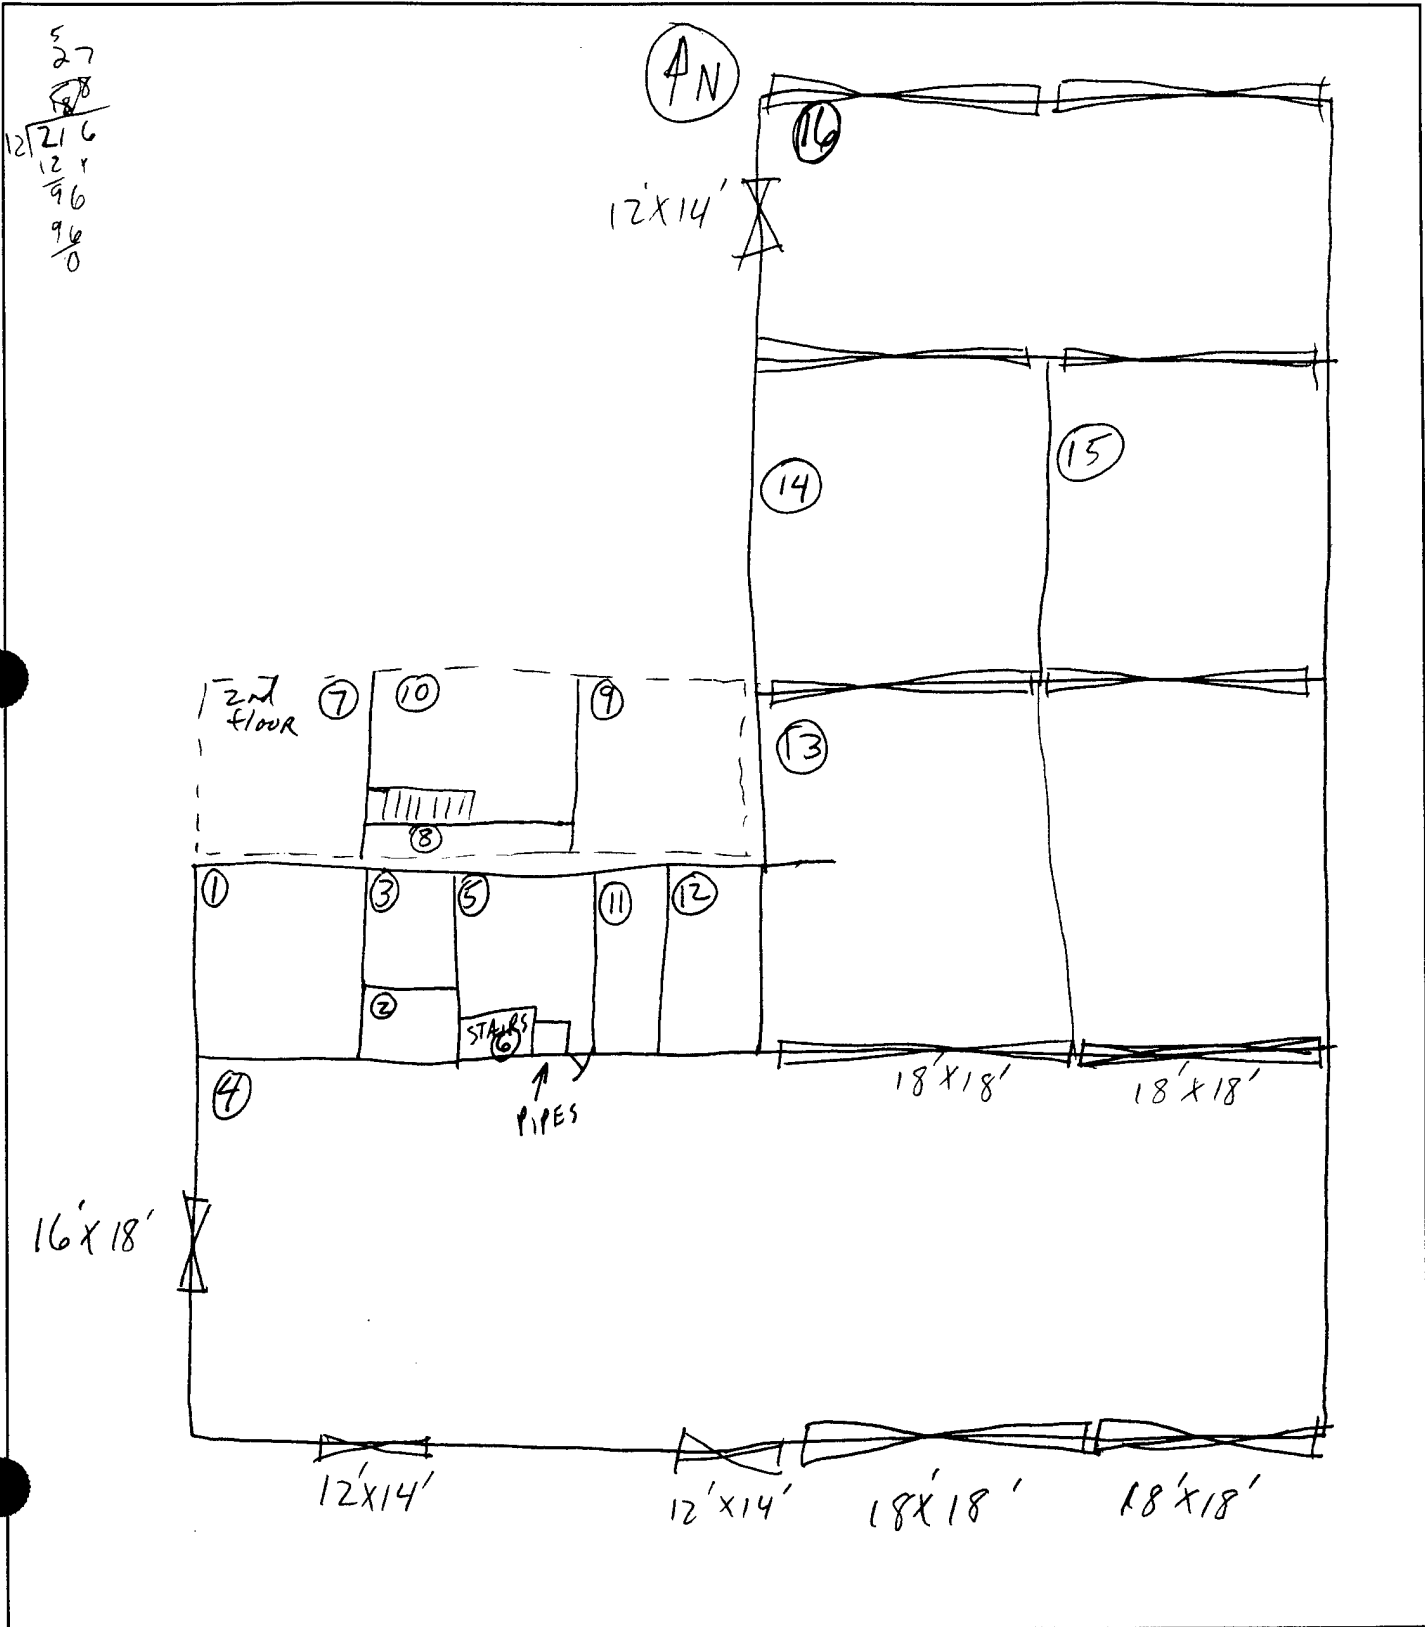

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_


SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY LC DATE 8-8-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

*BLDG 401 G.*

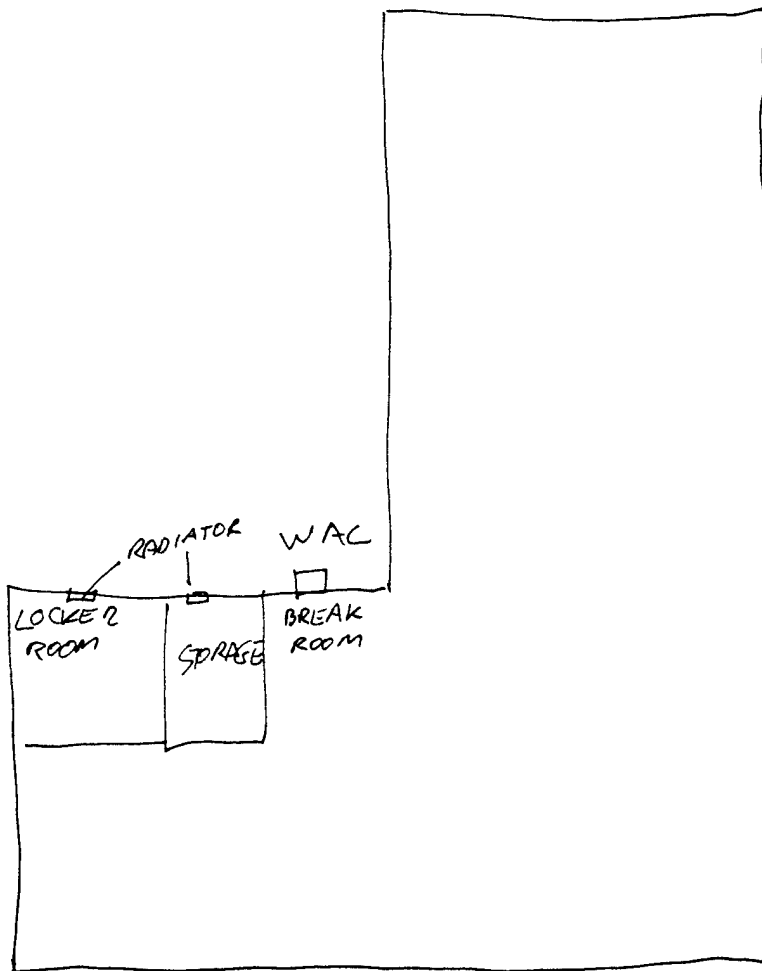

*UPSTAIR*

BUILDING 403

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB: Ft. McPherson/Ft. Gillem Energy Study  
PROJ.#: EMC # 3105.000  
SHEET NO.: \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/7/92

BLDG.# 403-G  
ECO 4

DOMESTIC HOT WATER

FAUCET LOCATION	WATER TEMPERATURE
SOUTH WEST MEN'S ROOM	120°F
NORTH WEST MESS HALL	136°F
* NORTH BATHROOM	156°F
PROBLEMS:	

COMMENTS: OPERATING HRS. 7:30 - 4:30pm  
THIS BUILDING IS A MESS HALL STORAGE FACILITY  
\* OLD WATER HEATER (ELECTRIC) IS SET TOO HIGH.

BLDG.# 403  
ECO 5

MOTORS

MOTOR #	<u>1</u>	HP	<u>1/2</u>	PH	<u>1Ø</u>	RPM	<u>1725</u>
MODEL #	<u>AAC17DK14A</u>	VOLTS	<u>115</u>	AMPS	<u>8.8</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>LESSON</u>	REQUIRED HR.				TO	
FRAME	<u>LS 56C</u>	EFF.	<u>62</u>				
DESCRIPTION	<u>COND. PUMP 1. &amp; 2</u>		COMMENTS	<u>FLOAT SW.</u>			

MOTOR #	<u>2</u>	HP	<u>3/4</u>	PH	<u>1</u>	RPM	
MODEL #	<u>11A5077</u>	VOLTS	<u>220</u>	AMPS	<u>5.9</u>		
SERIAL #		PRESENT HR.				TO	
MFG	<u>AMERICAN STANDARD</u>	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	<u>AHU</u>		COMMENTS	<u>OLD ASBESTOS IN SUPPLY DUCT</u>			

MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.				TO	
MFG		REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION		COMMENTS					

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 403  
Ft. Gillem.


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-7-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

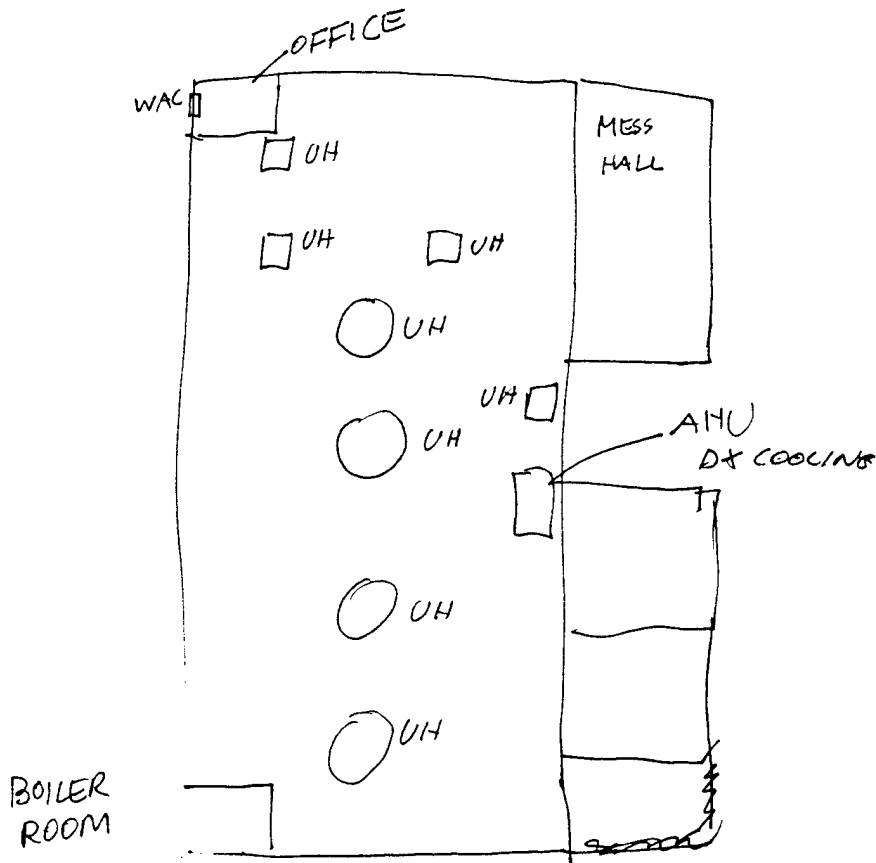

\* ONLY ○ UH IS WORKING, □ UH NOT WORKING.  
CANNOT GET UH NAMEPLATE NOT ACCESSABLE.



**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 403 G.

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY RC DATE 1-7-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

BLDG 403 FL. GILLEM

BOILER BRYAN FLEXIBLE TUBE BOILERS

MOD CLZ70-S-15-FDGO YR 1990

SER 68537 BRYAN NO. 89144Z

INPUT 2700 MBH (MAX) 1350 MBH MIN

OUTPUT 2160 MBH.

15 PSI STM

BUILDING 505

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KCC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-8-92

BLDG.# 505  
 ECO 5

**MOTORS**

MOTOR #	<u>1</u>	HP	<u>1/3</u>	PH	<u>3</u>	RPM	<u>3450</u>
MODEL #	<u>1303002110</u>	VOLTS	<u>208</u>	AMPS	<u>1.5</u>		
SERIAL #		PRESENT HR.		TO			
MFG	<u>FRANKLIN ELEC.</u>	REQUIRED HR.		TO			
FRAME	<u>56J</u>	EFF.					
DESCRIPTION	<u>COND. PUMP (2)</u>	COMMENTS	<u>FLOAT SW.</u>				
<i>BLOG 935G</i>							
MOTOR #	<u>2, 3</u>	HP	<u>0.75</u>	PH	<u>1</u>	RPM	
MODEL #		VOLTS	<u>240</u>	AMPS	<u>6.8</u>		
SERIAL #		PRESENT HR.		<u>0000</u>	TO	<u>2400</u>	
MFG	<u>COMFORT MAKER</u>	REQUIRED HR.		<u>0700</u>	TO	<u>1900</u>	
FRAME		EFF.					
DESCRIPTION	<u>AHU FOR RACKET BALL DX COOLING. (2 COURTS)</u>	COMMENTS	<u>ELEC. HEATER 208V 3Ø 34A</u>				
MOTOR #	<u>4</u>	HP	<u>3/4</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>NO MOD.# HYDROFLOW ELECTRIC MTR.</u>	VOLTS	<u>208</u>	AMPS	<u>2.5</u>		
SERIAL #		PRESENT HR.		<u>0</u>	TO	<u>2400</u>	
MFG	<u>BELL &amp; GOSSETT</u>	REQUIRED HR.		<u>0700</u>	TO	<u>1900</u>	
FRAME	<u>203</u>	EFF.					
DESCRIPTION	<u>HWPUMP NEAR BIG BOILER</u>	COMMENTS					

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 505

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/8/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

BOILER # 2 SOUTH

MOHAWK

M# 4-5-5081-GP S# 9510

508ft<sup>2</sup> 5/16" shell thick

MAX STEAM <sub>WP</sub> 15 PSIG

STEAM CAP = 3450 lb/hr.

CTRL. CKT = 1 $\phi$  5A 120V

BURNER = 3 $\phi$  7.4A 3HP 240V  
MOTOR

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG. 505 G.

JOB 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY KC DATE 1-8-92  
CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_  
SCALE \_\_\_\_\_

BOILER/ SMOHAWK BOILER BURNER UNIT

MOO. 1-5-508  
NAT'L BOARD NO. 9607  
HEAT SURFACE 508 SQ. FT. YR 1983  
STM CAP. 3450 LBS HRS.

BOILER - MODEL 1-5-508-GP SN 9607  
MAX FIRING RATE 4200 CU' FT/HR  
MIN " " 21400 CU' FT/HR. | 30 GAL/HR  
NAT GAS | 10 GAL/HR  
NO. 2 FUEL OIL.

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

Ft Gill

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY RMS DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

List of Boilers      Shut off      @ hrs

505

511

512

213

114

101

304

308

403

Left on

935 - Gya

205 - liquor store

103 ~~203/4~~ - Fire dept

735 chapel (theater)

BUILDING 506

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_

SHEET NO \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

See Bldg.

512



BUILDING 507

**E M C ENGINEERS, INC.**  
Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_

SHEET NO \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

See Bldg.

512

BUILDING 508

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

See Bldg.

512

BUILDING 509

**E M C ENGINEERS, INC.**  
Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_

SHEET NO \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

See Bldg.

512

BUILDING 510

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • Germany

See Bldg.

512



BUILDING 511

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

See Bldg.

512

BUILDING 514

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

See Bldg.

512

BUILDING 512

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. OF  
 CALCULATED BY: CEL  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/9/92

BLDG.# 512-6  
ECO 1

**WALL & ROOF INSULATION**

AREAS IN SQ. FEET	NORTH	SOUTH	EAST	WEST
WALLS <i>see plan for</i>	600	185		
WINDOWS <i>505</i>	52" x 18" <i>15.20</i>	52 x 13 <i>40</i>	42 + 5 + 20 + 20 30 + 20 + 12 + 12 2 + 15 + 20 <i>198</i>	70 - 52 x 3 100 - 198 =
OVERHEAD DOORS	6 - 10' x 10'	1 - 0' x 10'	7 - 0' x 10'	2 - 10' x 10'
PERSONNEL DOORS	1 - 48 x 96 1 - 72 x 36	Ø	5 - 72 x 36"	2 - 48 x 96"

*52" x 3"*

SKETCH WALL CROSS-SECTION	COMPONENTS
	1. OUTSIDE AIR FILM 2. 12" BRICK 3. 4. 5. 6. 7. INSIDE AIR FILM
SKETCH ROOF CROSS-SECTION	COMPONENTS
	1. OUTSIDE AIR FILM 2. 2 PLY <i>ROCK</i> 3. ROOF DECK 4. 5. 6. 7. INSIDE AIR FILM
PERSONNEL DOOR TYPE <u>1/2 METAL 1/2 GLASS</u>	BASEMENT [ ] SLAB [ <u>L</u> ] CRAWL SPACE [ ]
OVERHEAD DOOR TYPE <u>METAL ROLL UP</u>	

**COMMENTS:**  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

Fl. McPherson/Ft. Gillem Energy Study  
EMC # 3105.000

JOB  
PROJ.#  
SHEET NO. KC  
CALCULATED BY:  
CHECKED BY:  
DATE: 1-9-92

BLDG.# 6126  
ECO 1

PIPE INSULATION

LOCATION	PIPE DIAMETER	PIPE LENGTH	FLUID TYPE	FLUID TEMP.	AIR TEMP.	INSULATION TYPE	INSULATION THICKNESS	INSULATION CONDITION
AHU NORTH	1 1/2"	20'	HW		63°F	FIBER G.	1"	*
AHU SOUTH	1 1/2"	50'	STM		63°F	NONE	NONE	
SOUTH BAYS	6'	15'	STM		63°F	FIB. G. W/PAPER	1"	NBGO REPAIR
BAY 4	VARIOUS		STM					GOOD
BAY 3	2"	30'	STM					NEED REPAIR
BAY 2	VARIOUS		STM					GOOD
BAY 1	VARIOUS		STM					** GOOD

COMMENTS: \* NO INSULATION ON CORNERS (3)

\*\* NO INSULATION

\*\*\* HAS BEEN REINSULATED

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

Ft. McPherson/Ft. Gillem Energy Study  
EMC # 3105.000

JOB  
PROJ.#  
SHEET NO. KC  
CALCULATED BY:  
CHECKED BY:  
DATE 1-9-92

BLDG.# 5126  
ECO 1

**DUCT INSULATION**

LOCATION	DUCT CROSSSECTION	SHAPE	DUCT TEMP. (°F)	SURROUND AIR TEMP. (°F)	INSULATION TYPE	INSULATION THICKNESS	INSULATION CONDITION
AHU NORTH	3' X 2'	□		63°F	FIBERG. w/Foil	3/4"	GOOD
AHU SOUTH	3' X 2'	□	85°F	65°F	NONE	NONE	*

COMMENTS: \* NEED TO INSULATE SUPPLY AIR DUCT (≈ THE LENGTH OF BAYS)




EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

Ft. McPherson/Ft. Gillem Energy Study  
EMC # 3105.000

JOB  
PROJ.#  
SHEET NO.  
CALCULATED BY:  
CHECKED BY:  
DATE:

1 OF  
CBL  
1/9/92

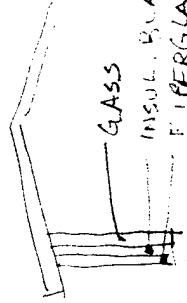

BLDG.# 512  
ECO 2

WINDOWS SURVEY

WINDOW NO.	SINGLE/DOUBLE PANE	TYPE - SLIDING FIXED, CASEMENT	FRAME MAT'L	ORIENTATION	GLASS SHADING	WINDOW COVER	DIMENSIONS (INCH)
1	SINGLE (WAREHOUSE)	CASEMENT	WPC	ALL	NONE	NONE	5' x 10' *
2	" * (CLEARSTORY)	FIXED	METAL	E & V	FANDED GREEN	*	20' 6" high
3	SINGLE (OFFICE)	CASEMENT	METAL	ALL	<del>SHED</del> NONE	MINI BLINDS	length of building

COMMENTS: \* See ECO 1 FORM FOR GLASS AREA


BLDG.# 512-9  
ECO 3

WEATHERSTRIPING AND CAULKING

DOOR/ WINDOW	CONDITION OF W.S./CAULK	INFILTRATION	ORIENTATION	DIMENSIONS (INCH)
P. DOOR	W.S. NONE	HIGH	<del>ALL</del>	48x96
WINDOW	CAULK <del>W.S.</del> W.S. NONE	MED	ALL	52x18 sections *
P. DOOR	W.S. NONE	HIGH	E	72" x 36"
OVERH. DOOR	W.S. <del>TOP</del> BOTTOM	HIGH	ALL	10' x 10'

COMMENTS:

48x48" VENT FAN OPEN

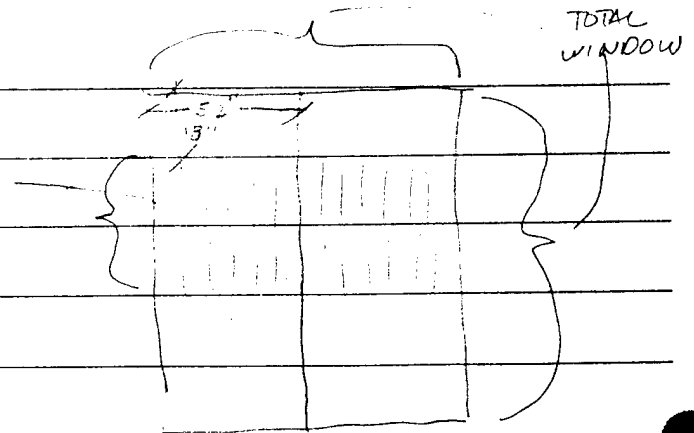

THIS PART  
OPENS NO  
WEATHERSTRIP

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/9/92

BLDG.# 512  
ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
MEN'S ROOM WEST BAY #2	101°F
BREAK ROOM NORTHWEST BAY #1	129.4°F

**PROBLEMS:**

**COMMENTS:**

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KC  
CHECKED BY: \_\_\_\_\_  
DATE: 1-9-92

BLDG.# 512 G  
ECO 5

MOTORS

MOTOR #	<u>4</u>	HP	<u>3</u>	PH	<u>3</u>	RPM	_____
MODEL #	<u>BH15C</u>	VOLTS	<u>208</u>	AMPS	<u>7.6</u>		
SERIAL #	_____	PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>TRANE</u>	REQUIRED HR.	<u>700</u>	TO	<u>1545</u>		
FRAME	_____	EFF.	_____				
DESCRIPTION	<u>AHU SOUTH END</u>		COMMENTS	<u>NO MOTOR NAME PLATE</u>			
	<u>DX</u>			<u>AHU TAG. RECORDED</u>			
	<u>STM</u>						

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____		COMMENTS	_____			

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____		COMMENTS	_____			

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-9-92

BLDG.# 512 G  
 ECO 5

**MOTORS**


MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	<u>115 V</u>	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	<u>UNIT HEATER A</u>		COMMENTS <u>CAN NOT GET NAME PLATE</u>				
MOTOR #	<u>2</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>17400</u>
MODEL #	<u>UVE184TDR7627ACL</u>		VOLTS	<u>200</u>	AMPS	<u>14.8</u>	
SERIAL #	_____	PRESENT HR.	<u>0600</u>	TO	<u>1600</u>	<u>2400</u>	
MFG	<u>MARATHON</u>	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	<u>85.5</u>				
DESCRIPTION	<u>AHU NORTH END</u> <u>DX</u> <u>HW</u>		COMMENTS <u>TIME CLOCK w/ PINS.</u>				
MOTOR #	<u>3</u>	HP	<u>1/12</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>M09186 3-84</u>		VOLTS	<u>115</u>	AMPS	<u>1.8</u>	
SERIAL #	_____	PRESENT HR.	_____	TO	<u>2400</u>		
MFG	<u>B &amp; G.</u>	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	<u>HW. CIR. PUMP</u>		COMMENTS <u>SERVE HEATING COIL OF AHU.</u>				

BLDG.# 512 G  
 ECO 10

**AIR STRATIFICATION**

LOCATION	<u>BAY 1 (TYP. FOR ALL BAYS)</u>	REQ. TEMP.	_____
TEMP. AT TSTAT	_____	SOURCE	<u>UH.</u>
TEMP. AT CEILING	<u>71' F</u>	OPP. HOURS	<u>0700 TO 1545</u>
TEMP. AT FLOOR	<u>63 F</u>		

SKETCH ROOM - DIMENSIONS, T-STATS, DUCTS, FANS, ETC.

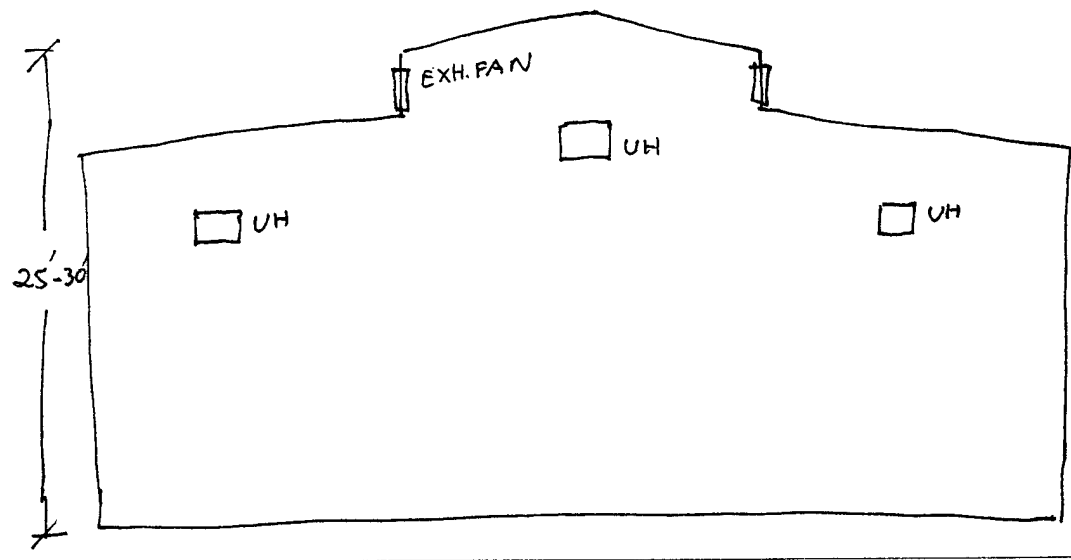

COMMENTS: EVERY BAY HAS 4 EXH. FANS.

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

BLDG.# 512  
ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
1	43	2 <sup>8'</sup>	96	F	ON	Y	N	12 <sup>CB</sup>	N
2	4	2 <sup>8'</sup>	96	F	ON	Y	Y	1	Y
3	4	2 <sup>8'</sup>	96	F	ON	Y	N	<del>2</del> 2	N
4	4	2 <sup>8'</sup>	96	F	ON	Y	N	<del>2</del> 2	N
<del>4</del>	4	4	34	F	ON	Y	N	<del>2</del> 2	N
5	12	4	34	F	ON	Y	N	2	N
1	1	1	34	F	ON	Y	N	1	Y
6	67	2 <sup>8'</sup>	96	F	ON	Y	N	8 <sup>CB</sup>	N
7	3	2 <sup>8'</sup>	96	F	ON	Y	N	1	Y
8	3	2 <sup>8'</sup>	96	F	ON	Y	N	1	N
9	1	4	34	F	ON	Y	N	1	N
10	1	4	34	F	ON	Y	N	1	Y
11	70	2 <sup>8'</sup>	<del>96</del> 96	F	ON	Y	N	16 <sup>CB</sup>	N
	1	2	34	F	ON	Y	N	1	Y
12	106	2 <sup>8'</sup>	96	F	ON	Y	N	19 <sup>CB</sup>	N
	5	4	34	F	ON	Y	N	1	N
	6	1	200	I	OFF	Y	N		N
13	4	2 <sup>8'</sup>	96	F	ON	Y	N	1	N

NEXT PAGE ALSO

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: CS  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-9-92

BLDG.# 512  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
14	2	2 <sup>8'</sup>	96	F	ON	Y	N	1	Y
15	22	2 <sup>8'</sup>	96	F	ON	Y	N	<del>3</del> <sup>CB</sup> 13	Y
16	24	2	34	F	ON	Y	N	3	N
17	44	2	34	F	ON	Y	N	<del>1</del> 6	N
18	9	2	34	F	ON	Y	<del>N</del> Y	6	Y
19	4	2 <sup>8'</sup>	96	F	ON	Y	Y	1	Y
11	6	1	200	I	OFF		N		N

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_



JOB Fl. McPherson/Fl. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: CEL  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/9/92

VI. BUILDING DATA SURVEY OBSERVATIONS

BLDG NO: 512-G BLDG NAME: WAREHOUSE JOB: 3105.000  
 PRIMARY FUNCTION: \_\_\_\_\_ GROSS SQ FT \_\_\_\_\_ NO OF FLRS 1  
 BUILDING MANAGER NAME: \_\_\_\_\_  
 PHONE: \_\_\_\_\_ OFFICE NO. \_\_\_\_\_

SPECIAL AREAS: COMPUTER FACILITY [ ] - ZONE NO'S. \_\_\_\_\_  
 AUDITORIUM [ ] - ZONE NO'S. \_\_\_\_\_  
 LABORATORIES [ ] - ZONE NO'S. \_\_\_\_\_  
 CAFETERIA [ ] - ZONE NO'S. \_\_\_\_\_  
 OTHER [ ] - ZONE NO'S. \_\_\_\_\_

ZONE NO. 1 FUNCTION: WAREHOUSE SPECIAL REQ. YES [ ] NO [ ]  
 LOCATION: \_\_\_\_\_ (IDENTIFIED ON FLOOR PLAN [ ])  
 OCCUPANCY HOURS: M-F 7:00 TO 3:45, SAT 0 TO 0, SUN 0 TO 0  
 PRESENT TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F  
 REQUIRE TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F

REMARKS: WAREHOUSE HEATING ONLY

ZONE NO. \_\_\_\_\_ FUNCTION: \_\_\_\_\_ SPECIAL REQ. YES [ ] NO [ ]  
 LOCATION: \_\_\_\_\_ (IDENTIFIED ON FLOOR PLAN [ ])  
 OCCUPANCY HOURS: M-F \_\_\_\_\_ TO \_\_\_\_\_, SAT \_\_\_\_\_ TO \_\_\_\_\_, SUN \_\_\_\_\_ TO \_\_\_\_\_  
 PRESENT TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F  
 REQUIRE TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F

REMARKS: \_\_\_\_\_

ZONE NO. \_\_\_\_\_ FUNCTION: \_\_\_\_\_ SPECIAL REQ. YES [ ] NO [ ]  
 LOCATION: \_\_\_\_\_ (IDENTIFIED ON FLOOR PLAN [ ])  
 OCCUPANCY HOURS: M-F \_\_\_\_\_ TO \_\_\_\_\_, SAT \_\_\_\_\_ TO \_\_\_\_\_, SUN \_\_\_\_\_ TO \_\_\_\_\_  
 PRESENT TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F  
 REQUIRE TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F

REMARKS: \_\_\_\_\_

ZONE NO. \_\_\_\_\_ FUNCTION: \_\_\_\_\_ SPECIAL REQ. YES [ ] NO [ ]  
 LOCATION: \_\_\_\_\_ (IDENTIFIED ON FLOOR PLAN [ ])  
 OCCUPANCY HOURS: M-F \_\_\_\_\_ TO \_\_\_\_\_, SAT \_\_\_\_\_ TO \_\_\_\_\_, SUN \_\_\_\_\_ TO \_\_\_\_\_  
 PRESENT TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F  
 REQUIRE TEMP: WINTER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F, SUMMER OCC \_\_\_\_\_ °F UNOCC \_\_\_\_\_ °F

REMARKS: \_\_\_\_\_

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY CRU DATE 1/9/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_


SCALE \_\_\_\_\_


**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

512-4

O.H. DOORS & IR. HEATERS



20' 

20'

ESTIMATE EACH DOOR USED  
1 HOUR PER DAY

JOB Gillem

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY CS DATE 1-9-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 512

Two ~~One~~ foot tear in the 3<sup>rd</sup> bay South End. Small piping.

Two foot tear in North end of the 3<sup>rd</sup> bay. Two sections are missing covering paper. Small piping.

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_


CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

512

HAS AIR CURTAINS?  
OH DOOR (WELL SEALED)

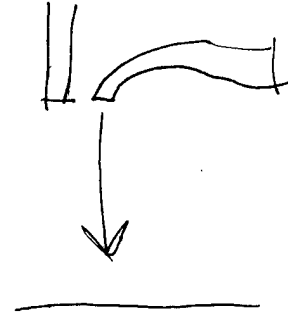

DOORS LEFT OPEN WITH UH ON

VENTILATION FANS IN CURPICO  
BAROMETRIC DAMPERS

GAS UH & HW OR SW UH

TEMP → 75°F ONE BAY (LIQUOR STORE)  
65°F OTHERS  
→ 74°F T/S SETPOINT  
TIMECLOCK INOPERABLE

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BUILDING. 512 G'  
WAREHOUSE


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KCC DATE 1-9-82

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

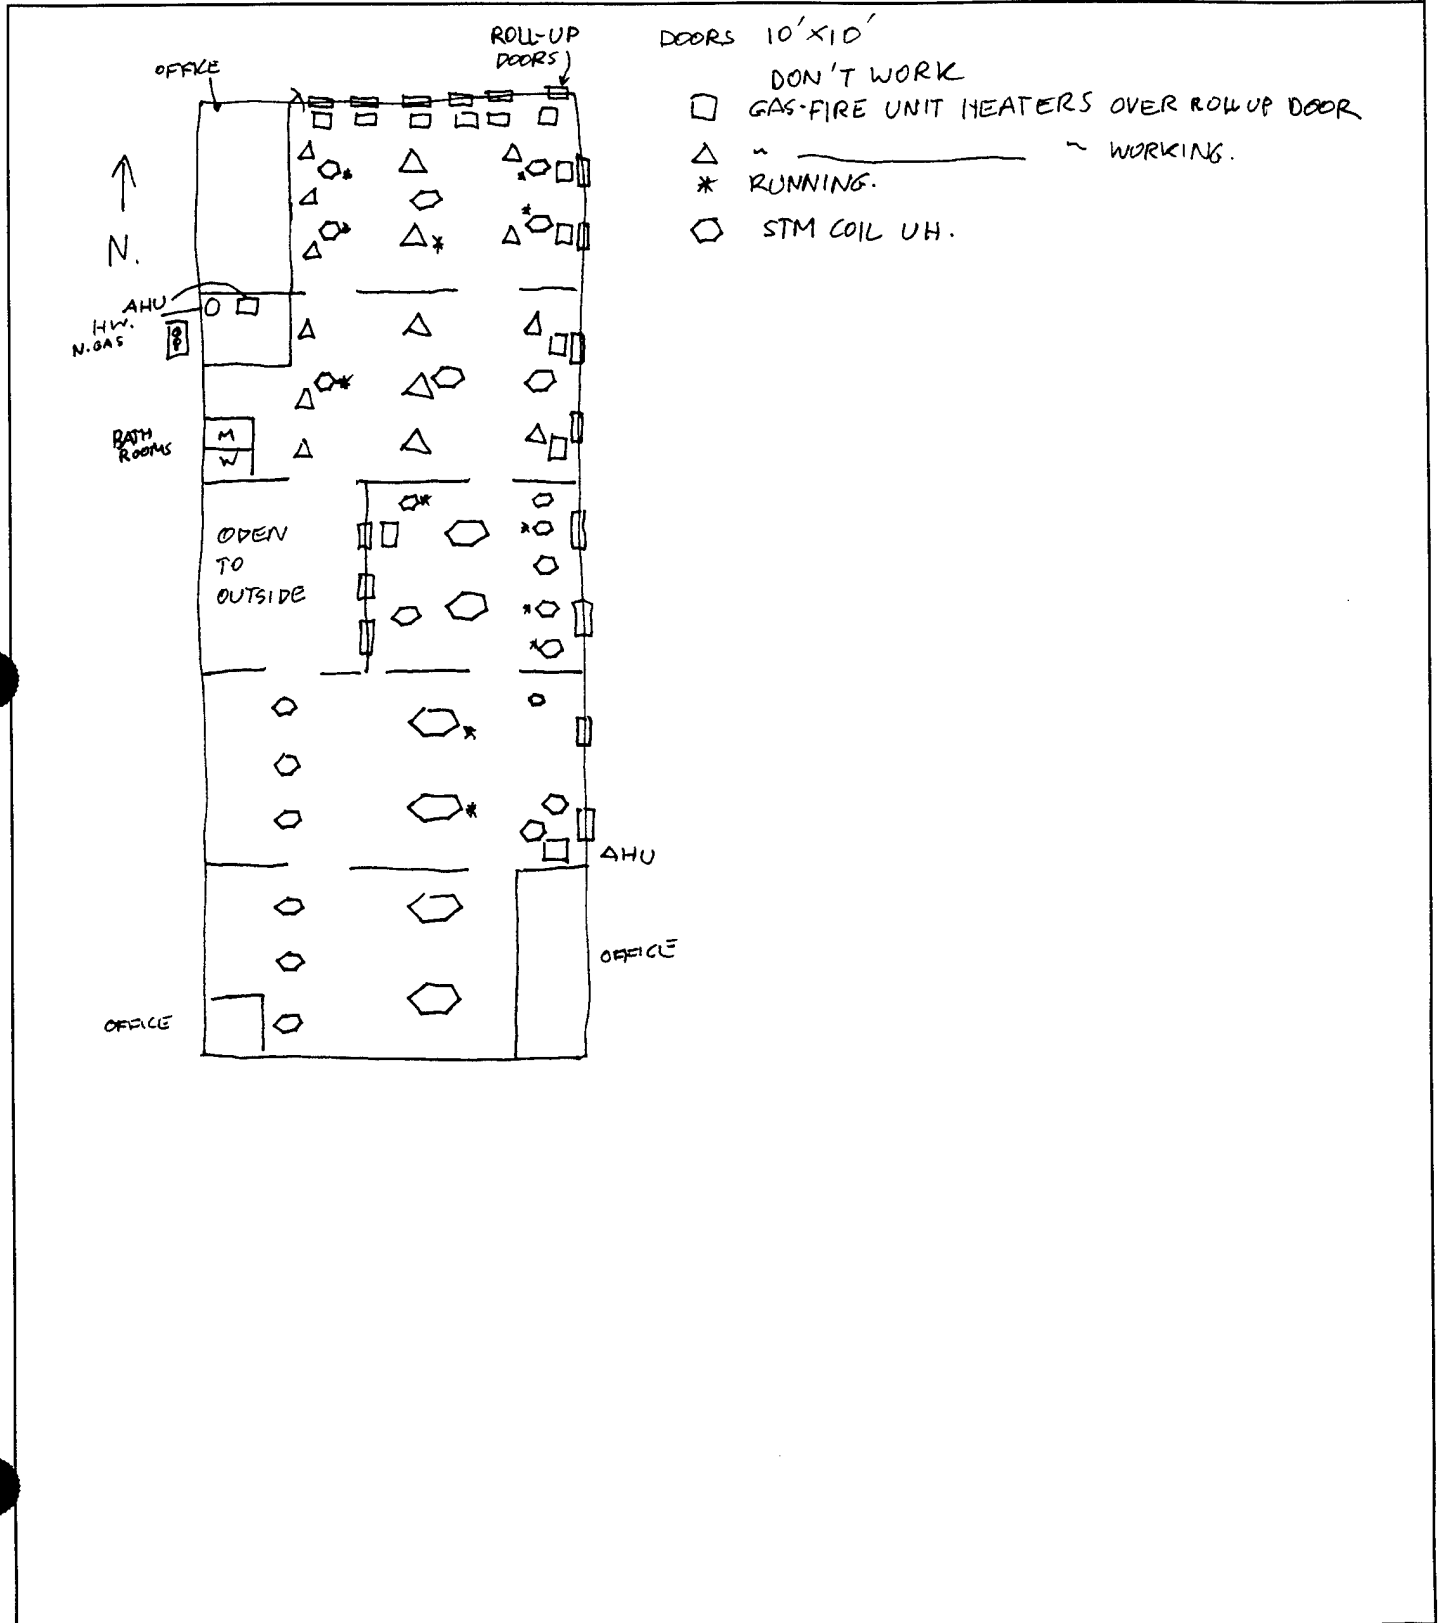

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 512


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/9/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

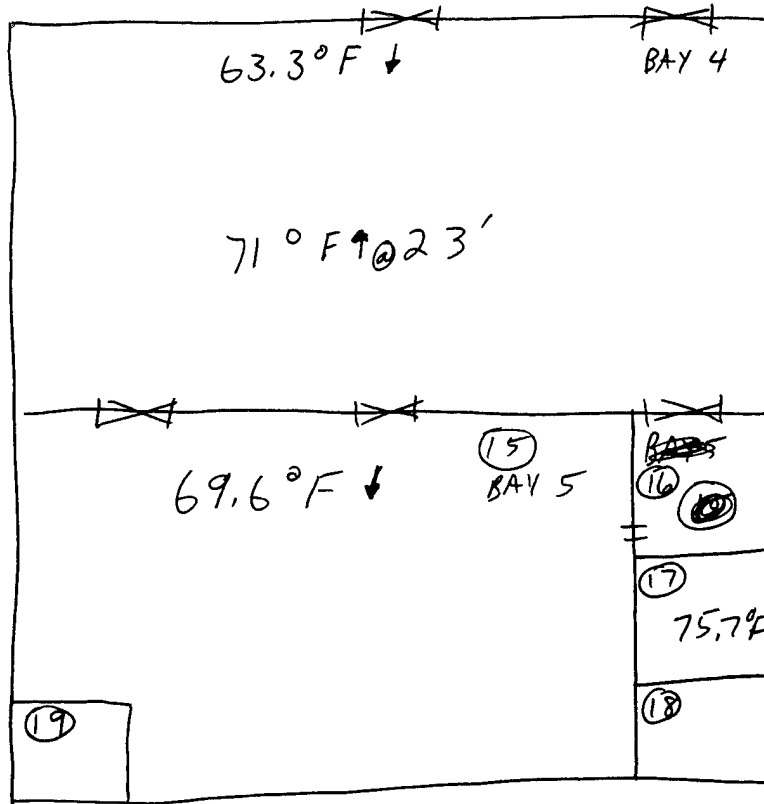

OFFICE HRS 7:00 - 3:45 pm

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 512

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_


CALCULATED BY JW DATE 1/9/82

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_



OA TEMP AT  
9:45AM 58.5°F

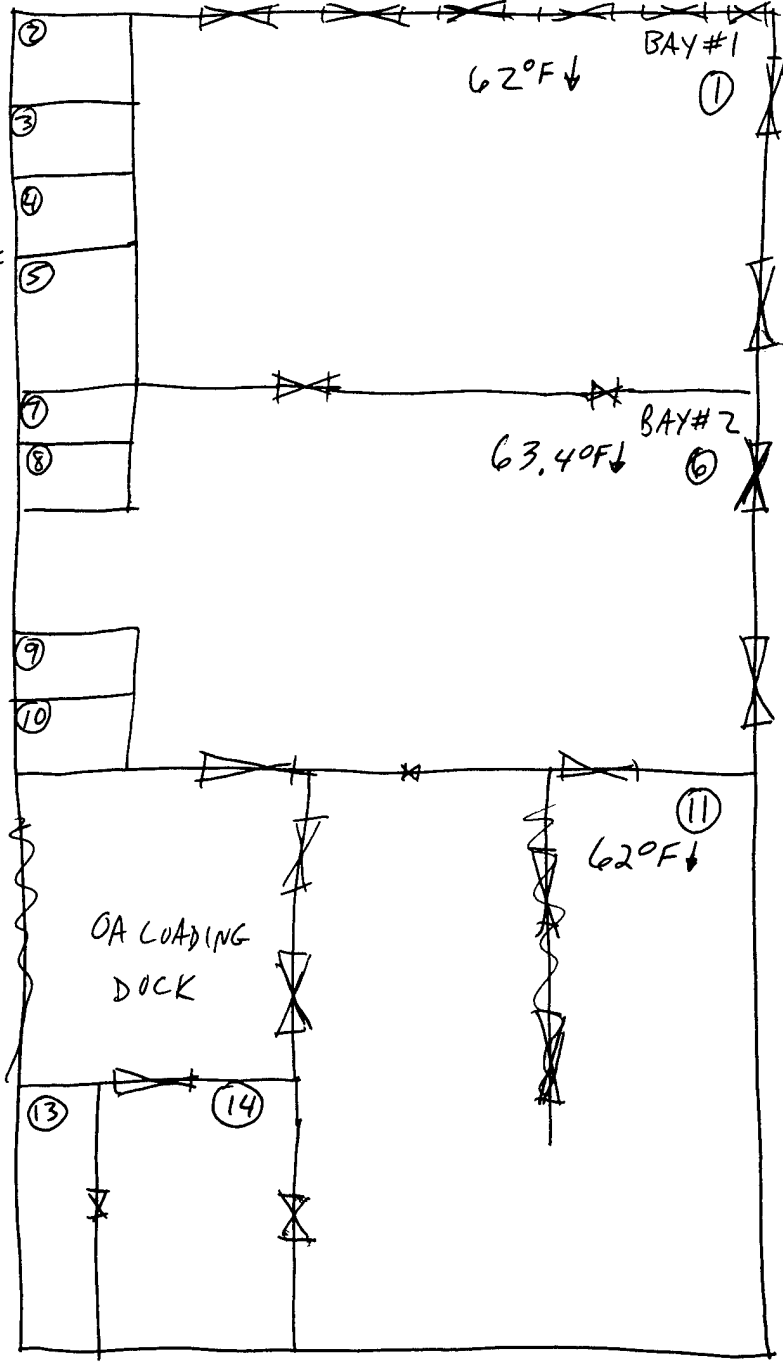

BUILDING 513



**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/9/92

BLDG.# 513  
ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
<del>NORTH</del> EAST WOMEN'S ROOM	144°F
EAST MEN'S ROOM	151°F

PROBLEMS:

COMMENTS:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 513

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY JW DATE 1/9/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

INADEQUATE LIGHTING

BAY 4, SOUTH TWO ISLES HAVE POOR LIGHTING.

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 5136


JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-9-92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

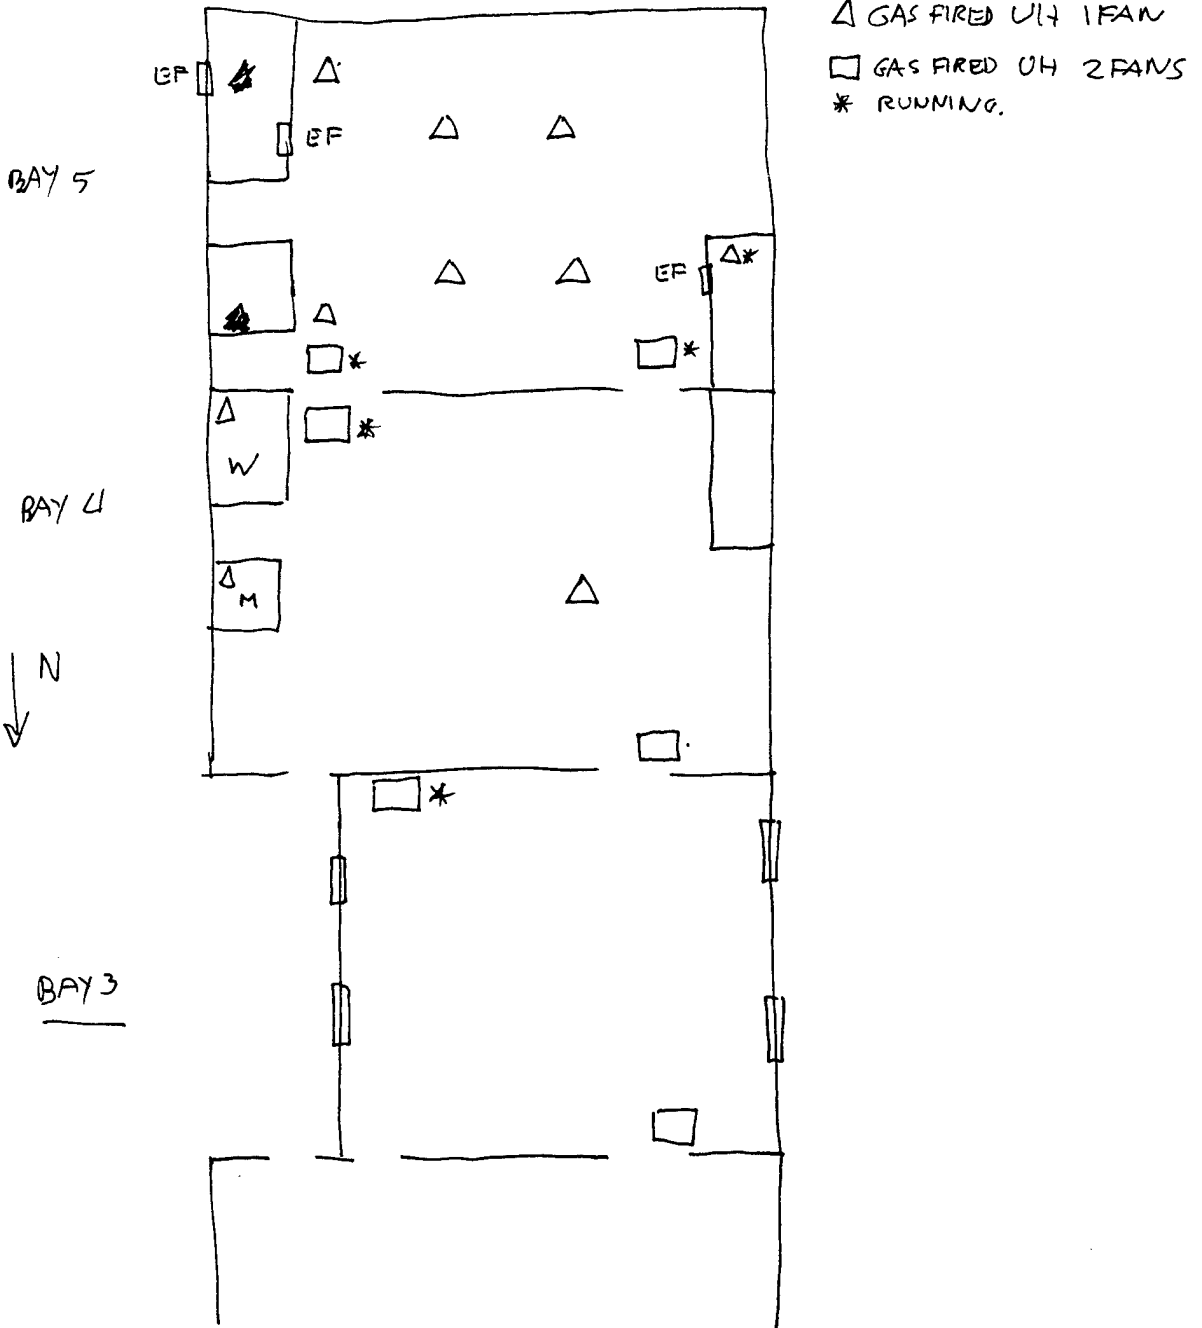

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_


CALCULATED BY CEM DATE 1/9/92

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

513-6

SEE PAWN SKETCH

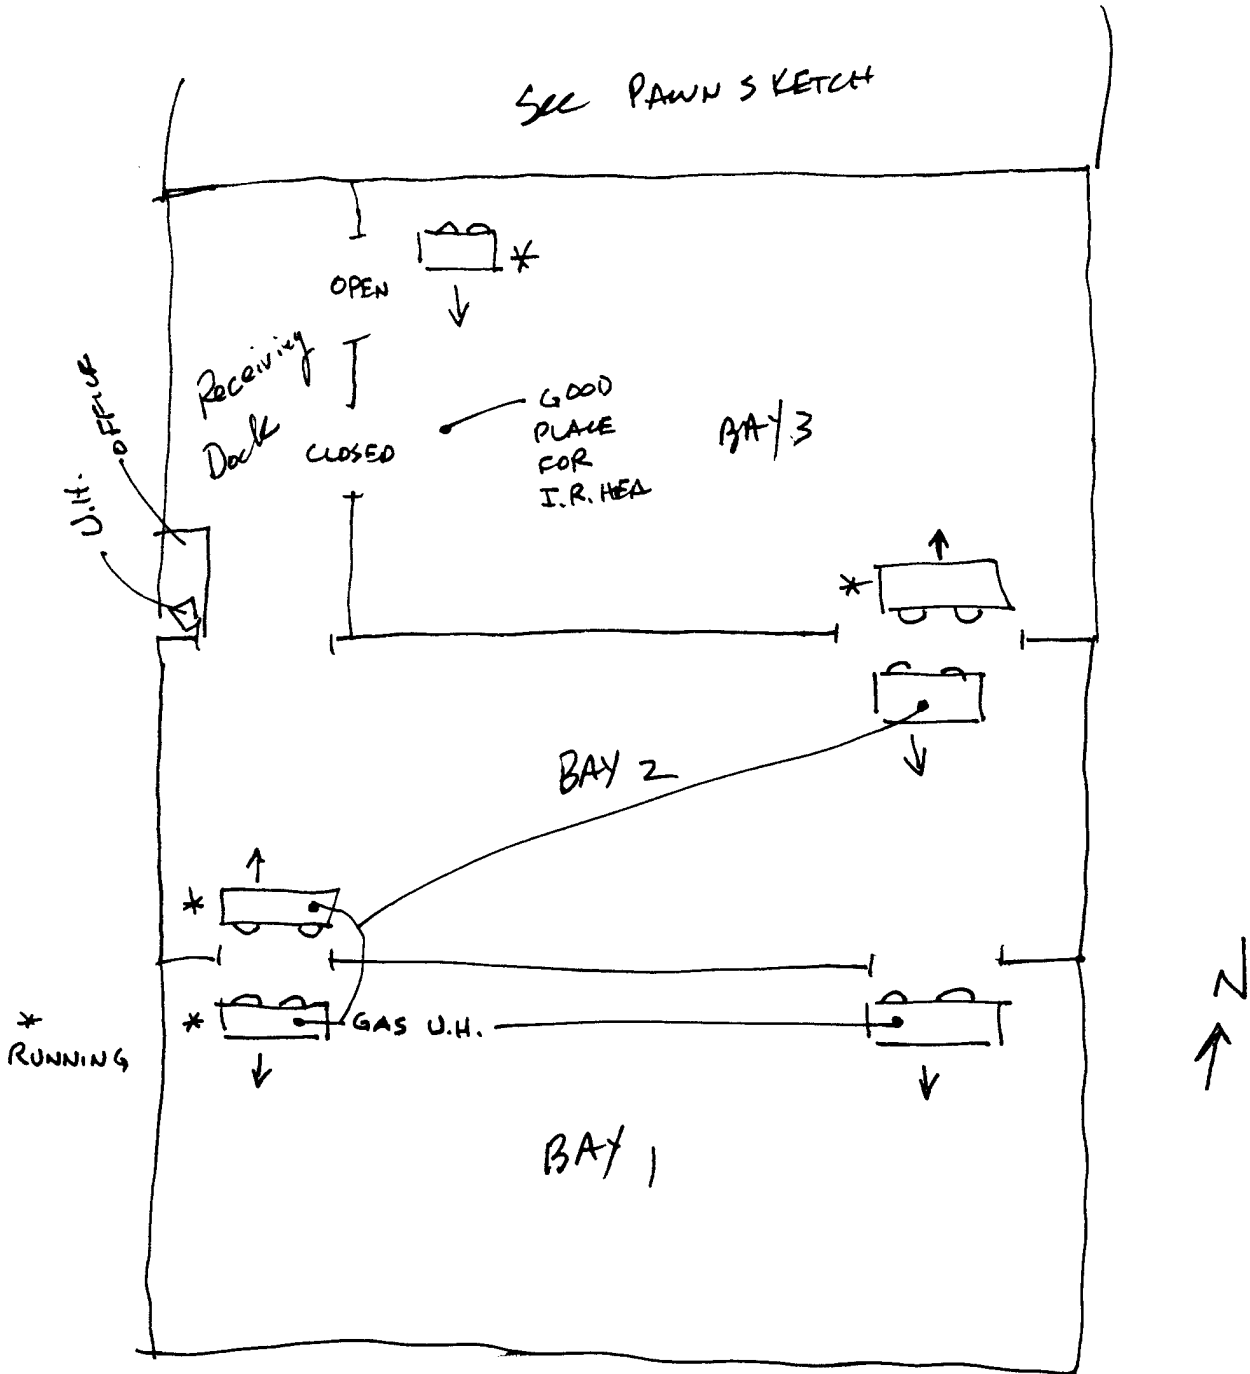

BUILDING 735

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. OF  
 CALCULATED BY: JW  
 CHECKED BY:  
 DATE: 1/9/92

BLDG.# 735  
 ECO 1

WALL & ROOF INSULATION

AREAS IN SQ. FEET	NORTH	SOUTH	EAST	WEST
WALLS				
WINDOWS				
OVERHEAD DOORS				
PERSONNEL DOORS				

SKETCH WALL CROSS-SECTION	COMPONENTS
	<ul style="list-style-type: none"> <li>1. OUTSIDE AIR FILM 0.17</li> <li>2. VINYL SIDING 0.61</li> <li>3. STYROFOAM 1" 0.61</li> <li>4. FRAME 3.33</li> <li>5. GYPBOARD 0.45</li> <li>6. 0.68</li> <li>7. INSIDE AIR FILM</li> </ul> <p style="text-align: right;"><u>5.85</u></p>

SKETCH ROOF CROSS-SECTION	COMPONENTS
	<ul style="list-style-type: none"> <li>1. OUTSIDE AIR FILM 0.17</li> <li>2. SLINGLE 0.44</li> <li>3. WOOD DECK 0.62</li> <li>4. AIR SPACE 1.24</li> <li>5. 6" BLOWN-IN FIBER 20.0</li> <li>6. GYP BRD 0.45</li> <li>7. INSIDE AIR FILM 0.68</li> </ul> <p style="text-align: right;"><u>23.6</u></p>

PERSONNEL DOOR TYPE	METAL (& WOOD)	BASEMENT [ ]
OVERHEAD DOOR TYPE	NONE	SLAB [ <input checked="" type="checkbox"/> ]
		CRAWL SPACE [ ]

COMMENTS:

---



---



---



---

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. KC OF \_\_\_\_\_  
 CALCULATED BY: \_\_\_\_\_  
 CHECKED BY: \_\_\_\_\_  
 DATE 1-9-92

BLDG.# 735 G  
 ECO 1

PIPE INSULATION

LOCATION	PIPE DIAMETER	PIPE LENGTH	FLUID TYPE	FLUID TEMP.	AIR TEMP.	INSULATION TYPE	INSULATION THICKNESS	INSULATION CONDITION
Mech. Room	2"	30'	HW	125°F	62°F	FIB. w/PAPER	2"	GOOD

COMMENTS:

---



---



---



---



**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

Ft. McPherson/Ft. Gillem Energy Study  
EMC # 3105.000

JOB  
PROJ.#  
SHEET NO. 12  
CALCULATED BY:  
CHECKED BY:  
DATE 1-9-92

BLDG.# 735 G  
ECO 1

DUCT INSULATION

LOCATION	DUCT CROSSSECTION	SHAPE	DUCT TEMP. (°F)	SURROUND AIR TEMP. (°F)	INSULATION TYPE	INSULATION THICKNESS	INSULATION CONDITION
Mechroom	20" X 20" ≈ 25' long		*	62	NONE	NONE	
"	40" X 40" ≈ 10' long		*	62			

COMMENTS: \* NOT RUNNING.



**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

BLDG.# 735  
ECO 2

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/9/92

WINDOWS SURVEY

WINDOW NO.	SINGLE/DOUBLE PANE	TYPE - SLIDING FIXED, CASEMENT	FRAME MAT'L	ORIENTATION	GLASS SHADING	WINDOW COVER	DIMENSIONS (INCH)
	SINGLE	SLIDING	WOOD	N/S/E/W	NONE	CURTAINS	REFER TO WEATHERSTRIP FORM

COMMENTS:

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY: JW

CHECKED BY: \_\_\_\_\_

DATE: 1/9/92

BLDG.# 735  
ECO 3

WEATHERSTRIPING AND CAULKING

DOOR/ WINDOW	CONDITION OF W.S./CAULK	INFILTRATION	ORIENTATION	DIMENSIONS (INCH)		
DW	FAIR	LOW	E	30x53	1	
D		MED	E	64x80	1	
W		LOW	E	30x27	1	
D		MED	N	64x80	2	
W		LOW	N	30x53	1	
D		MED	N	30x70	1	
W		LOW	W	30x54	2	
D		HIGH	S	64x80	2	
W		LOW	S	30x54	1	
W		↓	LOW	S	30x27	1

COMMENTS:

DOUBLE DOOR ON SOUTH EAST CORNER HAS  $\frac{3}{4}$ " AIR  
GAP BETWEEN.

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/9/92

BLDG.# 735  
ECO 4

DOMESTIC HOT WATER

FAUCET LOCATION	WATER TEMPERATURE
MEN'S	155°
WOMEN'S	155°
PROBLEMS:	

COMMENTS: ELECTRIC  
AIR TEMP = 68°F

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-9-92

BLDG.# 735  
 ECO 5

**10+ HP MOTORS**  
 \*MEASURED\*

MOTOR#	<u>1</u>	PHASE A	PHASE B	PHASE C
DESCRIPTION	<u>AHU</u>	<u>2084</u>	<u>2084</u>	
MFG	<u>GOULD</u>	<u>23</u>	<u>23</u>	
MODEL #	<u>6339075-D</u>	<u>5.4</u> <del>4.562</del>		
SERIAL #		<u>4 8.2</u>		
FRAME	<u>3 215T</u>	<u>1076.2</u>		
HP	<u>10</u> RPM <u>1750</u>	<u>75.6</u>		
VOLT	<u>200</u>			
AMPS	<u>30</u>	PRESENT	TO	
EFF.		REQ HR.	TO	
COMMENTS	<u>T' STAT CONTROL @ 70°F.</u>			

MOTOR#	_____	PHASE A	PHASE B	PHASE C
DESCRIPTION	_____			
MFG	_____			
MODEL #	_____			
SERIAL #	_____			
FRAME	_____			
HP	_____ RPM _____			
VOLT	_____			
AMPS	_____	PRESENT	TO	
EFF.	_____	REQ HR.	TO	
COMMENTS	_____			

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KC  
CHECKED BY: \_\_\_\_\_  
DATE: 1-9-92

BLDG.# 735  
ECO 5

MOTORS

MOTOR #	1	HP	10	PH	3	RPM	1750
MODEL #	6339075-01	VOLTS	200	AMPS	30		
SERIAL #		PRESENT HR.				TO	
MFG	GOULD	REQUIRED HR.				TO	
FRAME	S215T	EFF.					
DESCRIPTION	AHU MOTOR SEE 10HP FORM	COMMENTS	NOT RUNNING. NEITHER AS BOILER BUILDING LOCK.				
MOTOR #	2	HP	1/2	PH	1	RPM	1725
MODEL #	8-16578-20	VOLTS	115	AMPS	7.3		
SERIAL #		PRESENT HR.		0		TO	2460
MFG	CENTURY	REQUIRED HR.				TO	
FRAME	J56J	EFF.					
DESCRIPTION	HW PUMP	COMMENTS	RUNNING				
MOTOR #		HP		PH		RPM	
MODEL #		VOLTS		AMPS			
SERIAL #		PRESENT HR.				TO	
MFG		REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION		COMMENTS					

BUILDING 918

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: CS  
CHECKED BY: \_\_\_\_\_  
DATE: 1-9-92

BLDG.# 918  
ECO 4

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
SINK IN MECH. ROOM (NEXT TO HEATER)	131° F
MEN'S ROOM	127° F

**PROBLEMS:**

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

**COMMENTS:**

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-9-92

BLDG.# 918 G  
 ECO 5

**MOTORS**

MOTOR #	<u>1</u>	HP	<u>2</u>	PH	<u>3</u>	RPM	<u>1725</u>
MODEL #	<u>8-164660-01</u>	VOLTS	<u>230</u>	AMPS	<u>6.8</u>		
SERIAL #		PRESENT HR.	<u>0</u>	TO	<u>2400</u>		
MFG	<u>MAGNETEK</u>	REQUIRED HR.	<u>M-SAT 3:00 PM - 11:00 PM</u> <u>SUN 1:00 PM TO 9:00 PM</u>				
FRAME	<u>P456</u>	EFF.					
DESCRIPTION	<u>AHU.</u>	COMMENTS					
	<u>DX HEAT PUMP</u>						

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				

MOTOR #	_____	HP	_____	PH	_____	RPM	_____
MODEL #	_____	VOLTS	_____	AMPS	_____		
SERIAL #	_____	PRESENT HR.	_____	TO	_____		
MFG	_____	REQUIRED HR.	_____	TO	_____		
FRAME	_____	EFF.	_____				
DESCRIPTION	_____	COMMENTS	_____				



**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.# EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/9/92

BLDG.# 918 BOWLING  
 ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/ FIXTURE	WATTS/ BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
1	<del>2</del> 6	4	34	F	ON	Y	N		N
2	1	2	34	F	OFF	Y	Y	1	N
3	2	2	34	F	OFF	Y	N	1	N
4	2	<del>1</del>	100	I	OFF	Y	N	1	N
5	7	2	34	F	ON	Y	<del>N</del>	1	N
6	3	2	96	F	OFF	Y	Y	1	N
7	7	4	34	F	ON	Y	N	1	N
8	2	2	34	F	ON	Y	<del>Y</del>	1	Y
9	2	4	34	F	ON	Y	Y	1	Y
10	2	2	34	F	ON	Y	N	1	Y
11	5	4	34	F	ON	Y	N	1	Y
12	2	2-U		F	OFF	Y	<del>N</del>	1	N
13	$\frac{2}{1}$	$\frac{2-4}{2}$	$\frac{34}{2}$	F	ON	Y	N	1	<del>Y</del>
14	1								

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY CKE DATE 1/9/92


CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

918

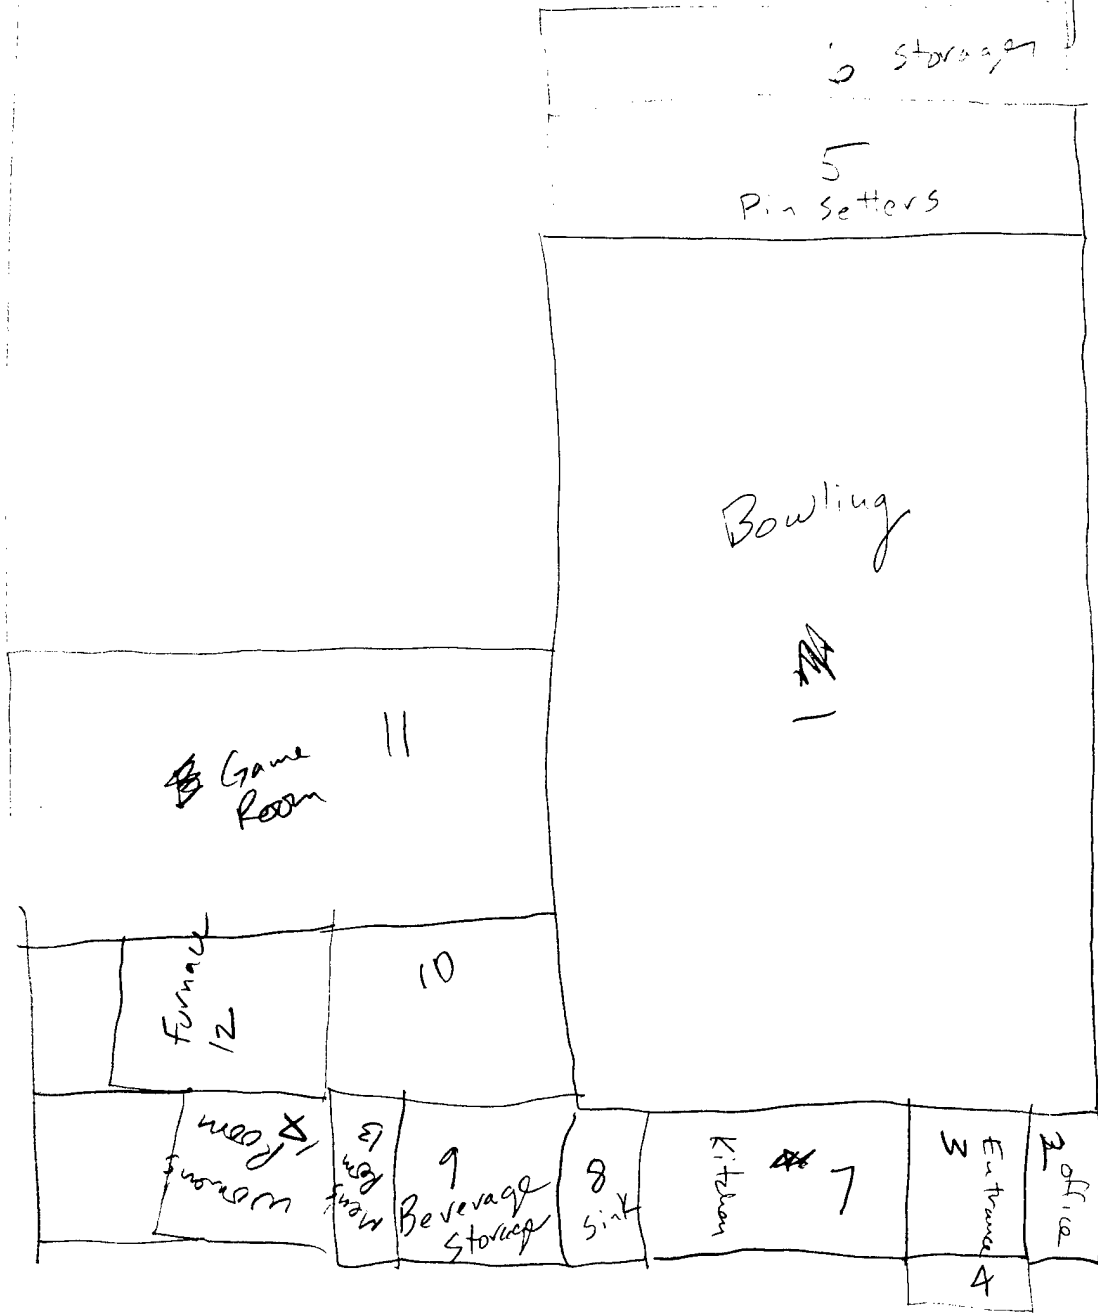

BUILDING 935

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

BLDG.# 935  
ECO 4

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJ.# EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: JW  
CHECKED BY: \_\_\_\_\_  
DATE: 1/9/92

**DOMESTIC HOT WATER**

FAUCET LOCATION	WATER TEMPERATURE
MEN'S LOCKER RM.	129°F

PROBLEMS:

COMMENTS:

---

---

---

---

---

---

---

---

**EMC ENGINEERS, INC.**  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
PROJECT NO. EMC # 3105.000  
SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
CALCULATED BY: KCC  
CHECKED BY: \_\_\_\_\_  
DATE: 1-9-92

BLDG.#  
ECO 5

935 G

**MOTORS**

MOTOR #	<u>5</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>3460</u>
MODEL #	<u>6-35725-01</u>		VOLTS	<u>230</u>	AMPS	<u>12.8</u>	
SERIAL #	_____		PRESENT HR.	<u>0</u>	TO	<u>2400</u>	
MFG	<u>CENTURY</u>		REQUIRED HR.	<u>0700</u>	TO	<u>1900</u>	
FRAME	<u>B182TO</u>		EFF.	<u>82.5</u>	PF = <u>89.5</u>		
DESCRIPTION	<u>HWP NEAR BOILER #1</u>		COMMENTS	<u>MAKE ALOT OF NOISE</u>			
MOTOR #	<u>6</u>	HP	<u>5</u>	PH	<u>3</u>	RPM	<u>1740</u>
MODEL #	<u>2N9375</u>		VOLTS	<u>208</u>	AMPS	<u>14.7</u>	
SERIAL #	_____		PRESENT HR.	<u>0</u>	TO	<u>2400</u>	
MFG	<u>DAYTON.</u>		REQUIRED HR.	<u>0700</u>	TO	<u>1900</u>	
FRAME	<u>215</u>		EFF.	<u>86.5</u>	M-1F		
DESCRIPTION	<u>AHU <sup>5</sup> NEAR BOILER</u>		COMMENTS	<u>HEATING ONLY</u>			
MOTOR #	<u>7</u>	HP	<u>1/12</u>	PH	<u>1</u>	RPM	<u>1725</u>
MODEL #	<u>M09181 4-84</u>		VOLTS	<u>115</u>	AMPS	<u>1.75</u>	
SERIAL #	_____		PRESENT HR.	<u>0</u>	TO	<u>2400</u>	
MFG	<u>B2</u>		REQUIRED HR.	_____	TO	_____	
FRAME	_____		EFF.	_____	_____		
DESCRIPTION	<u>HWCIRC PUMP. #003</u>		COMMENTS	<u>OFF DURING SURVEY</u>			

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study  
 PROJECT NO. EMC # 3105.000  
 SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: KC  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1-9-92

BLDG.# 935 G.  
 ECO 5

**MOTORS**

MOTOR #	<u>1</u>	HP	<u>1 1/2</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>184-71225-00</u>	VOLTS	<u>208</u>	AMPS	<u>4.8</u>		
SERIAL #		PRESENT HR.			<u>0700</u>	TO	<u>1900</u>
MFG	<u>WAGNER</u>	REQUIRED HR.			<u>0700</u>	TO	<u>1900</u>
FRAME	<u>184</u>	EFF.					
DESCRIPTION	<u>AHU IN WEIGHT ROOM #4</u>	COMMENTS	<u>T' STAT CONTROL OLD MOTOR.</u>				
MOTOR #	<u>2,3</u>	HP	<u>3/4</u>	PH	<u>1</u>	RPM	<u>-</u>
MODEL #		VOLTS	<u>240</u>	AMPS	<u>6.8</u>		
SERIAL #		PRESENT HR.			<u>0000</u>	TO	<u>2400</u>
MFG	<u>COMFORTMAKER</u>	REQUIRED HR.			<u>0700</u>	TO	<u>1900</u>
FRAME		EFF.					
DESCRIPTION	<u>AHU FOR RACKETBALL COURTS #2,3</u>	COMMENTS	<u>ELEC HEATER</u>				
	<u>(2) DX COOLING</u>		<u>208V 3Ø 3AA</u>				
MOTOR #	<u>4</u>	HP	<u>3/4</u>	PH	<u>3</u>	RPM	<u>1750</u>
MODEL #	<u>NO MODEL #</u>	VOLTS	<u>208</u>	AMPS	<u>2.5</u>		
SERIAL #		PRESENT HR.			<u>0</u>	TO	<u>2400</u>
MFG	<u>BEG</u>	REQUIRED HR.			<u>0700</u>	TO	<u>1900</u>
FRAME	<u>203</u>	EFF.					
DESCRIPTION	<u>HW PUMP NEAR BOILER #12</u>	COMMENTS	<u>OLD MOTOR</u>				

**EMC ENGINEERS, INC.**

DENVER \* ATLANTA \* GERMANY

JOB

Ft. McPherson/Ft. Gillem Energy Study

PROJECT NO.

EMC # 3105.000

SHEET NO.

OF

CALCULATED BY:

KCL

CHECKED BY:

DATE:

1-9-92

BLDG.#

9356

ECO 5

**MOTORS**

MOTOR #	8	HP	1/6	PH	1	RPM	1725
MODEL #	M10293		1-88	VOLTS	115	AMPS	2.4
SERIAL #		PRESENT HR.			0	TO	2400
MFG	BG	REQUIRED HR.				TO	
FRAME		EFF.					
DESCRIPTION	D HW CIRC. PUMP #1						
COMMENTS							
MOTOR #	9	HP	3	PH	3	RPM	3450
MODEL #	14736	VOLTS	200-230/960	AMPS	9.0-8.6		
SERIAL #		PRESENT HR.			0	TO	2400
MFG	CENTURY	REQUIRED HR.			0700	TO	1900
FRAME	L56C	EFF.					M-F
DESCRIPTION	HW CIRC. PUMP #2						
COMMENTS	PART 8-142017-01						
MOTOR #	10	HP	2	PH	3	RPM	1750
MODEL #	NO MOD#	VOLTS	208	AMPS	6.1		
SERIAL #	80464	PRESENT HR.			0	TO	2400
MFG	BG	REQUIRED HR.				TO	
FRAME	224	EFF.					
DESCRIPTION	AHU HEATING COIL #1						
COMMENTS							

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

Plg 935

Shower - full flow

30 sec = 9 quarts  
7.5 quarts

low flow - worst fit



JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

935

> 8 showers in the mens <sup>lockers</sup> rooms

Other ELO's

- low flow showers

-

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY KC DATE 1-9-92


CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

**E. M. C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

BLDG 935G

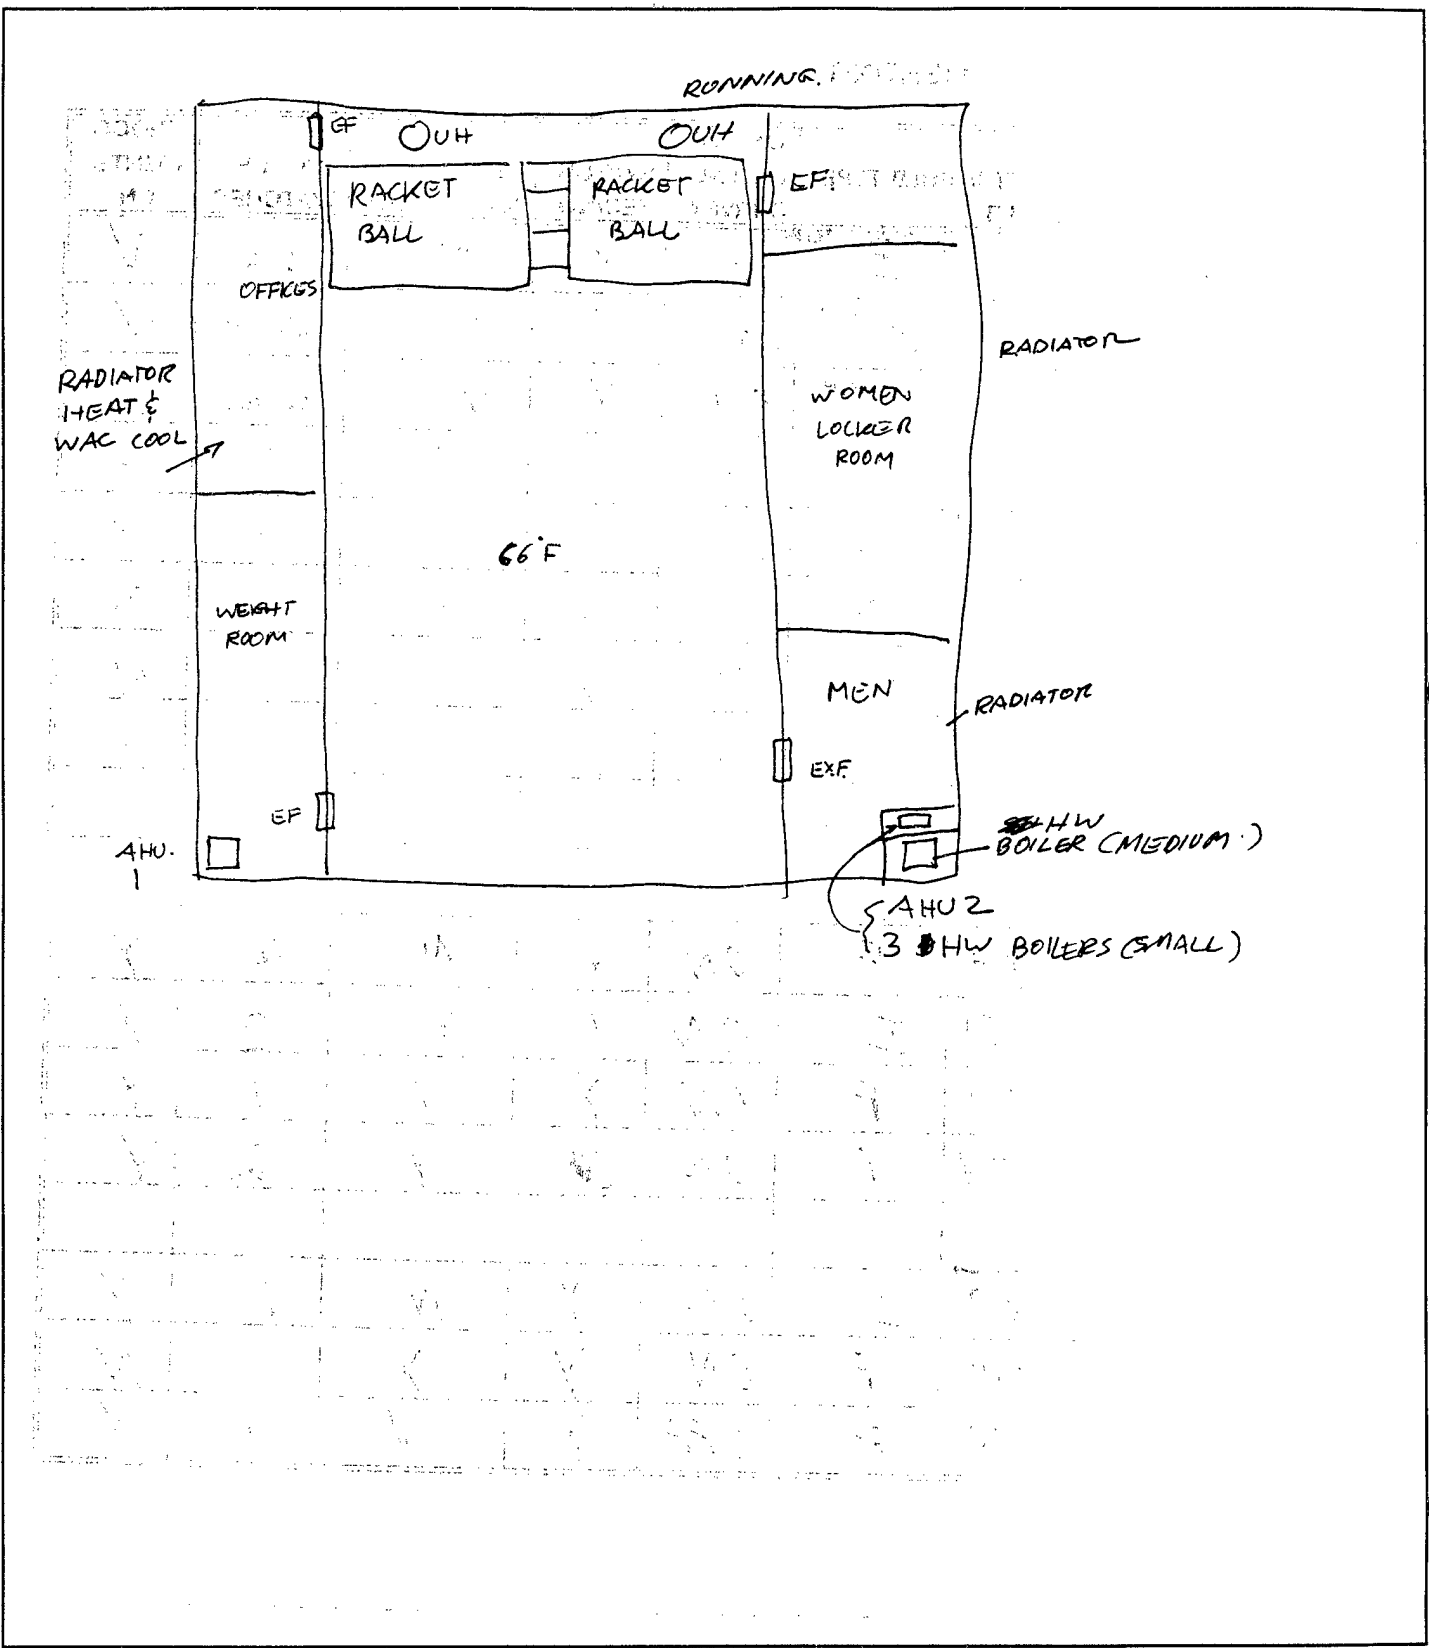

EMC ENGINEERS, INC.  
DENVER \* ATLANTA \* GERMANY

JOB Ft. McPherson/Ft. Gillem Energy Study

PROJ.# EMC # 3105.000

SHEET NO. \_\_\_\_\_ OF \_\_\_\_\_

CALCULATED BY: JW

CHECKED BY:

DATE: 1/9/92

BLDG.# 935  
ECO 15

LIGHTING

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
1	36	1	400	METAL HALIDE I	ON	Y	N	2.B.	N
2	6	1	400	I MH	ON	Y	N	2.B.	N
3	6	1	400	I MH	ON	Y	N	2.B.	N
4	2	4	34	F	ON	N	Y	0	Y
5	2	1	50	I	ON	N	Y	0	Y
6	3	2	34	F	ON	Y	Y	1	N
6	3	2	34	F	ON	Y	Y	1	N
6	3	2	34	F	ON	Y	Y	1	N
7	under construction								
8	<del>1</del> 1	1	150	I	ON	Y	Y	1	Y
9	9	2	34	F	ON	Y	N	2	Y
10	8	1	150	I	ON	Y	Y	2	Y
2-A	3	1	34	F	ON	Y	Y	1	Y
11	9	2	34	F	ON	Y	Y	2	Y
12	LOCKED								
13	4	1	<del>200</del> 200	I	ON	Y	N	1	Y
14	4	4	34	F	ON	Y	Y	1	N
15	1	2	34	F	OFF	Y	N	1	Y

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**EMC ENGINEERS, INC.**  
 DENVER \* ATLANTA \* GERMANY

JOB: Ft. McPherson/Ft. Gillem Energy Study  
 PROJ.#: EMC # 3105.000  
 SHEET NO.: \_\_\_\_\_ OF \_\_\_\_\_  
 CALCULATED BY: JW  
 CHECKED BY: \_\_\_\_\_  
 DATE: 1/9/92

BLDG.# 935  
 ECO 15

**LIGHTING**

ROOM #	# OF FIXTURES	LAMPS/FIXTURE	WATTS/BULB	BULB TYPE	ON/OFF DURING SURVEY	SWITCH YES/NO	GOOD FOR OCC. SENSOR	NO. OF SWITCHES	UNOCC LIGHTS ON
16	3	2	34	F	ON	Y	N	2	Y
17	30	2	34	F	ON	Y	N	3	N
18	15	2	34	F	OFF	Y	Y	3	N
19	10	2	34	F	OFF	Y	Y	2	N
<del>20</del>									
<del>21</del>									

# OF EXIT SIGNS - \_\_\_\_\_

COMMENTS: \_\_\_\_\_

**E M C ENGINEERS, INC.**

Denver • Colorado Springs • Atlanta • West Germany

JOB \_\_\_\_\_

SHEET NO. \_\_\_\_\_

CALCULATED BY CRCL DATE 1/9/72

CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

SCALE \_\_\_\_\_

935

129°F

UPSTAIRS

