

Maintaining Water Supplies to a Remote Island Population when Source Water Becomes Contaminated



UNITED STATES ARMY PUBLIC HEALTH COMMAND (Provisional)

Mr. Jerry Manint
Environmental Engineer

May 2011

Report Documentation Page

Form Approved
OMB No. 0704-0188

Public reporting burden for the collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden, to Washington Headquarters Services, Directorate for Information Operations and Reports, 1215 Jefferson Davis Highway, Suite 1204, Arlington VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to a penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number.

1. REPORT DATE MAY 2011		2. REPORT TYPE		3. DATES COVERED 00-00-2011 to 00-00-2011	
4. TITLE AND SUBTITLE Maintaining Water Supplies to a Remote Island Population when Source Water Becomes Contaminated				5a. CONTRACT NUMBER	
				5b. GRANT NUMBER	
				5c. PROGRAM ELEMENT NUMBER	
6. AUTHOR(S)				5d. PROJECT NUMBER	
				5e. TASK NUMBER	
				5f. WORK UNIT NUMBER	
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) U.S. Army Public Health Command (Provisional), 5158 Blackhawk Road, Aberdeen Proving Ground, MD, 21010-5403				8. PERFORMING ORGANIZATION REPORT NUMBER	
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)				10. SPONSOR/MONITOR'S ACRONYM(S)	
				11. SPONSOR/MONITOR'S REPORT NUMBER(S)	
12. DISTRIBUTION/AVAILABILITY STATEMENT Approved for public release; distribution unlimited					
13. SUPPLEMENTARY NOTES Presented at the NDIA Environment, Energy Security & Sustainability (E2S2) Symposium & Exhibition held 9-12 May 2011 in New Orleans, LA.					
14. ABSTRACT					
15. SUBJECT TERMS					
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT Same as Report (SAR)	18. NUMBER OF PAGES 22	19a. NAME OF RESPONSIBLE PERSON
a. REPORT unclassified	b. ABSTRACT unclassified	c. THIS PAGE unclassified			



Satellite picture of the Atafu atoll in Tokelau in the Pacific Ocean (reference 1)




Problem Statement

- United States Army Kwajalein Atoll (USAKA)
- Remote Island had high wave activity – Dec 2008
- Seawater contaminated nearly all lenswell water
- Water treatment plant ineffective
- Working lenswell had a history of high Volatile Organic Chemical (VOC) contamination



Where is the United States Army Kwajalein Atoll?

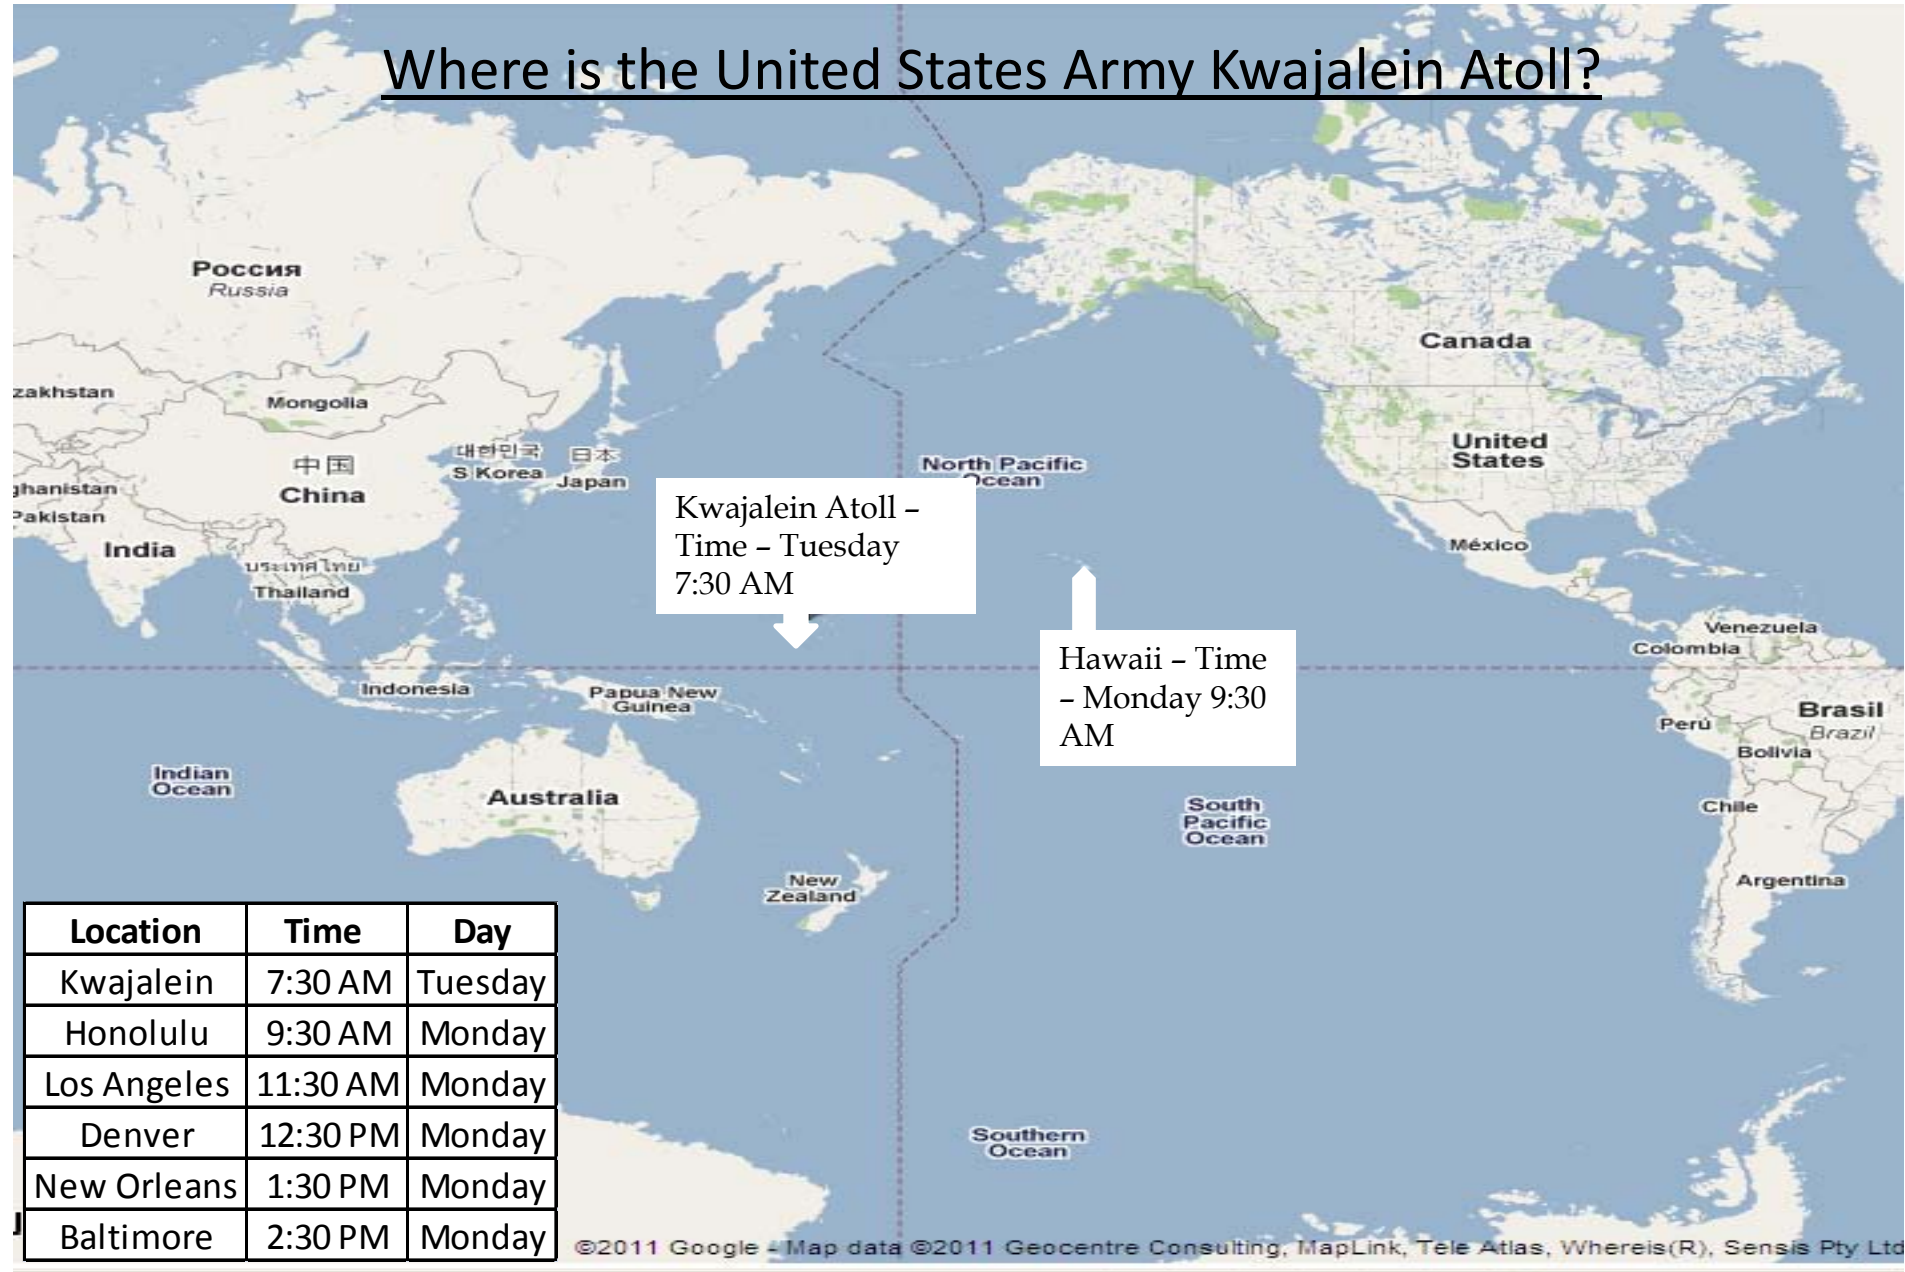

Location	Time	Day
Kwajalein	7:30 AM	Tuesday
Honolulu	9:30 AM	Monday
Los Angeles	11:30 AM	Monday
Denver	12:30 PM	Monday
New Orleans	1:30 PM	Monday
Baltimore	2:30 PM	Monday



General Information


- Occupied by Japanese forces prior to WWII
 - Major Japanese air base
 - First of Japan's pre-war territories to fall to U.S.
 - Main support center for the first atomic military tests
- The Kwajalein Atoll selected for the Anti-Missile Program in 1960s
- Managed by U.S. Space and Missile Defense Command (US SMDC) located in Huntsville, AL
- Currently home to 140 residents

Roi-Namur From The Air



Weather Related Information

- The mean temperature = 82 degrees Fahrenheit (°F)
 - Average Daily Temp ranges between 87° F (high) – 78° F (low)
- Relative Humidity = 79%
- Two Seasons
 - Rainy season (June to November)
 - Dry season (December to May)

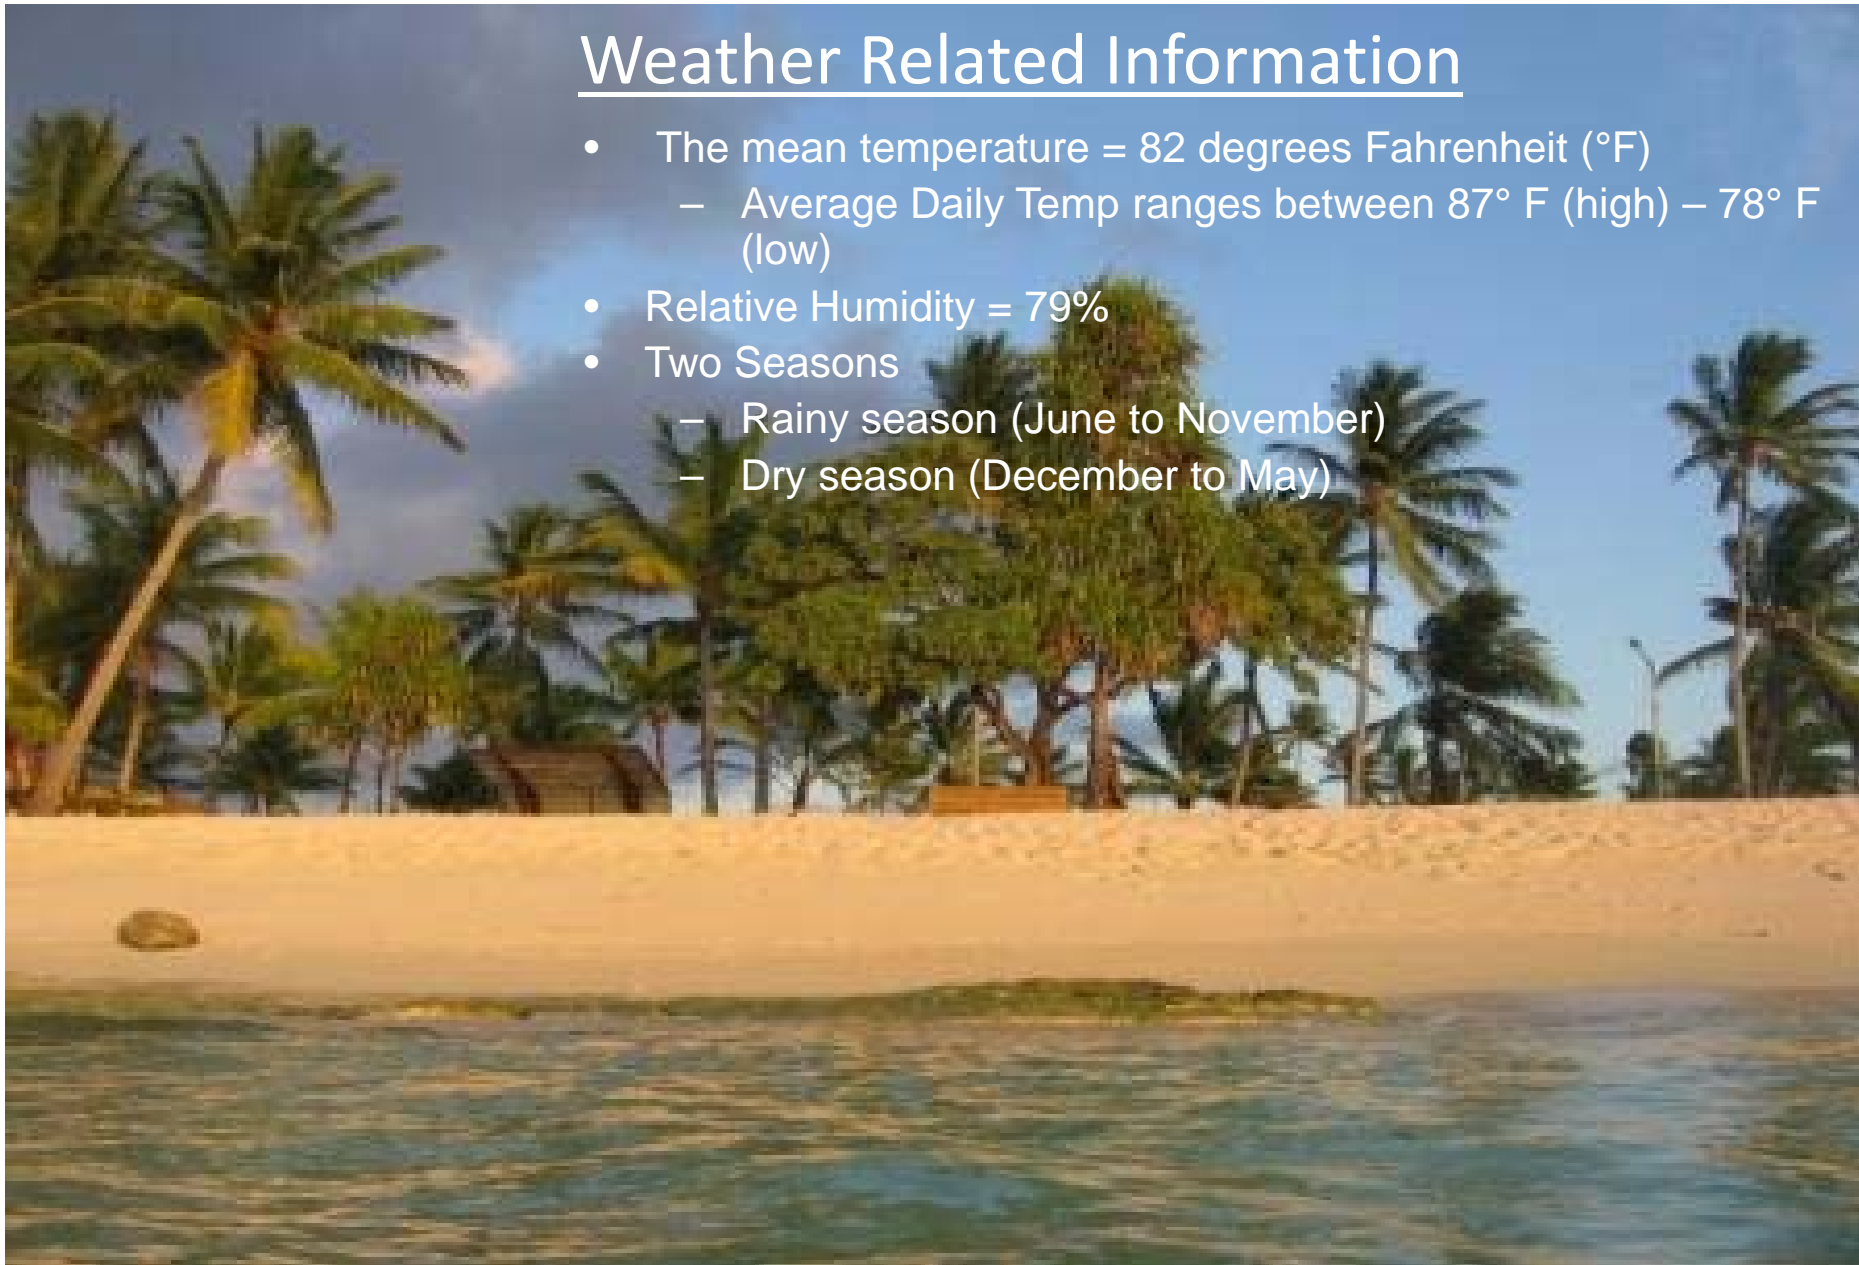

Island Survival

Primary water source – Rain Water

Monthly Rainfall (inches) - Data From 2002 - 2006 (reference 2)

MONTH	EXTREME MIN	EXTREME MAX	AVERAGE
January	0.48	15.66	4.32
February	0.04	10.21	3.02
March	0.16	24.33	4.72
April	0.20	20.09	6.78
May	0.53	26.86	9.02
June	3.56	19.61	9.15
July	3.53	22.29	10.05
August	5.38	23.61	10.50
September	3.77	21.16	11.08
October	5.04	20.05	11.99
November	3.51	19.51	10.97
December	1.90	30.38	8.50

- Rain water collected via water catchments (23 acres) (reference 3)

- Daily Water Demand on Roi-Namur is 35,000 Gallons per Day (GPD) (reference 4)

- What amount of rainfall is required to meet Roi-Namur water demands?

Where Does All The Water Go?

- Evaporation rate difficult to assess but it is a substantial loss
 - Carrier equation - developed for unoccupied pools (reference 5)

$$E = \frac{(95 + 0.425 * u) * A * \Delta p}{i} \rightarrow 0.021 \frac{ft}{day}$$

Where:

E = rate of evaporation (lbs / hr)

u = velocity of air parallel to water (ft/min) (low values or 0 are normally used)

A = Surface area of pool (ft²)

p = partial pressure of water in air (inches of Hg)

Δp = p (at water-surface temperature) – p (at room temperature)

i = latent heat of vaporization (BTU / lb)

- Regional evaporation rate data (reference 6 and 7)
 - Brisbane Australia = 0.024 ft/day
 - Hagatna Guam = 0.020 ft/day

- *Required monthly rainfall - **8 inches** per month to meet drinking water demand before using lenswells*
- *Therefore, rainfall during the dry season typically is not enough to meet demand*
- *Where does Roi-Namur get its make-up water?*

Lenswell Reliance

- What are lenswells?
 - Fresh water less dense than salt water
 - Replenished by rain water (recharge)
 - Lenswells are shallow and spread over a long length of the aquifer
 - Estimated 226 million gallons (Mgal) of potable water (reference 3)

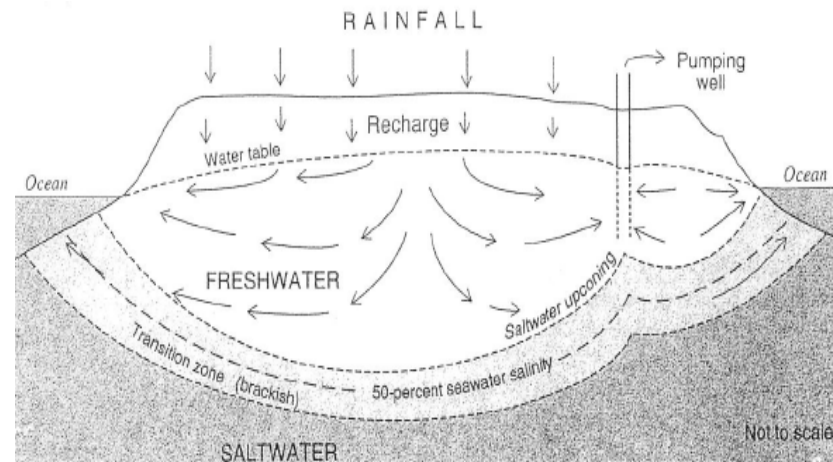


Diagram taken from Reference 3

A Picture Is Worth...

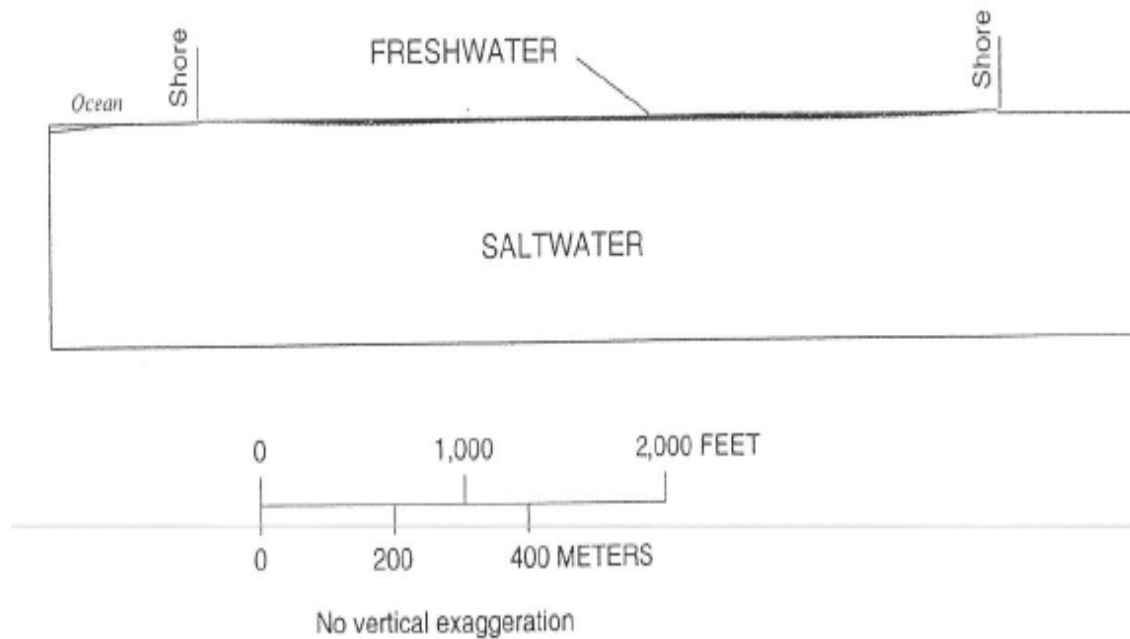


Diagram taken from Reference 3

Tidal Activity

- December 8, 2008 Roi-Namur had high wave activity (onset of dry season)
- Nearly all lenswells were contaminated with salt water
 - Drinkable chloride concentration= 250 mg/L
 - Ocean water chloride concentration= 35,000 mg/L
- Only well not contaminated had a history of Volatile Organic Compound (VOC) contamination
- Roughly 12 days of raw water in storage under normal operation
- Roughly 30 days of treated water in storage under normal operation

Situational Assessment

- Utilize contaminated lenswell to supplement drinking water
 - What contaminants and how much?
 - VOC data on records dated 2001
 - Will current water treatment remove suspected VOCs?

2001 Source Water Data For Contaminated Lenswell

Contaminant	Result (ug/L)	EPA Maximum Contaminant Level (MCL) (ug/L)	Potential Long-Term Health Effects	Sources of Contamination
Trichloroethylene (TCE)	5.1	5	Increased risk of cancer	Metal cleaning operations
Tetrachloroethylene or Perchloroethylene (PCE)	16	5	Increased risk of cancer; liver problems	Metal cleaning operations
cis - 1,2 - Dichloroethylene (cis - 1,2 - DCE)	7.2	70	Liver problems	Industrial chemical
trans - 1, 2 - Dichloroethylene (trans - 1,2 -DCE)	1.5	100	Liver problems	Industrial chemical




Extending Water Supply

- Water treatment consisted of Granular Activated Carbon (GAC)
 - Natural Organic Matter competition (Disinfectant By-Product (DBP) Precursors)
 - Treatment not proven for VOC removal
- 20/80 lenswell to rain water mixture recommended
 - PCE value of 3 ug/L (EPA MCL = 5 ug/L)
 - Extended water usage by 3 days under normal operation
- Expedited VOC sample containers

Monitoring Scheme

- Water monitoring frequency
- Monitoring results
 - No detects after Trident filter or GAC effluent during same time period and frequency
 - Table below shows results from contaminated lenswell (Only detected parameters are listed in Table)

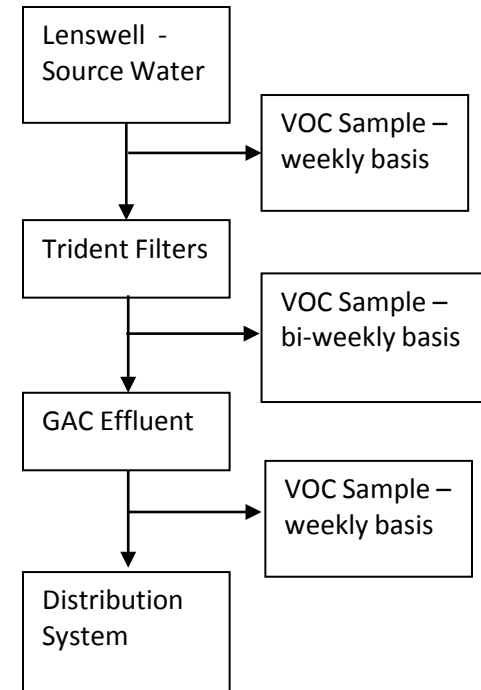

Contaminant (all results in ug/L unless otherwise stated)	EPA MCL	12/17/2008	12/31/2008	1/7/2009	1/19/2009	1/26/2009
trans-1,2-Dichloroethene	100	1	3	2	2	3
cis-1,2-Dichloroethene	70	6	20	9	8	10
Trichloroethene(TCE)	5	3	8	5	5	7
Tetrachloroethene(PCE)	5	9	20	10	10	10

Sustainable Water Supply

- Potential risk to contaminated lenswell
 - Only source of water
 - High drawdown rates could damage well
- Other water options
 - Barge water from Kwajalein Island
 - Dig new wells
 - Install new treatment for brackish water (reverse osmosis purification units (ROWPUs))

Contact Made

- Procedure for obtaining temporary ROWPU
 - Contacted the Program Manager-Petroleum and Water Section (PM-PAWS)
 - Advised to contact Pacific Command (PACOM)
 - Request eventually routed through PACOM
- Temporary ROWPUs installed on Roi-Namur on February 6, 2009
- Efforts for permanent reverse osmosis system

Recovery Time


- ROWPU / Reverse Osmosis costly
 - Rain Needed!
 - Estimated recovery time = 2 years (2011)
 - Permanent Reverse Osmosis System installed January 2010
 - Very good lenswell water quality this year
- Estimated Lenswell Volume = $226 \times 10^6 \text{ gal} = 30.2 \times 10^6 \text{ ft}^3$ (reference 2)
 - Estimate of Lenswell Area = $5.25 \times 10^6 \text{ ft}^2$ (reference 2)
 - Average Annual Rainfall = 100 inches = 8.33 ft (reference 1)
 - Recharge Rate = 30 % of average annual rainfall (reference 8)
 - Estimate of Annual Recharge = $0.3 \times 8.33 = 2.50 \text{ ft/yr}$
 - Estimated Time to Remove Saline Water = $30.2/5.25/2.50 = 2.30 \text{ years}$

References

1. <http://en.wikipedia.org/wiki/Atafu>
2. Analysis of Existing Facilities, U.S. Army Kwajalein Atoll, Marshall Islands, Kwajalein Range Services, LLC, July 2007
3. Ground-Water Resources and Contamination at Roi-Namur Island, Kwajalein Atoll, Republic of Marshall Islands, 1990-1991, Gingerich, Stephen, U.S. Geological Survey, Hawaii, 1996
4. U.S. Army Kwajalein Atoll/Regan Test Site Drinking Water Treatment Plant Sanitary Survey, United States Army Center for Health Promotion and Preventive Medicine (USACHPPM), APG, MD, 2006
5. Calculating Evaporation from Indoor Water Pools, HPAC Engineering, Shah, Mohammed, March 2006
6. The Facts about Pool Blankets – Fact Sheet 1 – Evaporation, Daisy Pool Covers, Australia, 2005
7. Rapid Watershed Assessment – Ugum Watershed, United States Department of Agriculture – Natural Resources Conservation Services, March 2009
8. Water Resources Tsunami Impact Assessment and Sustainable Water Sector Recovery Strategies, GWP Consultants, September 2005

Who Are We?

- We are the United States Army Public Health Command (Provisional) (USAPHC (Prov)) formally known as the Center for Health Promotion and Preventive Medicine (USACHPPM)
- We provide consultative expertise to Army and DoD installations worldwide for environmental health aspects of drinking water supply, treatment, and distribution, as well as recreational waters.
- We have a multi-disciplined team of engineers, scientists, biologists, and technicians supported by an extensive analytical laboratory

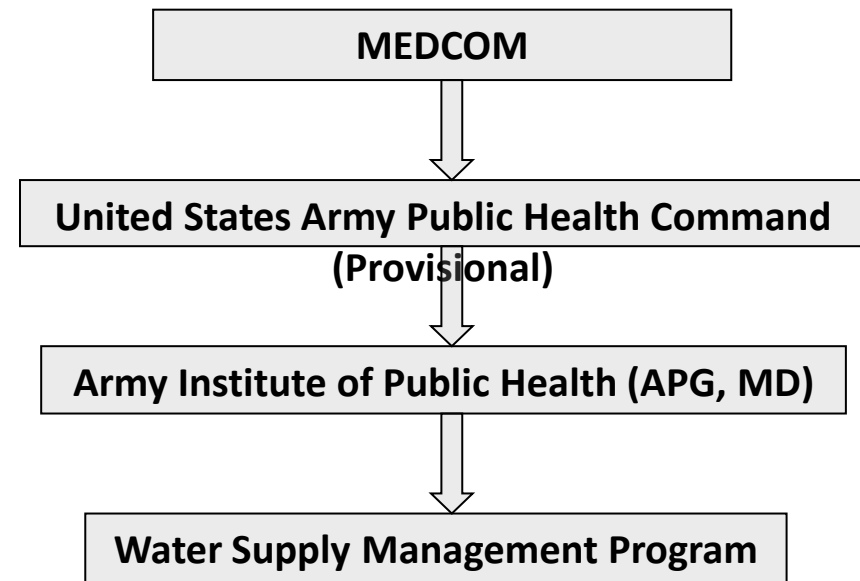

Acknowledgements

- Mr. Stan Jazwinski – Liquid Systems Manager, Chugach Management Services, Inc. (CMSI)
- Ms. Rachael Harris – Environmental Scientist, Kwajalein Range Services (KRS)
- Ms. Beverly Cannon – Teledyne Solution, Inc.
- Mr. Steve Clarke – Environmental Engineer, USAPHC (Prov)
- Mr. John Brokaw – Supervisory Microbiologist, USAPHC (Prov)