

ERDC/CERL CR-13-2

Construction Engineering
Research Laboratory



**US Army Corps
of Engineers®**
Engineer Research and
Development Center

ERDC
INNOVATIVE SOLUTIONS
for a safer, better world

Ontology for Life-Cycle Modeling of Electrical Distribution Systems: Model View Definition

Kristine Fallon Associates, Inc.

June 2013

*11 E. Adams Street, Suite 1100
Chicago, IL 60603*

Prepared under CRADA-07-CERL-02 under the supervision of

E. William East, Project Manager (CEERD-CF-N)

*Construction Engineering Research Laboratory
US Army Engineer Research and Development Center
2902 Newmark Drive
Champaign, IL 61822*

The US Army Engineer Research and Development Center (ERDC) solves the nation's toughest engineering and environmental challenges. ERDC develops innovative solutions in civil and military engineering, geospatial sciences, water resources, and environmental sciences for the Army, the Department of Defense, civilian agencies, and our nation's public good. Find out more at www.erd.c.usace.army.mil.

To search for other technical reports published by ERDC, visit the ERDC online library at <http://acwc.sdp.sirsi.net/client/default>.

Ontology for Life-Cycle Modeling of Electrical Distribution Systems: Model View Definition

Tim Chipman

Constructivity.com LLC
2625 North Loop Drive
Ames, Iowa 50010

Kristine K. Fallon, Robert A. Feldman, Gregory Williams, and Omobolawa Fadojutimi

Kristine Fallon Associates, Inc.
11 East Adams Street, Suite 1100
Chicago, IL 60603

Final report

Approved for public release; distribution is unlimited.

Prepared for US Army Corps of Engineers
Washington, DC 20314-1000

Under Cooperative Research and Development Agreement CRADA-07-CERL-02

Monitored by Construction Engineering Research Laboratory
US Army Engineer Research and Development Center
2902 Newmark Drive
Champaign, IL 61822

Abstract

Previous efforts by the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) to develop a life-cycle building model have resulted in the definition of a “core” building information model that contains general information describing facility assets such as spaces and equipment. To describe how facility assets (i.e., components) function together, information about assemblies of assets and their connections must also be defined. The definitions of assets, assemblies, and connections for the various building-information domains are discipline-specific.

The work documented here addresses the process flow and data exchange requirements for the design of electrical distribution systems in typical Army facilities. This ontology advances the state of the art by defining an Industry Foundation Class (IFC) Model View for electrical system design supporting end users in developing compliant BIM models suggesting potential areas of automation in electrical system design.

DISCLAIMER: The contents of this report are not to be used for advertising, publication, or promotional purposes. Citation of trade names does not constitute an official endorsement or approval of the use of such commercial products. All product names and trademarks cited are the property of their respective owners. The findings of this report are not to be construed as an official Department of the Army position unless so designated by other authorized documents.

DESTROY THIS REPORT WHEN NO LONGER NEEDED. DO NOT RETURN IT TO THE ORIGINATOR.

Contents

Abstract	ii
Figures and Tables	v
Preface	vi
Unit Conversion Factors	vii
1 Introduction	1
1.1 Background.....	1
1.2 Objectives.....	2
1.3 Approach	2
1.4 Scope.....	5
1.5 Mode of technology transfer	6
2 Electrical System Design Process Models	7
2.1 Overview.....	7
2.1.1 <i>Electrical system design process</i>	7
2.1.2 <i>Electrical system design phases</i>	7
2.2 Specification of processes	8
2.2.1 <i>Criteria Phase electrical system design</i>	9
2.2.2 <i>Schematic Design Phase electrical system design</i>	15
2.2.3 <i>Coordinated Design Phase electrical system design</i>	21
3 Fundamental Concepts	26
3.1 Overview.....	26
3.2 Concept templates	26
3.2.1 <i>Roots</i>	27
3.2.2 <i>Project</i>	28
3.2.3 <i>Control</i>	29
3.2.4 <i>Product</i>	29
3.2.5 <i>Resource</i>	33
3.2.6 <i>Resource type</i>	33
3.2.7 <i>Association</i>	34
3.2.8 <i>Definition</i>	35
3.2.9 <i>Composition</i>	37
3.2.10 <i>Assignment</i>	39
3.2.11 <i>Connectivity</i>	41
4 Model View Definition	43
4.1 Overview.....	43
4.2 Exchanges.....	43
4.2.1 <i>Facility occupancy model</i>	43

4.2.2	<i>Electrical project requirements</i>	44
4.2.3	<i>Equipment room requirements</i>	45
4.2.4	<i>Space program</i>	45
4.2.5	<i>Coordinate concept design</i>	46
4.2.6	<i>Electrical system types</i>	46
4.2.7	<i>Electrical basis of design</i>	47
4.2.8	<i>Electrical source of supply</i>	48
4.2.9	<i>Electrical space requirements</i>	49
4.2.10	<i>Energy performance</i>	49
4.2.11	<i>Document concept design</i>	50
4.2.12	<i>Locate electrical loads</i>	50
4.2.13	<i>Electrical equipment requirements</i>	51
4.2.14	<i>Electrical equipment rooms</i>	52
4.2.15	<i>Lighting layout</i>	52
4.2.16	<i>Size electrical system</i>	53
4.2.17	<i>Raceway layout</i>	53
4.2.18	<i>Electrical schematic design</i>	54
4.2.19	<i>Coordinate with other building systems</i>	54
4.2.20	<i>Estimate energy usage</i>	55
4.2.21	<i>Facility spatial configuration</i>	56
4.2.22	<i>Electrical supply requirements</i>	56
4.2.23	<i>System loads</i>	57
4.2.24	<i>Cabling schematic</i>	57
4.2.25	<i>Redistribute circuits</i>	58
4.2.26	<i>Cabling and equipment size</i>	59
4.2.27	<i>Architectural light fixtures</i>	59
4.2.28	<i>Product type specifications</i>	59
4.2.29	<i>Document coordinated design</i>	60
5	Conclusions	61
	References	63
	Report Documentation Page	

Figures and Tables

Figures

Figure 1. Process diagram for Criteria Phase electrical system design.	10
Figure 2. Process diagram for Schematic Design Phase electrical system design.	16
Figure 3. Process diagram for Coordinated Design Phase electrical system design.	21

Tables

Table 1. Task form description.	3
Table 2. Subject matter experts.	4

Preface

This study was conducted for the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) and the National Institute of Building Sciences (NIBS) by Kristine Fallon Associates Inc., and Constructivity.com, LLC, under CRADA-07-CERL-02, “Cooperative Research and Development Agreement Between US Army Engineer Research and Development Center–Construction Engineering Laboratory and National Institute Of Building Sciences.” The CRADA supports Research, Development, Test, and Evaluation (RDT&E) Program Element 622784 T41, “Military Facilities Engineering Technology”; Project 157249, “Life-Cycle Model For Mission Ready Sustainable Facilities (LCM).” The ERDC-CERL project manager was Dr. E. William East (CEERD-CF-N), and the NIBS project manager was Dominique Fernandez.

The work was supervised and monitored by the Engineering Processes Branch (CF-N) of the Facilities Division (CF), ERDC-CERL. Dr. East was the Project Manager. At the time of publication, Donald K. Hicks was Chief, CEERD-CF-N; L. Michael Golish was Chief, CEERD-CF; and Martin J. Savoie, CEERD-CV-ZT, was the Technical Director for Installations. The Deputy Director of ERDC-CERL was Dr. Kirankumar Topudurti and the Director was Dr. Ilker Adiguzel.

COL Kevin J. Wilson was the Commander of ERDC, and Dr. Jeffery P. Holland was the Director.

Unit Conversion Factors

Multiply	By	To Obtain
acres	4,046.873	square meters
acre-feet	1,233.5	cubic meters
angstroms	0.1	nanometers
atmosphere (standard)	101.325	kilopascals
bars	100	kilopascals
British thermal units (International Table)	1,055.056	joules
centipoises	0.001	pascal seconds
centistokes	1.0 E-06	square meters per second
cubic feet	0.02831685	cubic meters
cubic inches	1.6387064 E-05	cubic meters
cubic yards	0.7645549	cubic meters
degrees (angle)	0.01745329	radians
degrees Fahrenheit	(F-32)/1.8	degrees Celsius
fathoms	1.8288	meters
feet	0.3048	meters
foot-pounds force	1.355818	joules
gallons (US liquid)	3.785412 E-03	cubic meters
hectares	1.0 E+04	square meters
horsepower (550 foot-pounds force per second)	745.6999	watts
inches	0.0254	meters
inch-pounds (force)	0.1129848	newton meters
kilotons (nuclear equivalent of TNT)	4.184	terajoules
knots	0.5144444	meters per second
microinches	0.0254	micrometers
microns	1.0 E-06	meters
miles (nautical)	1,852	meters
miles (US statute)	1,609.347	meters
miles per hour	0.44704	meters per second
mils	0.0254	millimeters
ounces (mass)	0.02834952	kilograms
ounces (US fluid)	2.957353 E-05	cubic meters
pints (US liquid)	4.73176 E-04	cubic meters

Multiply	By	To Obtain
pints (US liquid)	0.473176	liters
pounds (force)	4.448222	newtons
pounds (force) per foot	14.59390	newtons per meter
pounds (force) per inch	175.1268	newtons per meter
pounds (force) per square foot	47.88026	pascals
pounds (force) per square inch	6.894757	kilopascals
pounds (mass)	0.45359237	kilograms
pounds (mass) per cubic foot	16.01846	kilograms per cubic meter
pounds (mass) per cubic inch	2.757990 E+04	kilograms per cubic meter
pounds (mass) per square foot	4.882428	kilograms per square meter
pounds (mass) per square yard	0.542492	kilograms per square meter
quarts (US liquid)	9.463529 E-04	cubic meters
slugs	14.59390	kilograms
square feet	0.09290304	square meters
square inches	6.4516 E-04	square meters
square miles	2.589998 E+06	square meters
square yards	0.8361274	square meters
tons (force)	8,896.443	newtons
tons (force) per square foot	95.76052	kilopascals
tons (long) per cubic yard	1,328.939	kilograms per cubic meter
tons (nuclear equivalent of TNT)	4.184 E+09	joules
tons (2,000 pounds, mass)	907.1847	kilograms
tons (2,000 pounds, mass) per square foot	9,764.856	kilograms per square meter
yards	0.9144	meters

1 Introduction

1.1 Background

Previous efforts by the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) to develop a life-cycle building model have resulted in the definition of a “core” building information model that contains general information describing facility assets such as spaces and equipment (East, Love, and Nisbet 2010). To describe how facility assets (i.e., components) function together, information about assemblies of assets and their connections must also be defined. The definitions of assets, assemblies, and connections for the various building-information domains are discipline-specific. Taken together, studies of all essential building-information domains will create a unified framework for developing automatic design checks, ensuring construction compliance, improving operations and maintenance efficiency, and evaluating alternatives for redesign within completed facilities.

COBie (East 2012a) was the first step in analyzing information exchanges in the life cycle of a building. Since March 2012, COBie has been part of the National BIM Standard–United States (NBIMS-US). COBie defines the format for providing information about building assets from the planning phase through design, construction, and operations. Properties of these assets may also be captured in the COBie data exchange format. The *COBie Guide*, a commentary on the COBie standard (public draft downloadable at link from http://www.nibs.org/?page=bsa_cobieguide), does not prescribe how to model specific assemblies of components or how components and assemblies are connected (East 2007, East 2012a). Those aspects of modeling and information exchange require a domain-specific ontology for every system needed to construct a functional building.

The work documented here addresses the process flow and data exchange requirements for the design of electrical distribution systems in typical Army facilities. This ontology advances the state of the art by

1. defining an Industry Foundation Class (IFC) Model View for electrical system design
2. supporting end users in developing compliant BIM models
3. suggesting potential areas of automation in electrical system design.

1.2 Objectives

The objectives of the present work were to identify and document the requirements for building electrical system design for the purpose of creating formal specifications that can be directly applied to open-standards building information models (BIM) at the coordinated design stage of building construction.

1.3 Approach

To document the process and exchange requirements, the team followed the Information Delivery Manual (IDM) and Model View Definition (MVD) procedures defined by the International Organization for Standardization (ISO) and buildingSmart International (e.g., Wix 2007, Hietanen 2008). Validation of the process diagrams and exchange requirements followed the process outlined below:

1. Create drafts of process diagrams and task descriptions for each of three phases of the design process—Criteria (i.e., Programming and Concept Design), Schematic Design (i.e., Design Development), and Coordinated Design (i.e., Construction Documents). The draft process diagrams included suggested steps for the typical Army design process, and the task descriptions included suggested information requirements needed to accomplish the task step.
2. Assemble a group of subject matter experts (SMEs) to review and comment on the draft process diagrams and task descriptions. This group included two architects, two engineers, and two specifiers with experience in the design of building electrical systems.
3. Meet with the SME reviewers to explain the process and review criteria.
4. Send the process diagrams and task descriptions to the SMEs for their review.
5. Analyze the SME comments and contact the SMEs for clarification and additional comments, as needed.
6. Revise the process diagrams and task descriptions based on the SME comments.

The research team also consulted a publication on ELie (East 2012c) and unpublished research notes on the exploratory modeling of electrical system components and connections, called SPARKie (East 2012b).

The specific selection and sequencing of tasks was intended as a starting point that would be refined using the SME reviewers' feedback. The task forms included the information summarized in Table 1

Table 1. Task form description.

Item	Description
Task ID	Sequential ID number for the task.
Task Name	A short descriptive name for the task
Information Provider (Roles Involved)	The role or roles that provide the input information necessary to do the task.
Information Provider (Phase)	The stage in the process when the required information is created.
Actor (Roles Involved)	The role or roles that complete the task.
Actor (Phase)	The stage in the process at which the task requires the information.
Information Required	The input information necessary to complete the task.
Current Methods	A short description of the task and its inputs and outputs.

The experts were asked to review the tasks with the following questions in mind:

- Do the task forms accurately and completely detail all information needed to perform the task?
 - If not, what is missing?
 - Who provides the additional inputs?
- Are current methods of performing the task accurately described?

For the process diagrams, the reviewers were asked:

- Although every project has unique circumstances, are the tasks shown in the typically correct order?
- Have we missed any tasks?
- Are there any unnecessary tasks?
- Are all tasks assigned to the correct phase(s)?
- Are all tasks assigned to the correct actor?
- Are all actors that provide the Information Required indicated?
- Are any extraneous actors indicated?

Table 2 lists the expert reviewers and pertinent background information.

Table 2. Subject matter experts.

Name	Organization	Area of Expertise
Randy Deutsch AIA, LEED AP	Deutsch Insights, Inc.	Architect
	Senior Architectural Designer & Associate Principal with proven track record for design leadership. Demonstrated success designing and managing complex projects including high-rises, retail, mixed-use developments, housing & master plans. Professional thought leader, presenter, instructor, mentor & author. Instrumental in firm-wide BIM and IPD adoption & implementation. AIA Young Architect Award recipient. University building technology, design studio & professional practice instructor. Author of <i>BIM and Integrated Design</i> (Wiley 2011).	
Susan F. King, FAIA, LEED AP BD+C	Harley Ellis Devereaux	Architect
	As a principal with Harley Ellis Devereaux, Susan King is the firm's National Sustainable Design Leader, developing and implementing nationwide design policies in regards to sustainability. A practicing architect with 25 years of experience, she has lead numerous multi-disciplinary sustainable developments teams on projects ranging in scale from urban infill for newly constructed housing to the repurposing of existing structures to the master planning study of the 35 acre Chicago 2016 Olympic Village site. A true collaborator, Susan joins design teams with ease and a practical approach to the integrated design process. An advocate for green market transformation of the building industry, Ms. King is routinely invited to speak on sustainable design topics.	
Jim Forester	Newforma, Inc.	Engineer
	California P.E. license M24307. Co-Founder and Senior Technical Advisor at Newforma, Inc. Original member of the buildingSmart International Model Support Group. I was involved with the many of the original definitions of the building services concepts and how they are connected, including the underlying graph representations supporting both symbolic and physical connectivity that would support mass and energy flow simulations.	

Name	Organization	Area of Expertise
Kenneth Solvik	Data Design System	Engineer
	<p>Master of Management. Electrical Engineer, specialized field installation, automation, building control and programming.</p> <p>CTO and R&D coordinator. Manager and participant in multiple R&D projects. IFC (EL-1 & EL-2), MEP Quantity Take Off (IDM), MEP Fast and Easy planning, Innovative MEP design and simulations process, BIM enhancer & BIM energy efficiency optimizer.</p>	
Mark Kalin FAIA FCSI LEED	Kalin Associates	Specifier
	<p>Registered architect, CSI-certified construction specifier, LEED-accredited professional, and one of only 27 individuals ever advanced to fellowship in both the American Institute of Architects and the Construction Specifications Institute. Author of numerous publications on specifications, product selection, and green specs, who has presented more than 100 sessions at regional and national conventions. He has taught architectural specifications at Harvard University Graduate School of Design and is currently chair of the Sustainable Facilities Practice Group of the Construction Specifications Institute.</p>	
Chris Nelson	Nelson Electric	Specifier
	<p>Chris specifies and designs electrical systems on commercial and industrial building projects at Nelson Electric in Ames, Iowa. Previously, he served as Enterprise Systems Manager at The Weitz Company for 9 years, where he had significant experience leading Building Information Modeling initiatives. He was also a Project Engineer at The Meyne Company for 2 years. He has an MBA from the University of Iowa, an MS in Civil & Construction Engineering from Iowa State University, and a BS in Chemical Engineering from Iowa State University.</p>	

1.4 Scope

The scope of the work documented here was to diagram the electrical system design process, and to identify and document the relevant data exchanges. A separate report (ERDC/CERL CR-13-3) applies this ontology to the updating of three previously developed experimental BIM models using commercial off-the-shelf (COTS) software. Those models represent three types of typical low-rise Army facilities: a duplex apartment, an office building, and a medical clinic. The experimental application work

identifies some current product limitations in achieving successful information exchange.

1.5 Mode of technology transfer

Documentation of this ontology will be used as the basis for a ballot submission to the National BIM Standard–United States. Model files created for the related validation application (ERDC/CERL CR-13-3) will be made publicly available for testing and evaluation of the proposed open BIM standard that results from this work.

2 Electrical System Design Process Models

2.1 Overview

Building design is a highly iterative process during which information is gathered, design options are evaluated and selections are made. The goal is to achieve a final design in which aesthetics, cost and systems performance are all optimized. During design, each choice has multiple effects. Optimized design can only be achieved through multiple iterations of interdependent analyses.

Today's designers and owners seek to optimize multiple aspects of a building, including first cost, life cycle cost and environmental impact. Early adopters of building information modeling technology have demonstrated that the use of computable building models, coupled with the availability of analysis software, facilitates and reduces cycle times of the iterations necessary to achieve such optimization (Fallon and Palmer 2007). The purpose of this electrical systems ontology is to define a standardized computable description of all electrical system parameters necessary for a complete design. The availability of such a standardized, computable description supports the development and use of electrical system design automation software.

2.1.1 Electrical system design process

The design of building electrical systems iterates through multiple steps, involving multiple parties and the repeated refinement of the design as it moves from generalized concepts and equipment types to detailed construction documents with the required equipment specified. The process diagrams in this document focus on the design tasks and data exchanges involving the Architect and Electrical Engineer. Data required from other project participants are also documented.

2.1.2 Electrical system design phases

The design process documented in this report is divided into three general phases, typical of the Design-Bid-Build process for USACE projects. Although the sequence of tasks and even the actors for each task can vary, depending on project delivery approach and on the internal organization

of the professional services provider company(ies), the tasks that must be completed and the information required remain constant.

2.1.2.1 Criteria (Programming and Concept Design)

The Criteria phase requires gathering the necessary information that will define the project's scope, budget, and overall goals. The Owner's Project Requirements (OPR), building codes, site location, and sustainability goals are all identified during this phase. Once the building program has been developed, the Facility Occupancy Model can be determined. This information allows the Architect and Electrical Engineer to develop a Concept Design. Typically, several options are created to compare designs or system alternatives.

2.1.2.2 Schematic design (Design Development)

The Schematic Design phase requires using the information developed during the Criteria phase to develop the building design further. For electrical systems design, most of the information is generated by the Electrical Engineer. The Architect provides information regarding electrical load types and locations. Other consultants will provide electrical requirements for other building systems. This information allows the Electrical Engineer to determine the overall electricity demand. During this phase, specifications for the anticipated equipment are developed in addition to the drawings. The specifications identify performance requirements for the various electrical system components.

2.1.2.3 Coordinated design (Construction Documents)

The Coordinated Design phase involves finalizing the documents in preparation for bidding and construction. Primarily, this involves updating the drawings and specifications completed in the previous phases with more detailed, accurate information about the building and systems. Again, this requires that the Electrical Engineer receive input from the Architect and any others involved whose particular discipline could have an impact on the electrical system design.

2.2 Specification of processes

This section contains three Process Diagrams covering the electrical system design phases of (1) Criteria (Programming and Concept Design), (2) Schematic Design (Design Development) and (3) Coordinated Design

(Construction Documents). These phases have been assigned an arbitrary sequential number (10, 20 or 30) to aid in tracking and coordinating tasks. Following each of the three diagrams are tabular descriptions of the tasks shown in each diagram.

The diagrams and task descriptions have been revised to reflect the reviews and comments made by the SMEs. Several of the reviewers suggested alternative process flows, based on their experience with specific types of projects and project delivery approaches – Design-Build versus Design-Bid-Build, for example. The suggestions were evaluated and, in some cases, the original flow was modified. Even where the workflow differed, however, the design tasks and information requirements have remained the same.


The solidification of the design involves an iterative process, where the owner, architect, the plumbing engineer and other specialists must reconcile their needs with those of others. An explicit understanding of the process and its information requirements can help streamline the process by focusing on what exchanges take place and who is affected. It can also be used to help define new ways of reviewing multiple design options and integrating them into the overall process.

The detailed Exchange Requirements derived from the following task descriptions are described in the next chapter.

2.2.1 Criteria Phase electrical system design

The Criteria Phase consists of the following tasks, shown diagrammatically in Figure 1.

Figure 1. Process diagram for Criteria Phase electrical system design.

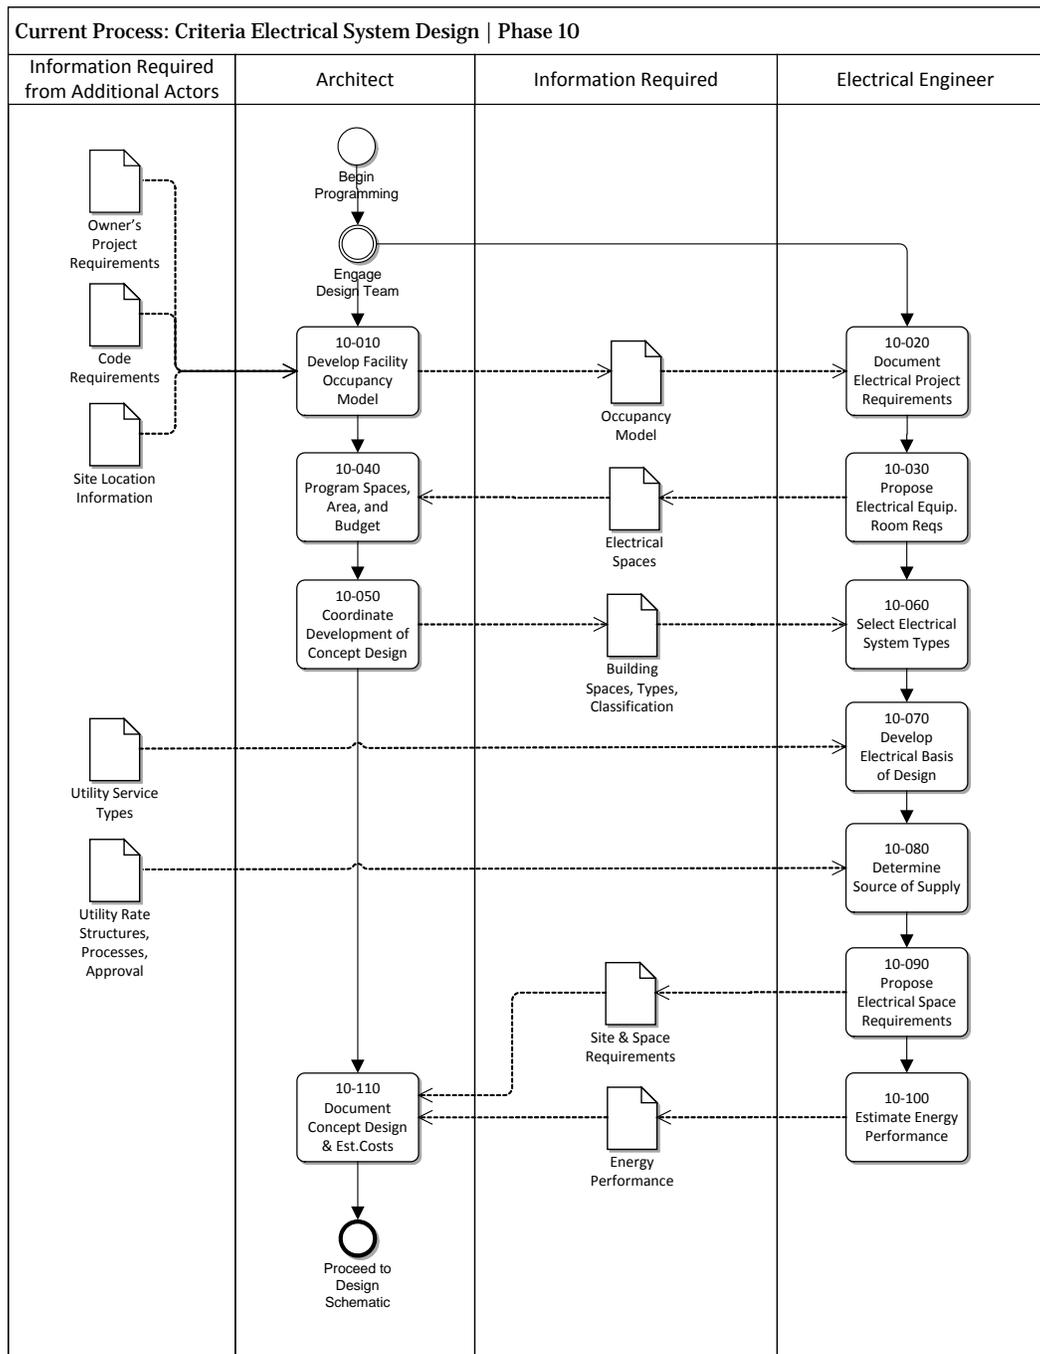

Task Form			
Task ID	10-010	Task Name	Develop Facility Occupancy Model
Participants	Roles Involved	Phase	
Information Provider	Building Owner, Building Codes	10	
Actor	Architect	10	
Information Required	Site Location Information Owner's Project Requirements <ul style="list-style-type: none"> ▪ Facility Type, Space Types, Area Standards, Occupant Load, Hours of Occupancy and design priorities, Climate Control requirements Building Code Requirements		
Current Methods	Architect receives document(s) from the Owner. Architect uses these documents, in conjunction with Building Code guidelines and standards to develop the Facility Occupancy Model.		

Task Form			
Task ID	10-020	Task Name	Document Electrical Project Requirements
Participants	Roles Involved	Phase	
Information Provider	Building Owner, Architect	10	
Actor	Electrical Engineer	10	
Information Required	<u>Project Location</u> (determines climate, applicable building codes, utility rate structures) <u>Occupation Factors</u> : number of occupants, hours of occupancy, occupancy type <u>Cost Factors</u> : level of finishes <u>Architectural Factors</u> : size of building (area), number of floors, floor height <u>Building Environments</u> : heating, cooling, central/unitary <u>Illumination Criteria</u> : lighting level, light sources, daylighting, footcandles req'd, indoor/outdoor/site lighting <u>Mechanical Systems</u> : pumps, chillers, fans (Power/Area for each space) <u>Building Equipment</u> : elevators, production equip. <u>Auxiliary Systems</u> : automation, fire alarm, security, data, lighting controls, life safety, severe weather, telecom (data/phone) <u>Sustainability Criteria</u> : LEED <u>Future Needs</u> : spare electrical capacity		
Current Methods	Determine system types for consideration Determine scope of major HVAC equipment Determine power density at building scope		

Task Form			
Task ID	10-030	Task Name	Propose Electrical Equipment Room Requirements
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer		10
Actor	Architect		10
Information Required	Equipment list		
Current Methods	Verify owner's list of equipment that may impact electrical load and location.		

Task Form			
Task ID	10-040	Task Name	Program Spaces, Area, and Budget
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer		10
Actor	Architect		10
Information Required	Electrical Equipment and required spaces (Distribution Board: Footprint Area, Access Area) Site Lighting		
Current Methods	Program spaces according to size and proximity requirements. Verify space sizes and ideal shapes of rooms with electrical service provider, including equipment sizes and clearances around and between equipment.		

Task Form			
Task ID	10-050	Task Name	Coordinate Development of Concept Design
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer		10
Actor	Architect		10
Information Required	Space types, areas, proximity requirements (e.g., external utility hookup)		
Current Methods	Review and modify spaces and areas per service provider and consultant input.		

Task Form		
Task ID	10-060	Task Name Select Main Electrical System Types
Participants	Roles Involved	Phase
Information Provider	Architect	10
Actor	Electrical Engineer	10
Information Required	<p><u>List of major equipment consuming electricity:</u> (Chillers, Boilers, Compressors, Condensers, Unitary Equipment, Air Handlers, Transport Elements [e.g. elevators]): Load, Voltage, System Type,</p> <p><u>List of equipment (if any) for generating electricity:</u> (Generators, Solar Panels, Wind Turbines): Output Voltage, System Type, Generating Capacity</p> <p><u>List of equipment for storing electricity:</u> (UPS): Connected Load, Uptime</p> <p><u>General-purpose electrical demand in building:</u> Space: Power Density for Lighting, Appliances, Equipment</p> <p><u>Building Layout:</u> Preliminary building spaces, types and classifications</p>	
Current Methods	Determine electrical systems – three-phase vs. single-phase Determine transformers between systems	

Task Form		
Task ID	10-070	Task Name Develop Electrical Basis of Design
Participants	Roles Involved	Phase
Information Provider	Architect	10
Actor	Electrical Engineer	10
Information Required	Utility Service Types Available Electrical System Types	
Current Methods	<p>Document process model, constraints, formulas, and tables used for making decisions on electrical design.</p> <ul style="list-style-type: none"> Lighting calculations showing required and designed foot-candles Estimated panel board loading (including 25% extra as a projection of future building loads) A projection/summation of the panel board loads to justify the sizing of the building transformers An economic analysis to justify the selection of either 120V/208V or 277Y/480V on the secondary side of the building transformers An analysis, for the 277Y/480 V choice, as to whether the step down transformer(s) shall be large central units or smaller units placed throughout the building A short-circuit analysis to determine the AIC rating of the system components. A coordination study to determine the circuit breaker settings and system coordination. <p>Examples: http://www.wright.edu/administration/construction/forms/public_forms/designProcess/Electrical_Basis_of_Design_Standards_Guidelines.pdf https://www.neco.navy.mil/necoattach/N4008011R061512_Final_Elect_Calcs_as_1_PDF.pdf</p>	

Task Form		
Task ID	10-080	Task Name Determine Source of Supply
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	10
Actor	Electrical Engineer	10
Information Required	<u>Utility Rate Structures, Processes, Approvals:</u> <ul style="list-style-type: none"> • Rate structures for each system type, time intervals, and usage. • Process model for coordinating electrical utility service. • Approval requirements. Example: www.lipower.org/pdfs/commercial/redbook/redbook.pdf	
Current Methods	Perform economic analysis to justify selection of electrical supply source(s).	

Task Form		
Task ID	10-090	Task Name Propose Electrical Space Requirements
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	10
Actor	Architect	10
Information Required	List of major equipment for consuming, generating, transforming, and storing electricity.	
Current Methods	Estimate and verify additional voltage requirements (e.g., annual, seasonal or unusual circumstances), including electrical back-up generators, per code and ordinances. Re-size room accordingly.	


Task Form		
Task ID	10-100	Task Name Estimate Energy Performance
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	10
Actor	Architect	10
Information Required	Operating Costs (based on utility rate structures) Performance History (power usage time series at hourly intervals for year):	
Current Methods	Calculate operating costs at system level based on current rate structures from utility.	

Task Form			
Task ID	10-110	Task Name	Document Concept Design & Estimated Costs
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer, Cost Estimator (or GC in negotiated contractor situation)		10
Actor	Architect		10
Information Required	<p><u>Space Requirements:</u> Space: area, relation to other spaces, exterior requirements</p> <p><u>Mechanical Requirements:</u> Ventilation, thermal loads, fuels</p> <p><u>Structural Requirements:</u> Weight</p> <p><u>Construction Requirements (primarily for existing construction):</u> Installation Method, Clearances</p> <p><u>Construction Costs for each system:</u> Systems: Count Circuits: Count</p> <p><u>Operating Costs (based on systems):</u> Energy performance of proposed electrical systems, Performance History (power usage time series at hourly intervals for year)</p>		
Current Methods	<p>Calculate construction costs at system level.</p> <p>Calculate operating costs at system level.</p>		

2.2.2 Schematic Design Phase electrical system design

The Schematic Design Phase consists of the following tasks, shown diagrammatically in Figure 2.

Figure 2. Process diagram for Schematic Design Phase electrical system design.

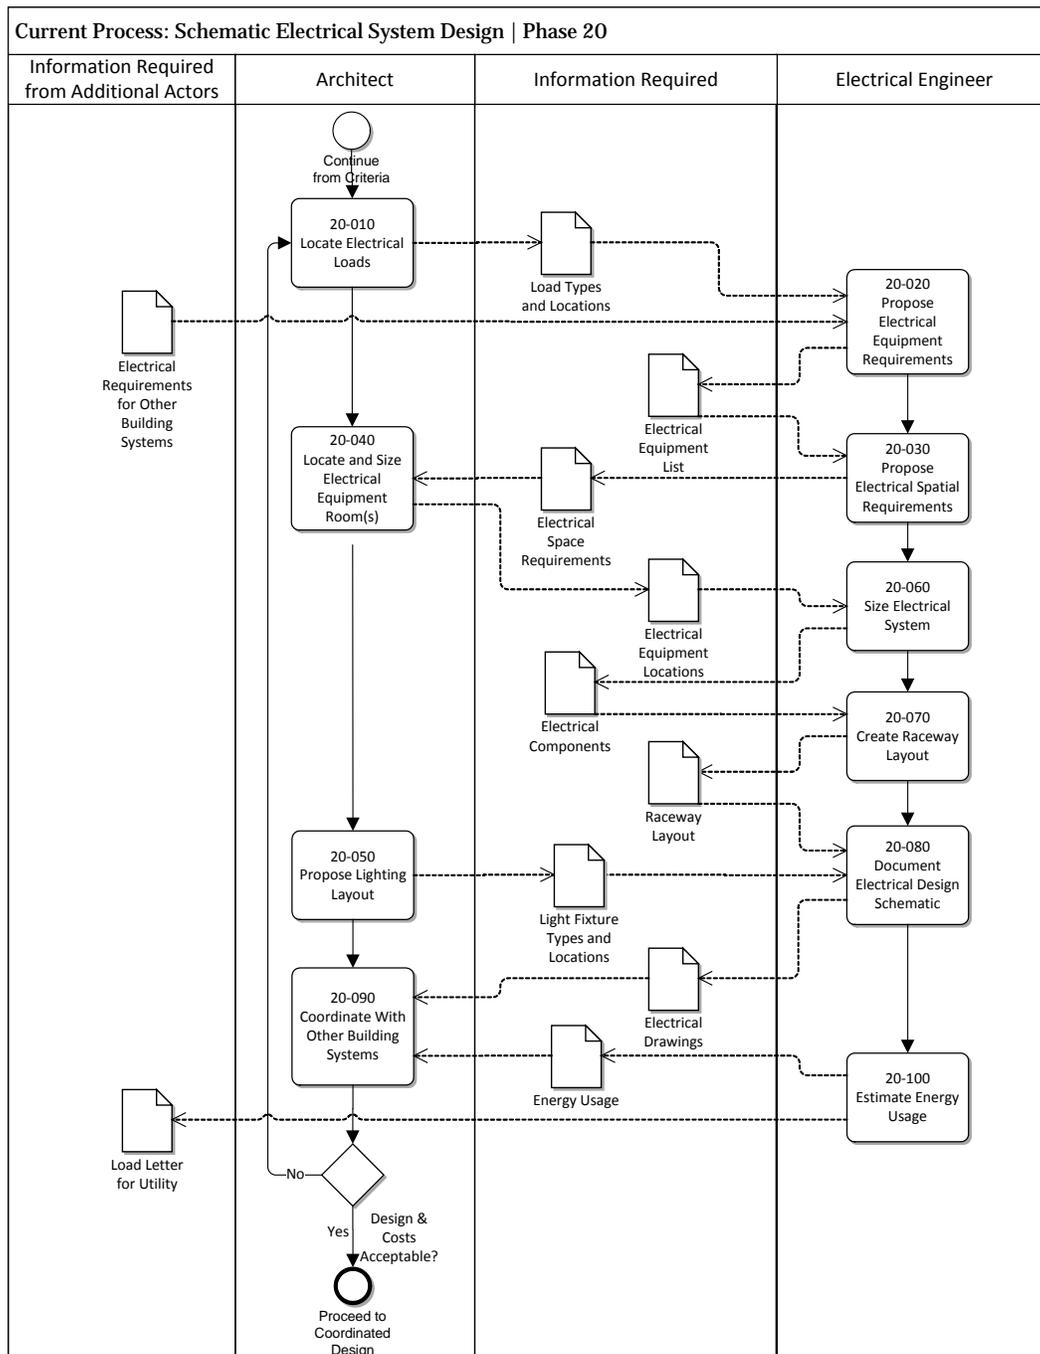

Task Form		
Task ID	20-010	Task Name Locate Electrical Loads
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	10
Actor	Architect	20
Information Required	<u>Preliminary Schedule of Electrical Load Types</u> Light fixtures, outlets, other devices consuming electricity (e.g., Unitary Equipment) Space classification and requirements indicating power density.	
Current Methods	Architect uses the recommendations and preliminary schedule from the Electrical Engineer to indicate locations of major electrical loads in the initial schematic plans.	

Task Form		
Task ID	20-020	Task Name Propose Electrical Equipment Requirements
Participants	Roles Involved	Phase
Information Provider	Architect	20
Actor	Electrical Engineer	20
Information Required	<u>Electrical requirements for all building systems</u> <u>Load Types and Locations</u> <ul style="list-style-type: none"> • Space: Type, Lighting Power Density, Appliance Power Density • Zone: Light fixtures within zones • Unitary Equipment: Unitary A/C locations within spaces • Other Major Electrical Loads: Locations within spaces • Provision for Voids: Locations for raceways 	
Current Methods	Generate One Line Diagram http://en.wikipedia.org/wiki/One-line_diagram Determine process for acquiring electrical equipment (e.g., design assist) and verify that the process is acceptable to all participating parties Determine connected load and demand load for each space Determine diversity coefficients Determine circuits Determine loads at distribution points Select equipment (or candidates) at each occurrence	

Task Form		
Task ID	20-030	Task Name Propose Electrical Spatial Requirements
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	20
Actor	Electrical Engineer	20
Information Required	Electrical Equipment List Lighting Layout: Surface finish, clearance Raceway: Above ceiling clearance, wall construction type (masonry/studs, etc.)	
Current Methods	Electrical Engineer uses the Electrical Equipment List and preliminary architectural plans to develop proposed Electrical Space Requirements.	

Task Form		
Task ID	20-040	Task Name Locate and Size Electrical Equipment Room(s)
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	20
Actor	Architect	20
Information Required	Space: Required Area, Required Wall Lengths Equipment (e.g., Distribution Board): Clearance Area Cable Carrier: Location, Profile, Access Locations	
Current Methods	Verify location of service access to site. Determine site lighting loads on system. Reserve space for electrical use Reserve site areas for electrical utilities	

Task Form		
Task ID	20-050	Task Name Propose Lighting Layout
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer, Architect	20
Actor	Architect	20
Information Required	Space: Space Type, Lighting Density, Lighting Type Light Fixture: Light Source Type, Light Emission	
Current Methods	Arrange layout of light fixtures in spaces.	

Task Form		
Task ID	20-060	Task Name Size Electrical System
Participants	Roles Involved	Phase
Information Provider	Architect	20
Actor	Electrical Engineer	20
Information Required	Building elements (e.g., wall, slab): Materials, Fire rating (hours) Electrical Equipment Locations	
Current Methods	Review and verify hourly ratings and code requirements for separations between electrical equipment rooms and adjoining spaces (could potentially impact room areas). Size distribution boards, cables, transformers	

Task Form		
Task ID	20-070	Task Name Create Raceway Layout
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	20
Actor	Electrical Engineer	20
Information Required	Cable Carriers: Location, Profile, Axis Path Cables: Location (containing carrier), Profile, Axis Path	
Current Methods	Layout plan for cables, cores, busbars	

Task Form		
Task ID	20-080	Task Name Document Electrical Systems Schematic Design
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	20
Actor	Electrical Engineer	20
Information Required	<p><u>Systems</u></p> <ul style="list-style-type: none"> Systems: ID, Voltage, Type (Electrical subtype, lighting control, life safety) Circuits: ID, Voltage Type, Wire Size, Continuous Length, Run Length Elements: Location, Mounting, Connections <p><u>Panelboard Schedules:</u></p> <ul style="list-style-type: none"> Distribution Boards: Name, Description, Capacity, Spare Capacity Protective Devices: Load Name, Load KVA Lighting, Load KVA Receptacles, Load KVA Other/Motor, Over Current Amps, Over Current Protection, Circuit #, Phase Balance A/B/C. <p><u>Equipment Schedules:</u></p> <ul style="list-style-type: none"> Equipment: Name, Mark, Power, Voltage, Phase, Speed, Location, Controller Accessories, Controller Type, Controller Size, Panel Designation, Branch Circuit Type, Branch Circuit Size, Conductor Phase, Conductor Ground, Conduit Size, Notes Generation Equipment: Capacity, Connected Load, Transfer Switch Type, Fuel Type, Single/Three-Phase <p><u>Lighting Fixture Schedules:</u></p> <ul style="list-style-type: none"> Light Fixture: Type, Description, Applications, Load Type, Supply Volts, Watts Per Fixture, Manufacturer, Lighting Power Density (LPD) Lamp: Count, Power, Lamp Code <p><u>Feeder Schedules:</u></p> <ul style="list-style-type: none"> Cable Segment: Name, Cable Insulation, Size in AWG or MCM, Method of Installation, Overcurrent Protection, Connected Load, Demand Load 	
Current Methods	Create plans from building model Create schedules from items and attributes	


Task Form		
Task ID	20-090	Task Name Coordinate With Other Building Systems
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	20
Actor	Architect	20
Information Required	Electrical Drawings and Specifications: Electrical plans showing equipment locations as well as cable routing and connectivity Electrical Schedules for equipment, fixtures, feeders, panelboards.	
Current Methods	Electrical Engineer sends the electrical drawings to the Architect.	

Task Form		
Task ID	20-100	Task Name Estimate Energy Usage
Participants	Roles Involved	Phase
Information Provider	Electrical Engineer	20
Actor	Electrical Engineer	20
Information Required	<p>Load profile at each device consuming electricity</p> <p>Generation profile at each device generating electricity (Load at hourly intervals throughout year)</p> <p>Service Location</p> <p>Total Area</p> <p>Conditioned Space Area</p> <p>Type of Heat</p> <p>Similar Business: Name, Address, Utility Account#</p> <p>Type of Service: Underground, Overhead, Service Change, Relocation, New, Temporary</p> <p>Service Characteristics: Size of Load Wires, Sets of Load Wires Per Phase, Load Wire Type (AL/CU), Terminations: Meterbase/C.T.Cabinet/ConnectionBox/Switchgear/Other</p> <p>Service Size (amp): 100/150/200/300/400/600/other</p> <p>Voltage: 1P3W-120/240, 3P4W-120/240 (<=200 amps), 3P4W-Wye-120/208, 3P4W-Wye-277/480, Other</p> <p>Electric Load Excluding Motor Load (kW): Interior Lighting, Exterior Lighting, Electric Cooking, Water Heating, Dryer, Heat Pump, Heat Pump Strip Heat, Computers, Receptacles, Refrigeration, Electric Heat, AC (tons): Data Processing Load Only, Not Including Data Processing</p> <p>Electric Motor Load (Except Heating and AC): Phase, Number of Motors, HP, Voltage, Hours of Operation per week</p> <p>Estimated Business Operating Time: Hours Per Week, Month Per Year</p> <p>Meter Location Desired</p> <p>Service Equipment Location Desired</p>	
Current Methods	<p>Calculate connected loads and demand loads at each circuit, and for overall electrical system.</p> <p>Submit Load Letter (format provided by utility), with values specified per project.</p>	

2.2.3 Coordinated Design Phase electrical system design

The Coordinated Design Phase comprises the following tasks, shown diagrammatically in Figure 3.

Figure 3. Process diagram for Coordinated Design Phase electrical system design.

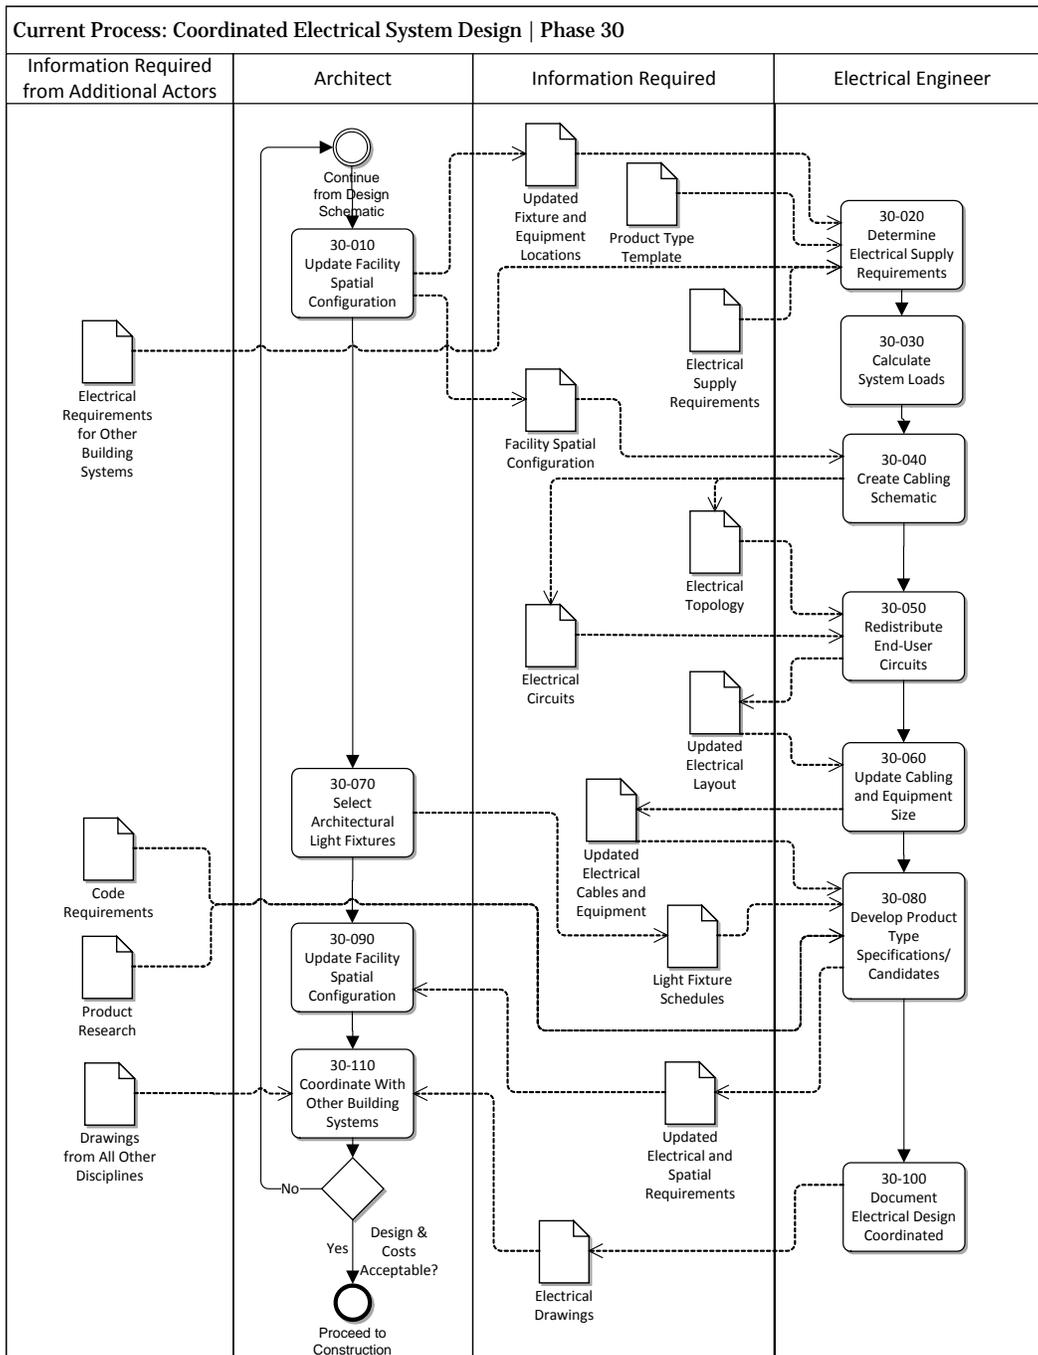

Task Form		
Task ID	30-010	Task Name Update Facility Spatial Configuration
Participants	Roles Involved	Phase
Information Provider	Architect	20
Actor	Architect	30
Information Required	Spatial Elements (Buildings, Levels, Spaces, etc.) Building Elements (Walls, Slabs, Doors, Windows, etc.) Distribution Elements (Electrical, HVAC, Plumbing, etc.) Spatial Zones Systems & Circuits Connectivity (Space Boundaries, Ports, Connections, Interferences) Actors & Assignments	
Current Methods	Architect revises the facility spatial configuration plans based on the results of the coordination that took place at the end of Design Schematic.	

Task Form		
Task ID	30-020	Task Name Determine Electrical Supply Requirements
Participants	Roles Involved	Phase
Information Provider	Architect	30
Actor	Electrical Engineer	30
Information Required	<u>Product Type Template:</u> Electrical system performance specifications <ul style="list-style-type: none"> ▪ Cable segment: size, location, amps, resistance Schedules of Electrical Fixtures and Devices Updated Electrical Equipment Sizes <u>Updated Location of Electrical Fixtures & Equipment</u> <ul style="list-style-type: none"> ▪ Electrical Plan <u>System Type</u> <ul style="list-style-type: none"> ▪ Voltage, Phases 	
Current Methods	Electrical Engineer uses the Product Type Template and updated plans and other-discipline information to determine total electrical supply requirements. Select from compatible product types for each product occurrence. [or if required, select 3 compatible product types that are suitable] Obtain owner's approval.	

Task Form			
Task ID	30-030	Task Name	Calculate System Loads
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer		30
Actor	Electrical Engineer		30
Information Required	Element: Load, Time-phased load Circuit: Connected Load, Demand Load, Time-phased load System: Connected Load, Demand Load, Time-phased load Diversity Coefficient		
Current Methods	Add connected loads and demand loads at each circuit, multiply by coefficients		

Task Form			
Task ID	30-040	Task Name	Create Cabling Schematic
Participants	Roles Involved		Phase
Information Provider	Architect, Electrical Engineer		30
Actor	Electrical Engineer		30
Information Required	<u>Facility Spatial Configuration</u> <u>Detail Layout</u> <ul style="list-style-type: none"> • Switch: Location, Lighting Load, Controls • Outlet: Location, Appliance Load • Cable Segment: Location, Connections, Load, Length, Wiring method (EMT/ENT/MC/Rigid/etc.) • Switchgear/Panels • Junction Box: Location (note: may not be at this level of detail) • Life Safety devices / control panels: Location • Lighting: Location • Telecom: Location • Generating Equipment: controls, transfer switches, interconnects: Location <u>For all products</u> <ul style="list-style-type: none"> • Product Type: Manufacturer, Model, (Specifications) • Product Resource: Supplier, Location, Cost 		
Current Methods	Layout Raceways, Circuits, Distribution Equipment		

Task Form			
Task ID	30-050	Task Name	Redistribute End User Circuits
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer		30
Actor	Electrical Engineer		30
Information Required	<u>Electrical Topology</u> <u>Electrical Circuits</u> : Capacity, Connected Load, Demand Load, Desired Load Factor Range, Future Expansion		
Current Methods	For circuits with loads above desired factor, split into separate circuits. For circuits with loads below minimum factor, combine circuits		

Task Form			
Task ID	30-060	Task Name	Update Cabling and Equipment Size
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer		30
Actor	Electrical Engineer		30
Information Required	Updated electrical layout Electrical Circuits: Capacity, Connected Load, Demand Load, Desired Load Factor Range, Future Expansion		
Current Methods	Electrical Engineer updates the schedules of raceways, cables, and equipment sizes.		

Task Form			
Task ID	30-070	Task Name	Select Architectural Light Fixtures
Participants	Roles Involved		Phase
Information Provider	Architect, Electrical Engineer		30
Actor	Architect		30
Information Required	Light Fixture: specific type, or assignment of 3 approved types		
Current Methods	Select suitable type(s) from vendor catalogs		

Task Form			
Task ID	30-080	Task Name	Develop Product Type Specifications/Candidates
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer, Architect		30
Actor	Electrical Engineer		30
Information Required	Updated electrical cables and equipment Light fixture schedules Calculated load at main electrical equipment		
Current Methods	Resize to meet capacity, selecting alternate product types that fit requirements.		

Task Form			
Task ID	30-090	Task Name	Update Facility Spatial Configuration
Participants	Roles Involved		Phase
Information Provider	Electrical Engineer, Architect		30
Actor	Architect		30
Information Required	Updated electrical layout <ul style="list-style-type: none"> ▪ Electrical Plan(s) – Fixtures, Equipment, Cable routing, distribution sources Updated electrical spatial requirements		
Current Methods	Architect revises the facility spatial configuration plans based on the updated electrical layout and spatial requirements provided by the Electrical Engineer.		

Task Form			
Task ID	30-100	Task Name	Document Electrical Design Coordinated
Participants	Roles Involved	Phase	
Information Provider	Electrical Engineer	30	
Actor	Electrical Engineer	30	
Information Required	All information from 20-080 plus: <ul style="list-style-type: none"> • Types (manufacturer/model) – either exact, generic with or without assigned types that meet requirements • Placement (e.g., junction boxes) • Connectivity • Wiring Paths • Controls/transfers • Connections/Disconnects 		
Current Methods	Create plans with detail on elements. Create schedules based on elements and acceptable product types.		

Task Form			
Task ID	30-110	Task Name	Coordinate With Other Building Systems
Participants	Roles Involved	Phase	
Information Provider	Electrical Engineer	30	
Actor	Architect	30	
Information Required	Updated Electrical drawings showing physical size and location of all elements in the electrical system Final Electrical Specifications Updated Drawings from all other Disciplines		
Current Methods	Electrical Engineer sends the electrical drawings to the architect. Architect incorporated the information into the design.		

3 Fundamental Concepts

3.1 Overview

This chapter documents common concepts of information modeling applied to various object types found in data exchanges. Each individual concept template may also be referred to as a *functional part*, and describes a graph of object classes and attributes. Such templates are further refined at each applicable object class to indicate specific values or types that may be used. For a complete presentation of the MVD, including IFC instance diagrams and tables indicating how the concepts are used by entities for exchanges, see http://docs.buildingsmartalliance.org/MVD_SPARKIE.

3.2 Concept templates

Various concept templates have been introduced in this specification, and existing concept templates have been adapted from the IFC4 specification of BuildingSmart International (www.buildingsmart-tech.org).

NOTE: This specification is also available in HTML and MVFXML form, where the online specification contains additional content including instantiation diagrams and exchange requirements tables.

This specification consists of a schema defining data types, along with common concepts indicating use of data types for particular scenarios. This chapter defines such common concepts, which are applied at entities having specific use. Such concepts also form the basis of Model View Definitions, which are supplementary specifications that adapt the scope and rules of this schema for targeted domains within the building industry.

Each concept template defines a graph of entities and attributes, with constraints and parameters set for particular attributes and instance types. Various entities within this schema reference such concept templates and adapt them for particular use according to parameters. For example, the 'Ports' concept template defines distribution system connectivity for mechanical, electrical, and plumbing systems and a pipe segment defines an application of the 'Ports' concept, having one port as an inlet and another as an outlet.

3.2.1 Roots

All entities having semantic significance derive from *IfcRoot*, where instances are identifiable within a data set using a compressed globally unique identifier (IFC-GUID). This identifier must never change during the lifetime of an object, which allows data to be merged, versioned, or referenced from other locations.

Resource-level instances (not deriving from *IfcRoot*) do not have any identity, such that two instances having identical state are considered equal. For example, if an object has coordinates described by an *IfcCartesianPoint* instance, another object with the same coordinates may have a separate instance of *IfcCartesianPoint* or share the same instance; such difference is a matter of data storage optimization and does not imply any semantic relationship. This also implies that non-rooted instances may only exist if referenced by at least one rooted instance through either a direct attribute or inverse attribute, or following a chain of attribute references on instances.

The distinction between rooted and non-rooted (resource-level) entities achieves several goals:

- File size may be reduced by interning (sharing) non-rooted data instances;
- Database retrieval may be more efficient by storing non-rooted data local to rooted data instances;
- Storage size may be reduced by avoiding IFC-GUID storage for items not requiring direct retrieval;
- Comparisons of differences may be done at a higher level where the context of such change is apparent;
- Implementations may treat non-rooted data instances as immutable for efficiency or simplified usage.

3.2.1.1 Identity

An object needs to be identifiable for accurate processing by both human and automated processes. Identification may be through several attributes such as Identification, Name, Description or GUID. The GUID is compressed for the purpose of being exchanged within an IFC data set - the compressed GUID is referred to as "IFC-GUID". While the IFC-GUID is normally generated automatically and has to be persistent, the Identifica-

tion may relate to other informal registers but should be unique within the set of objects of the same type. The Name and Description should allow any object to be identified in the context of the project or facility being modeled.

Various objects may have additional identifications that may be human-readable and/or may be structured through classification association.

Various file formats may use additional identifications of instances for serialization purposes; however there is no requirement or guarantee for such identifications to remain the same between revisions or across applications. For example, the IFC-SPF file format lists each instance with a 64-bit integer that is unique within the particular file.

3.2.2 Project

All files contain a single IfcProject instance indicating overall context and a directory of objects contained within.

3.2.2.1 Project declaration

The project provides a directory of objects contained within using declaration relationships

3.2.2.1.1 Object type definitions

Declaration of object types, such as element types utilized by the element occurrences within this project, within the context of the project

3.2.2.1.2 3. Property set templates

Declaration of property set templates, including the property templates that are used as property definitions. Such templates define the applicable properties, their names, descriptions, measure types and property type (single, enumerated, bounded list or table value).

3.2.2.2 Project units

The project context includes the definition of the default units within the IFC data set. Default units are those units that apply:

- To all geometric representation items within the geometric representation contexts;
- To all attributes with a defined datatype indicating a measure datatype;
- To all properties and quantities with a defined datatype indicating a measure datatype and with no local unit definitions provided.

3.2.2.3 Project context

A project representation context indicates the coordinate system orientation, direction of true north, precision, and other values that apply to all geometry within a project or project library. 3.2.3 Actor

An actor is a person or organization participating in a project. Actors may fulfill one or more roles such as engineers, contractors, manufacturers, building occupants, etc.

3.2.2.4 Contact

Contact information indicates roles and addresses of people and organizations.

3.2.3 Control

A control is a directive to meet specified requirements such as for scope, time, and/or cost.

3.2.3.1 Cost

Cost information is used to indicate rate structures within a cost schedule which are applicable to assigned objects.

3.2.3.2 Calendar

Calendar information is used to filter other objects to indicate time periods during which the control applies.

3.2.4 Product

A product is an occurrence of a physical or virtual object with finite spatial extent.

3.2.4.1 Product placement

Product occurrences can be placed in 3D space relative to where they are contained. Placement is defined by a relative position (X, Y, Z coordinates), a horizontal reference direction, and a vertical axis direction. At the outermost level, relative directions are defined according to representation context; for example, +X may point east, +Y may point north, and +Z may point up.

Placement follows aggregation and containment relationships as follows:

- At the outermost level, a site is globally positioned according to latitude, longitude, and elevation;
- For spatial structures, positioning is relative to aggregation. For example, a site may aggregate multiple buildings, each building may aggregate multiple building stories, and each building story may aggregate multiple spaces;
- For building elements, positioning is relative to the containing spatial structure. For example, a building story may contain slabs, walls, columns, and beams;
- For aggregated parts, positioning is relative to aggregation. For example, a staircase may aggregate one or more stair flights;
- For feature elements, positioning is relative to the affected building element. For example, an opening element is positioned relative to the wall it voids, which in turn is positioned relative to a building story;
- For fillings, positioning is relative to the filled opening. For example, a door is positioned relative to an opening which in turn is positioned relative to a wall;
- For distribution ports, positioning is relative to the containing distribution element. For example, an air terminal may have a port connection for a duct segment or fitting;
- For distribution elements, positioning is relative to the containing spatial structure, however may be constrained by port connections. For example, an electrical junction box may fill an opening within a wall, and the junction box may contain ports for contained outlets or switches; the placement of such connected elements is constrained relative to connected port of the junction box. As another example, an air terminal may fill a ceiling covering which is placed relative to a space; the placement of a connecting duct fitting may be constrained relative to the air terminal.

If a containing spatial structure contains a grid, then placement may also be based relative to grid coordinates.

3.2.4.2 Product representation

The shape of products may be represented in multiple ways for different purposes. Each representation has a well-known string identifier and a particular representation context. There may be multiple representation contexts to describe a shape at various levels of detail. Most building elements have a 'Body' representation which defines or approximates the physical shape and volume. In addition to physical building elements, non-physical elements may have representations such as spaces and openings.

3.2.4.2.1 Axis geometry

Elements following a path provide an 'Axis' representation indicating a line segment or any arbitrary open bounded curve. Examples of such elements include walls, beams, columns, pipes, ducts, and cables. For elements that have a material profile set association indicating cross-section, a 'Body' representation may be generated based on the axis curve and material profiles. Curve styles may indicate particular colors, line thicknesses, and dash patterns for 2D rendering.

3.2.4.2.2 Footprint geometry

Elements filling a boundary provide a 'Footprint' representation indicating a rectangle or any arbitrary set of outer and inner boundary curves. Examples of such elements include slabs and spaces. For elements that have a material layer set association indicating material thicknesses, a 'Body' representation may be generated based on the footprint and material layers. Fill area styles may indicate particular colors, tiles, or hatching for 2D rendering.

The representation identifier of the footprint geometric representation is:

`IfcShapeRepresentation.RepresentationIdentifier = 'FootPrint'`

3.2.4.2.3 Surface geometry

Elements may have a 'Surface' representation describing the outer surface of the object. Such representation may be used for hit-testing objects having part composition such as framed walls.

3.2.4.2.4 Body geometry

Elements may have a 'Body' representation describing the volumetric shape of the object. Such representation may be used for 3D rendering or quantity take-off. Geometry may be based on boundary representations describing outer faces, primitives such as spheres or cones, swept solids such as profile extrusions or revolutions, Constructive Solid Geometry (CSG) such as clippings or subtractions of other shapes, or Non-Uniform Rational B-Spline (NURBS) geometry. Surface styles may indicate particular colors, textures, and reflectance for 3D rendering.

The representation identifier of the body representation is:

IfcShapeRepresentation.RepresentationIdentifier = 'Body'

3.2.4.2.5 Lighting geometry

Elements emitting light provide a 'Lighting' representation. Examples of such elements include lamps and light fixtures. Such representation may be used for 3D rendering or lighting design.

3.2.4.2.6 Clearance geometry

Elements requiring surrounding space for clearance provide a 'Clearance' representation. The reason for clearance space may be due to ventilation, maintenance, or other purpose. Examples of such elements include boilers and chillers. Such representation may be used for interference checks, where the 'Clearance' representation must not intersect with the 'Body' representation of other objects, though may intersect with the 'Clearance' representation of other objects.

3.2.4.3 Site location

The site location may be used to determine climate conditions and applicable building codes.

3.2.4.4 Building location

The building location may indicate the address as found on a map.

3.2.4.5 Grid

Grids are used for layout according to rectangular, triangular or circular patterns.

3.2.5 Resource

A resource represents usage of something, having costs and environmental impacts.

3.2.5.1 Resource cost

Resources can have associated costs indicating financial costs and environmental impacts incurred according to a specified base quantity.

Each cost value may be defined using a constant amount or calculated according to specified formula.

3.2.5.2 Resource quantity

Resources may be defined according to a base quantity, where assigned tasks consume such amount of resource relative to an output quantity.

For work-based resources such as labor and equipment, quantities are based on time. For product-based resources, quantities are based on count. For material-based resources, quantities are based on volume.

3.2.6 Resource type

A resource type represents a template of usage of something, having cost rates and environmental impact rates.

3.2.6.1 Resource cost rate

Resource cost rates are provided for anything that may be sold in quantity, such as product models that may be ordered, or common services that may be priced by unit.

3.2.7 Association

Association refers to relating objects to external information such as documents, databases, and classifications.

3.2.7.1 Classification

Objects, type objects, properties, and some resource schema entities can be further described by associating references to external sources of information. The source of information can be:

- A classification system;
- A dictionary server;
- Any external catalogue that classifies the object further;
- A service that combine the above features.

An individual item within the external source of information can be selected. It then applies the inherent meaning of the item to the object or property.

3.2.7.2 Material

Any product or product type can have associated materials indicating the physical composition of an object. Materials can have representations for surface styles indicating colors, textures, and light reflectance for 3D rendering. Materials can have representations for fill styles indicating colors, tiles, and hatch patterns for 2D rendering. Materials can have properties such as density, elasticity, thermal resistance, and others as defined in this specification. Materials can also be classified according to a referenced industry standard.

An object can be comprised of a single material or a set of materials with a particular layout. Several examples include:

- A slab may have an associated layer of concrete;
- A beam may have an associated I-Shape profile of steel;
- A door may have associated constituents for framing and glazing;
- A port may have an associated profile and/or material flowing through it such as hot water.

EXAMPLE: Material information can also be given at object type, defining the common material data for all occurrences of the same type. It is then accessible by the inverse *IsTypedBy* relationship pointing via *HasAssociations* and via *IfcRelAssociatesMaterial.RelatingMaterial* to the material information. If both are given, then the material directly assigned to object occurrence overrides the material assigned to object type.

3.2.7.2.1 Material profile set

Material profile sets are associated with elements or element types where materials are placed in cross-sections of specified dimensions following a path defined at occurrences of the type. Examples of such products are beams, columns, members, reinforcing, footings, piles, pipe segments, duct segments, and cable segments.

Material profile sets are associated by using the relationship *IfcRelAssociatesMaterial* having the *RelatingMaterial* pointing to an *IfcMaterialProfileSet*. The *RelatedObjects* either point to a single or multiple occurrences of *IfcElement*, or to a single or multiple *IfcElementType*.

EXAMPLE: Material profile sets can be provided at the *IfcColumnType*, defining the common material information for all occurrences of the same column type. It is then accessible by the inverse *IsTypedBy* relationship at *IfcColumn* pointing to *IfcColumnType* having the *HasAssociations* inverse relationship to *IfcRelAssociatesMaterial* with *RelatingMaterial* referring to the *IfcMaterialProfileSet*. If an individual material association is provided at the *IfcColumn* and the *IfcColumnType*, then the material directly assigned to *IfcColumn* overrides the material assigned to *IfcColumnType*.

3.2.7.2.2 Material profile set usage

Material profile set usage defines layout at occurrences to indicate the offset from the 'Axis' reference curve according to cardinal point, and a reference extent such as for a default column height.

3.2.8 Definition

Objects may be defined by having a number of properties, where such properties may be organized partially (into property sets) or fully (into templates).

3.2.8.1 Object typing

Object occurrences can be defined by a particular object type, using the Object Typing concept. A pair of entities is defined for most semantic objects - an object occurrence entity and a corresponding object type entity.

EXAMPLE: The *IfcTank* is the object occurrence entity that has a corresponding *IfcTankType* being the object type entity.

On instance level, an object occurrence instance may have:

- Similar state as its object type instance by applying all characteristics defined at the type;
- Overridden state for particular characteristics;
- No defined object type instance.
- Characteristics defined at the object type level may include:
- Common naming and predefined type;
- Common properties within a type driven property set;
- Common geometry representations, applied as mapped representation to each occurrences;
- Common material assignments (with exception of material set usages);
- Common definition of a decomposition structure.

Many object occurrence and object type entities have an attribute named *PredefinedType* consisting of a specific enumeration. Such predefined type essentially provides another level of inheritance to further differentiate objects without the need for additional entities. Predefined types are not just informational; various rules apply such as applicable property sets, part composition, and distribution ports.

EXAMPLE: For scenarios of object types having part compositions, such parts may be reflected at object occurrences having separate state. For example, a *wall type* may define a particular arrangement of studs, a *wall occurrence* may reflect the same arrangement of studs, and studs within the wall occurrence may participate in specific relationships that do not exist at the type such as being connected to an electrical junction box.

The object type is attached using the *IfcRelDefinesByType* objectified relationship and is accessible by the *IsTypedBy* inverse attribute. Only a maximum one, or zero, object types can define an object occurrence. If the

object type has aggregated elements, such objects are reflected at the object occurrence using the *IfcRelDefinesByObject* relationship.

3.2.8.2 Property sets

Any specialization of object can be related to multiple property set occurrences. A property set contains multiple property occurrences. The data type of property occurrence are single value, enumerated value, bounded value, table value, reference value, list value, and combination of property occurrences.

3.2.8.3 Property sets for types

For object types, property sets are defined directly.

This concept is used by entities for exchanges as shown.

3.2.8.4 Property sets for performance

For performance history, properties are in the form of time series, for tracking data at points in time.

3.2.9 Composition

Objects may be composed into parts to indicate levels of detail, such as a building having multiple stories, a framed wall having studs, or a task having subtasks. Composition may form a hierarchy of multiple levels, where an object must have a single parent, or if a top-level object then declared within the single project or a project library.

3.2.9.1 Object aggregation

An aggregation indicates an unordered part composition relationship between the whole structure, referred to as the "composite", and the subordinate components, referred to as the "parts". The concept of aggregation is used in various ways. Examples are:

- Aggregation is used on building elements to indicate parts such as studs within a wall;
- Aggregation is used on spatial elements to indicate a spatial structure such as a story within a building;

- Aggregation is used on systems to indicate subsystems such as branch circuits.

Aggregation is a bi-directional relationship, the relationship from the composite to its parts is called Decomposition, and the relationship from the part to its composite is called Composition.

3.2.9.1.1 Element decomposition

Element decomposition refers to an aggregation structure where the element, representing the composite, is decomposed into parts represented by other elements.

The composite then provides, if such concepts are in scope of the Model View Definition, exclusively the following:

- Placement — the common object coordinate system to which the parts are placed relative
- By default the following constraints apply to an element being decomposed by Element Decomposition:
- Body Geometry — composite is constructed from the sum of the Body Geometry of the parts;
- The composite shall not have an own Body Geometry, body geometry is provided at the parts;
- The composite shall not have an own Material assignment, material is assigned to the parts.

3.2.9.1.2 Spatial decomposition

Spatial decomposition refers to an aggregation structure where a spatial structure of the project is decomposed into parts represented by other spatial structure elements. The spatial structure is a hierarchical tree of spatial structure elements (site, building, story, space) ultimately assigned to the project. Decomposition refers to the relationship to lower level elements (e.g., this story has spaces).

The order of spatial structure elements being included in the concept are from high to low level: IfcProject, IfcSite, IfcBuilding, IfcBuildingStorey, IfcSpace. Therefore a spatial structure element can only has parts of an element at the same or lower level.

3.2.9.2 Object nesting

Nesting indicates an ordered arrangement relationship. Nesting is used:

- On building elements to indicate features placed in sequence such as ports.
- On control objects to indicate specification hierarchies.
- On process objects to indicate subordinate task details.
- On resource objects to indicate subordinate resource allocations.

3.2.9.3 Ports

Ports indicate possible connections to other objects according to specified system types, flow direction, and connection properties. Ports are typically connected between devices via cables, pipes, or ducts.

Ports may have placement defined indicating the position and outward orientation of the port relative to the product or product type.

Ports may have material profile sets defined indicating the flow area and connection enclosure.

3.2.10 Assignment

Objects may provide services to other objects, where the "assigned from" object acts upon or observes requirements of the "assigned to" object. There is a general cycle of assignments where actors (people) issue controls (such as work orders or schedules), which may result in groups (such as building systems) comprised of products (such as building elements) operated upon by processes (such as construction tasks) performed by resources (such as labor) which may in turn be fulfilled by actors (people). Requirements are established at the "to" side and are fulfilled at the "from" side, where costs, time, scope, or other metrics may be calculated in the "from-to" direction.

3.2.10.1 Actor assignment

Actors may have assignments indicating objects for which they have responsibility. An example of such assignment is a work order assigned to an organization.

3.2.10.2 Control assignment

Controls may have assignments indicating objects that must observe the established requirements. An example of such assignment is a labor resource assigned to a calendar.

3.2.10.3 Group assignment

Group Assignment established an arbitrary collection of objects within a group. The grouping relationship does not apply any other meaning than grouping objects under some aspect. It is non-hierarchical, that is objects can be grouped into different logical groups, and it does not interfere with other relationship concepts, such as ObjectAggregation.

The Group Assignment concept establishes a given object as being the group collection for other objects. It usually implies the existence of a grouping relationship and the provision of some identity under which the group is characterized.

The group collection is handled by an instance of `IfcRelAssignsToGroup`, which assigns all group members to the `IfcGroup` being the collection.

Objects included in group as collected items are linked by `IsGroupedBy` pointing to `IfcRelAssignsToGroup`

NOTE: The `IfcGroup` maybe not yet have a grouping relationship established, it then identifies an empty group.

EXAMPLE: An air handler belonging to an air conditioning system is an example of such group assignment.

3.2.10.4 Process assignment

Processes may have assignments indicating resources consumed or occupied by the process. An example of such assignment is a carpenter labor resource building a wall.

3.2.10.5 Resource assignment

Resources may have assignments indicating sources available to be used. An example of such assignment is a person fulfilling a carpenter labor resource.

3.2.10.6 Product type assignment

Product types may have assignments indicating re-usable process types for which occurrences may operate on occurrences of the product type. An example of such assignment is a task type for placing concrete in slabs on grade.

3.2.10.7 Process type assignment

Process types may have assignments indicating re-usable resource types for which occurrences may be consumed or occupied by occurrences of the process type. An example of such assignment is a concrete mixer resource type for delivering concrete.

3.2.11 Connectivity

Objects may participate in various connectivity relationships with other objects.

3.2.11.1 Spatial structure

Spatial structures, such as site, building, story, or spaces, may contain physical elements, including building elements, distribution elements, and furnishing elements. The containment relationship between the physical elements and the spatial structures is hierarchical, i.e. a physical element shall only be contained within a single spatial structure.

EXAMPLE: An *IfcBeam* is placed within the spatial hierarchy using the objectified relationship *IfcRelContainedInSpatialStructure*, referring to it by its inverse attribute *SELF\IfcElement.ContainedInStructure*. Subtypes of *IfcSpatialStructureElement* are valid spatial containers, with *IfcBuildingStorey* being the default container.

The spatial containment relationship, together with the Spatial decomposition relationship, being hierarchical as well, establishes the hierarchical project tree structure in a building information model.

EXAMPLE: The *IfcBuildingStorey* that logically contains the *IfcBeam* decomposes the *IfcBuilding* using the *IfcRelAggregates* relationship. Therefore the *IfcBeam* is also indirectly contained in the building.

3.2.11.1.1 Spatial containment

The Spatial Containment concept defines the relationship of physical elements, such as building elements, distribution elements, or furnishing elements as being contained within a spatial structure element.

3.2.11.1.2 Space coverings

Spaces may have related coverings for floorings, ceilings, and wall coverings. Such relationship provides for parametric use of building materials where such elements may automatically adapt to changes in the size, layout, and openings for the space.

3.2.11.2 Element connectivity

Elements may be connected to other elements, where the RelatingElement is of equal or higher priority, is generally constructed first, and/or anchors the RelatedElement.

3.2.11.2.1 Port connectivity

Ports on objects may be connected using elements such as cables, ducts, or pipes.

3.2.11.3 Interference

Elements may interfere with other elements, such as cable carriers going through walls. The interference relation enables precedence of interfering elements to be asserted.

4 Model View Definition

4.1 Overview

This chapter documents use cases for exchanging information related to electrical disciplines for building design and construction. Industry Foundation Classes (IFC) is the international standard for exchanging Building Information Modeling (BIM) data, which defines hundreds of classes for common use in software, currently supported by approximately 150 applications. A Model View Definition (MVD) defines a subset of the IFC schema that is needed to satisfy one or many Exchange Requirements of the AEC industry. Together with the IFC schema subset, a set of implementation instructions and validation rules, called MVD Concepts, are published. The electronic format to publish the concepts and associated rules is mvdXML. While IFC defines how building information can be represented electronically in general, an MVD defines which information is required for particular scenarios.

4.2 Exchanges

Information required at various stages of a building project is organized into Exchanges. Each exchange defines what information is required, optional, inapplicable, or restricted. Application software may support filtering data to be imported or exported for a particular exchange, and contracts for projects may refer to such exchanges to identify the scope and format of information required for delivery.

4.2.1 Facility occupancy model

4.2.1.1 Requirements

The facility occupancy model describes the site location, owner's project requirements, and building requirements.

The site location indicates the geographic location for determining climate information, and the legal address for determining the jurisdiction and applicable building codes.

The owner's project requirements consist of a facility type and a set of space types, each indicating occupancy loads, hours of occupancy, design priorities, and climate control requirements.

4.2.1.2 Usage

The *IfcProject* indicates overall context including default units. The *IfcProject* is aggregated by an *IfcSite* which indicates the geographic location and postal address. The *IfcSite* is aggregated by an *IfcBuilding* which indicates overall building requirements in the form of property sets. The *IfcProject* declares *IfcOccupant* instances (via *IfcRelDeclares*) for each class of building occupant which may correspond to a number of people as indicated within the *Pset_ActorCommon* property set. Each *IfcOccupant* may have *IfcWorkCalendar* assignments using *IfcRelAssignsToActor*. The *IfcProject* declares *IfcWorkCalendar* instances (via *IfcRelDeclares*) for each calendar of occupancy. Each *IfcWorkCalendar* may have *IfcBuilding* assignments using *IfcRelAssignsToControl*.

4.2.2 Electrical project requirements

4.2.2.1 Requirements

Electrical project requirements are based on electrical usage criteria as well as equipment determined from usage criteria of other systems such as HVAC and other mechanical systems.

- Occupation: Number of occupants, hours of occupancy, occupancy type
- Cost: Level of finishes
- Architectural: Size of building, number of floors, floor height
- Environment: Heating, cooling, central/unitary
- Illumination: Lighting level, light sources, daylighting, site lighting
- HVAC: Pumps, chillers, fans (power/area for each space)
- Transport: Elevators, escalators
- Control: Automation systems

4.2.2.2 Usage

The *IfcBuilding* contains various property sets for indicating overall building requirements.

4.2.3 Equipment room requirements

4.2.3.1 Requirements

This exchange captures equipment with significant electrical loads.

4.2.3.2 Usage

Electrical equipment rooms are indicated using IfcSpace with classification source set to 'Omniclass' Table 13 ('Spaces By Function') using identification of '13-81 31 11' having the description 'Power Distribution Spaces', which may be further classified according to more specific space usage. As the building spatial hierarchy is not yet defined at this stage, the IfcSpace is declared on the IfcProject using IfcRelDeclares, and has no placement or representation indicated. The IfcSpace may contain equipment (such as IfcChiller, IfcUnitaryEquipment, or IfcElectricDistributionBoard) using IfcRelContainedInSpatialStructure, where the particular locations of the equipment are not yet defined. However, representations of the equipment are required to determine necessary area and volume using the 'Body', 'Footprint', and 'Clearance' representations.

4.2.4 Space program

4.2.4.1 Requirements

Spaces are programmed according to size and proximity requirements. Equipment sizes and clearances must be provided.

4.2.4.2 Usage

Spaces are indicated using IfcSpace with classification source set to 'Omniclass' Table 13 ('Spaces by Function'), which may be further classified according to specific space usage. As the building spatial hierarchy is not yet defined at this stage, the IfcSpace is declared on the IfcProject using IfcRelDeclares, and has no placement or representation indicated. Each IfcSpace may contain equipment using IfcRelContainedInSpatialStructure, where the particular locations of the equipment are not yet defined. However, representations of the equipment are required to determine necessary area and volume using the 'Body', 'Footprint', and 'Clearance' representations.

4.2.5 Coordinate concept design

4.2.5.1 Requirements

Once space requirements have been determined, space locations and dimensions are allocated, where they are then adjusted according to specific disciplines to fulfill more detailed requirements.

4.2.5.2 Usage

Spaces are indicated using `IfcSpace` with classification source set to 'Omniclass' Table 13 ('Spaces by Function'), which may be further classified according to specific space usage. The building spatial hierarchy is defined at this stage, where spaces formerly declared on the `IfcProject` using `IfcRelDeclares` are then allocated within the `IfcBuilding` and `IfcBuildingStorey` spatial elements using `IfcRelAggregates`. Placement and representation of each space is indicated, including 'Body' and 'Footprint'. Each `IfcSpace` may contain equipment using `IfcRelContainedInSpatialStructure`, where the particular locations of the equipment are not yet defined. However, representations of the equipment are required to determine necessary area and volume using the 'Body', 'Footprint', and 'Clearance' representations.

4.2.6 Electrical system types

4.2.6.1 Requirements

Information is required for selecting main electrical system types.

For devices consuming electricity, the following items are needed:

- Load
- Voltage
- System Type

For devices generating electricity (if any), the following items are needed:

- Capacity
- Output Voltage
- System Type

For devices storing electricity (if any), the following items are needed:

- Connected Load
- Uptime

For spatial electrical demand, the following items are needed:

- Lighting power density
- Appliance power density
- Equipment power density

4.2.6.2 Usage

Electrical systems are described using `IfcDistributionSystem` having `PredefinedType` set to `ELECTRICAL`. Each top-level system is declared on the `IfcProject` using `IfcRelDeclares`. Devices within each system (e.g. `IfcChiller`, `IfcTransportElement`, `IfcElectricalGenerator`) are assigned using the `IfcRelAssignsToGroup` relationship, where property sets indicate power requirements on devices.

Systems provided by utilities are assigned to the utility company using `IfcRelAssignsToActor` where an `IfcActor` identifies the `IfcOrganization` of the utility having an `IfcActorRole` set to the user-defined value of 'UTILITY'. Utility-level systems typically contain `IfcTransformer` and `IfcFlowMeter` elements.

4.2.7 Electrical basis of design

4.2.7.1 Requirements

- Document process model, constraints, formulas, and tables used for making decisions on electrical design.
- Lighting calculations showing required and designed foot-candles
- Estimated panel board loading (including 25% extra as a projection of future building loads)
- A projection/summation of the panel board loads to justify the sizing of the building transformers
- An economic analysis to justify the selection of either 120V/208V or 277Y/480V on the secondary side of the building transformers
- An analysis, for the 277Y/480 V choice, as to whether the step down transformer(s) shall be large central units or smaller units placed throughout the building

- A short-circuit analysis to determine the AIC rating of the system components.
- A coordination study to determine the circuit breaker settings and system coordination.

4.2.7.2 Usage

To indicate multiple scenarios within a project, each scenario is indicated using `IfcWorkPlan` declared on the `IfcProject` using the `IfcRelDeclares` relationship. Once a plan is approved for usage, it may be nested within an approved `IfcProjectOrder`. Such work plan may have a nested `IfcPerformanceHistory` record indicating projected energy usage, which may be nested into sub-components corresponding to subsystems. The particular systems are indicated using `IfcDistributionSystem` and are assigned to the `IfcPerformanceHistory` energy projection using the `IfcRelAssignsToControl` relationship.

4.2.8 Electrical source of supply

4.2.8.1 Requirements

Rate structures must be defined for each system type, indicating time intervals and usage.

A process model may be defined coordinating electrical utility service, along with approval requirements.

4.2.8.2 Usage

Each available service is indicated using `IfcTaskType` indicating a process model with `PredefinedType` set to `OPERATION`. Such process model may have nested recurring tasks (`IfcTask`) via `IfcRelNests` with time periods indicating when the service applies using `IfcTaskTimeRecurring`. Costs of each rate structure are indicated by `IfcSubContractResourceType` where `BaseCosts` contains one or more `IfcCostValue` instances. Each `IfcSubContractResourceType` is assigned to the `IfcTaskType` or nested `IfcTask` using the `IfcRelAssignsToProcess` relationship. The utility (represented by `IfcActor`) is assigned to the subcontract resource type using the `IfcRelAssignsToResource` relationship.

4.2.9 Electrical space requirements

4.2.9.1 Requirements

Electrical requirements for each space are elaborated, and each space lists major equipment for consuming, generating, transforming, and storing electricity.

4.2.9.2 Usage

Spaces are indicated using `IfcSpace` with classification source set to 'Omniclass' Table 13 ('Spaces by Function'), which may be further classified according to specific space usage. The building spatial hierarchy is indicated within the `IfcBuilding` and `IfcBuildingStorey` spatial elements using `IfcRelAggregates`. Placement and representation of each space is indicated, including 'Body' and 'Footprint'. Electrical space requirements are defined on each `IfcSpace` using property sets, particularly `SPARKie_SpaceElectricalRequirements`. Each `IfcSpace` may contain equipment using `IfcRelContainedInSpatialStructure`, where the particular locations of the equipment are established at this stage. Representations of the equipment are also required to determine necessary area and volume using the 'Body', 'Footprint', and 'Clearance' representations.

4.2.10 Energy performance

4.2.10.1 Requirements

Energy usage is estimated based on major equipment, power densities indicated at spaces, and occupancy schedules.

4.2.10.2 Usage

The `IfcProject` declares one or more `IfcPerformanceHistory` instances, where the lifecycle phase should be set to `DESIGNDEVELOPMENT` to indicate development-level estimation precision. Top-level `IfcPerformanceHistory` instances (typically one) refer to electrical usage at a main utility port, typically corresponding to that on the SINK side of an `IfcFlowMeter` electrical meter, where such `IfcDistributionPort` may be assigned to the `IfcPerformanceHistory` via the `IfcRelAssignsToControl` relationship. The `IfcPerformanceHistory` makes use of the `Pset_DistributionPortPHistoryCable` property set for indicating electrical

loads at periods of time, where each `IfcPropertyReferenceValue` points to `IfcIrregularTimeSeries`.

4.2.11 Document concept design

4.2.11.1 Requirements

A completed concept design contains requirements for all disciplines as follows.

- **Architectural:** For each space, area and relation to other spaces is indicated along with any exterior space requirements.
- **Mechanical:** For each distribution element, ventilation, thermal loads, and fuel types are indicated.
- **Structural:** For each element, static weight is indicated as well as dynamic loads (such as from elevator accelerating).
- **Construction:** For large equipment, installation methods, sequencing, and paths are indicated.
- **Costs:** Construction and operation costs are established for each system.

4.2.11.2 Usage

The `IfcProject` contains a full spatial hierarchy, with instances of `IfcElement` subtypes are contained in spatial elements using `IfcRelContainedInSpatialStructure`. Property sets indicate qualitative requirements using `IfcPropertySet`. Structural weight requirements are described by quantity sets holding a 'NetWeight' property. Construction installation paths are indicated via an assigned `IfcAnnotation` of `ObjectType` 'Annotation curve' containing an 'Axis' representation, and assigned `IfcTask` of type MOVE. Costs are indicated by instances of `IfcConstructionResource` subtypes assigned to `IfcTask` instances which qualify the type of task for which costs apply.

4.2.12 Locate electrical loads

4.2.12.1 Requirements

Light fixtures, outlets, and other devices consuming electricity are placed within the building. The quantity and layout of devices is determined by space classification and electrical power density requirements.

4.2.12.2 Usage

Electrical devices such as distribution boards, junction boxes, and equipment are positioned within spaces using `IfcRelContainedInSpatialStructure`, and embedded or attached to wall coverings or ceiling coverings using `IfcRelConnectsElements`. Note that `IfcWall` and `IfcSlab` indicate structural elements; for example, the blocks of a CMU wall or the framing of a stud wall. Drywall and brick are considering coverings for which `IfcCovering` is connected using `IfcRelCoversBldgElements`. Devices embedded within coverings are positioned such that the origin is on the plane of the positive surface, the Axis is perpendicular to the surface, and the `RefDirection` points in the +X direction of the surface when installed with normal orientation. Outlets and switches may be aggregated within junction boxes using `IfcRelAggregates` and hold `IfcDistributionPort` connections via `IfcRelNests` linking to the enclosing junction box, which in turn has ports connecting to upstream and downstream devices within the same `IfcDistributionCircuit`. Loads on devices are indicated using property sets, specifically `Pset_ElectricalDeviceCommon`.

4.2.13 Electrical equipment requirements

4.2.13.1 Requirements

For each space, the connected load and demand load is determined along with diversity coefficients. Lighting zones may span within a single space or across multiple spaces, for which any geometrically contained light fixtures are considered part of the zone. Circuits are allocated and loads are determined at distribution points. For each device occurrence, equipment is specified in one of three ways: (a) a specific product model; (b) an arbitrary specification with required properties indicated; or (c) an arbitrary specification with multiple acceptable product models indicated. Locations where raceways may later be positioned are allocated using `IfcProxy` with custom type *PROVISIONFORVOID*.

One-line diagrams may be derived from this information.

4.2.13.2 Usage

Loads are indicated at `IfcDistributionCircuit` and `IfcDistributionSystem` using property sets. Lighting zones are indicated using `IfcSpatialZone` having `PredefinedType` of *LIGHTING*. Device occurrences are indicated by

instances of `IfcDistributionElement` subtypes and assigned to `IfcDistributionCircuit` circuits using `IfcRelAssignsToGroup`. Type definitions are indicated by instances of `IfcDistributionElementType` subtypes defined on occurrences using `IfcRelDefinesByType`. For a type definition that refers to a specific product model, the property set `Pset_ManufacturerTypeInformation` is included. For an arbitrary type definition where multiple product models meet the specification, such product model types (`IfcDistributionElementType` subtype) may be assigned to the specification type (`IfcDistributionElementType` subtype) using `IfcRelAssignsToProduct`.

4.2.14 Electrical equipment rooms

4.2.14.1 Requirements

For electrical equipment rooms, locations and connectivity of distribution boards and cable carriers are determined.

4.2.14.2 Usage

Distribution boards are indicated using `IfcDistributionBoard` and are typically placed on walls using `IfcRelConnectsElements`. Distribution boards that are to be recessed within walls should fill an opening (`IfcOpening` with type *RECESS*) using `IfcRelFillsElements`.

4.2.15 Lighting layout

4.2.15.1 Requirements

Lighting may be arranged to indicate specific placement of fixtures. Such fixtures may be attached or hung to surfaces, embedded within coverings, or suspended from ceiling grids. The quantity of fixtures may be determined according to the required lighting power density for the space and the power of each fixture.

4.2.15.2 Usage

Light fixtures are indicated using `IfcLightFixture` and are contained within spaces using `IfcRelContainedInSpatialStructure`. Light fixtures that are attached to surfaces should use `IfcRelConnectsElements` where `RelatedElements` contains the `IfcLightFixture`. Light fixtures that are to be recessed within walls should fill an opening (`IfcOpening` with type

RECESS) using *IfcRelFillsElements*. Light fixtures that are placed within ceiling grids should be placed within an *IfcGrid* that is connected to the *IfcCovering* corresponding to the ceiling grid.

4.2.16 Size electrical system

4.2.16.1 Requirements

Sizing electrical systems involves review and verification of hourly ratings and code requirements for separations between electrical equipment rooms and adjoining spaces (could potentially impact room areas). Information in this exchange is used to size distribution boards, cables, and transformers.

4.2.16.2 Usage

Each *IfcCableSegment* must be sized to accommodate the rated load, where the NEC defines required wire gauges according to amps. Each *IfcDistributionBoard* must be sized to accommodate the number of circuits and spare capacity for future expansion. Each *IfcTransformer* must be sized to accommodate the capacity and voltage of the transformed circuit. Property sets (particularly *Pset_ElectricalDevice*) indicate electrical characteristics of devices.

4.2.17 Raceway layout

4.2.17.1 Requirements

Layout of raceways indicates paths and connectivity of each raceway along with allocation of cables within raceways.

4.2.17.2 Usage

Raceways are indicated using *IfcCableCarrierSegment* for straight segments and *IfcCableCarrierFitting* for transitions. A single *IfcCableCarrierSegment* may be defined with an arbitrary 'Axis' representation indicating the path, where specific segments and fittings are elaborated as assigned objects at finer level of detail using *IfcRelAssignsToProduct*. Cable carrier segments and fittings are connected together using *IfcDistributionPort* having *PredefinedType* of *CABLECARRIER*. Cables are indicated using *IfcCableSegment* and are

contained within an overall `IfcCableCarrierSegment` using `IfcRelAggregates`.

4.2.18 Electrical schematic design

4.2.18.1 Requirements

Electrical schematic design includes information needed to calculate electrical performance in its entirety. This information may be used to derive schedules for systems, panelboards, equipment, light fixtures, and feeders.

4.2.18.2 Usage

Electrical systems are indicated using `IfcDistributionSystem`, with individual circuits defined by `IfcDistributionCircuit`. Panelboard schedules are derived from `IfcDistributionBoard` and aggregated `IfcProtectiveDevice` elements for each circuit breaker. Equipment schedules are derived from instances of `IfcFlowTerminal` subtypes powered by electrical power. Lighting schedules are derived from `IfcLightFixture` and aggregated `IfcLamp` elements for each lamp. Feeder schedules are derived from `IfcCableSegment`. Property sets indicate specific values at each object.

4.2.19 Coordinate with other building systems

4.2.19.1 Requirements

For coordination with other building systems, plans are created showing equipment locations as well as cable routing and connectivity. Electrical Schedules for equipment, fixtures, feeders, panelboards are derived.

4.2.19.2 Usage

Equipment is indicated primarily by subtypes of `IfcFlowTerminal`, `IfcFlowController`, and `IfcEnergyConversionDevice`. Equipment specific to a space is placed within an `IfcSpace`, while equipment that serves multiple spaces is placed within an `IfcBuildingStorey`. Cables connecting equipment are attached to ports (`IfcDistributionPort`) on each device using `IfcRelConnectsPorts`.

4.2.20 Estimate energy usage

4.2.20.1 Requirements

Energy usage is estimated based on load profiles of major equipment. Estimating energy usage involves calculating connected loads and demand loads at each circuit, and for the overall electrical system. The end result of this calculation may be captured in a Load Letter (format provided by utility), with values specified per project.

- Utilities may require the following information for establishing service:
- Load profile at each device consuming electricity
- Generation profile at each device generating electricity
- Service Location
- Total Area
- Conditioned Space Area
- Type of Heat
- Similar Business: Name, Address, Utility Account Number
- Type of Service: Underground, Overhead, Service Change, Relocation, New, Temporary
- Service Characteristics: Size of Load Wires, Sets of Load Wires Per Phase, Load Wire Type (AL/CU), Terminations: Meterbase/C.T. Cabinet/Connection Box/Switchgear/Other
- Service Size (amp): 100/150/200/300/400/600/other
- Voltage: 1P3W-120/240, 3P4W-120/240 (<=200 amps), 3P4W-Wye-120/208, 3P4W-Wye-277/480, Other
- Electric Load Excluding Motor Load (kW): Interior Lighting, Exterior Lighting, Electric Cooking, Water Heating, Dryer, Heat Pump, Heat Pump Strip Heat, Computers, Receptacles, Refrigeration, Electric Heat, AC (tons): Data Processing Load Only, Not Including Data Processing
- Electric Motor Load (Except Heating and AC): Phase, Number of Motors, HP, Voltage, Hours of Operation per week
- Estimated Business Operating Time: Hours Per Week, Month Per Year
- Meter Location Desired
- Service Equipment Location Desired

4.2.20.2 Usage

The IfcProject declares one or more IfcPerformanceHistory instances, where the lifecycle phase should be set to *DESIGNSCHEMATIC* to indicate schematic-level estimation precision. Top-level

IfcPerformanceHistory instances (typically one) refer to electrical usage at a main utility port, typically corresponding to that on the SINK side of an IfcFlowMeter electrical meter, where such IfcDistributionPort may be assigned to the IfcPerformanceHistory via the IfcRelAssignsToControl relationship. The IfcPerformanceHistory makes use of the Pset_DistributionPortPHistoryCable property set for indicating electrical loads at periods of time, where each IfcPropertyReferenceValue points to IfcIrregularTimeSeries.

4.2.21 Facility spatial configuration

4.2.21.1 Requirements

This exchange enables an architect to revise the facility spatial configuration plans based on the results of the coordination that took place at the end of Design Schematic. Required information includes:

- Spatial Elements (Buildings, Levels, Spaces, etc.)
- Building Elements (Walls, Slabs, Doors, Windows, etc.)
- Distribution Elements (Electrical, HVAC, Plumbing, etc.)
- Spatial Zones
- Systems & Circuits
- Connectivity (Space Boundaries, Ports, Connections, Interferences)
- Actors & Assignments

4.2.21.2 Usage

Project participants responsible for particular systems are indicated using IfcActor with assignments through IfcRelAssignsToActor.

Interferences with other building elements are indicated using IfcRelInterferesElements, where priorities may be indicated at such intersection.

4.2.22 Electrical supply requirements

4.2.22.1 Requirements

In this exchange, an electrical engineer uses the product type templates, updated plans, and other discipline information to determine total electrical supply requirements. For each electrical device, compatible product types are selected for each product occurrence (or if required, three compatible product types are selected that are suitable). The project delivery

method may require the owner's approval for final product selection. The total electrical supply requirements are calculated on each circuit according to connected load, demand load, and diversity factor.

4.2.22.2 Usage

For each electrical device, the specified type or range of types is defined using `IfcRelDefinesByType`. Overall electrical supply requirements are established at property set on `IfcDistributionSystem` of type `ELECTRICAL`.

4.2.23 System loads

4.2.23.1 Requirements

Loads are calculated by rolling up elements, circuits, and systems as follows:

- Element: Load, Time-phased load
- Circuit: Connected Load, Demand Load, Time-phased load
- System: Connected Load, Demand Load, Time-phased load, Diversity Coefficient

4.2.23.2 Usage

Devices are indicated using instances of `IfcDistributionElement` subtypes. Circuits are indicated using `IfcDistributionCircuit` having `PredefinedType` set to `ELECTRICAL` and have devices assigned using `IfcRelAssignsToGroup`. Systems are indicated using `IfcDistributionSystem` having `PredefinedType` set to `ELECTRICAL` and have circuits nested using `IfcRelNests`.

4.2.24 Cabling schematic

4.2.24.1 Requirements

This exchange provides detailed information for connectivity and placement of devices cables, including the following:

- Switch: Location, Lighting Load, Controls
- Outlet: Location, Appliance Load
- Cable Segment: Location, Connections, Load, Length, Wiring method (EMT/ENT/MC/Rigid/etc.)

- Switchgear/Panels
- Junction Box: Location (note: may not be at this level of detail)
- Life Safety devices / control panels: Location
- Lighting: Location
- Telecom: Location
- Generating Equipment: controls, transfer switches, interconnects: Location

All products may have defined types indicating Manufacturer, Model, and Specifications. Such types may also have assigned tasks and resources for procurement, where resource types indicate Supplier, Location, and Cost.

4.2.24.2 Usage

All electrical devices are connected together via ports (*IfcDistributionPort* having *PredefinedType* of CABLE and *SystemType* of ELECTRICAL), where the relationship *IfcRelConnectsPorts* has *RelatingPort* set to the power source (having *FlowDirection* of SOURCE) and *RelatedPort* set to the load (having *FlowDirection* of SINK). Product types are indicated via subtypes of *IfcDistributionElementType*. Costs rates for product types are indicated via subtypes of *IfcConstructionResourceType* assigned to *IfcTaskType* assigned to the *IfcDistributionElementType*. The task type qualifies the scenario for which the cost applies.

4.2.25 Redistribute circuits

4.2.25.1 Requirements

This exchange is used to rebalance circuits based on calculations derived from the cabling schematic. Circuits with loads above a maximum factor may be split into separate circuits. Circuits with loads below a minimum factor may be combined.

4.2.25.2 Usage

Each circuit is represented using *IfcDistributionCircuit* with *PredefinedType* set to ELECTRICAL. Loads may be calculated according to information at property sets, particularly *Pset_ElectricalDeviceCommon*.

4.2.26 Cabling and equipment size

4.2.26.1 Requirements

Based on final allocation of circuits, cabling and equipment sizes may be adjusted.

4.2.26.2 Usage

Cable segments are indicated using `IfcCableSegment`, where cable size information is indicated via `IfcMaterialProfileSet`.

Raceways are indicated using `IfcCableCarrierSegment`, where cross section is indicated via `IfcMaterialProfileSet`.

4.2.27 Architectural light fixtures

4.2.27.1 Requirements

For this exchange, the architect selects specific light fixture models (or an approved list from several manufacturers).

4.2.27.2 Usage

Light fixture occurrences are indicated by `IfcLightFixture`, where the selected model is defined by `IfcLightFixtureType` defined using `IfcRelDefinesByType`. To indicate multiple accepted models, the top-level model (`IfcLightFixtureType`) indicates an abstract template (not having a model defined via `Pset_ManufacturerTypeInformation`) and has candidate types assigned using `IfcRelAssignsToProduct`. Each candidate type has model information defined via the `Pset_ManufacturerTypeInformation` property set.

4.2.28 Product type specifications

4.2.28.1 Requirements

For this exchange, the engineer selects specific electrical equipment models (or an approved list from several manufacturers).

4.2.28.2 Usage

Electrical equipment occurrences are indicated by various `IfcDistributionElement` subtypes, where the selected model is defined by

IfcDistributionElementType defined using IfcRelDefinesByType. To indicate multiple accepted models, the top-level model (IfcDistributionElementType) indicates an abstract template (not having a model defined via Pset_ManufacturerTypeInfoInformation) and has candidate types assigned using IfcRelAssignsToProduct. Each candidate type has model information defined via the Pset_ManufacturerTypeInfoInformation property set.

4.2.29 Document coordinated design

4.2.29.1 Requirements

The coordinated design contains full detail for all electrical devices and their placement and interaction with other services within the building.

4.2.29.2 Usage

Electrical elements are defined using subtypes of IfcDistributionElement, with ObjectPlacement and Representation set for all instances. Electrical distribution ports are indicated using IfcDistributionPort, where all ports having FlowDirection of SINK must be connected. (Source ports may not necessarily be connected such as open outlets or the last junction box within a circuit.)

5 Conclusions

In developing Model View Definitions, the challenge is to extract detailed information from industry experts yet find commonalities that could be applied generally across varying project delivery methods, participants, and localities. During this project there were varying levels of input. Some experts would work within the assumptions of the preliminary structure, others would alter various steps, and some created new process diagrams from scratch. Each party had different project delivery methods. Therefore, dependencies were factored out by making each exchange role-based, not contract-based. Achieving this level of granularity required many more exchanges than traditionally used in IFC Model View Definitions. For example, information sent to a utility for obtaining rate structures and connection information is one specific exchange, rather than being lumped into a higher level category such as “early design.” The definition of role-based exchanges supports a variety of project delivery methods. Where possible, exchanges were aggregated into higher levels when appropriate.

Once each exchange was defined, the specific information needed down to the attribute-level of detail was described, leveraging the existing scope of the IFC data model where possible. While most product geometry information was already well-defined within IFC version 2x3 and implemented by many vendors, there were many concepts that required some of the lesser-supported IFC data structures and some that required the expanded MEP scope in IFC version 4 to achieve adequate levels of detail. There were also many cases of data constructs already in possible in the IFC schema but never detailed in the documentation – some examples of these include indicating multiple approved product types, ceiling grids for lighting layout, and indicating projected power usage at different times of day throughout a year. While realizing that many of these concepts were not supported by existing COTS software, the MVD has been defined to allow partial compliance for now, but with allowances to later relax or replace some requirements after testing models produced by existing software.

In detailing functional parts used within the model view, this project also contributed new concepts back to IFC4 that appeared to have wider uses in other disciplines (as IFC4 was not yet finalized at the time). For example, a functional part for generically mapping data to spreadsheets was

formalized to support common tables such as lighting schedules, while also supporting other Model View Definitions such as COBie; this functional part also involved advancing the parametric capability of IFC with the ability to generically reference object attributes. Similarly, as details on connections between equipment were elaborated, such uses also made their way into expanded port specifications within IFC4.

Once the Model View Definition was complete, IFC files were tested with the mvdXML electronic validation format and noted concepts that were supported by existing software and those requiring new functionality. There were some very basic limitations such as not capturing the physical building address, which is required for determining applicable codes and utilities, and more complex limitations such as detailing projected utility usage. In trying to find a balance that would encourage faster adoption by vendors, critical concepts were strongly enforced while others were relaxed by making certain attributes optional.

Going forward, the IFC4 release and supporting technology has provided for integrated Model View Definitions where the IFC specification and all published Model View Definitions will be made available online in an integrated form. This will enable developers of IFC to instantly cross-reference usage of entities across multiple model views and to define templates only once where they are re-used across model views. The supporting mvdXML technology provides for computer-interpretable validation, content filtering, sub-schema generation, and data adaptation. This enables new IFC software vendors to support information models with a substantially lower barrier of entry, and enables established software vendors with full IFC support to handle new Model View Definitions automatically without additional work. This Model View Definition is one of the first to leverage the growing ecosystem of mvdXML and has influenced the future direction of IFC with the various supporting concepts.

References

- East, E.W. 2007. Construction Operations Building Information Exchange (COBIE), Requirements Definition and Pilot Implementation Standard, ERDC/CERL TR-07-30, US Army Corps of Engineers, http://www.wbdg.org/pdfs/erdc_cerl_tr0730.pdf August 2007.
- East, E.W. 2012a. "Construction Operations Building Information Exchange (COBie)," <http://www.wbdg.org/resources/cobie.php> 6 August 2012.
- East, E.W. 2012b. "Electrical System information exchange (Sparkie)," <http://www.buildingsmartalliance.org/index.php/projects/activeprojects/178> 17 August 2012.
- East, E.W. 2012c. "Equipment Layout information exchange (ELie)," <http://www.buildingsmartalliance.org/index.php/projects/activeprojects/114> 17 August 2012.
- East, E.W., Danielle Love and Nicholas Nisbet. 2010. "A Life-Cycle Model for Contracted Information Exchange." *Proceedings of the CIB W78 2010: 27th International Conference –Cairo, Egypt, 16–18 November 2010.*
- East, E.W. "COBie Guide web page," National Institute of Building Sciences, accessed 19 June 2013, http://www.nibs.org/?page=bsa_cobieguide.
- Fallon, Kristine K. and Mark E. Palmer. 2007. *General Buildings Information Handover Guide: Principles, Methodology and Case Studies*. NISTIR 7417, National Institute of Standards and Technology, August 2007.
- Hietanen, J. 2008. IFC Model View Definition Format," http://www.iai-tech.org/downloads/accompanying_documents/formats/MVD_Format_V2_Proposal_080128.pdf.
- Wix, J., ed. 2007. "Information Delivery Manual: Guide to Components and Development Methods," http://www.iai.no/idm/idm_resources/idm_methods_guides/IDM2_Methodology_20071022.pdf.

REPORT DOCUMENTATION PAGE

Form Approved
OMB No. 0704-0188

Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing this collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden to Department of Defense, Washington Headquarters Services, Directorate for Information Operations and Reports (0704-0188), 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number. **PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS.**

1. REPORT DATE (DD-MM-YYYY) June 2013		2. REPORT TYPE Final		3. DATES COVERED (From - To)	
4. TITLE AND SUBTITLE Ontology for Life-Cycle Modeling of Electrical Distribution Systems: Model View Definition				5a. CONTRACT NUMBER CRADA-07-CERL-02	
				5b. GRANT NUMBER	
				5c. PROGRAM ELEMENT NUMBER 622784 T41	
6. AUTHOR(S) Tim Chipman, Kristine K. Fallon, Robert A. Feldman, Gregory Williams, and Omobolawa Fadojutimi				5d. PROJECT NUMBER	
				5e. TASK NUMBER	
				5f. WORK UNIT NUMBER	
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) Kristine Fallon Associates, Inc. 11 E. Adams Street, Suite 1100 Chicago, IL 60603				8. PERFORMING ORGANIZATION REPORT NUMBER	
9. SPONSORING / MONITORING AGENCY NAME(S) AND ADDRESS(ES) US Army Engineer Research and Development Center Construction Engineering Research Laboratory P.O. Box 9005 Champaign, IL 61826-9005				10. SPONSOR/MONITOR'S ACRONYM(S) ERDC-CERL	
				11. SPONSOR/MONITOR'S REPORT NUMBER(S) ERDC/CERL CR-13-2	
12. DISTRIBUTION / AVAILABILITY STATEMENT Approved for public release; distribution is unlimited.					
13. SUPPLEMENTARY NOTES					
14. ABSTRACT <p>Previous efforts by the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) to develop a life-cycle building model have resulted in the definition of a "core" building information model that contains general information describing facility assets such as spaces and equipment. To describe how facility assets (i.e., components) function together, information about assemblies of assets and their connections must also be defined. The definitions of assets, assemblies, and connections for the various building-information domains are discipline-specific.</p> <p>The work documented here addresses the process flow and data exchange requirements for the design of electrical distribution systems in typical Army facilities. This ontology advances the state of the art by defining an Industry Foundation Class (IFC) Model View for electrical system design supporting end users in developing compliant BIM models suggesting potential areas of automation in electrical system design.</p>					
15. SUBJECT TERMS information exchange, electrical systems, product data templates, guide specifications, Construction Operations Building information exchange (COBie), Building Information Modeling (BIM)					
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT	18. NUMBER OF PAGES	19a. NAME OF RESPONSIBLE PERSON
a. REPORT Unclassified	b. ABSTRACT Unclassified	c. THIS PAGE Unclassified			19b. TELEPHONE NUMBER (include area code)