

AD-A142 685


NATIONAL PROGRAM FOR INSPECTION OF NON-FEDERAL DAMS  
MIANUS FILTER PLANT D..(U) CORPS OF ENGINEERS WALTHAM  
MA NEW ENGLAND DIV FEB 80


1/2

UNCLASSIFIED

F/G 13/13

NL

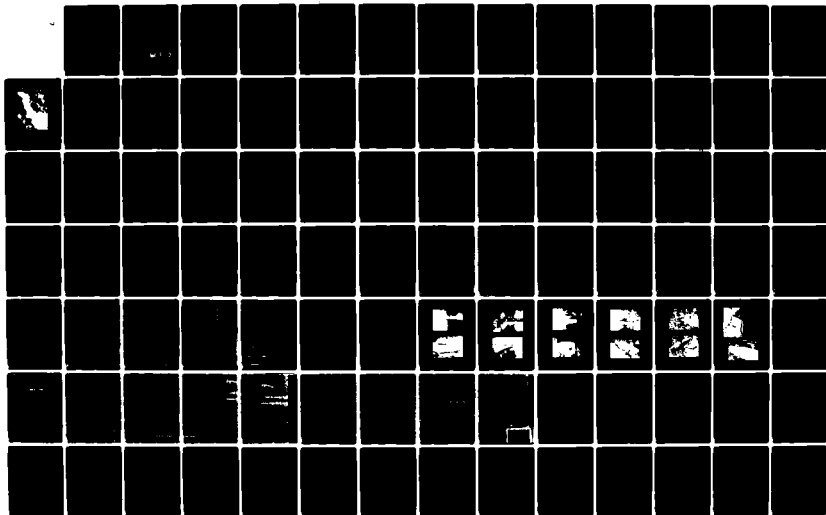

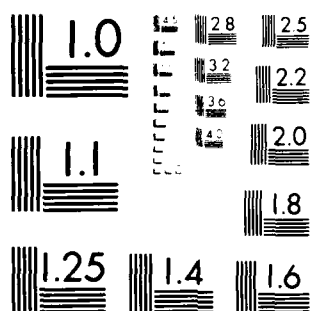

MICROCOPY RESOLUTION TEST CHART  
 NATIONAL BUREAU OF STANDARDS-1963-A

1

**SOUTHWESTERN COASTAL BASIN  
GREENWICH, CONNECTICUT**

AD-A142 685

**MIANUS FILTER PLANT DAM  
CT 00040**

**PHASE 1 INSPECTION REPORT  
NATIONAL DAM INSPECTION PROGRAM**



**DTIC**  
**ELECTE**  
JUL 05 1984  
**S E D**

DTIC FILE COPY

**DEPARTMENT OF THE ARMY  
NEW ENGLAND DIVISION, CORPS OF ENGINEERS  
WALTHAM, MASS.**

**FEBRUARY, 1980**

This document has been approved  
for public release and sale; its  
distribution is unlimited.

84 07 02 039

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER CT 00040	2. GOVT ACCESSION NO. Ab A142 685	3. RECIPIENT'S CATALOG NUMBER
4. TITLE (and Subtitle) Southwestern Coastal Basin Greenwich, Conn., Mianus Filter Plant Dam NATIONAL PROGRAM FOR INSPECTION OF NON-FEDERAL DAMS		5. TYPE OF REPORT & PERIOD COVERED INSPECTION REPORT
7. AUTHOR(s) U.S. ARMY CORPS OF ENGINEERS NEW ENGLAND DIVISION		6. PERFORMING ORG. REPORT NUMBER
9. PERFORMING ORGANIZATION NAME AND ADDRESS		8. CONTRACT OR GRANT NUMBER(s)
11. CONTROLLING OFFICE NAME AND ADDRESS DEPT. OF THE ARMY, CORPS OF ENGINEERS NEW ENGLAND DIVISION, NEDED 424 TRAPELO ROAD, WALTHAM, MA. 02254		10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS
14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office)		12. REPORT DATE February 1980
		13. NUMBER OF PAGES 79
		15. SECURITY CLASS. (of this report) UNCLASSIFIED
		15a. DECLASSIFICATION/DOWNGRADING SCHEDULE
16. DISTRIBUTION STATEMENT (of this Report) APPROVAL FOR PUBLIC RELEASE: DISTRIBUTION UNLIMITED		
17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report)		
18. SUPPLEMENTARY NOTES Cover program reads: Phase I Inspection Report, National Dam Inspection Program; however, the official title of the program is: National Program for Inspection of Non-Federal Dams; use cover date for date of report.		
19. KEY WORDS (Continue on reverse side if necessary and identify by block number) DAMS, INSPECTION, DAM SAFETY, Southwestern Coastal Basin, Greenwich, Conn. Mianus Filter Plant Dam		
20. ABSTRACT (Continue on reverse side if necessary and identify by block number) The dam at the Mianus Filter Plant is a stone masonry dam built in the 1870's and is a source of water supply for the surrounding area. The water treatment facility was renovated in 1954. The dam is approx. 130 ft. long, 31 ft. high and has a top width of 7 ft. The outlet works for the dam consist of a 65 ft. long spillway, a 30 inch supply main to the water treatment facility, a low level blowoff, and two 4 ft. wide by 5 ft. high flood control gates.		



DEPARTMENT OF THE ARMY  
NEW ENGLAND DIVISION, CORPS OF ENGINEERS  
424 TRAPELO ROAD  
WALTHAM, MASSACHUSETTS 02154

REPLY TO  
ATTENTION OF  
NEDED

MAR 21 1980

Honorable Ella T. Grasso  
Governor of the State of Connecticut  
State Capitol  
Hartford, Connecticut 06115

Dear Governor Grasso:

Inclosed is a copy of the Mianus Filter Plant Dam Phase I Inspection Report, which was prepared under the National Program for Inspection of Non-Federal Dams. This report is presented for your use and is based upon a visual inspection, a review of the past performance and a brief hydrological study of the dam. A brief assessment is included at the beginning of the report. I have approved the report and support the findings and recommendations described in Section 7 and ask that you keep me informed of the actions taken to implement them. This follow-up action is a vitally important part of this program.

A copy of this report has been forwarded to the Department of Environmental Protection, the cooperating agency for the State of Connecticut. In addition, a copy of the report has also been furnished the owner, Connecticut American Water Company, Greenwich, Connecticut.

Copies of this report will be made available to the public, upon request, by this office under the Freedom of Information Act. In the case of this report the release date will be thirty days from the date of this letter.

I wish to take this opportunity to thank you and the Department of Environmental Protection for your cooperation in carrying out this program.

Sincerely,

  
MAX B. SCHEIDER

Colonel, Corps of Engineers  
Division Engineer

Incl  
As stated

**SOUTHWESTERN COASTAL BASIN**

**GREENWICH, CONNECTICUT**

**MIANUS FILTER PLANT DAM**

**CT 00040**

Accession For	
NTIS GRA&I	<input checked="checked" type="checkbox"/>
DTIC TAB	<input type="checkbox"/>
Unannounced	<input type="checkbox"/>
Justification	
By	
Distribution/	
Availability Codes	
Dist	Avail and/or Special



**PHASE I INSPECTION REPORT**

**NATIONAL DAM INSPECTION PROGRAM**

# NATIONAL DAM INSPECTION PROGRAM

## PHASE I - INSPECTION REPORT

Identification No.: CT 00040

Name of Dam: Mianus Filter Plant Dam

Town: Greenwich, Connecticut

County and State: Fairfield County, Connecticut

Stream: Mianus River

Date of Inspection: November 13, 1979

### BRIEF ASSESSMENT

The dam at the Mianus Filter Plant is a stone masonry dam built in the 1870s and is a source of water supply for the surrounding area. The water treatment facility was renovated in 1954. The dam is approximately 130 feet long, 31 feet high and has a top width of 7 feet. The outlet works for the dam consist of a 65 foot long spillway, a 30 inch supply main to the water treatment facility, a low level blowoff, and two 4 foot wide by 5 foot high flood control gates.

Based on the visual inspection, the review of the 1954 renovation plans and past operational performance, the dam is judged to be in FAIR condition. However, there is a concern about the seepage zone at the downstream face of the dam, which requires further study.

The dam is classified as *SMALL* in size and a *HIGH* hazard potential structure in accordance with recommended guidelines established by the Corps of Engineers. The test flood for this dam is 1/2 the Probable Maximum Flood (PMF). The test flood has an outflow discharge equal to 14100 cfs and will overtop the dam in a stillwater condition. The maximum outflow capacity of the spillway under stillwater condition is 680 cfs which represents approximately 5 percent of the test flood.

It is recommended that the owner take the following actions: Monitor the seepage on the downstream face, remove the trees from the upstream channel bed and develop and implement a formal emergency warning system.

Recommendations and remedial measures that should be implemented by the Owner within one year period after receipt of this Phase I Inspection Report, are further described in Section 7.

JAMES P. PURCELL ASSOCIATES, INC.

Sudhir A. Shah

Sudhir A. Shah, P.E.  
Vice-President  
Connecticut P.E. No. 8012





This Phase I Inspection Report on Mianus Filter Plant Dam has been reviewed by the undersigned Review Board members. In our opinion, the reported findings, conclusions, and recommendations are consistent with the Recommended Guidelines for Safety Inspection of Dams, and with good engineering judgment and practice, and is hereby submitted for approval.

Carney M. Terzian

CARNEY M. TERZIAN, MEMBER  
Design Branch  
Engineering Division

Richard J. DiBuono

RICHARD DIBUONO, MEMBER  
Water Control Branch  
Engineering Division

Aramast Mahtesian

ARAMAST MAHTESIAN, CHAIRMAN  
Foundation & Materials Branch  
Engineering Division

APPROVAL RECOMMENDED:

Joe B. Fryar

JOE B. FRYAR  
Chief, Engineering Division

## PREFACE

**This report is prepared under guidance contained in the Recommended Guidelines for Safety Inspection of Dams, for Phase I Investigations. Copies of these guidelines may be obtained from the Office of Chief of Engineers, Washington, D.C. 20314. The purpose of a Phase I Investigation is to identify expeditiously those dams which may pose hazards to human life or property. The assessment of the general condition of the dam is based upon available data and visual inspections. Detailed investigation, and analyses involving topographic mapping, subsurface investigations, testing, and detailed computational evaluations are beyond the scope of a Phase I Investigation. However, the investigation is intended to identify any need for such studies.**

**In reviewing this report, it should be realized that the reported condition of the dam is based on observations of field conditions at the time of inspection along with data available to the inspection team. In cases where the reservoir was lowered or drained prior to inspection, such action, while improving the stability and safety of the dam, removes the normal load on the structure and may obscure certain conditions which might otherwise be detectable if inspected under the normal operating environment of the structure.**

**It is important to note that the condition of a dam depends on numerous and constantly changing internal and external conditions, and is evolutionary in nature. It would be incorrect to assume that the present condition of the dam will continue to represent the condition of the dam at some point in the future. Only through continued care and inspection can there be any chance that unsafe conditions be detected.**

**Phase I inspections are not intended to provide detailed hydrologic and hydraulic analyses. In accordance with the established Guidelines, the spillway test flood is based on the estimated "Probable Maximum Flood" for the region (greatest reasonably possible storm runoff), or fractions thereof. Because of the magnitude and rarity of such a storm event, a finding that a spillway will not pass the test flood should not be interpreted as necessarily posing a highly inadequate condition. The test flood provides a measure of relative need for more detailed hydrologic and hydraulic studies, considering the size of the dam, its general condition and downstream damage potential.**

**The Phase I Investigation does not include an assessment of the need for fences, gates, no-trespassing signs, repairs to existing fences and railings and other items which may be needed to minimize trespass and provide greater security for the facility and safety to the public. An evaluation of the project for compliance with OSHA rules and regulations is also excluded.**

## TABLE OF CONTENTS

Section	Page
Letter of Transmittal	
Brief Assessment	
Review Board Page	
Preface	i
Table of Contents	ii- v
Overview Photo	vi
Location Map	vii

## REPORT

### 1. PROJECT INFORMATION

1.1 General	1
a. Authority	
b. Purpose of Inspection	
1.2 Description of Project	1
a. Location	
b. Description of Dam and Appurtenances	
c. Size Classification	
d. Hazard Classification	
e. Ownership	
f. Operator	
g. Purpose	
h. Design and Construction History	
i. Normal Operational Procedure	

1.3 Pertinent Data	3
--------------------	---

### 2. ENGINEERING DATA

2.1 Design	8
------------	---

## TABLE OF CONTENTS (CONT'D)

Section	Page
2.2 Construction	8
2.3 Operation	8
2.4 Evaluation	8
3. VISUAL INSPECTION	
3.1 Findings	9
a. General	
b. Dam	
c. Appurtenant Structures	
d. Reservoir Area	
e. Downstream Channel	
3.2 Evaluation	11
4. OPERATIONAL AND MAINTENANCE PROCEDURES	
4.1 Operational Procedures	12
a. General	
b. Description of any Warning System in Effect	
4.2 Maintenance Procedures	12
a. General	
b. Operating Facilities	
4.3 Evaluation	12
5. EVALUATION OF HYDRAULIC/HYDROLOGIC FEATURES	
5.1 General	13
5.2 Design Data	13
5.3 Experience Data	13

## TABLE OF CONTENTS (CONT'D)


Section	Page
5.4 Test Flood Analysis	13
5.5 Dam Failure Analysis	14
6. EVALUATION OF STRUCTURAL STABILITY	
6.1 Visual Observation	16
6.2 Design and Construction Data	16
6.3 Post Construction Changes	16
6.4 Seismic Stability	3
7. ASSESSMENT, RECOMMENDATIONS AND REMEDIAL MEASURES	
7.1 Dam Assessment	17
a. Condition	
b. Adequacy of Information	
c. Urgency	
7.2 Recommendations	17
7.3 Remedial Measures	17
a. Operation and Maintenance Procedures	
7.4 Alternatives	18
APPENDIXES	
APPENDIX A - INSPECTION CHECKLIST	A-1
APPENDIX B - ENGINEERING DATA	B-1
APPENDIX C - PHOTOGRAPHS	C-1

## TABLE OF CONTENTS (CONT'D)

Section	Page
APPENDIX D - HYDROLOGIC AND HYDRAULIC COMPUTATIONS	D-1
APPENDIX E - INFORMATION AS CONTAINED IN THE NATIONAL INVENTORY OF DAMS	E-1



• **PROFESSOR** **DR. J. H. J. VAN DIJK** is a senior research fellow at the Institute of Social Studies, The Hague, The Netherlands. He is also a senior research fellow at the Center for the Study of Democracy, University of Toronto, Canada.

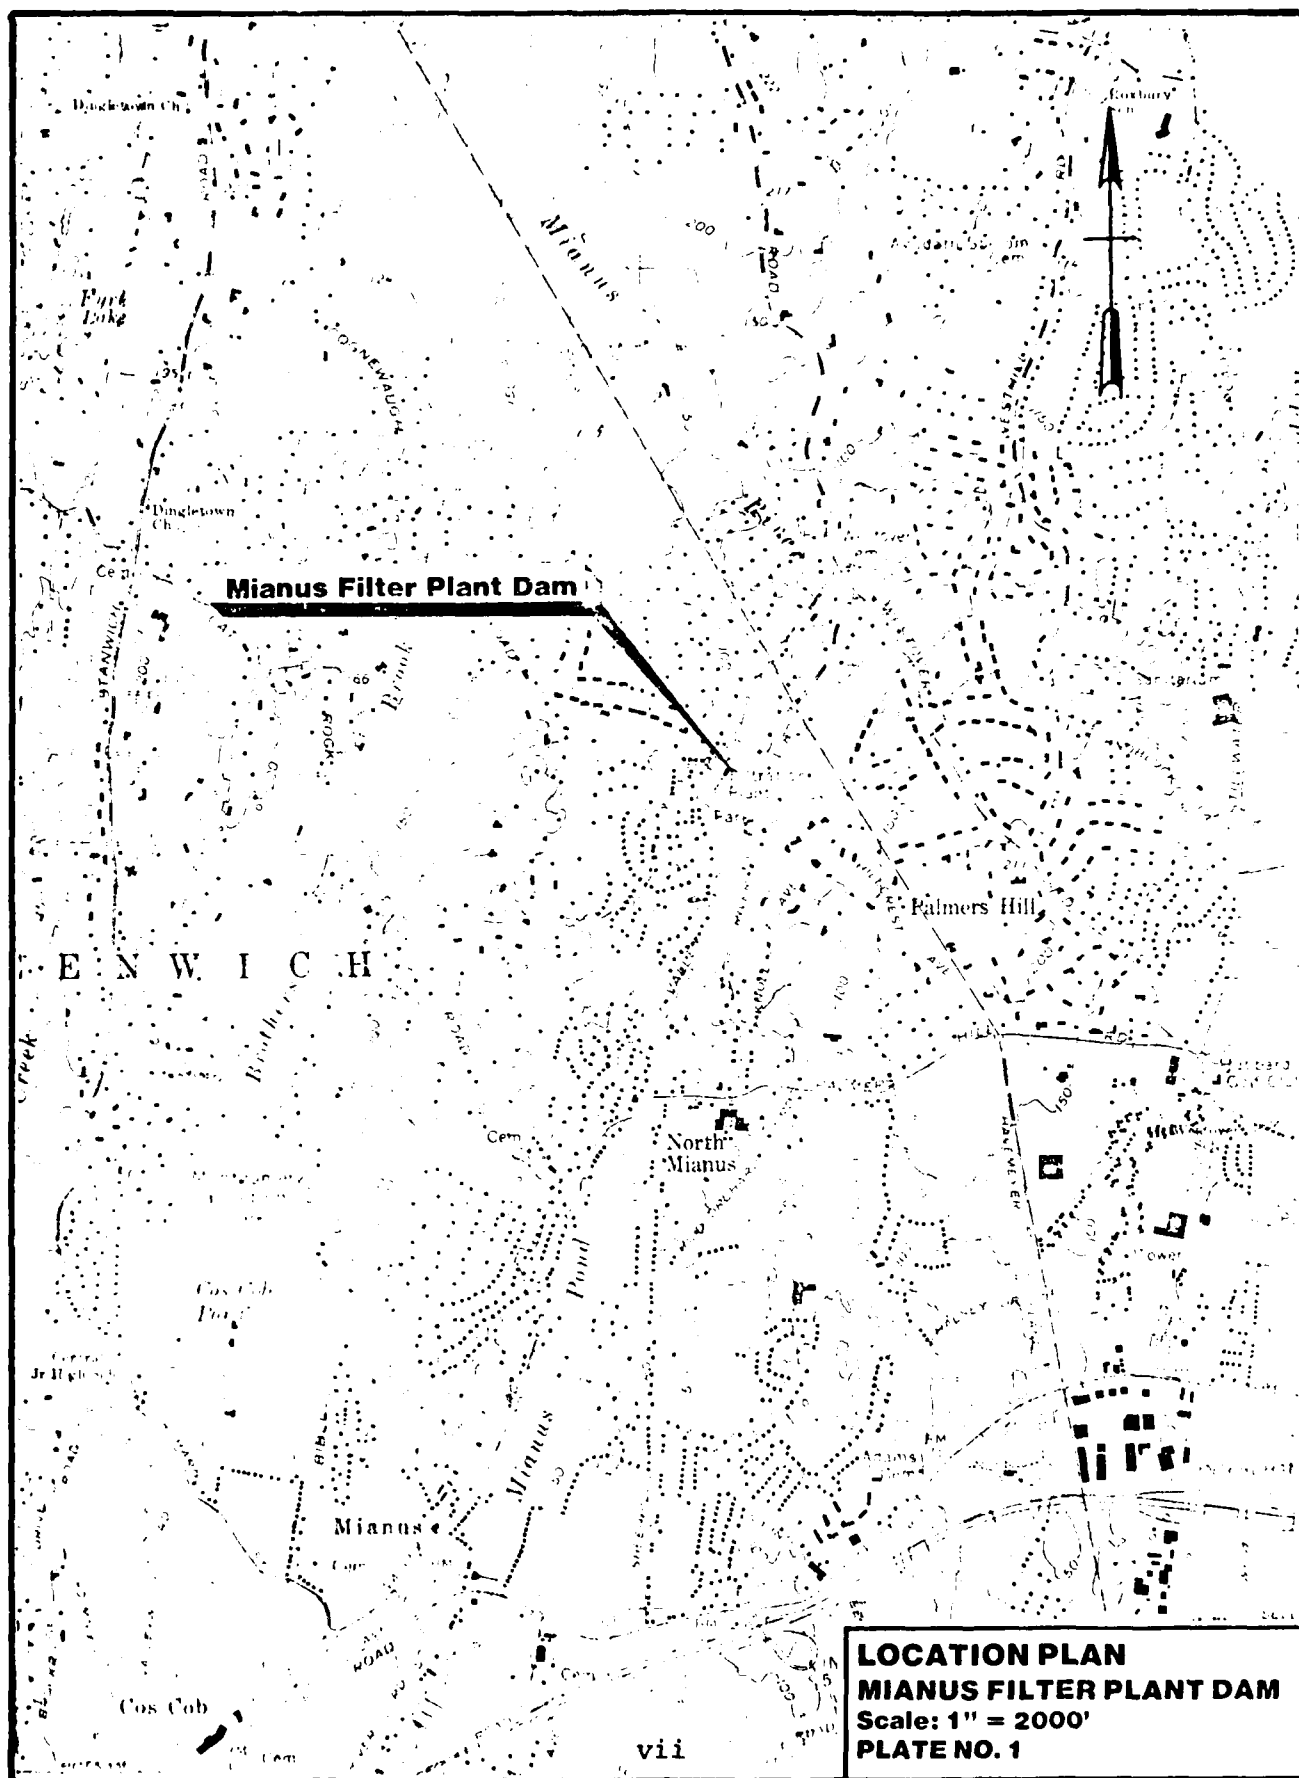



# **NATIONAL DAM INSPECTION PROGRAM**

## **PHASE I - INSPECTION REPORT**

**NAME OF DAM: MIANUS FILTER PLANT DAM**

### **SECTION 1**

#### **PROJECT INFORMATION**

##### **1.1 General**

- a. **Authority:** Public Law 92-367, August 8, 1972, authorized the Secretary of the Army through the Corps of Engineers to initiate a national program of dam inspection throughout the United States. The New England Division of the Corps of Engineers has been assigned the responsibility of supervising the inspection of dams within the New England Region. James P. Purcell Associates, Inc. has been retained by the New England Division to inspect and report on *selected dams in the State of Connecticut*. Authorization and notice to proceed was issued to James P. Purcell Associates, Inc., under a letter from William E. Hodgson, Jr., Colonel, Corps of Engineers. Contract No. DACW33-80-C-0002 has been assigned by the Corps of Engineers for this work.
- b. **Purpose of Inspection**
  - 1. Perform technical inspection and evaluation of non-Federal dams to identify conditions which threaten the public safety and thus permit correction in a timely manner by non-Federal interests.
  - 2. Encourage and prepare the States to initiate quickly, effective dam safety programs for non-Federal dams.
  - 3. To update, verify and complete the National Inventory of Dams.

##### **1.2 Description of Project**

- a. **Location:** Mianus Filter Plant Dam is located in Fairfield County, Connecticut, approximately 0.8 miles north of North Mianus, Connecticut. The dam impounds water from the Mianus River and is located approximately 4000 feet upstream of Mianus Pond and the Village of North Mianus.

The impoundment is situated in a north/south direction, with the dam located at the southern end. Latitude 41°-04'-06", longitude 73°-34'-42".

All elevations used in this report are based on the Greenwich Water Company Datum (GWCD) unless noted. The datum is 7.29 feet above the U. S. Coast and Geodetic Survey mean low water datum.

- b. **Description of Dam and Appurtenances:** This dam impounds water from the Mianus River which is processed through the filtration plant and distributed to many customers in the surrounding area. The dam itself consists of stone masonry body and was believed to have been built approximately 100 years ago.

The outlet works for the dam consist of the following: A 30 inch pipe, controlled by a lift mechanism on the dam's west crest, for water supply to the filters; a low level blowoff controlled by a lift mechanism on the dam's west crest; two high level flood gates on the dam's east crest; and a 65 foot spillway.

The dam creates a narrow impoundment by flooding a portion of the natural valley of the Mianus River.

- c. **Size Classification:** The size classification of this dam is SMALL as per the criteria set forth in Recommended Guidelines for Safety Inspection of Dams by the Corps of Engineers. The impoundment storage at the top of the dam is 118 ac-ft (with the range 50 to 1000 ac-ft), and the maximum height of the dam is 31 feet (within the range 25 to 40 feet). The size classification is based on both the height and storage criteria.
- d. **Hazard Classification:** The hazard classification of this dam is HIGH as per the criteria set forth in Recommended Guidelines for Safety Inspection of Dams by the Corps of Engineers. Failure discharge can result in the loss of more than a few lives, and cause damage to residential structures along the downstream channel; and loss of the water supply would impose hardships on the service area. The estimated water depth due to a dam failure may range from 9.0 feet at the dam to 4.5 feet at Mianus Pond.
- e. **Ownership:** This dam is owned and operated by the Connecticut American Water Company.
- f. **Operator:** The person in charge of the day-to-day maintenance of the dam as well as the adjacent water treatment plant is:

Mr. William McCormick, Superintendent  
Connecticut American Water Company  
125 East Putnam Avenue  
Greenwich, Connecticut 06830  
Tel. (203) 869-5200  
(203) 661-7200

- g. **Purpose:** This dam impounds water from the Mianus River that is used to supply drinking water to approximately 13,000 customers in the surrounding area.
- h. **Design and Construction History:** The original dam was built in the 1870s. However, there are no documents available to support either the design or construction. In the 1950s when the filter plant was renovated, modifications to the blowoff system and intake piping were made, and this involved some construction to the body of the dam. It is not clear just what work was done to the dam body to make these renovations. During this renovation period the retaining walls along the downstream channel were built to accommodate the new plant facility.
- i. **Normal Operational Procedure:** The operating procedure for controlling the water level of the dam's pond is governed primarily by the water supply demands of the treatment plant. The emergency blowoff valves and flood gates are rarely used, because in the case of a storm emergency the gates would handle such a relatively small amount of the flow. An agreement with adjacent property owners requires a flow of one MGD to be discharged downstream and, therefore, a 4 inch gate valve at the flood gates is maintained in an open position.

### 1.3 Pertinent Data

- a. **Drainage Area:** Mianus Filter Plant Dam is located in Fairfield County, Connecticut. The dam lies just north of North Mianus, approximately 0.8 miles. The basin is generally rectangular in shape with a length of 11.9 miles and an average width of 4 miles, resulting in a total drainage area of 29.9 square miles. (See Drainage Basin Map in Appendix D). The topography is generally rolling to moderate terrain, with elevations ranging from a high of 810 to 69.65 at the spillway crest. Stream and basin slopes are flat to moderate, having average grades of 0.5 percent to 2.0 percent, respectively. The normal water surface area is 7.2 acres which is approximately 0.04 percent of the watershed.
- b. **Discharge at Dam Site:** Daily spillway discharge records are available from the Connecticut American Water Company. Listed below are calculated discharge values for the spillway and outlet works.

1. **Outlet Works:** A low level blowoff with an intake approximately at elevation 44.5 and a discharge capacity of 74 cfs at an elevation of 69.65, the spillway crest. Twin 4 foot wide by 5 foot high flood gates with an invert at elevation 65.15 and a discharge capacity of 206 cfs with water at the spillway crest level.
2. **Maximum known flood at dam site:** Recorded on June 19, 1972 to be in excess of 310 cfs (upper limit of flow recorder).
3. **Spillway capacity at top of dam:** 680 cfs at elevation 72.15 (east side).
4. **Spillway capacity at test flood:** 7650 cfs at elevation 82.2.
5. **Gated outlet capacity at normal pool elevation:** 74 cfs (blowoff) and 206 cfs (flood gates) at elevation 69.65.
6. **Gated outlet capacity at test flood elevation:** 92 cfs (blowoff) and 850 cfs (flood gates) at elevation 82.20.
7. **Gated outlet capacity at top of dam elevation:** 80 cfs (blowoff) and 410 (flood gates) at elevation 72.15.
8. **Total project discharge at top of dam:** 1,170 cfs at elevation 72.15 (east side).
9. **Total project discharge at test flood elevation:** 8590 cfs at elevation 82.20

**c. Elevation (Feet above GWCD)**

1. Streambed at toe of dam	41.6
2. Bottom of cutoff	Unknown
3. Maximum tailwater	Unknown
4. Recreation pool	N/A
5. Full flood control pool	N/A
6. Spillway crest	69.65
7. Design surcharge (Original Design)	Unknown

8.	Top of dam	72.15 east, 74.70 west
9.	Test flood level	82.20
d.	<b>Reservoir (Length in feet)</b>	
1.	Normal pool	1000
2.	Flood control pool	N/A
3.	Spillway crest pool	1000
4.	Top of dam	1000
5.	Test flood pool	2500
e.	<b>Storage (acre-feet)</b>	
1.	Normal pool	101
2.	Flood control pool	N/A
3.	Spillway crest pool	101
4.	Top of dam	118
5.	Test flood pool	419
f.	<b>Reservoir Surface (acres)</b>	
1.	Normal pool	7.2
2.	Flood control pool	N/A
3.	Spillway crest	7.2
4.	Test flood pool	60+
5.	Top of dam	7.6
g.	<b>Dam</b>	
1.	Type	Stone masonry

- |   |                 |  |
|---|-----------------|--|
| 2.  | Length          | 130 feet   |
| 3.  | Height          | 28 feet at spillway  |
| 4.  | Top Width       | 7 feet   |
| 5.  | Side Slopes     | Upstream: 1H:10V<br>Downstream: 1H:10V   |
| 6.  | Zoning          | Unknown  |
| 7.  | Impervious Core | Unknown  |
| 8.  | Cutoff          | Unknown  |
| 9.  | Grout curtain   | Unknown  |
| 10.                                       | Other           | Concrete weir located downstream   |
| <b>h. Diversion and Regulating Tunnel</b> |                 | N/A  |
| <b>i. Spillway</b>                        |                 |  |
| 1.  | Type            | Overflow, broad crested, uncontrolled weir   |
| 2.  | Length of weir  | 65 feet  |
| 3.  | Crest elevation | 69.65  |
| 4.  | Gates           | None   |
| 5.  | U/S Channel     | Natural Bed  |
| 6.  | D/S Channel     | Stone retaining wall on right side extending 500 ft. downstream of dam. Channel and left bank are natural. |
| <b>j. Regulating Outlets:</b>             |                 | Refer to Paragraph 1.2b "Description of Dam and Appurtenances" for description of outlet works.            |

1. 30 inch cast iron supply main, intake at elevation 49.75, sluice gate controlled by lift mechanism on top of dam.
2. Low level blowoff, intake at elevation 44.5, 24 inch sluice gate controlled by lift mechanism on top of dam.
3. Two 4 foot wide by 5 foot high flood gates, intakes at elevation 65.15, controlled by lift mechanisms on top of dam.

## **SECTION 2**

### **ENGINEERING DATA**

#### **2.1 Design**

There is no formal design data available for the dam both in terms of stability analysis or spillway capacity. Available design data consists of plans of the 1954 renovations to the sluice gates and water treatment facilities.

#### **2.2 Construction**

The years of construction appear to have been in the 1870s, although the exact date is unknown. Review of the contract plans for the 1954 renovation showed that the modifications to the body of the dam appear to be limited to the supply pipes and flood gates. The retaining walls in the downstream channel were also repaired. However, no records or photographs were available of this work.

#### **2.3 Operation**

The operation of the dam is for the purpose of water supply, and, therefore, the water level for this dam is established on the basis of the water supply demand. However, there is no written procedure that has been established for this purpose.

#### **2.4 Evaluation**

- a. **Availability:** The information concerning this dam was gathered only by field investigation and meetings with officials of the Connecticut American Water Company.
- b. **Adequacy:** The lack of in depth engineering did not allow a definitive review. Therefore, the adequacy of this dam could not be assessed from the standpoint of reviewing design and construction data, but is based primarily on the visual inspection, the dam's past performance, and sound engineering judgment.
- c. **Validity:** The validity of the limited information available must be verified.



## SECTION 3

### VISUAL INSPECTION

#### 3.1 Findings

- a. **General:** The visual inspection was conducted on November 13, 1979 and a copy of the visual inspection check list is contained in Appendix A of this report. The following procedure was used:

1. Inspection of the upstream area of the river which was impounded by the dam.
2. Visual survey of the face of the dam and spillway for cracks, loose stones, etc.
3. Review of the condition of the top of the dam for cracking, spalling or loose stones.
4. Survey of the process used by the water treatment plant as well as emergency procedures that could be used.
5. Check of the downstream area for seepage, piping, boils, or other distressed areas.
6. Photographs of the general area of the dam and of specific items of note were taken during the inspection, and are contained in Appendix C of this report.

Before the inspection, the design and construction documents and aerial photographs were studied and reviewed.

b. **Dam**

1. **Crest:** The top of the dam is constructed of granite stone and shows no evidence of settlement or misalignment. Grass is growing from joints on the east side. A concrete capped stone block platform, just upstream of the dam's west crest supports the lift mechanisms for the supply main and the blowoff (Photo C-7).
2. **Upstream Slope:** The upstream slope is stone masonry with a nearly vertical face above the water level. The joints are in a deteriorated condition. The flood gates are on the upstream face on the east side of the dam (Photo C-5).

3. **Downstream Slope:** The downstream slope is also stone masonry with a nearly vertical face. There are numerous places where seepage is steady on the face of each abutment (Photos C-8, 9). The condition of the joints is quite poor (Photo C-9) and one joint on the west abutment has a void which measures 18 inches deep (Photo C-10). A few loose stones were noted on the east abutment and grass was growing from some of the joints. The fill on the downstream face of the west abutment seemed to be quite moist, indicating that seepage occurs below grade as well as above.

**c. Appurtenant Structures**

1. **Spillway:** The spillway for the dam is a 65 foot long stone capped weir with a free drop of approximately 28 feet to the tailwater (Photos C-2, 4). The water level on the day of inspection was 30 inches below the east top of the dam and water was flowing over the spillway. The spillway appears to be in generally good condition.
  2. **30 Inch Supply Main:** This pipe extends from a sluice gate inlet below the west top of the dam to the filters located downstream on the west bank. The lift mechanism, located on the dam's west crest is reportedly operable (Photo C-7). A 20 inch and a 6 inch blowoff to the river (Photo C-12) is located off the 30 inch pipe in a covered valve chamber on the west bank downstream of the dam. The valves for the blowoffs are hydraulically controlled from inside the filter plant building but have not been operated for at least 6 years. Steady flow (5-10 GPM) from the ground to the floor of the valve chamber was noted. This reportedly has been constant since before the 1954 renovations.
  3. **Low Level Blowoff:** The blowoff is controlled by a 24 inch sluice gate below the dam's west crest and is operated by a lift mechanism on the top of the dam (Photo C-7). The conduit extends through the base of the dam to a 4 foot square opening in the face of the dam at the tailwater level. It was last operated in the summer of 1979.
  4. **Twin Flood Gates:** Two flood gates are located below the dam's east crest at a shallow level (Photos C-5, 6). They are controlled by lift mechanisms on the top of the dam and appear in good condition. A 4 inch gate valve at the base of the flood gates is maintained in an open condition as per an agreement with adjacent homeowners. A natural, rock discharge channel rejoins the Mianus River just downstream of the dam.
- d. Reservoir Area:** The dam creates an impoundment extending upstream in the natural riverbed. The upstream sides of the river seemed to be in a natural state

with no visible signs of erosion or sloughing. There were two trees in the riverbed that the maintenance personnel are trying to have removed, but some difficulty was noted (Photo C-1). Concern was expressed that during a heavy storm these trees could be a problem.

No geologic features were detected that could be expected to adversely affect the dam or appurtenant structures.

Trespassing on the dam is not permitted and the proximity of personnel in the adjacent filter plant building reduces the potential for trespassing.

- e. **Downstream Channel:** The spillway and downstream channel retaining walls appear to be founded on bedrock and are generally in fair condition (Photo 11). Some trees overhang the west side of the channel and access to this side is difficult. There is a metering weir about 440 feet downstream of the spillway which appears to be in good condition. On the right side of the spillway channel just below the face of the dam there are some holes behind the retaining walls noted. The cause is unknown; however, it appeared to be related to erosion.

### **3.2 Evaluation**

Based on the visual inspection, the Mianus Filter Plant Dam appears to be in fair condition and there are specific areas of concern that should be addressed:

The leakage on the downstream face and slope.

The missing mortar and holes on the faces of the dam.

The trees in the upstream channel bed.

## **SECTION 4**

### **OPERATIONAL AND MAINTENANCE PROCEDURES**

#### **4.1 Operational Procedures**

- a. **General:** The responsibility for the operation and maintenance of this facility is with the Connecticut American Water Company. The maintenance staff is headquartered at the water treatment facility which is adjacent to the dam site. These staff personnel operate and maintain the valves and equipment for the water treatment facility. Operation of the valves is in general for the sole purpose of regulating the water supply to the plant. No written procedure is available for emergency operation of the blowoff system, but one is now being written. The last time the hydraulic 20 inch blowoff to the 30 inch supply main was opened was 6 to 10 years ago.
- b. **Description of Any Warning System in Effect:** There is no warning system in effect.

#### **4.2 Maintenance Procedures**

- a. **General:** The maintenance of the dam is centered around those valves and sluice gates that supply water to the filtration plant. The downstream face of the dam has recently been cleared of vegetation. The water has never been drawn down so that the upstream face of the spillway could be inspected or repaired.
- b. **Operating Facilities:** The operation facilities consist of two flood gates on the left abutment, one low level blowoff, and one sluice gate which controls the raw water to the filtration plant.

#### **4.3 Evaluation**

The operation and maintenance of this dam could be oriented so that it more directly deals with the emergency procedure to be followed in case of a heavy storm.

## **SECTION 5**

### **EVALUATION OF HYDRAULICS/HYDROLOGIC FEATURES**

#### **5.1 General**

The Mianus Filter Plant Dam, built across the Mianus River, creates a narrow impoundment with a total storage capacity of 101 ac.-ft. at elevation 69.65, the spillway crest. Each foot of depth in the pond above the spillway crest can accommodate approximately 7.5 ac.-ft. The spillway is a 65 foot long by 7 foot wide broad crested weir. Stream and basin slopes are flat to moderate having average grades of 0.5 percent to 2.0 percent.

#### **5.2 Design Data**

- a. No specific design data is available for this watershed or the structures of the Mianus Filter Plant Dam. In lieu of existing design information, U.S.G.S. Topographic Maps (Scale 1" = 2000') were utilized to develop hydrologic parameters such as drainage areas, reservoir surface areas, basin lengths, time of concentration and other runoff characteristics. Elevation - storage relationships for the reservoir were approximated. Surcharge storage was computed using the U.S.G.S. maps. Some of the pertinent hydraulic design data was obtained and/or confirmed by actual field measurements at the time of the visual field inspection.
- b. Outflow values (routing procedures) and dam overtopping analysis were computed in accordance with the guidelines developed by the Corps of Engineers. Judgment was used in calculating final values outlined in this report, which are quite approximate and should not be considered a substitute for actual detailed analysis.

#### **5.3 Experience Data**

Historical Data for recorded discharges is limited and consists of records obtained since 1955 from a small measurement weir 440 feet downstream of the dam. The recent maximum discharge occurred on June 19, 1972 when the flow was in excess of 310 cfs (200 MGD), the upper range of the flow recorder.

#### **5.4 Test Flood Analysis**

Recommended guidelines for the Safety Inspection of Dams by the Corps of Engineers were used for the selection of the "Test Flood". This dam is classified as

a HIGH hazard and SMALL size structure. Guidelines indicate that 1/2 to 1 times Probable Maximum Flood (PMF) be used as the test flood for these classifications. A test flood of 1/2 PMF was chosen because the dam's height and impoundment storage are on the low side of the small size category. The watershed has a total area of 29.9 square miles. Snyder's lag was calculated to be 7.55 hours and a Snyder peaking coefficient of 0.625 was used. The 200 square mile - 24 hour probable maximum precipitation (PMP) is 22 inches. The flood hydrograph package, HEC-1 computer program, developed by the Corps of Engineers, was utilized to develop the inflow hydrograph, route the flood through the reservoir, and for the dam overtopping analysis. A test flood inflow was calculated to be 14200 cfs. The spillway was assumed to be the only outlet operating at the time of the flood, with the initial water level at the spillway crest.

The spillway capacity is hydraulically inadequate to pass the test flood (1/2 PMF) and overtopping of the dam will occur. The maximum outflow capacity of the spillway without overtopping the dam is 680 cfs. This corresponds to 5 percent of the test flood and a storage above the spillway level of 17 ac.-ft. The maximum outflow discharge value for the test flood is 14100 cfs corresponding to a depth of flow over the top of the dam of 7.5 feet and a storage above the spillway level of 318 ac.-ft. A spillway rating curve, outlet works (low level blowoff and flood gates) rating curves, and a reservoir surface area-capacity curve are included in Appendix D of this report.

At the spillway crest elevation of 69.65, the capacity of the low level blowoff is 74 cfs, and the capacity of flood gates is 206 cfs. It will require approximately .4 hours to lower the water level the first foot assuming a water surface area of 7.2 acres and use of these outlet works to regulate the water level for expected inflows. Storage for impending flood conditions can be provided quickly by use of the outlet works if the pool level is high. Use of the flood gates will lower the water level to elevation 65.15.

## **5.5 Dam Failure Analysis**

This dam is classified as a high hazard structure. Failure discharge can cause loss of life and damage due to high velocities, impact from debris and flooding to 3 to 5 residential homes. Also, loss of this dam would impose hardships on the local community because of the loss of water supply.

Calculated dam failure discharge is 8463 cfs at a pool level equal to the top of the dam. At this elevation, the flow in the downstream channel would be equal to the full spillway discharge of 680 cfs or a depth of flow of approximately 2 to 3 feet downstream. Failure will produce a water surface level approximately 9.0 feet immediately downstream from the dam. The failure discharge will affect downstream areas for a distance of 4000 feet from the dam. At this distance the water surface

level will be approximately 4.5 feet above normal observations. Beyond 4000 feet, the effects of the failure discharge will be reduced as it enters Mianus Pond. Water surface elevations due to the failure of the dam are listed in Appendix D. Probable consequences including the prime impact areas, are also listed in Appendix D.

## **SECTION 6**

### **EVALUATION OF STRUCTURAL STABILITY**

#### **6.1 Visual Observation**

This inspection revealed no signs of major physical distress in the structure. However, leakage was noted on the downstream face and embankment.

#### **6.2 Design and Construction Data**

The only design or construction data available were the contract drawings from the 1954 renovation of the treatment plant. These drawings revealed that the only work done to the dam was the fixing of sluice gates to facilitate a smoother operation of the water treatment process. The absence of any stability computations makes the visual aspect of this report the primary basis for evaluation.

#### **6.3 Post Construction Changes**

The following changes to Mianus Filter Plant Dam facility have been noted since its construction in the 1870s.

- a. Retaining wall replacement or repair of the downstream spillway channel.
- b. Replacement of the sluice gates for the 30 inch diameter raw water supply pipe and the low level blowoff.
- c. Replacement of the sluice gates and their operators for the flood control gates on the east abutment of the dam.
- d. Construction of a metering weir approximately 440 feet downstream of the dam.

All of the above changes took place during the 1954 renovation project.

#### **6.4 Seismic Stability**

This dam is in Seismic Zone 1 and hence does not require evaluation for seismic stability according to the USCE Recommended Guidelines.



## SECTION 7

### ASSESSMENT, RECOMMENDATIONS AND REMEDIAL MEASURES

#### 7.1 Dam Assessment

- a. **Condition:** After study of the contract plan for the 1954 renovation and the results of this inspection, the conclusion is that the general condition of the dam at the Mianus Filter Plant is FAIR. The stability of the original design was probably good based on the visual inspection and past performance. However, age and seepage have taken their toll and further study could reveal the need for specific design improvements.
- b. **Adequacy of Information:** The information available is such that the assessment of the safety of the dam is based primarily on the visual inspection results and the past operational performance of the structure.
- c. **Urgency:** It is considered that the recommendations suggested below be implemented by the owner within one year of receipt of this Phase I Inspection Report.

#### 7.2 Recommendations

It is recommended that the owner engage a qualified registered engineer to carry out the following actions:

- a. *A detailed hydrologic-hydraulic investigation to determine the need and means of increasing the discharge capacity of the project.*
- b. The pond be lowered and the upstream face be visually inspected and the toe be checked for potential undermining.

#### 7.3 Remedial Measures

- a. **Operation and Maintenance Procedures:**
  - 1. Trees from the floor of the upstream riverbed should be removed as soon as possible.
  - 2. The seepage on the downstream face should be monitored to note any change from the existing conditions.

3. Repointing of the downstream face of the abutment and replacing of loose stones on the left abutment, with repointing and replacement wherever it is needed.
4. Develop a formal flood warning and surveillance plan, including round-the-clock monitoring during heavy precipitation.
5. Insure the operability of all gate valves and blowoffs.
6. Institute a program of annual periodic technical inspection with particular emphasis on the entire downstream face for signs of distress and leakage.

#### **7.4 Alternatives**

None.

**APPENDIX A**  
**INSPECTION CHECK LIST**

# INSPECTION CHECK LIST

## PARTY ORGANIZATION

PROJECT MIANUS FILTER PLANT DAM DATE November 13, 1979

TIME 1:00 - 3:00 P.M.

WEATHER Overcast

W.S. ELEV. \_\_\_\_\_ U.S. \_\_\_\_\_ DN.S. \_\_\_\_\_

### PARTY:

- |                             |                                      |
|-----------------------------|--------------------------------------|
| 1. <u>R. Johnston, JPPA</u> | 6. <u>B. McCormick - Connecticut</u> |
| 2. <u>R. Lyon, JPPA</u>     | 7. <u>American Water Company</u>     |
| 3. <u>G. Salzman, CWDD</u>  | 8. _____                             |
| 4. _____                    | 9. _____                             |
| 5. _____                    | 10. _____                            |

PROJECT FEATURE	INSPECTED BY	REMARKS
1. <u>Hydraulics</u>	<u>R. Johnston</u>	
2. <u>Structural</u>	<u>R. Lyon</u>	
3. <u>Geotechnical</u>	<u>G. Salzman</u>	
4. _____		
5. _____		
6. _____		
7. _____		
8. _____		
9. _____		
10. _____		

# INSPECTION CHECK LIST

PROJECT MIANUS FILTER PLANT DAM

DATE November 13, 1979

PROJECT FEATURE \_\_\_\_\_

NAME \_\_\_\_\_

DISCIPLINE \_\_\_\_\_

NAME \_\_\_\_\_

AREA EVALUATED	CONDITION
<u>DAM EMBANKMENT</u>	
Crest Elevation 72.15 East 74.70 West	Good - Stone Crest
Current Pool Elevation 69.9+/-	Good - 3 inches above spillway
Maximum Impoundment to Date	
Surface Cracks	None observed.
Pavement Condition	N/A
Movement or Settlement of Crest	None observed.
Lateral Movement	None observed.
Vertical Alignment	Good
Horizontal Alignment	Good
Condition at Abutment and at Concrete Structures	Large spaces up to 18" deep between stones.
Indications of Movement of Structural Items on Slopes	None observed.
Trespassing on Slopes	Not permitted.
Vegetation on Slopes	Ground cover on right downstream face.
Sloughing or Erosion of Slopes or Abutments	None observed.
Rock Slope Protection - Riprap Failures	N/A
Unusual Movement or Cracking at or near Toes	None observed.
Unusual Embankment or Downstream Seepage	Slight on faces and from ground just below left face.
Piping or Boils	None observed.
Foundation Drainage Features	None observed.
Toe Drains	None observed.
Instrumentation System	Weir located 440 ft. downstream from dam.

# INSPECTION CHECK LIST

PROJECT MIANUS FILTER PLANT DAM DATE November 13, 1979

PROJECT FEATURE \_\_\_\_\_ NAME \_\_\_\_\_

DISCIPLINE \_\_\_\_\_ NAME \_\_\_\_\_

AREA EVALUATED	CONDITION
<p><u>OUTLET WORKS - INTAKE CHANNEL AND INTAKE STRUCTURE</u></p> <p>a. Approach Channel</p> <p>b. Intake Structures</p> <p>30 inch supply pipe</p> <p>Low Level Blow Off</p> <p>Flood Gates</p>	<p>Entire riverbed - underwater.</p> <p>30 inch sluice gate with bar rack. Controlled by gear lift on top of dam and maintained in an open condition. Visible portion in good condition and appears operable.</p> <p>24 inch sluice gate controlled by gear lift on top of dam. Visible portion in good condition and appears operable.</p> <p>Twin 4 ft. wide by 5 ft. high slide gates controlled by gear lifts on top of dam. 4 inch gate valve at base between slide gates maintained in open condition. Visible portions in good condition and appear operable.</p>

# INSPECTION CHECK LIST

PROJECT MIANUS FILTER PLANT DAM

DATE November 13, 1979

PROJECT FEATURE \_\_\_\_\_

NAME \_\_\_\_\_

DISCIPLINE \_\_\_\_\_

NAME \_\_\_\_\_

AREA EVALUATED	CONDITION
<p><u>OUTLET WORKS - TRANSITION AND CONDUIT</u></p> <p>30 Inch Supply Pipe</p> <p>Low Level Blow Off</p> <p>Flood Gates</p>	<p>30 inch pipe extends from the intake to a 24 inch tee (to blow offs) and a 24 inch valve. A 24 inch pipe then continues to filters.</p> <p>Square 4 ft. by 4 ft. blow off extends from the intake through the dam to the downstream face.</p> <p>An arched opening 10 ft. wide by 5 ft. high (at crown) and 4 ft. high (at sides) extends from the intakes through dam to the downstream face.</p>

## INSPECTION CHECK LIST

PROJECT MIANUS FILTER PLANT DAM DATE November 13, 1979  
 PROJECT FEATURE \_\_\_\_\_ NAME \_\_\_\_\_  
 DISCIPLINE \_\_\_\_\_ NAME \_\_\_\_\_

AREA EVALUATED	CONDITION
<p><u>OUTLET WORKS - OUTLET STRUCTURE AND OUTLET CHANNEL</u></p> <p>30 Inch Supply</p> <p>Low Level Blow Off</p> <p>Flood Gates</p>	<p>20 inch and 6 inch blow offs from the 24 inch tee discharge to the river. Hydraulically controlled valves are located in an underground concrete chamber, but are controlled from the plant building. Not operated for at least 6 years, but reportedly are operable. A steady flow (10 GPM±) was noted into chamber from the ground.</p> <p>A 24 inch line continues to the filters and then to distribution lines. Fire hydrants in service area could be opened to drain pond.</p> <p>Discharges from the downstream face of dam to the river.</p> <p>Discharges from the downstream face of dam through a natural rock channel to the river.</p>



# INSPECTION CHECK LIST

PROJECT MIANUS FILTER PLANT DAM

DATE November 13, 1979

PROJECT FEATURE \_\_\_\_\_

NAME \_\_\_\_\_

DISCIPLINE \_\_\_\_\_

NAME \_\_\_\_\_

AREA EVALUATED	CONDITION
<u>OUTLET WORKS - SPILLWAY WEIR, APPROACH AND DISCHARGE CHANNELS</u>	
a. Approach Channel	Entire riverbed - underwater
General Condition	
Loose Rock Overhanging Channel	
Trees Overhanging Channel	
Floor of Approach Channel	
b. Weir and Training Walls	
General Condition of Granite Blocks	Good
Rust or Staining	N/A
Spalling	None observed.
Any Visible Reinforcing	None observed.
Any Seepage or Efflorescence	Spillway flowing - not visible.
Drain Holes	None observed.
c. Discharge Channel	Entire riverbed underwater.
General Condition	Good
Loose Rock Overhanging Channel	None observed.
Trees Overhanging Channel	Yes.
Floor of Channel	Underwater - apparently rock.
Other Obstructions	5.5 ft. high weir 440 ft. downstream from dam.
A-6	

**APPENDIX B**  
**ENGINEERING DATA**

## **APPENDIX B-1**

### **DESIGN, CONSTRUCTION AND MAINTENANCE RECORDS AND LOCATION**

Mr. Victor J. Galgowski  
Dam Safety Engineer  
Water and Related Resources Unit  
Department of Environmental Protection  
State of Connecticut  
State Office Building  
Hartford, Connecticut 06115

Connecticut American Water Company  
125 East Putnam Avenue  
Greenwich, Connecticut 06830

## **APPENDIX B-2**

### **COPIES OF PAST INSPECTION REPORTS**

No. \_\_\_\_\_

WATER RESOURCES COMMISSION

SUPERVISION OF DAMS

Inventoried

INVENTORY DATA

By \_\_\_\_\_

Aug. 13-37-45

Date \_\_\_\_\_

Lat. 11-07-07

40

Name of Dam or Pond MIAMI WATER PLANT DAM

Code No. MI 3.8

Nearest Street Location Valley Rd

Town Greenwich

U.S.G.S. Quad. Stamford

Name of Stream Alagnus River

Owner General H. H. Co. Mr. J. H. H.

Address 175 E. Palm St.

General H. H. Co.

869-5200 08/13/78 0.472 0.056

Pond Used For Water Supply

Dimensions of Pond: Width 150' Length 100' Area 15000

Total Length of Dam 200' Length of Spillway 100'

Location of Spillway Center of Dam

Height of Pond Above Stream Bed 2.5'

Height of Embankment Above Spillway 2.5'

Type of Spillway Construction Concrete

Type of Dike Construction Concrete


Downstream Conditions Normal

Summary of File Data \_\_\_\_\_

Remarks 1. 100' x 150' x 2.5' concrete dam

Would Failure Cause Damage? \_\_\_\_\_ Class \_\_\_\_\_

**APPENDIX B-3**  
**RECORD DRAWINGS AND SKETCHES**

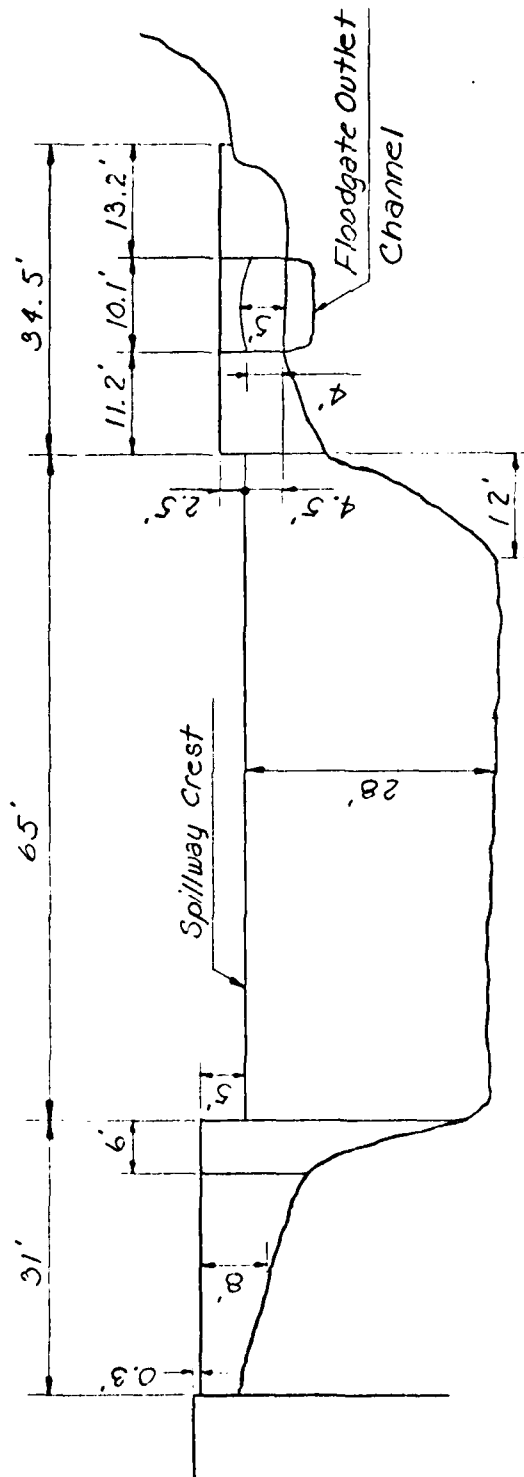

NOTE:  
All Dimensions Shown  
Are Plus Or Minus

# SKETCH OF DAM LOOKING UPSTREAM


SCALE: 1" = 20'

## MIANUS FILTER PLANT DAM

JOHN W. P. TULL AND ASSOCIATES, INC.  
ENGINEERS • ARCHITECTS • PLANNERS









MAINTAINED BY  
HONORABLE SECRETARY  
COM. RECONSTRUCTION, 1946

REVISIONS	<p>MIANUS FILTER PLANT EXISTING PLANT SITE PLAN</p> <p>GREENWICH WATER PLANT GREENWICH CONN.</p>	
<p>AMERICAN WATER WORKS SERVICE COMPANY, INC. 121 SOUTH BRIDGE STREET PHILADELPHIA 7, PA.</p>		
<p>SCALE: 1"=10'</p> <p>DRAWN BY JTB</p> <p>APPROVED NJC</p>	<p>DATE: 11-1-68</p> <p>PROJECT: 11-1-68</p>	<p>USE DIMENSIONS ONLY</p> <p>CHECKED BY</p> <p>INSP BY</p>
<p>USE APPROVED DRAWINGS ONLY FOR CONSTRUCTION PURPOSES</p>		<p>36-265-1A</p>






RECEIVED MAY 1965 ADDRESS RETURNED ADDRESS GOOD ONLY BY BUILDING DEPT. 10 01-50 0-0-0	MANUS ENTER PLANT LOCATION & SEALING PLANT	
	GREENHILL WATER CO. GREENHILL, OH.	
	AMERICAN WATER WORKS SERVICE COMPANY, INC. 101 SOUTH SHORE STREET GREENHILL, OH.	
	ORDER NO. 765 DATED BY J.T. APPROVED N.J.C.	DATE: 5-1-65 PROJECT # 7
	USE APPROVED MATERIALS ONLY FOR CONSTRUCTION PURPOSES	



ACCESS ROAD

A

24" High Service Discharge  
To Distribution System

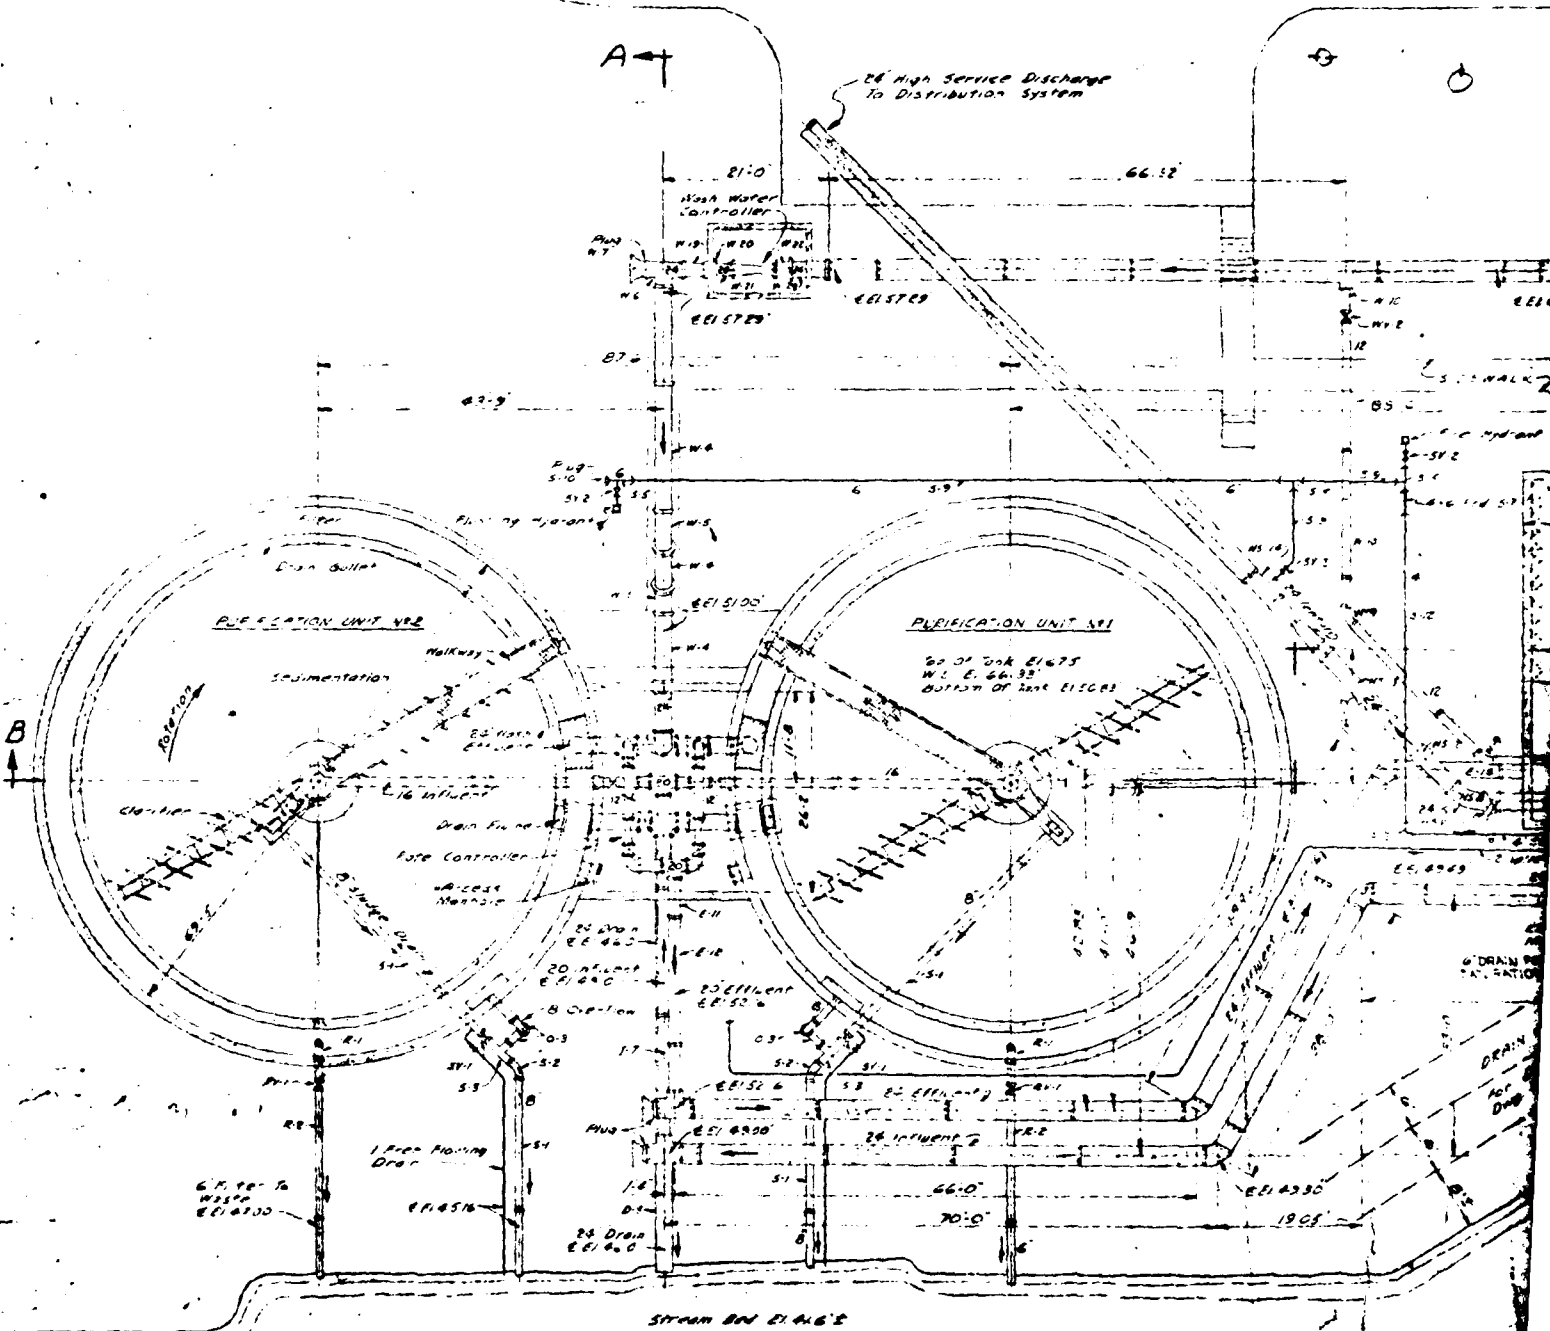

Stream Bed Elevation

MIANUS RIVER

A

B-8

SHEET REDUCED  
NOT TO SCALE

ACCESS ROAD

For Profile of Wash Water Line  
See Map 36-265-87

**CONTROL BUILDING**

510'-0" H. E. 17700  
Existing F. E. 6700  
E. 1700 E. 17500  
Existing Sewer W. E. 1750  
Clearwell Floor E. 17500

PUMP ROOM

LOADING PLATFORM  
E. 17700

B

DRY FIELD  
For Details See  
Map 36-265-81

NOTE:  
For sections see  
Map 36-265-8

**MIANUS FILTER PLANT  
GENERAL PLAN**

**GREENWICH WATER CO  
GREENWICH, CONN.**

**AMERICAN WATER WORKS SERVICE COMPANY INC.**  
121 SOUTH BRAD STREET  
PELHAM, MASS. 01976





SCALE 1"=10'-0"  
DRAWN BY J.M.M. DATE 1-25-54  
APPROVED BY PROJECT P. 7

USE APPROVED DRAWINGS ONLY  
FOR CONSTRUCTION PURPOSES


36-265-2

**SHEET REDUCED  
NOT TO SCALE**


PLANS PREPARED BY  
HOWARD F. HANDEL P.E.  
LOCAL REPRESENTATIVE

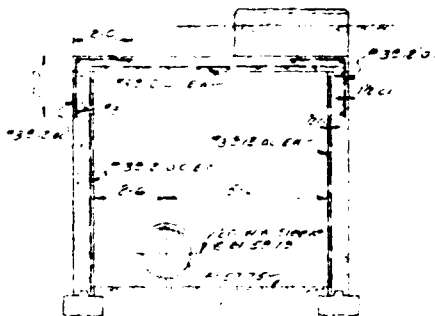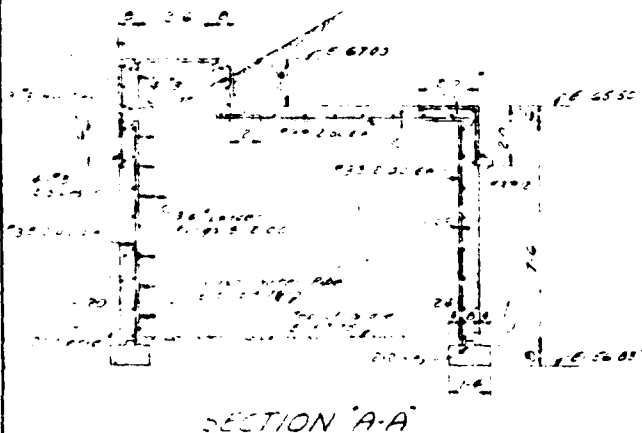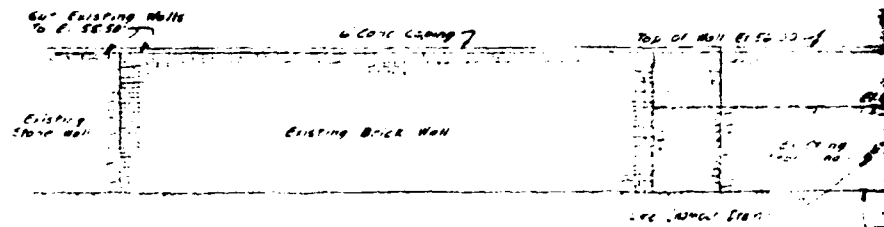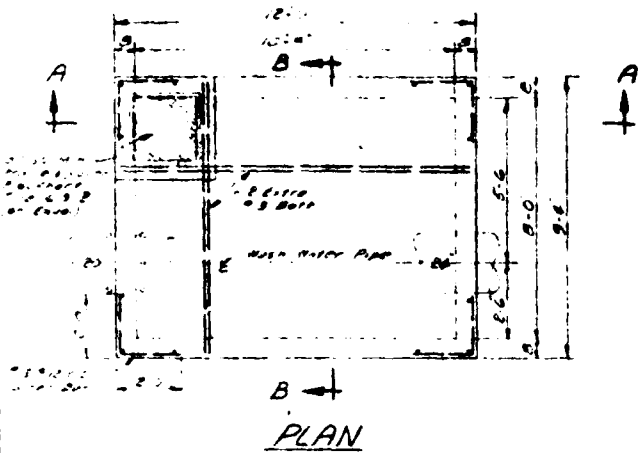

WASH WATER RATE CONTROLLER PIT DETAIL

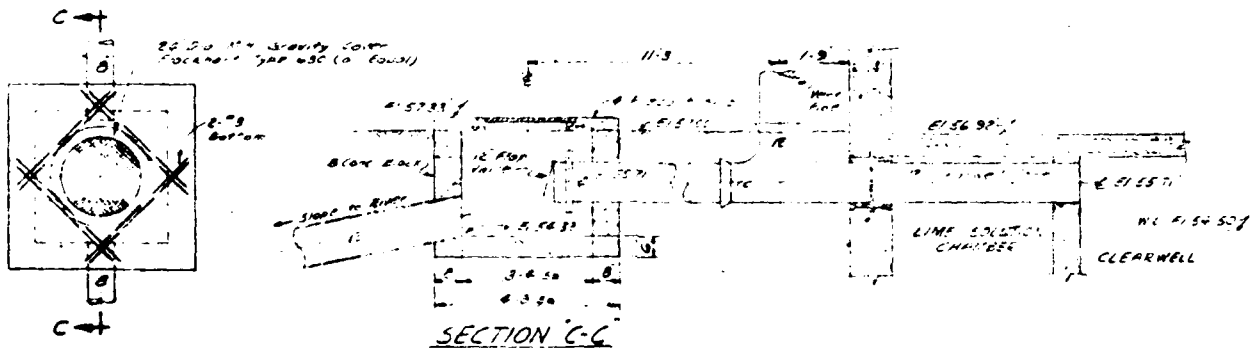


CLEARWELL VENT MANHOLE DETAILS

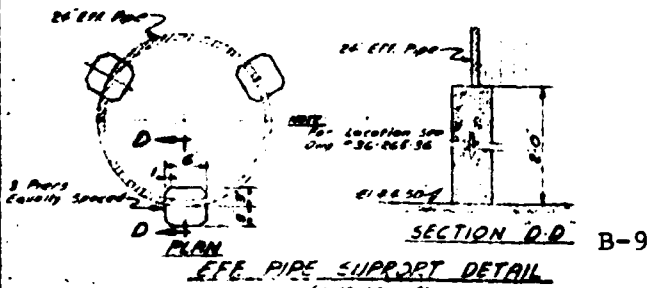


EPE PIPE SUPPORT DETAIL

SHEET R  
NOT TO S

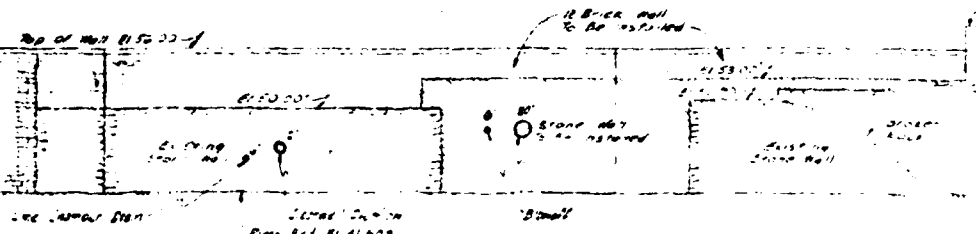


ELEVATION  
RIVER BANK RETAINING WALL  
Scale 1/4" = 1'-0"

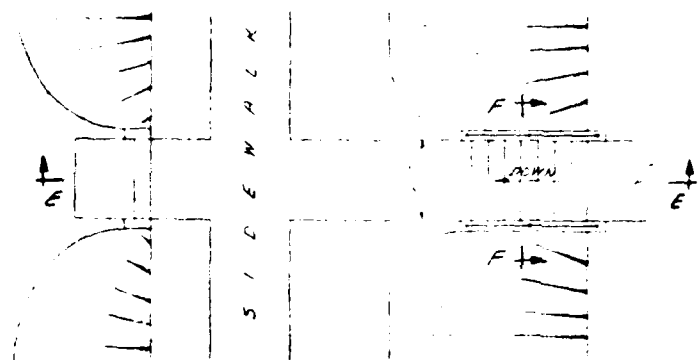

NOTE  
For location see  
Dwg. 36-2-5-1

PLAN

SECTION F-F

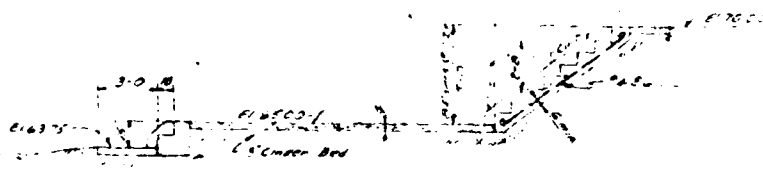

SECTION E-E  
OUTSIDE STEP DETAILS  
Scale 1/4" = 1'-0"



**SHEET REDUCED  
NOT TO SCALE**

DESIGNED BY  
DRAWN BY J.N.M.  
CHECKED BY  
APPROVED R.C.


REVISIONS 1. 12-1-54 2. 12-1-54		<b>MIANUS FILTER PLANT</b> <b>MISCELLANEOUS CONCRETE</b> <b>DETAILS</b>	
GREENWICH WATER CO GREENWICH, CONN.		AMERICAN WATER WORKS SERVICE COMPANY, INC. 121 N. 14th Street PHILADELPHIA 5, PA.	
SCALE: AS NOTED DRAWN BY J.N.M. APPROVED R.C.	DATE: 2-8-54 PROJECT P-17	USE DIMENSIONS ONLY CHECKED BY INSP. BY	USE APPROVED DRAWINGS ONLY FOR CONSTRUCTION PURPOSES
		<b>36-265-7E</b>	





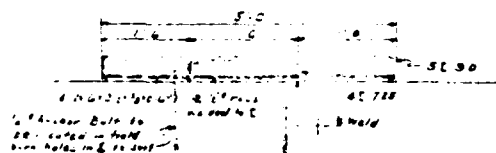

SEC. C-C  
Scale:  $\frac{3}{4}'' = 1'-0''$





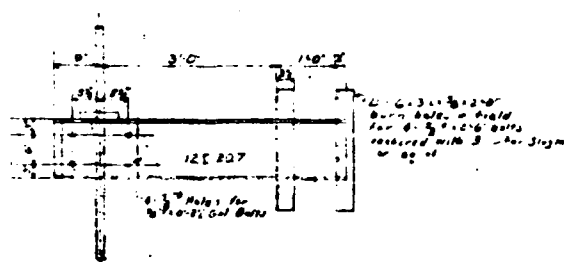


**BRACKET FOR  
STEM GUIDE**  
Scale 1:10


**SHEET REDUCED  
NOT TO SCALE**

PLANS PREPARED BY  
HOWARD F. FIDELL, C.E.  
COMM. REGISTRATION NO. 0280

REVISIONS	<u>MIANUS FILTER PLANT</u> <b>DAM SLUICE GATE SUPPORTS</b> <b>DETAILS</b>	
	<b>GREENWICH WATER COMPANY</b> <b>GREENWICH, CONN</b>	
	<b>AMERICAN WATER WORKS SERVICE COMPANY, INC.</b> 25 SOUTH GREEN STREET      PHILADELPHIA 7, PA.	
SCALE: AS SHOWN CHECKED BY E.L.S. APPROVED <i>H.A.C.</i>	DATE: 12-2-54 PROJECT: D-17	USE DIMENSIONS ONLY CHECKED BY E.L.S. DESG. BY
USE APPROVED DIMENSIONS ONLY SEE CONSTRUCTION METHODS	<b>36-265-29</b>	

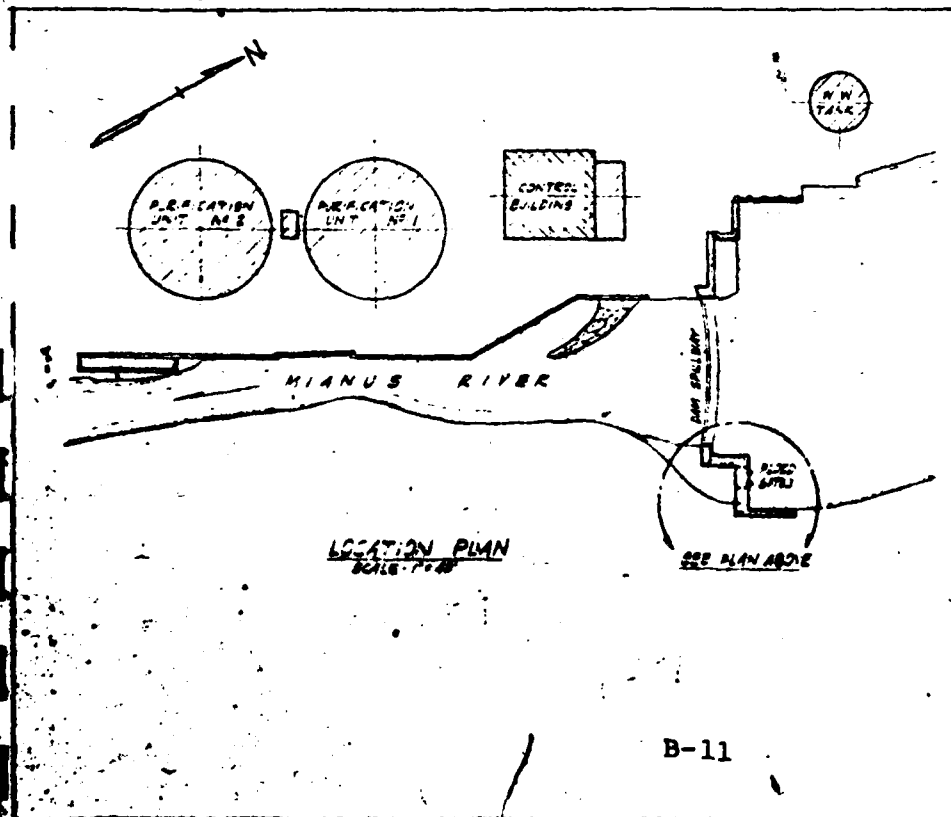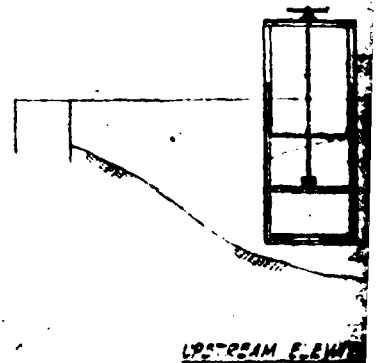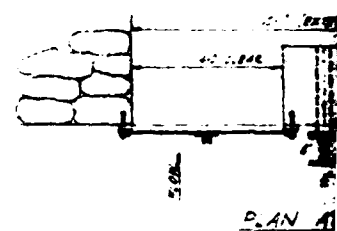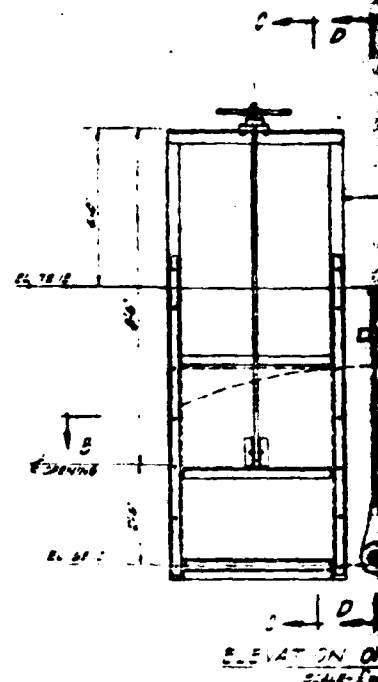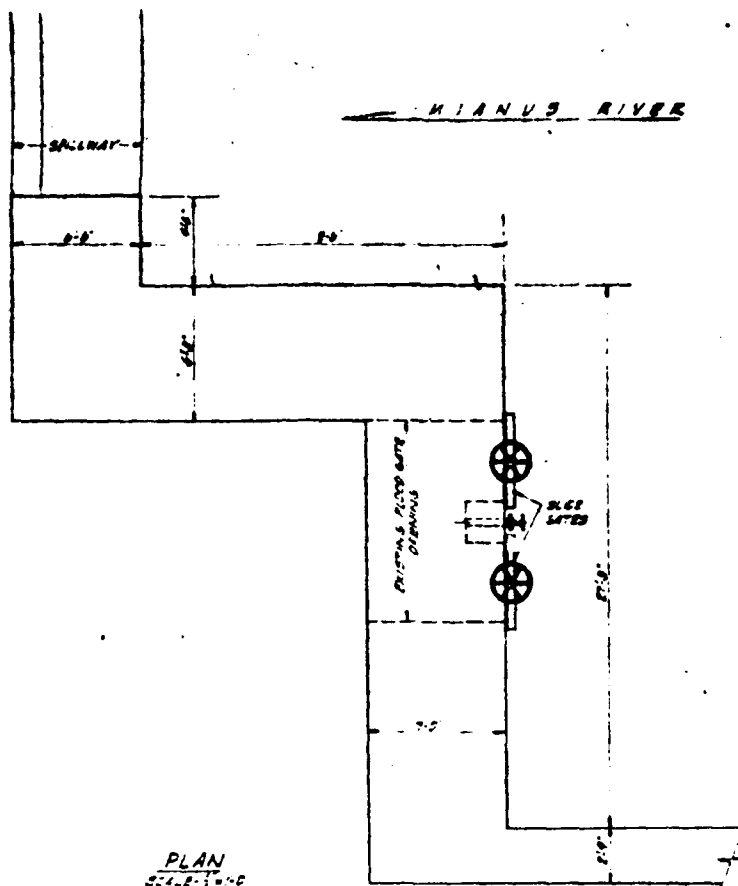


C-D

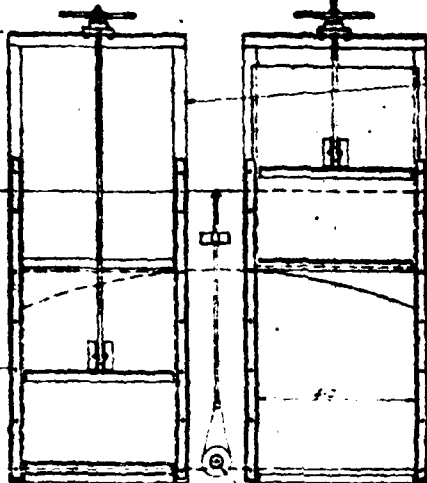


BRACE 2x8 SPS FRAME  
8 HORIZONTAL 1x4-8000  
WALL 2x8 1x4 1x4 BACK  
FOR MOUNTING TO BRASSKEY  
WALL


ELEVATION OF GATES  
SCALE 1/4" = 1'-0"

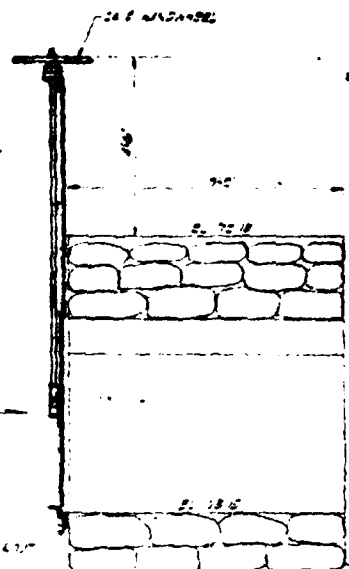


SECTION C-C

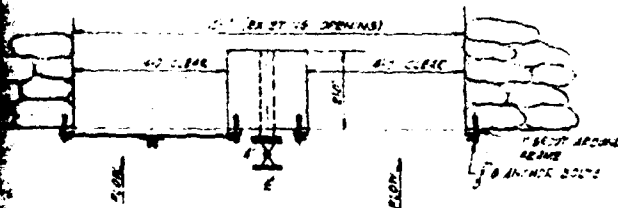

PLAN AT B-B

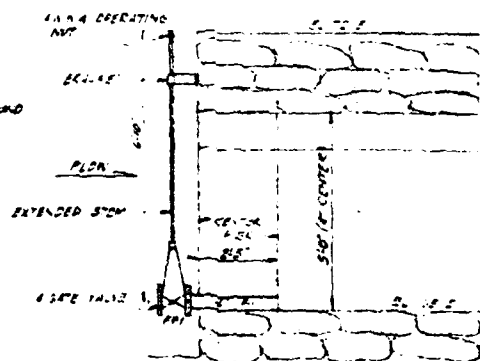

SECTION D-D

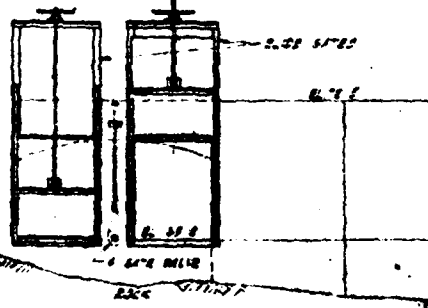


UPSTREAM ELEVATION OF FLOOD GATES

SHEET REDUCED  
NOT TO SCALE


PLANS PROVIDED BY  
HOWARD J. CARROLL & CO.  
CIVIL ENGINEERS NO. 2488

REVISIONS	<u>MILANUS FILTER PLANT</u>	
	FLOOD GATE	
	DETAILS	
	GREENWICH WATER CO.	
	GREENWICH, N.Y.	
AMERICAN WATER WORKS SERVICE COMPANY, INC.		
121 SOUTH BRAD STREET		
SCALE: 1/4" = 1'-0"	DATE: 1/1/22	USE DIMENSIONS ONLY
DRAWN BY: J. J. J.	CHECKED BY: J. J. J.	DATE: 1/1/22
APPROVED: J. J. J.	DATE: 1/1/22	DATE: 1/1/22
USE APPROVED DRAWINGS FOR CONSTRUCTION PURPOSES		36-265-50

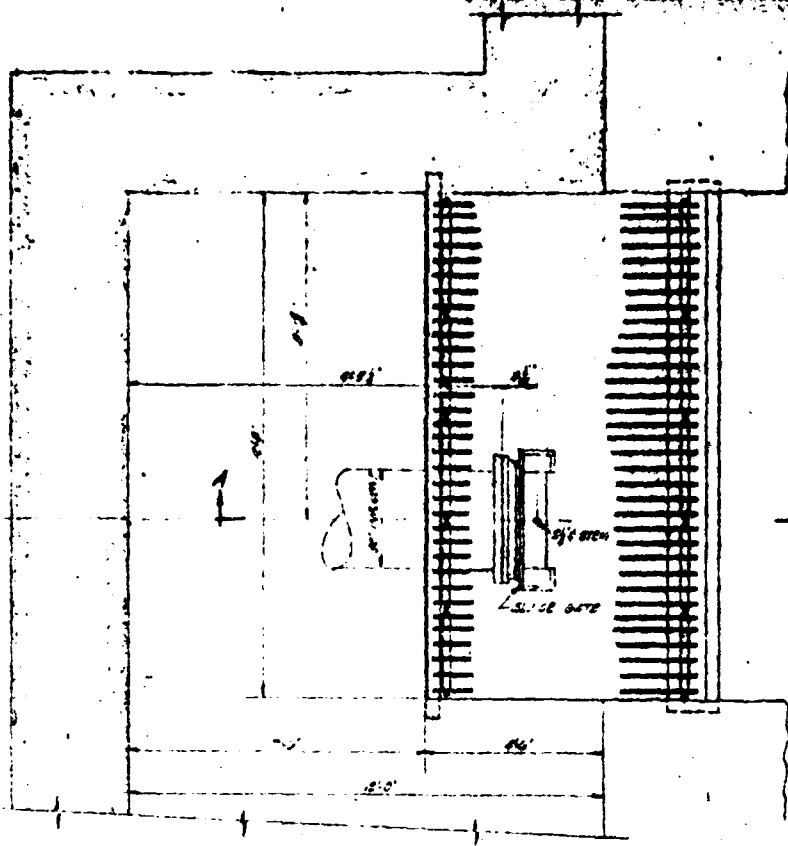


PLAN

FOR LOCATION PLAN  
SEE DWS 20-208-8

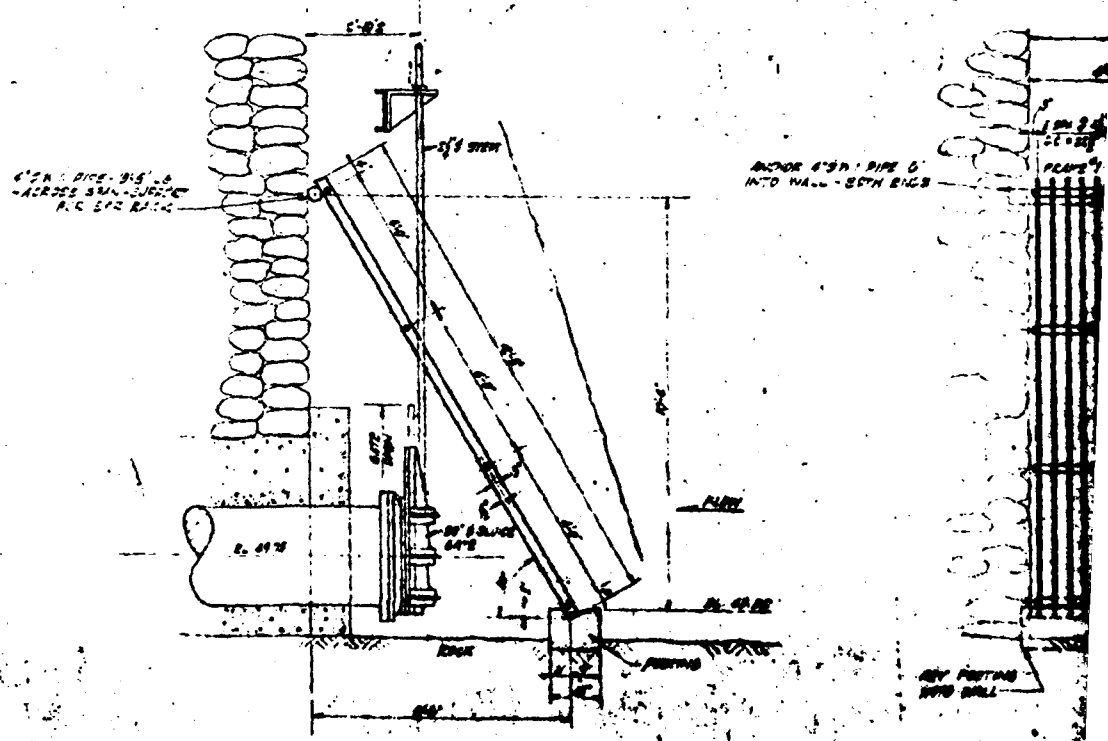


SECTION A-A

B-12



REVISIONS	<u>MANAGE ENTER POINT</u> <u>INTAKE BAR RACK</u> <u>DETAILS</u> <u>SUBMIT FOR REVIEW COMPANY</u> <u>AMERICAN WATER</u>	
	AMERICAN WATER WORKS SERVICE COMPANY, INC. 140 SOUTH STREET CHICAGO, ILL. 60606 ORDER BY: <u>78</u> APPROVED BY: <u>ALC</u>	USE DRAWING ONLY CHECKED BY: DATE: <u>1-1-78</u> PROJECT NO.: DESIGNED BY: DRAWN BY:
	USE APPROVED DRAWING ONLY FOR CONSTRUCTION PURPOSES	<u>36-265-91</u>

**APPENDIX C**  
**PHOTOGRAPHS**

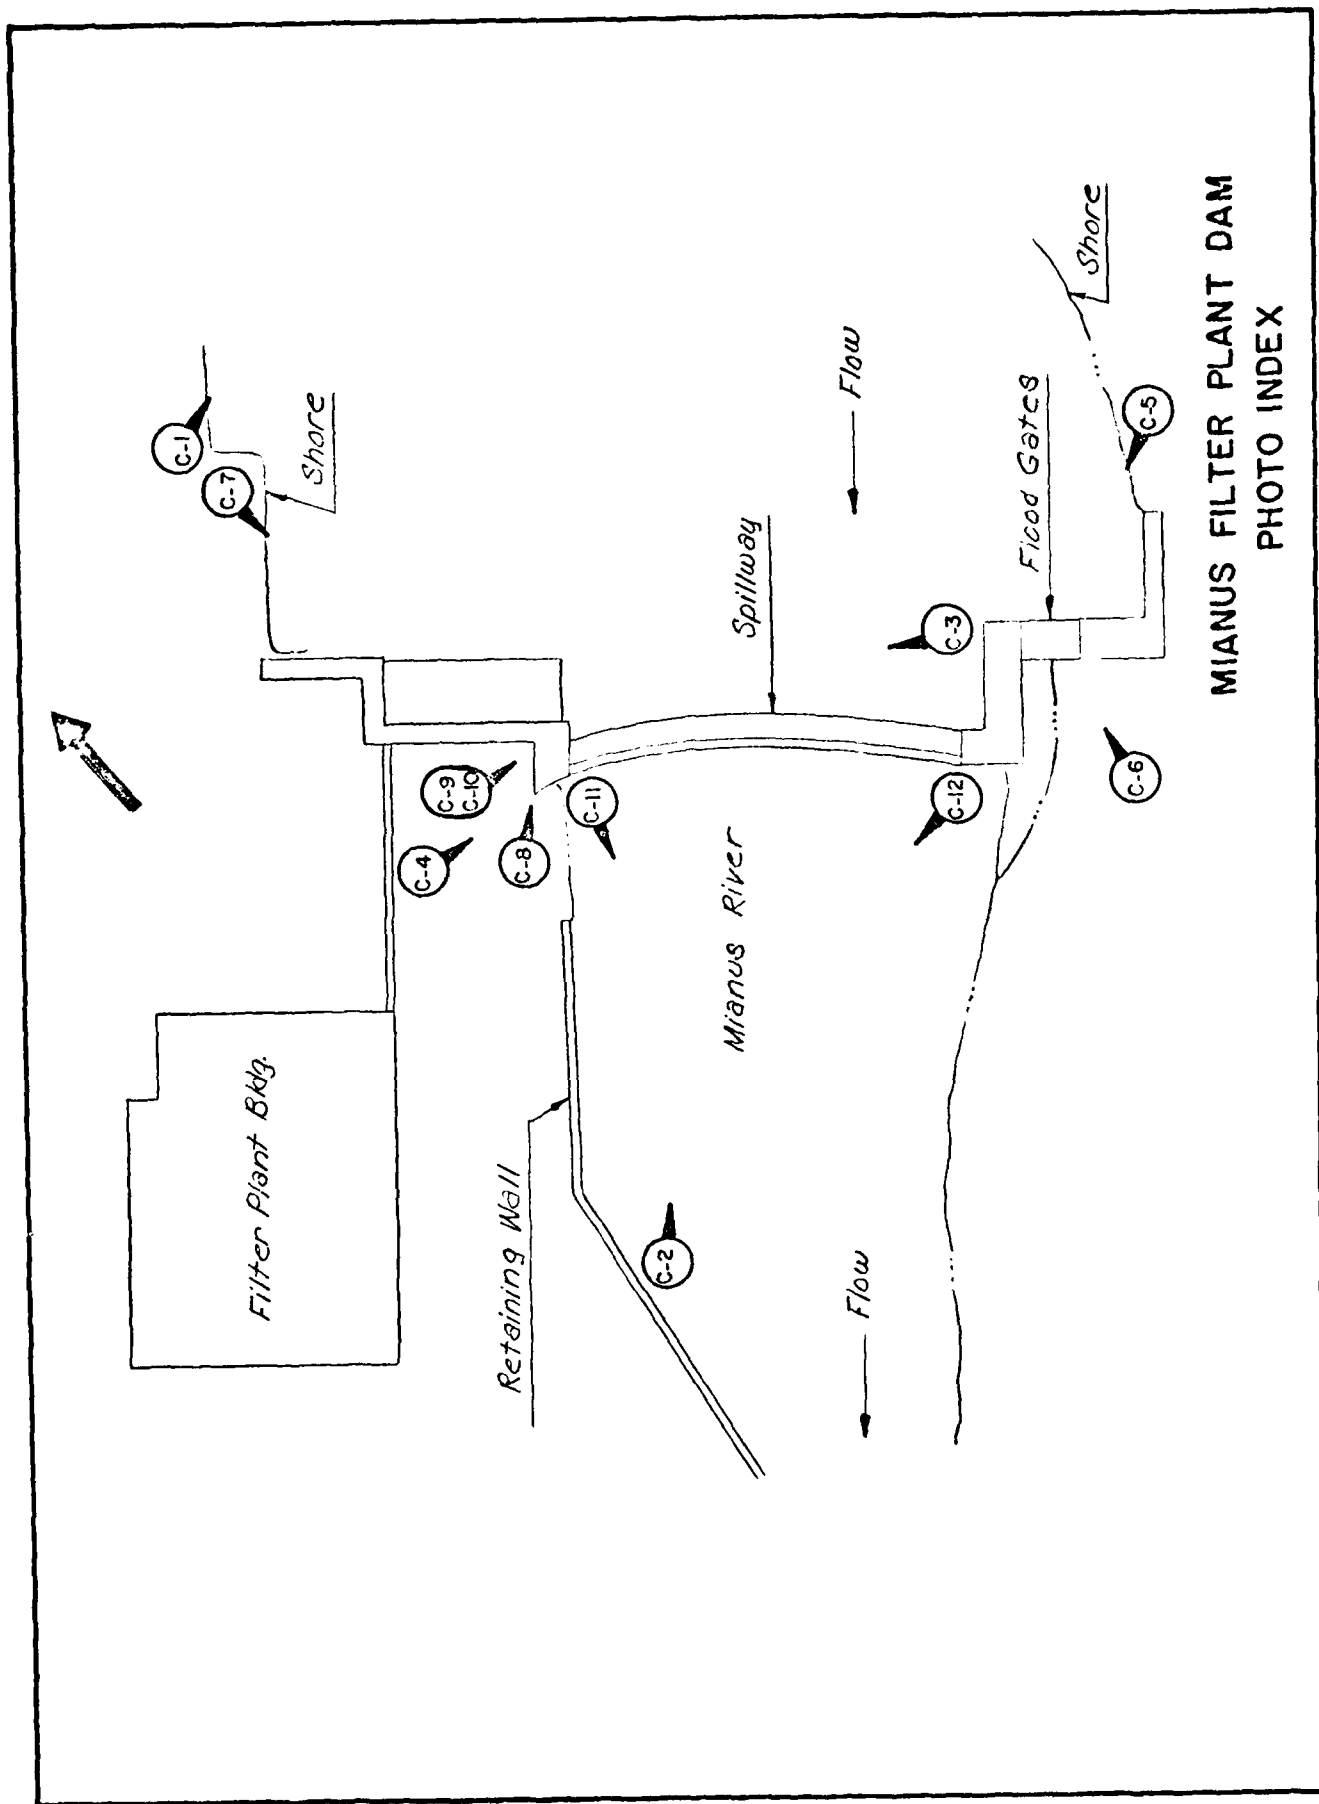



C-1 UPSTREAM IMPOUNDMENT - LOOKING FROM WEST  
BANK




C-2 DOWNSTREAM FACE OF DAM AND SPILLWAY





C-3 WEST CREST OF DAM - LOOKING FROM EAST CREST

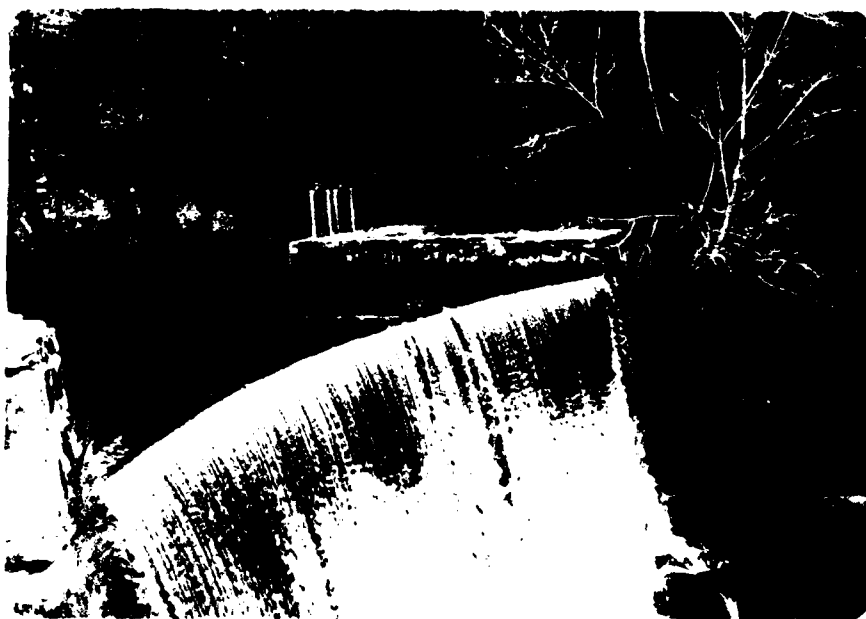


C-4 EAST CREST OF DAM - LOOKING FROM WEST ABUT-  
MENT



C-5 FLOODGATES ON EAST CREST



C-6 OPENING IN DOWNSTREAM FACE AT EAST CREST FOR FLOODGATES

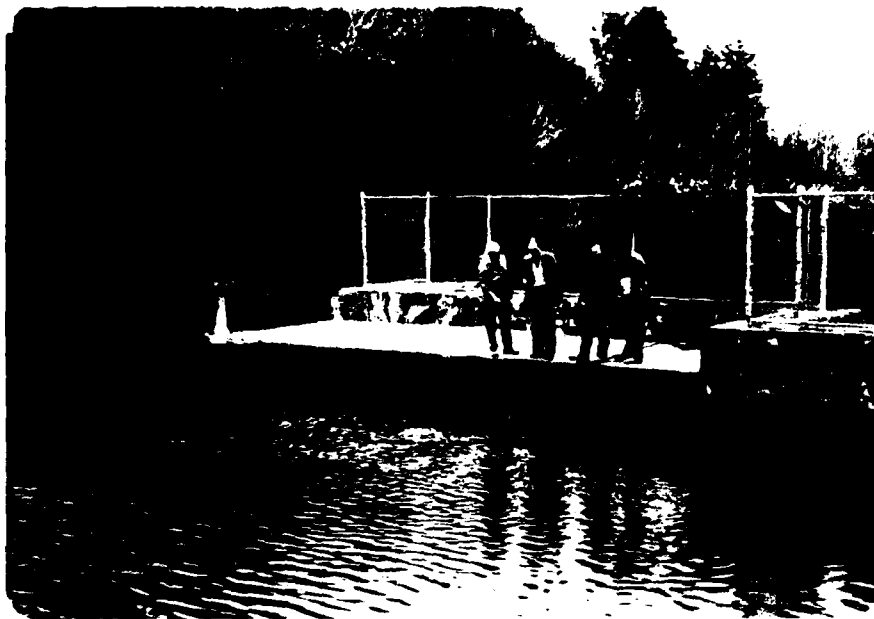

C-7 WEST CREST OF DAM - LOOKING FROM UPSTREAM  
BANK ON WEST




C-8 SEEPAGE POINT BELOW WEST CREST



C-9 SEEPAGE POINT BELOW WEST CREST



C-10 OPEN JOINT IN MASONRY ON DOWNSTREAM FACE  
BELOW WEST CREST

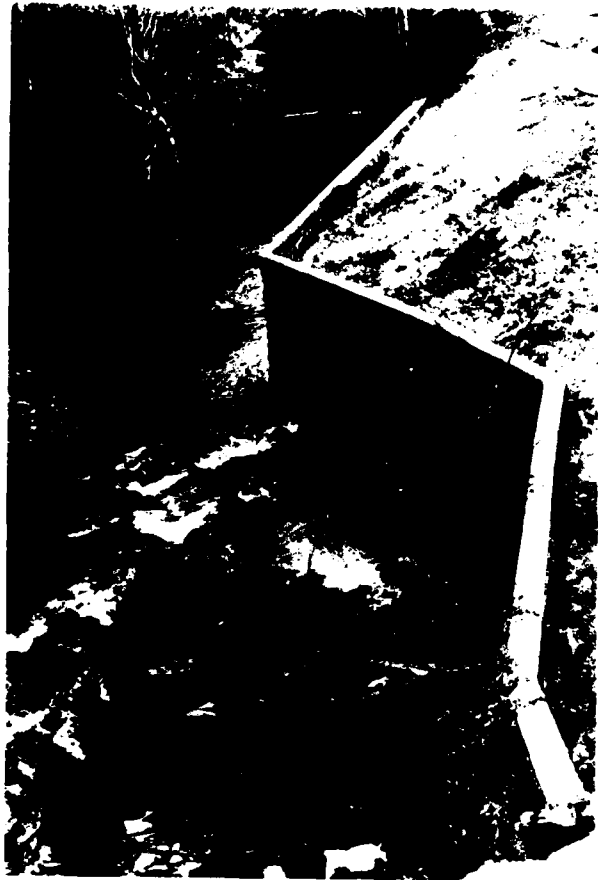

C-11 400' x 111' 7" CULVERT -  
LOOKING FROM WEST CRIST




C-12 RETAINING WALL AND PLOWOFF OUTLETS ON WEST  
BANK OF DOWNSTREAM CHANNEL - LOOKING FROM WEST  
CRIST

1


**APPENDIX D**  
**HYDROLOGIC AND HYDRAULIC COMPUTATIONS**


1

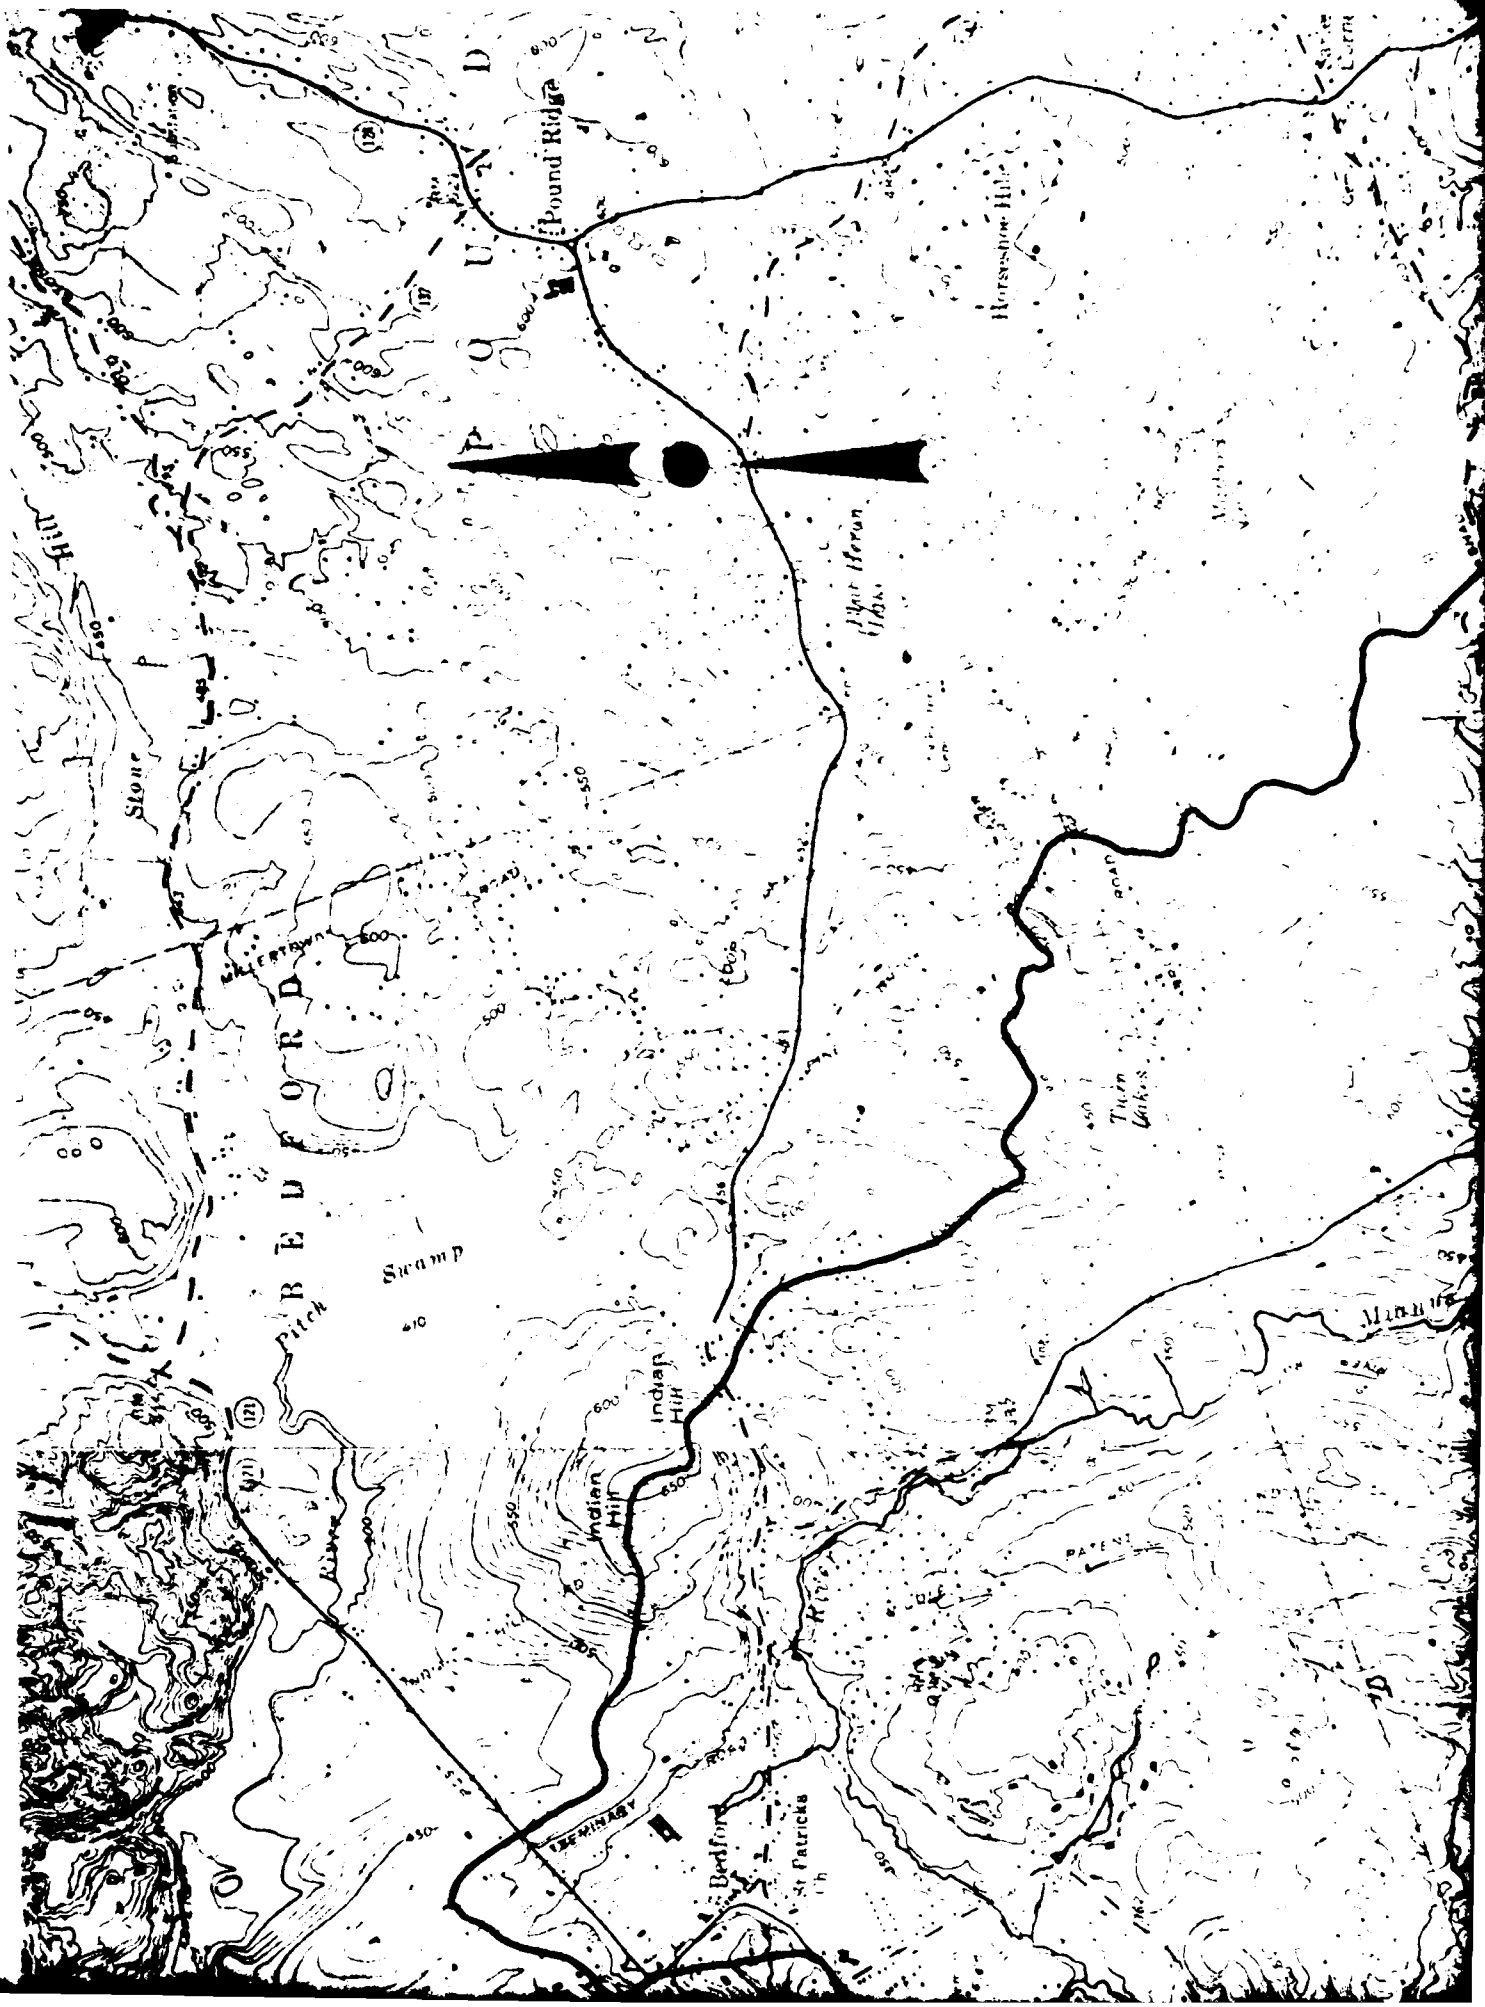






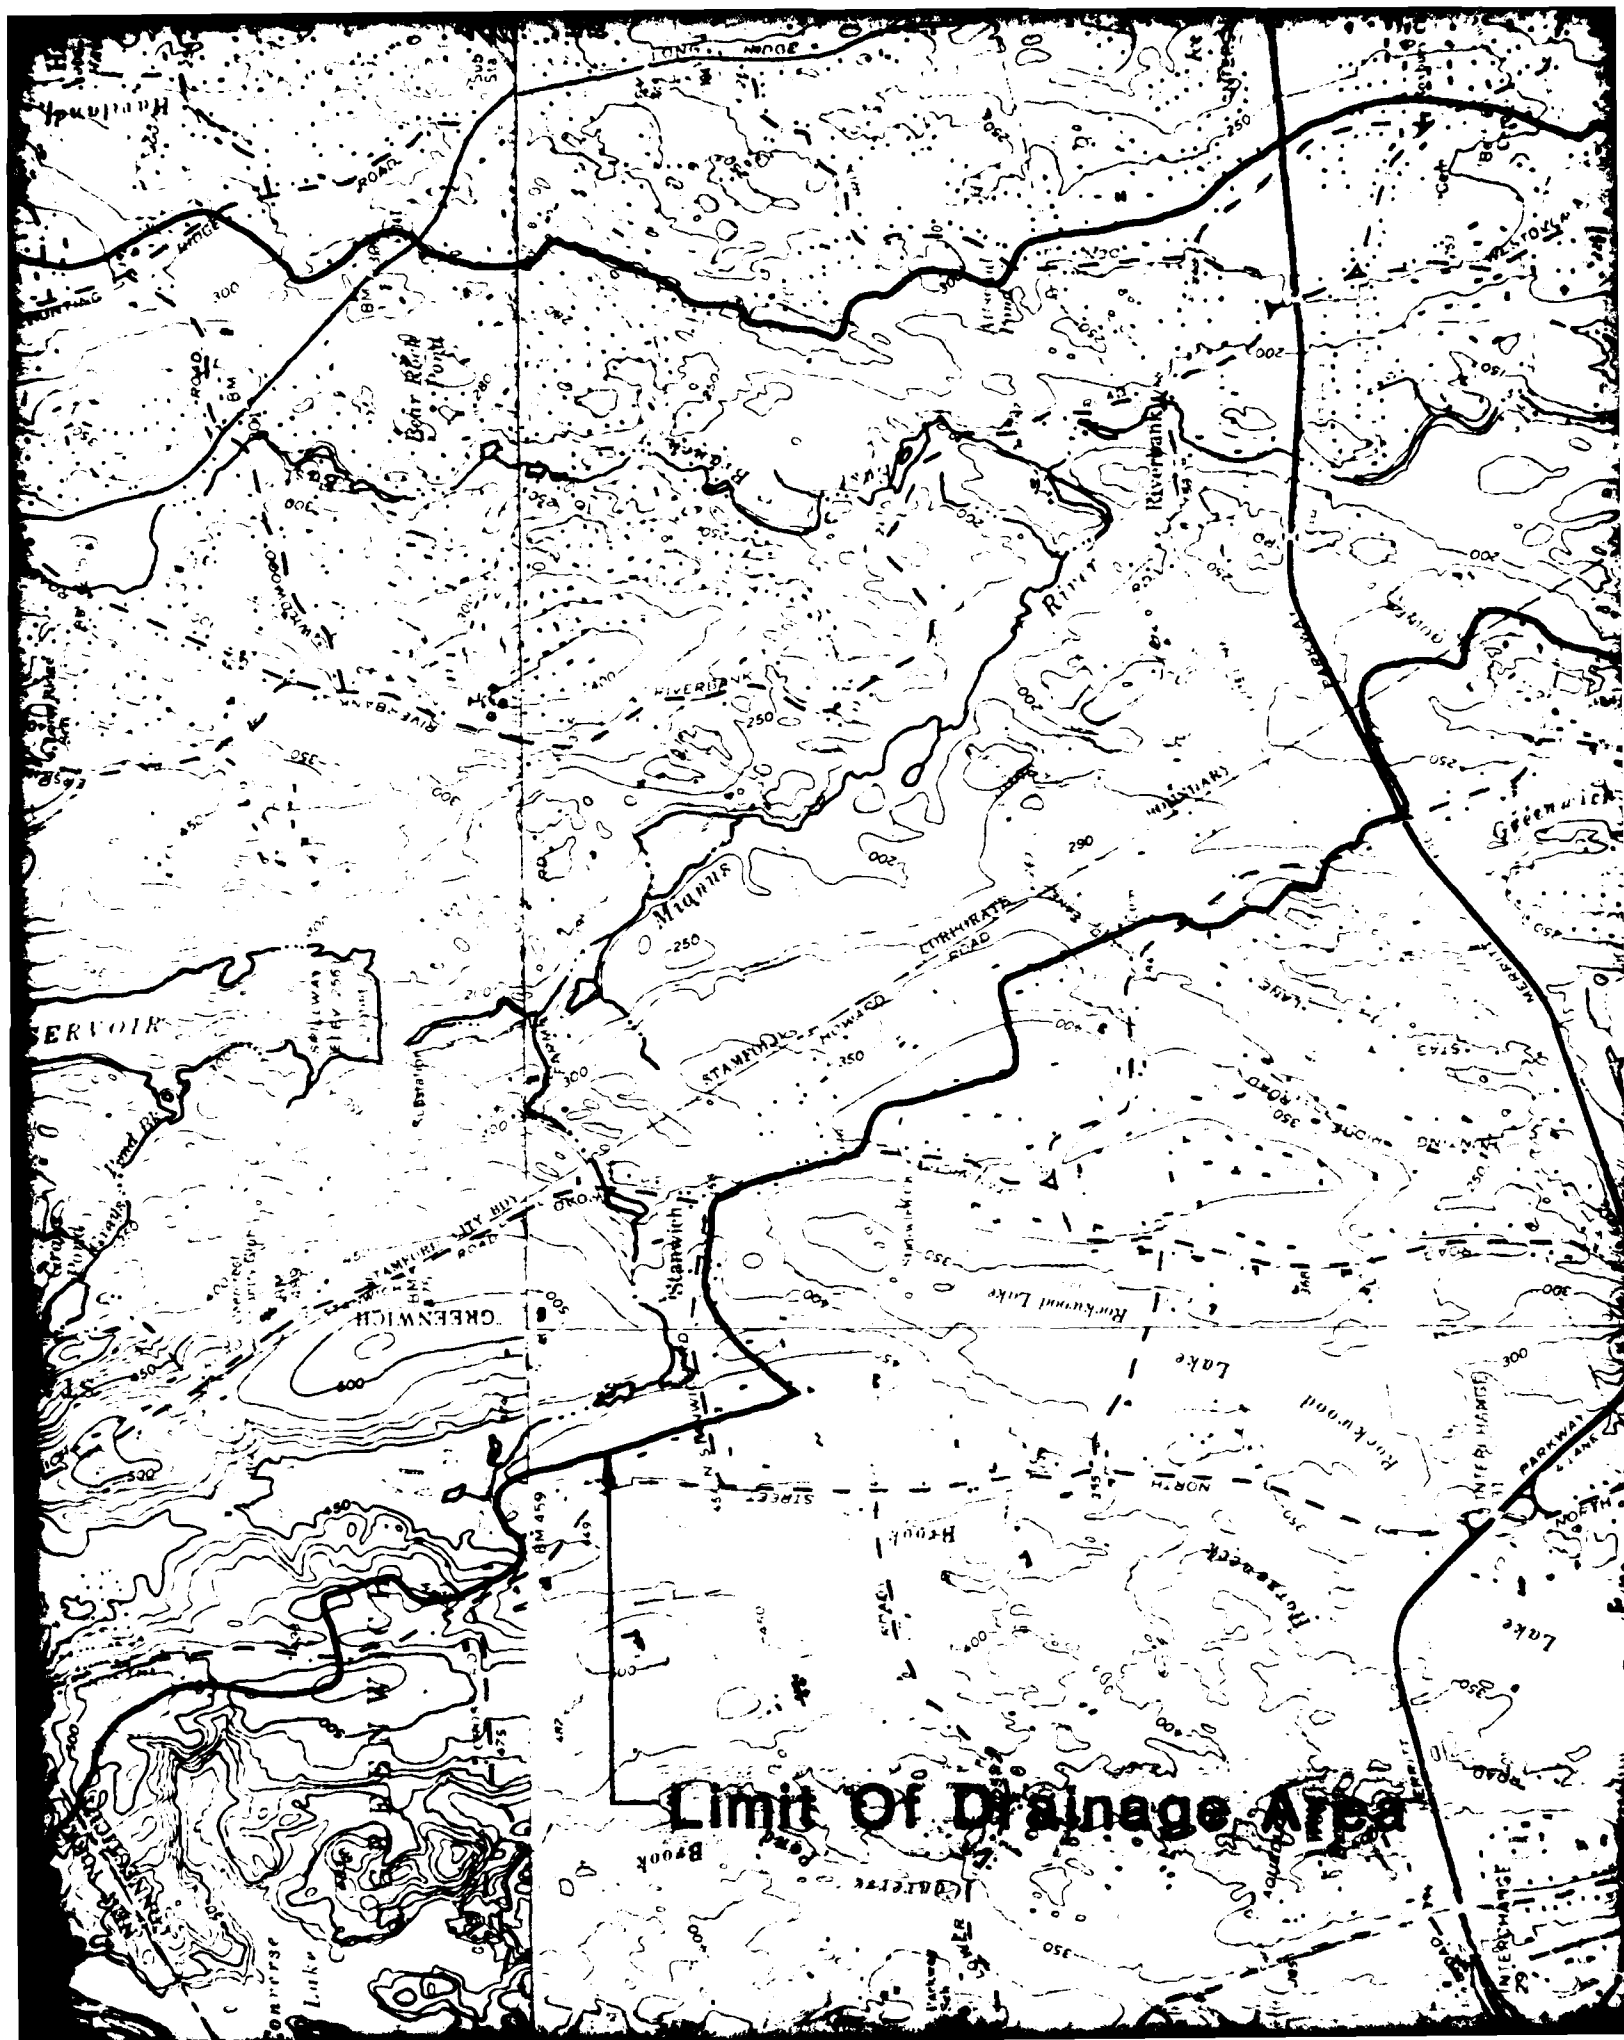


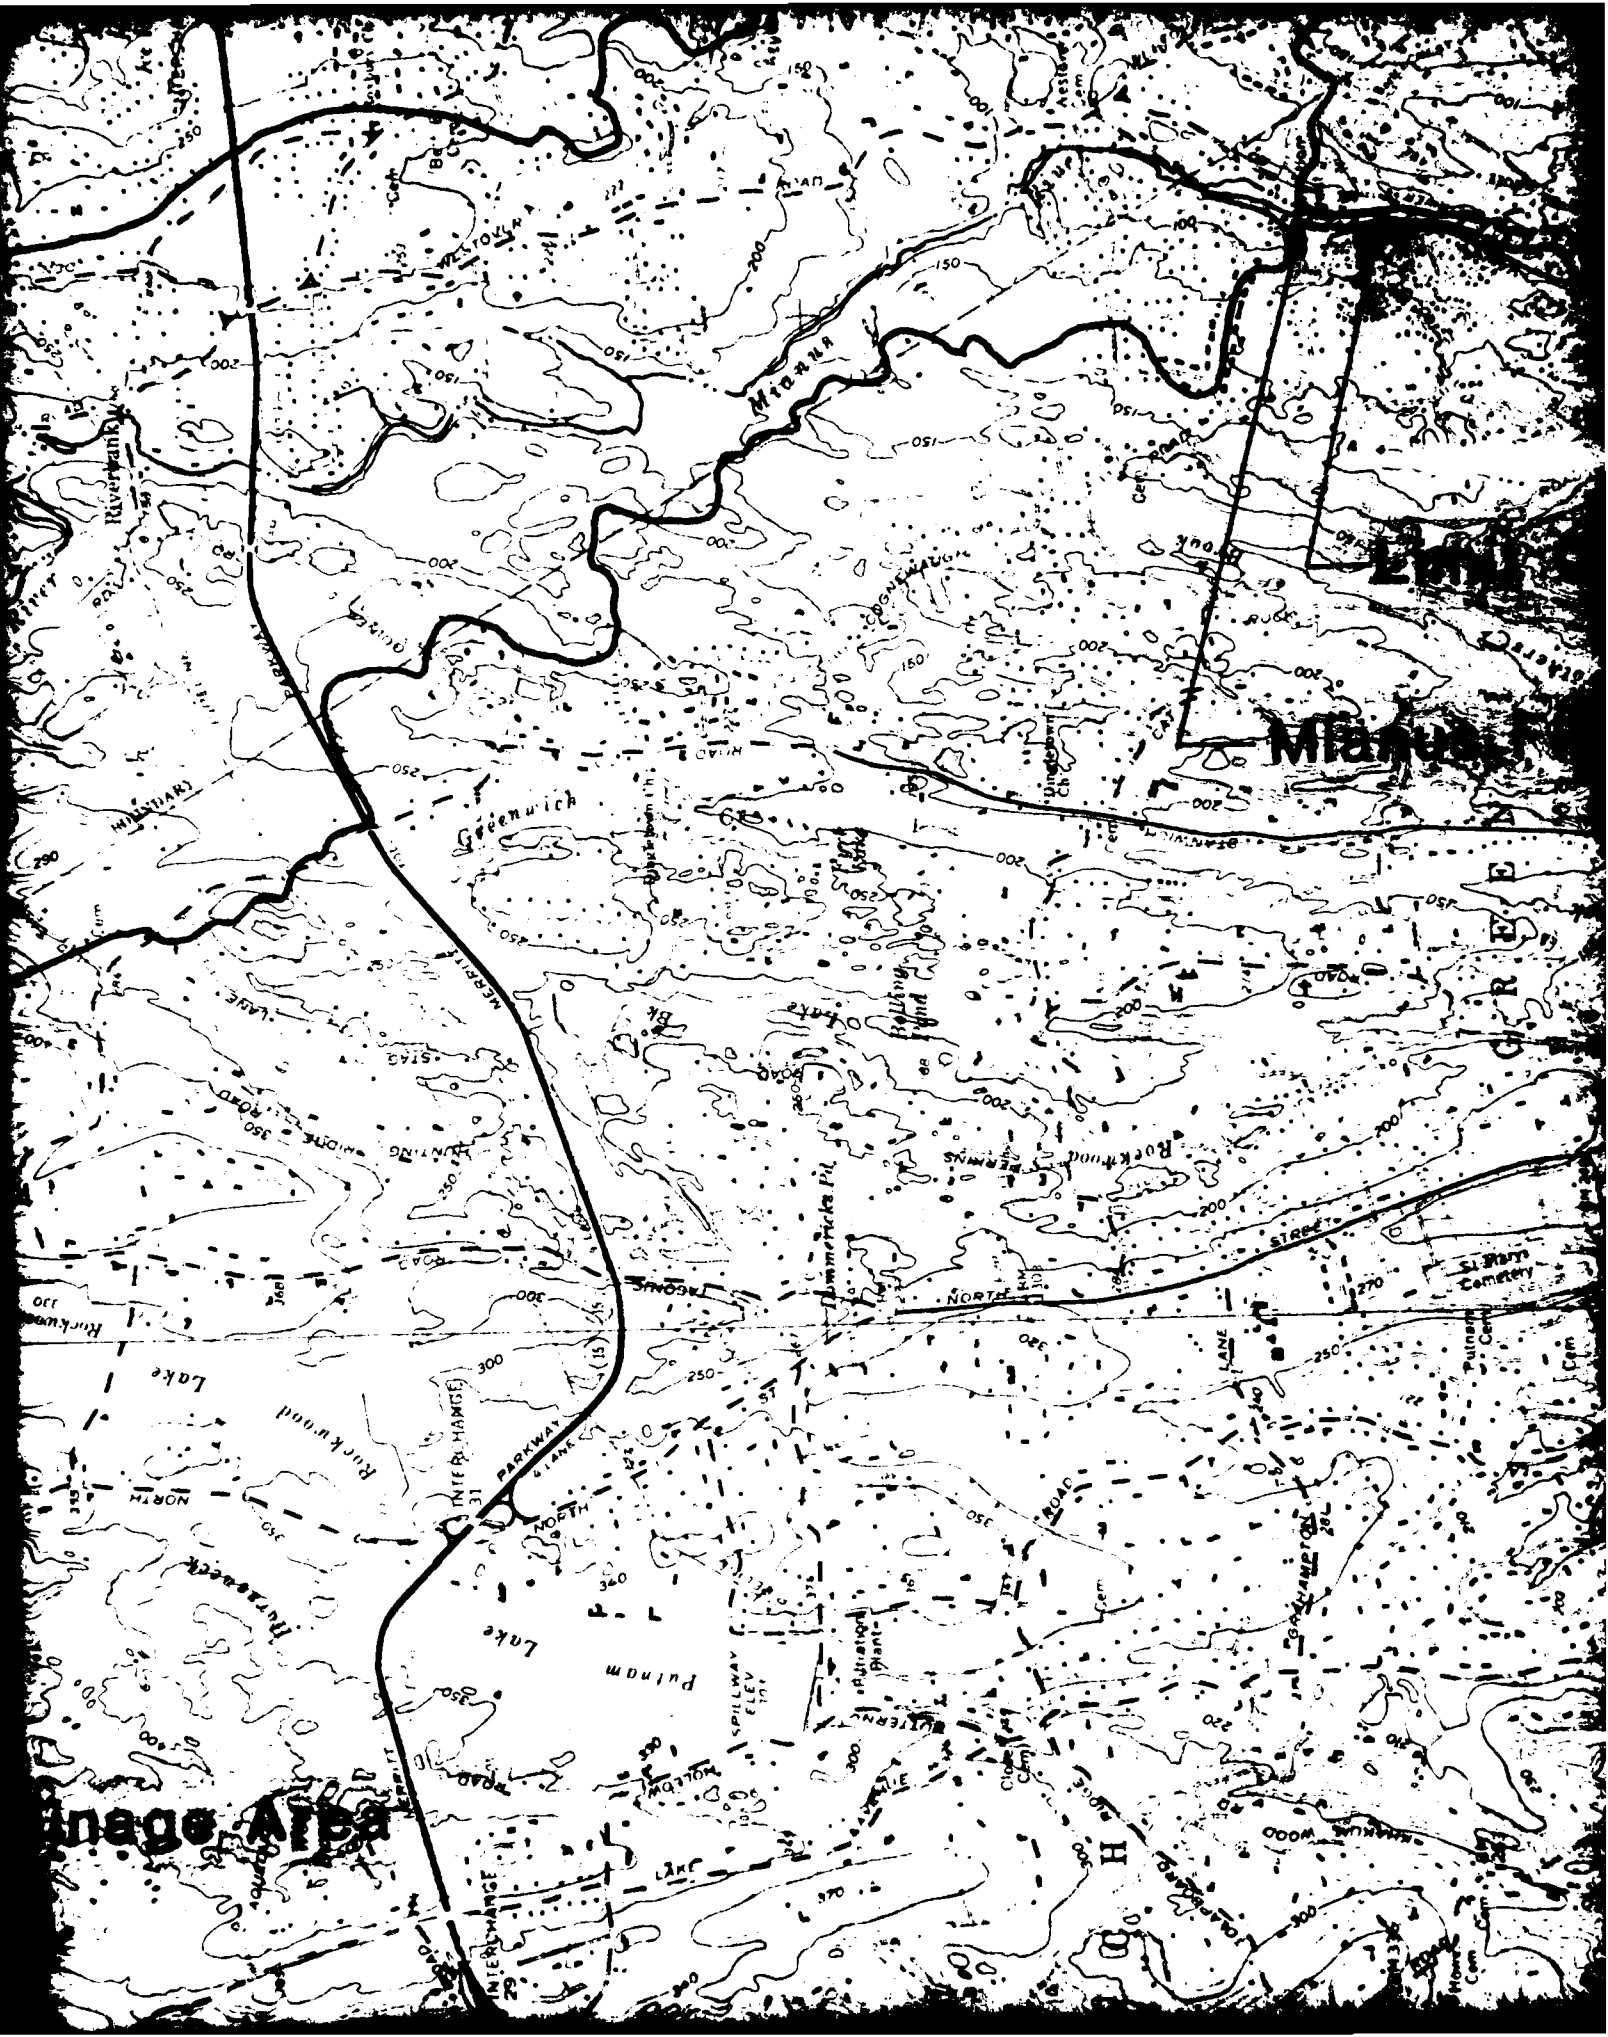



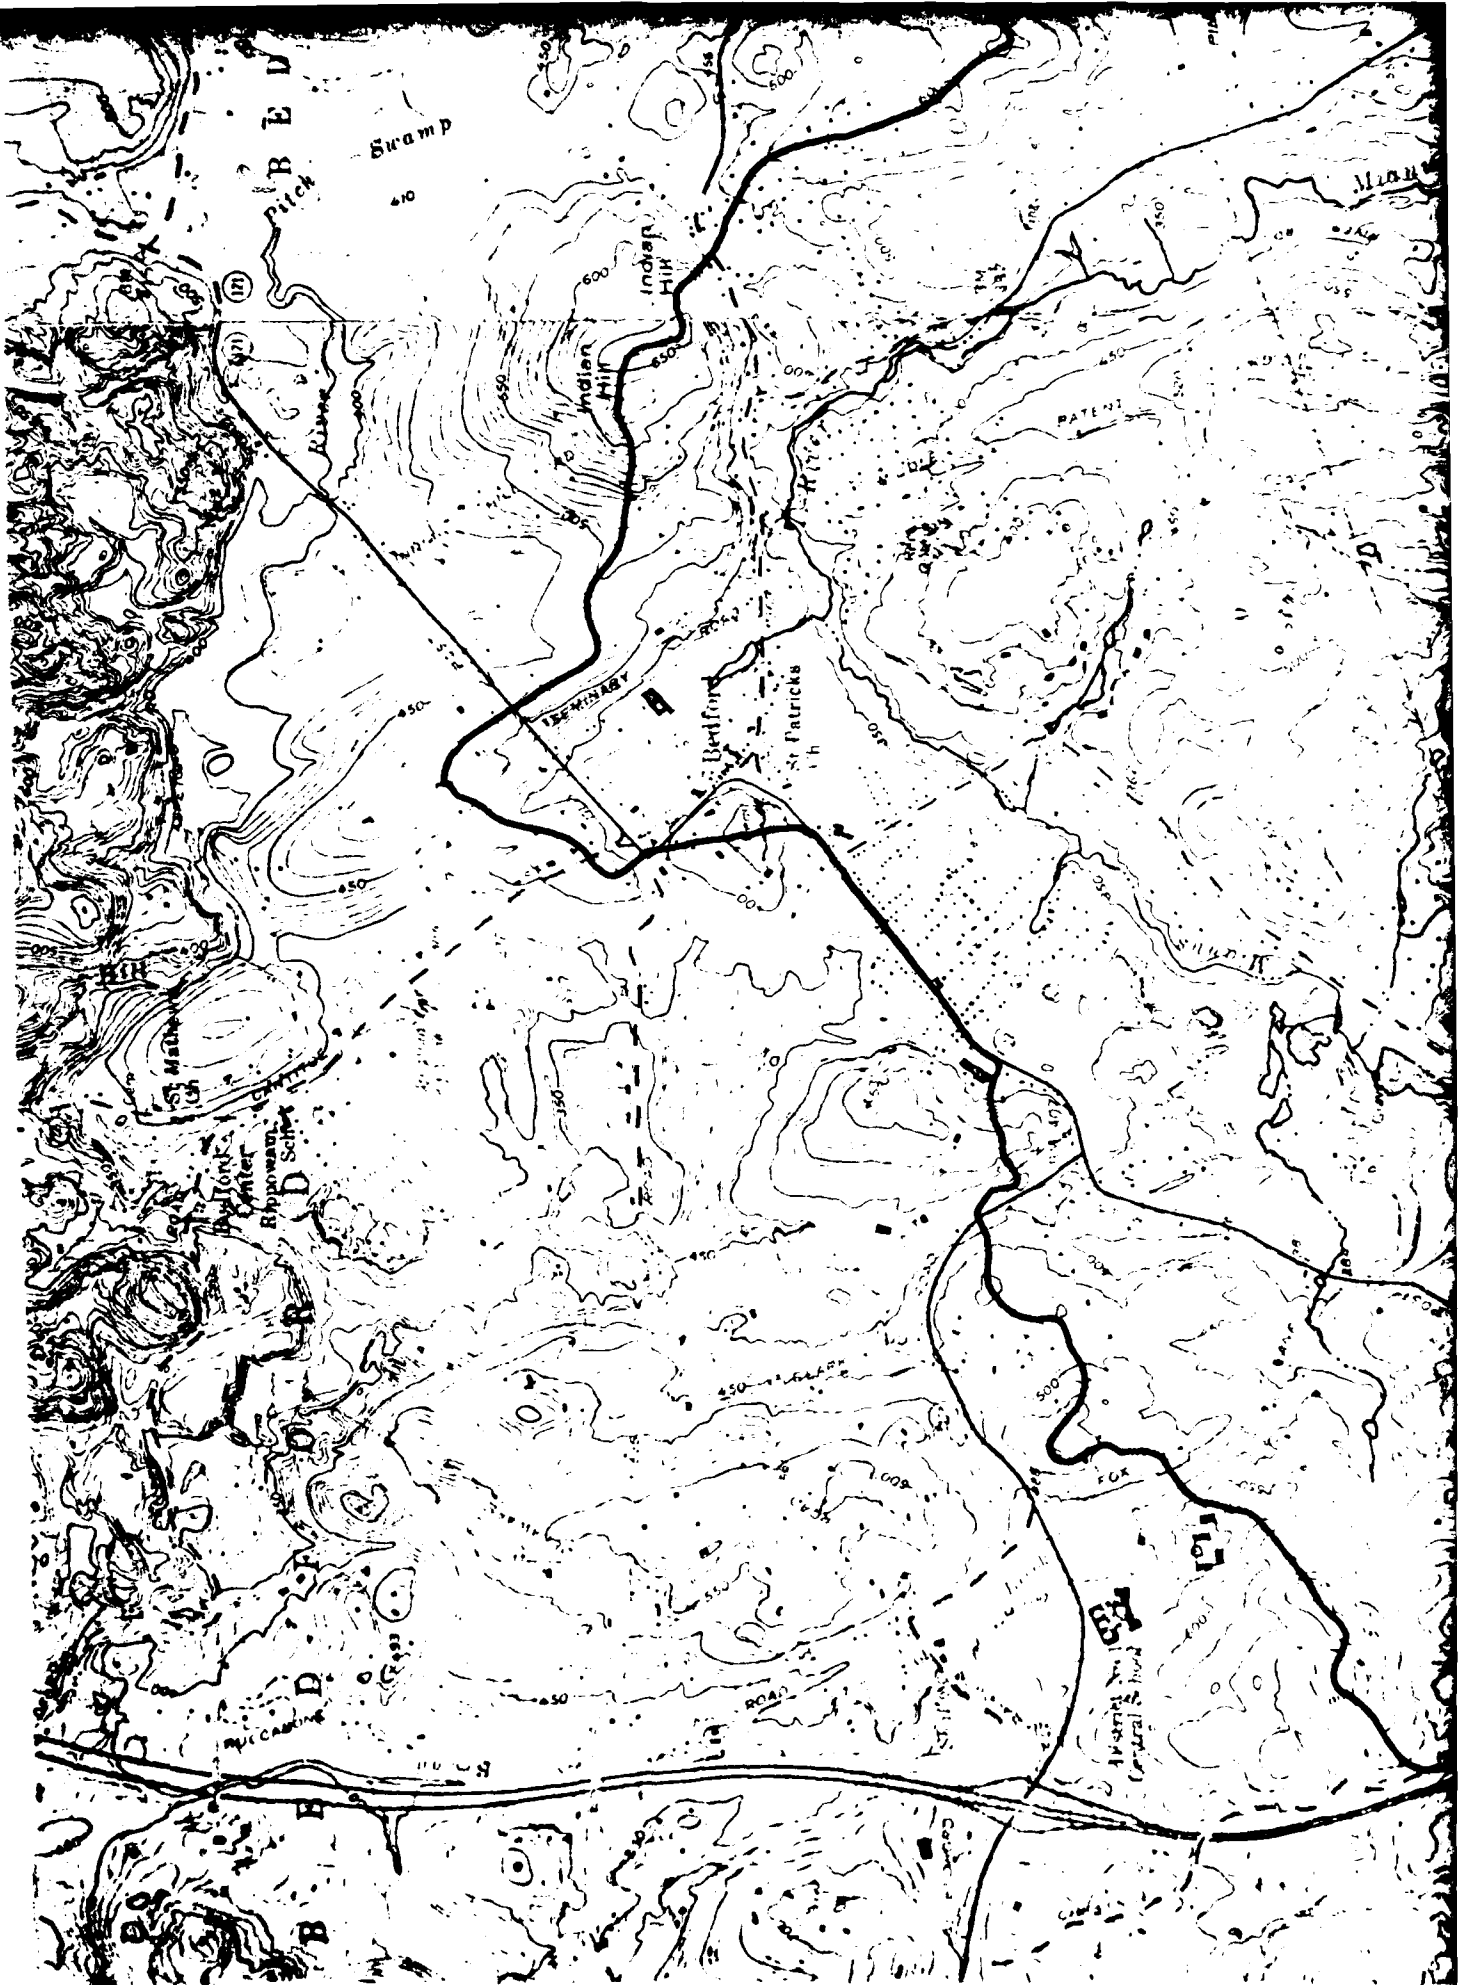



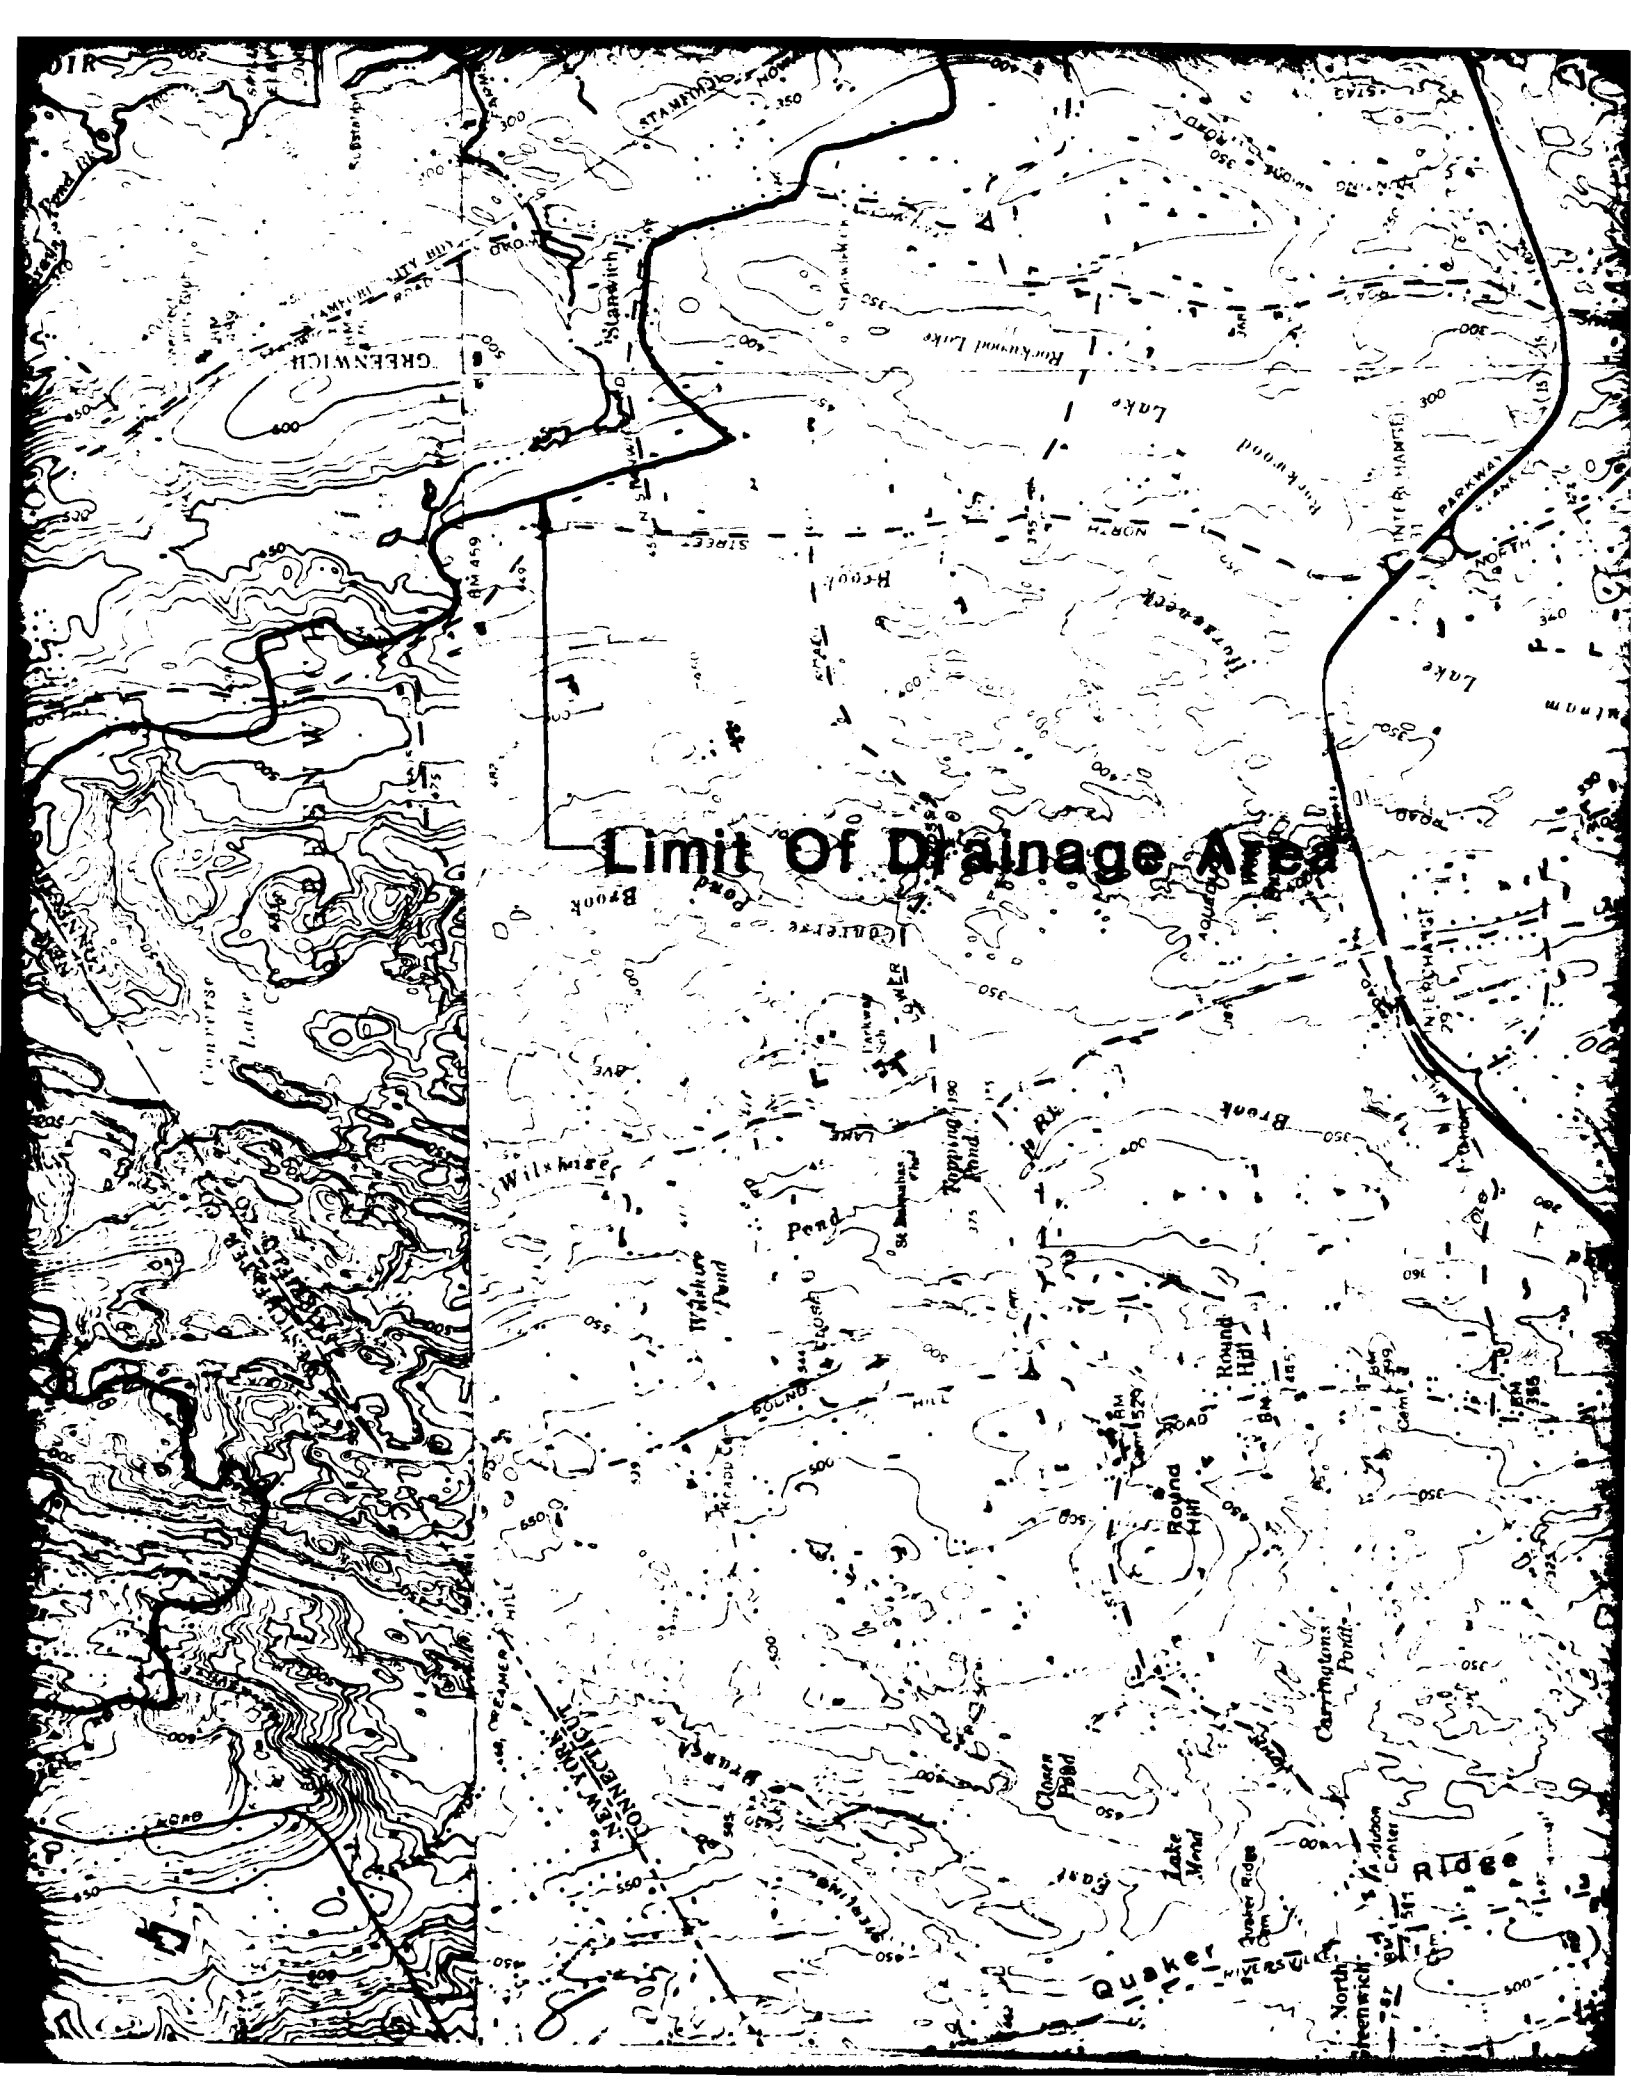





19

HYDROLOGIC AND HYDRAULIC ANALYSIS  
SUMMARY SHEET

Dam Mianus Filter Plant Dam

Test Flood 1/2 PMF

INFLOW HYDROGRAPH DEVELOPMENT

Drainage Area 29.9 sq. mi.

Probable Maximum Precipitation  
24 hour - 200 square mile PMP 22 inches

Initial Rainfall Loss 0 Inch  
Uniform Rainfall loss .1 Inch

Snyder's Lag 7.55 hours  
Snyder's Peaking Coefficient .625

Test Flood Inflow 14200 CFS

PMF Inflow 28300 CFS

RESERVOIR ROUTING AND DAM OVERTOPPING

Test Flood Outflow 14100 CFS

Spillway Capacity at Top of Dam 680 CFS  
5 % of Test Flood

Flow Over Spillway at Test Flood 7650 CFS

Spillway Crest Elevation	<u>69.65</u>	Feet
Top of Dam Elevation	<u>72.15</u>	Feet (east)
Test Flood Elevation	<u>82.2</u>	Feet



FINAL

\*\*\*\*\*  
 LAKE HYDROGRAPHIC STATION (INF-11)  
 LAKE SAFETY DESIGN JULY 1974  
 LAST MODIFICATION 26 FEB 79  
 \*\*\*\*\*

1	AI	LAKE SAFETY ANALYSIS-JULY NO. 79-905/01-EMJ									
2	AP	STATION FILED PLANT NAM-GRANTWICH-CUNN.									
3	AS	1-05-74 1/2 PMF									
4	AT	75	1	0	0	0	0	0	2	0	0
5	AV	5	1	2	1	0	0	0	0	0	0
6	AW	1	1	0	0	0	0	0	0	0	0
7	AX	5	1	0	0	0	0	0	0	0	0
8	AY	0	1	0	0	0	0	0	0	0	0
9	AZ	0	1	0	0	0	0	0	0	0	0
10	BA	1	1	20.9	0	20.9	0	0	0	0	1
11	BB	0	22	99	112	122	129	0	0	0	0
12	BC	0	0	0	0	0	0	0	0	0	0
13	BD	7.55	0.625	0	0	0	0	0	0	0	0
14	BE	1.0	0.05	2.0	0	0	0	0	0	0	0
15	BF	1	1	0	0	0	0	0	0	0	0
16	BG	0	0	0	1	1	0	0	0	0	0
17	BH	1	0	0	0	0	0	0	0	0	0
18	BI	1	0	0	0	0	0	0	0	0	0
19	BJ	7.2	4	17	50	0	0	0	0	0	0
20	BK	40.65	75	76	80	0	0	0	0	0	0
21	BL	55.69	65	2.65	1.5	0	0	0	0	0	0
22	BM	50	74.7	2.63	1.5	120	0	0	0	0	0
23	BN	99	0	0	0	0	0	0	0	0	0

# REVIEW OF SOURCE OF STREAM NETWORK CALCULATIONS

SOURCE HYDROGRAPH AT  
 ROUTE HYDROGRAPH TO  
 END OF NETWORK

02/00/10 04101 1.00

Q-000 SAFETY ANALYSIS-JOH. PG. 79-005/01-EPJ  
CONTAINS FILTER DAM-CRAFTERICH-COEN.  
12-05-79

		JOB SPECIFICATION						IPRT	NSTAN
NO	NMR	NATN	JDAY	IMR	IMIN	METRC	IPLY		
75	1	"	0	0	0	0	2	0	0
			JOEY	NAT	IMOPT	IPACK			
			5	0	0	0			

MULTI-PLAN ANALYSES TO BE PERFORMED  
PLAN= 1 'PTIO= 2 LATIO= 1

[illegible]

### 3.12-AREA RUNOFF COMPUTATION

## COMPARISON OF PWF-DEVELOPMENT OF INFLOW HYDROGRAPH

	ISTAG	IComp	IFCON	ITAPE	JPLT	JPRT	INAME	ISTAGE	IAUTO
1AYDG	1	0	0	0	0	0	1	0	0

	LUNG	TAPEA	SNAIP	IKSDA	INSPC	RATIO	ISNOW	ISAME	LOCAL
HYDROGRAPH DATA									
1AYDG				7	0.00	0.000	0	1	0

COFE	PM5	R6	R12	R24	R48	R72	R96
PRECIP DATA							

PROGRAM IS -835

LOSS DATA

[illegible]

## UNIT HYDROGRAPH DATA

$\tau_{\text{IN}} = 0$        $C_P = .75$        $N_A = 0$

FILED 1955 OCT 11 AM 11:00

STW<sub>0</sub> = 1.60      W(SN) = .05      PT10R = 2.00  
 COMMENTS: SNIP IN AGE TC = 6.64 AND WE = 6.87 INTERVALS

APPROXIMATE CLARK COEFFICIENTS FROM GIVEN SPYDEM CP AND IP ARE  $IC \approx 6.64$  AND  $IE \approx 6.87$  INTERVALS

	UNIT	MVZNOGAEAT	42 FLOW-REFRIND	DUALIATES*	LAGE	1.54 HOURS.	CP = .63	VOL = 1.00	
73.	280.	544.	992.	1152.	1404.	1470.	1632.	1563.	1388.
	1987.	773.	773.	670.	774.	501.	433.	374.	323.

DATE	TIME	WATER	EXCS	LOSS	CUM Q	MO.DA	HR.MN	PERIOD	MAIN	EXCS	LOSS	CUM Q
1.01	1.00	1	.01	0.00	1.	1.02	14.00	38	2.18	2.08	.10	2991.
1.01	2.00	2	.01	0.00	1.	1.02	15.00	39	2.73	2.63	.10	4327.
1.01	3.00	3	.01	0.00	1.	1.02	16.00	40	6.91	6.81	.10	6557.
1.01	4.00	4	.01	0.00	1.	1.02	17.00	41	2.55	2.45	.10	8434.
1.01	5.00	5	.01	0.00	1.	1.02	18.00	42	2.00	1.90	.10	14140.
1.01	6.00	6	.01	0.00	1.	1.02	19.00	43	.18	.08	.10	18656.
1.01	7.00	7	.02	0.00	1.	1.02	20.00	44	.18	.08	.10	22449.
1.01	8.00	8	.02	0.00	1.	1.02	21.00	45	.18	.08	.10	26173.
1.01	9.00	9	.02	0.00	1.	1.02	22.00	46	.18	.08	.10	28027.
1.01	10.00	10	.02	0.00	1.	1.02	23.00	47	.18	.08	.10	28341.
1.01	11.00	11	.02	0.00	1.	1.03	0.00	48	.18	.08	.10	27127.
1.01	12.00	12	.02	0.00	1.	1.03	1.00	49	0.00	0.00	0.00	24769.
1.01	13.00	13	.10	0.00	1.	1.03	2.00	50	0.00	0.00	0.00	21970.
1.01	14.00	14	.13	0.00	4.	1.03	3.00	51	0.00	0.00	0.00	19228.
1.01	15.00	15	.16	0.00	14.	1.03	4.00	52	0.00	0.00	0.00	16759.
1.01	16.00	16	.46	0.00	55.	1.03	5.00	53	0.00	0.00	0.00	14589.
1.01	17.00	17	.15	0.00	140.	1.03	6.00	54	0.00	0.00	0.00	12479.
1.01	18.00	18	.11	0.00	257.	1.03	7.00	55	0.00	0.00	0.00	10998.
1.01	19.00	19	.01	0.00	387.	1.03	8.00	56	0.00	0.00	0.00	9523.
1.01	20.00	20	.01	0.00	515.	1.03	9.00	57	0.00	0.00	0.00	8234.
1.01	21.00	21	.01	0.00	621.	1.03	10.00	58	0.00	0.00	0.00	7114.
1.01	22.00	22	.01	0.00	686.	1.03	11.00	59	0.00	0.00	0.00	6148.
1.01	23.00	23	.01	0.00	707.	1.03	12.00	60	0.00	0.00	0.00	5115.
1.02	0.00	24	.01	0.00	676.	1.03	13.00	61	0.00	0.00	0.00	4594.
1.02	1.00	25	.12	0.00	608.	1.03	14.00	62	0.00	0.00	0.00	3471.
1.02	2.00	26	.12	0.00	536.	1.03	15.00	63	0.00	0.00	0.00	3432.
1.02	3.00	27	.12	0.00	477.	1.03	16.00	64	0.00	0.00	0.00	2467.
1.02	4.00	28	.12	0.00	414.	1.03	17.00	65	0.00	0.00	0.00	2565.
1.02	5.00	29	.12	0.00	406.	1.03	18.00	66	0.00	0.00	0.00	2217.
1.02	6.00	30	.12	0.00	392.	1.03	19.00	67	0.00	0.00	0.00	1916.
1.02	7.00	31	.40	0.00	407.	1.03	20.00	68	0.00	0.00	0.00	1656.
1.02	8.00	32	.40	0.00	483.	1.03	21.00	69	0.00	0.00	0.00	1431.
1.02	9.00	33	.40	0.00	437.	1.03	22.00	70	0.00	0.00	0.00	1237.
1.02	10.00	34	.40	0.00	475.	1.03	23.00	71	0.00	0.00	0.00	1069.
1.02	11.00	35	.40	0.00	1147.	1.04	0.00	72	0.00	0.00	0.00	924.
1.02	12.00	36	.40	0.00	1449.	1.04	1.00	73	0.00	0.00	0.00	795.
1.02	13.00	37	1.72	0.00	2129.	1.04	2.00	74	0.00	0.00	0.00	684.
						1.04	3.00	75	0.00	0.00	0.00	588.

SUM 23.70 20.46 3.24 300779.  
( 602.3) ( 520.3) ( 82.3) (11065.63)

	PEAK	6-HOUR	24-HOUR	72-HOUR	TOTAL VOLUME
CFS	28341.	26144.	14651.	5423.	390478.
CMS	803.	740.	415.	154.	11057.
INCHES		8.13	18.23	20.25	20.25
MM		206.60	463.09	514.28	514.28
AC-FT		12966.	29059.	32271.	32271.
THOUS. CU M		15491.	35844.	39805.	39805.

0.00

STATION 1

PERFORMIT, OUTLINES(N) AND UNRESERVED FLOW(S)

0.	4000.	8000.	12000.	16000.	20000.	24000.	32000.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
1.00 11	.	.	.	.	.	.	.	.	.	.	.	L
2.00 21	.	.	.	.	.	.	.	.	.	.	.	L
3.00 31	.	.	.	.	.	.	.	.	.	.	.	L
4.00 41	.	.	.	.	.	.	.	.	.	.	.	L
5.00 51	.	.	.	.	.	.	.	.	.	.	.	L
6.00 61	.	.	.	.	.	.	.	.	.	.	.	L
7.00 71	.	.	.	.	.	.	.	.	.	.	.	L
8.00 81	.	.	.	.	.	.	.	.	.	.	.	L
9.00 91	.	.	.	.	.	.	.	.	.	.	.	L
10.00 101	.	.	.	.	.	.	.	.	.	.	.	L
11.00 111	.	.	.	.	.	.	.	.	.	.	.	L
12.00 121	.	.	.	.	.	.	.	.	.	.	.	L
13.00 131	.	.	.	.	.	.	.	.	.	.	.	L
14.00 141	.	.	.	.	.	.	.	.	.	.	.	L
15.00 151	.	.	.	.	.	.	.	.	.	.	.	L
16.00 161	.	.	.	.	.	.	.	.	.	.	.	L
17.00 171	.	.	.	.	.	.	.	.	.	.	.	L
18.00 181	.	.	.	.	.	.	.	.	.	.	.	L
19.00 191	.	.	.	.	.	.	.	.	.	.	.	L
20.00 201	.	.	.	.	.	.	.	.	.	.	.	L
21.00 211	.	.	.	.	.	.	.	.	.	.	.	L
22.00 221	.	.	.	.	.	.	.	.	.	.	.	L
23.00 231	.	.	.	.	.	.	.	.	.	.	.	L
24.00 241	.	.	.	.	.	.	.	.	.	.	.	L
25.00 251	.	.	.	.	.	.	.	.	.	.	.	L
26.00 261	.	.	.	.	.	.	.	.	.	.	.	L
27.00 271	.	.	.	.	.	.	.	.	.	.	.	L
28.00 281	.	.	.	.	.	.	.	.	.	.	.	L
29.00 291	.	.	.	.	.	.	.	.	.	.	.	L
30.00 301	.	.	.	.	.	.	.	.	.	.	.	L
31.00 311	.	.	.	.	.	.	.	.	.	.	.	L
32.00 321	.	.	.	.	.	.	.	.	.	.	.	L
33.00 331	.	.	.	.	.	.	.	.	.	.	.	L
34.00 341	.	.	.	.	.	.	.	.	.	.	.	L
35.00 351	.	.	.	.	.	.	.	.	.	.	.	L
36.00 361	.	.	.	.	.	.	.	.	.	.	.	L
37.00 371	.	.	.	.	.	.	.	.	.	.	.	L
38.00 381	.	.	.	.	.	.	.	.	.	.	.	L
39.00 391	.	.	.	.	.	.	.	.	.	.	.	L
40.00 401	.	.	.	.	.	.	.	.	.	.	.	L
41.00 411	.	.	.	.	.	.	.	.	.	.	.	L
42.00 421	.	.	.	.	.	.	.	.	.	.	.	L
43.00 431	.	.	.	.	.	.	.	.	.	.	.	L
44.00 441	.	.	.	.	.	.	.	.	.	.	.	L
45.00 451	.	.	.	.	.	.	.	.	.	.	.	L
46.00 461	.	.	.	.	.	.	.	.	.	.	.	L
47.00 471	.	.	.	.	.	.	.	.	.	.	.	L
48.00 481	.	.	.	.	.	.	.	.	.	.	.	L
49.00 491	.	.	.	.	.	.	.	.	.	.	.	L
50.00 501	.	.	.	.	.	.	.	.	.	.	.	L
51.00 511	.	.	.	.	.	.	.	.	.	.	.	L
52.00 521	.	.	.	.	.	.	.	.	.	.	.	L

10.00	39.
11.00	40.
12.00	41.
13.00	42.
14.00	43.
15.00	44.
16.00	45.
17.00	46.
18.00	47.
19.00	48.
20.00	49.
21.00	50.
22.00	51.
23.00	52.
24.00	53.
25.00	54.
26.00	55.
27.00	56.
28.00	57.
29.00	58.
30.00	59.
31.00	60.
32.00	61.
33.00	62.
34.00	63.
35.00	64.
36.00	65.
37.00	66.
38.00	67.
39.00	68.
40.00	69.
41.00	70.
42.00	71.
43.00	72.
44.00	73.
45.00	74.
46.00	75.



CFT 5000 0.0 2.7 1.5 0.0 0.0 0.0 0.0

DAM DATA  
 TOPFL 74.7  
 COOL 2.6  
 EAPD 1.7  
 DAMWIN 120.

STATION 1. PLAN 1. RATIO 1

END-OF-PERIOD HYDROGRAPH ORDINATES

OUTFLOW									
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.

STORAGE

0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.

STAGE

69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7

PEAK OUTFLOW IS 14134. AT TIME 47.00 HOURS

TOTAL VOLUME									
14134.	13029.	7327.	2710.	195109.	5525.	10.12	256.97	14125.	19890.
400.	369.	207.	77.	5525.	10.12	256.97	14125.	19890.	19890.
4.05	4.05	4.12	10.12	10.12	10.12	10.12	10.12	10.12	10.12
102.96	102.96	231.60	256.97	256.97	256.97	256.97	256.97	256.97	256.97
6461.	6461.	14533.	14125.	14125.	14125.	14125.	14125.	14125.	14125.
7969.	7969.	17926.	19890.	19890.	19890.	19890.	19890.	19890.	19890.



NO. 1

STATION 1

INLET (F), OUTLET (G) AND OBSERVED FLOW (H)

0.	2000.	4000.	6000.	8000.	10000.	12000.	14000.	16000.	0.	0.	0.	0.	0.
1.00													
2.00													
3.00													
4.00													
5.00													
6.00													
7.00													
8.00													
9.00													
10.00													
11.00													
12.00													
13.00													
14.00													
15.00													
16.00													
17.00													
18.00													
19.00													
20.00													
21.00													
22.00													
23.00													
24.00													
25.00													
26.00													
27.00													
28.00													
29.00													
30.00													
31.00													
32.00													
33.00													
34.00													
35.00													
36.00													
37.00													
38.00													
39.00													
40.00													
41.00													
42.00													
43.00													
44.00													
45.00													
46.00													
47.00													
48.00													
49.00													
50.00													
51.00													
52.00													
53.00													
54.00													



1100.0

STATION 1. PLAN 1. RATIO 2  
 100-DE-DEFINITION HYDROGRAPH ORDINATES

OUTFLOW									
1.	2.	3.	4.	5.	6.	7.	8.	9.	10.
1.	1.	1.	1.	1.	1.	1.	1.	1.	1.
504.	474.	705.	686.	625.	553.	490.	444.	349.	483.
461.	454.	536.	514.	414.	314.	2031.	2871.	4037.	395.
422.	1627.	1670.	2073.	2425.	2677.	27954.	27770.	26226.	23718.
20220.	14963.	15601.	13957.	11615.	10008.	8611.	7409.	6379.	5496.
4734.	4066.	3525.	3041.	2617.	2256.	1952.	1703.	1467.	1272.
1999.	952.	521.	707.	609.					

STORAGE									
1.	2.	3.	4.	5.	6.	7.	8.	9.	10.
0.	0.	0.	0.	0.	0.	0.	0.	0.	0.
17.	14.	19.	19.	19.	17.	15.	14.	13.	15.
14.	14.	17.	21.	26.	32.	39.	48.	65.	100.
164.	269.	412.	581.	751.	805.	955.	944.	858.	725.
686.	464.	370.	296.	238.	192.	157.	129.	107.	90.
77.	66.	57.	50.	45.	41.	38.	35.	31.	28.
24.	23.	21.	19.	17.					

STAGE									
1.	2.	3.	4.	5.	6.	7.	8.	9.	10.
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7	69.7
71.9	72.1	72.2	72.2	72.0	71.8	71.7	71.5	71.4	71.4
71.4	71.4	71.9	72.5	73.2	73.9	74.8	75.7	76.6	78.0
79.6	81.5	83.3	85.0	86.3	87.2	87.7	87.6	87.1	86.1
85.0	83.9	82.8	81.9	81.0	80.2	79.5	78.8	78.2	77.6
77.1	76.7	76.2	75.8	75.5	75.1	74.7	74.3	73.8	73.4
73.1	72.4	72.6	72.2	72.0					

PEAK OUTFLOW IS 27054. AT TIME 47.00 HOURS

PEAK				TOTAL VOLUME			
6-HOUR	24-HOUR	72-HOUR	PEAK	6-HOUR	24-HOUR	72-HOUR	PEAK
27054.	25855.	14654.	27054.	25855.	14654.	5420.	39072.
792.	732.	415.	792.	732.	415.	153.	11051.
INCHES				20.24			
AM				514.01			
AC-FT				32254.			
THOUS CU Y				39785.			

100000 (1) 100000 (2) AND OBSERVED FLOW (3)

4000.	8000.	12000.	16000.	20000.	24000.	28000.	32000.	0.	0.	0.	0.	0.
1.00	11											
2.00	21											
3.00	31											
4.00	41											
5.00	51											
6.00	61											
7.00	71											
8.00	81											
9.00	91											
10.00	101											
11.00	111											
12.00	121											
13.00	131											
14.00	141											
15.00	151											
16.00	161											
17.00	171											
18.00	181											
19.00	191											
20.00	201											
21.00	21.01											
22.00	22.1											
23.00	23.1											
24.00	24.1											
25.00	25.1											
26.00	26.1											
27.00	27.1											
28.00	28.1											
29.00	29.1											
30.00	30.1											
31.00	31.1											
32.00	32.1											
33.00	33.01											
34.00	34.1											
35.00	35.1											
36.00	36.1											
37.00	37.1											
38.00	38.1											
39.00	39.1											
40.00	40.1											
41.00	41.1											
42.00	42.1											
43.00	43.1											
44.00	44.1											
45.00	45.1											
46.00	46.1											
47.00	47.1											
48.00	48.1											
49.00	49.1											
50.00	50.1											
51.00	51.1											
52.00	52.1											
53.00	53.1											
54.00	54.1											



DEAD FLOW AND STORAGE (END OF PERIOD) SUMMARY FOR MULTIPLE PLAN-RATIO ECONOMIC COMPUTATIONS  
 FLOWS IN (CUBIC FEET PER SECOND) (CUBIC METERS PER SECOND)  
 AREA IN SQUARE FEET (SQUARE KILOMETERS)

OPERATION	STATION	AREA	PLAN	RATIOS APPLIED TO FLOWS	
				RATIO 1	RATIO 2
				.50	1.00
HYDROGRAPH AT	1	20,000	1	14170.	26941.
	(	77.44)	(	401.26)	802.52)
ROUTED TO	1	20,000	1	14144.	27954.
	(	77.44)	(	400.23)	741.57)

PLAN 1 .....

PLFVATION  
TIGMENT  
MATERIAL

INITIAL VALUE

SPILLWAY CHECK

TOP OF DAM

100  
11  
12

6573000  
 MI0004530  
 MI0010000

K. V. (1) 24A(1)  
 M. L. (1)  
 W. G. (1) 24A(1)

MAXIMUM  
STORAGE  
DATE

MAXIMUM  
OUTFLOW  
CFY

DURATION  
OVER TOP  
HOURS

TIME OF  
FAILURE  
HOURS

303

44-38861-100  
44-38861-101

7.50  
12.21

3114.  
4555.

• ۱۹۸۱  
• ۱۹۸۲

24.00  
30.00

0-00  
0-00

# MIANUS FILTER PLANT DAM

## A. Size Classification

Height of dam = 31 ft.; hence Small

Storage capacity at top of dam (elev. 72.15) = 118 AC-FT.; hence small

Adopted size classification small

## B.i) Hazard Potential

This dam is located upstream of North Mianus, an  
urbanized area. The pond supplies water through a  
24" pipe for this town.

## ii) Impact of Failure of Dam at Maximum Pool (Top of Dam)

It is estimated from the rule of "thumb" failure hydrograph, that the following adverse impacts are a possibility by the failure of this dam.

- a) Loss of homes Yes 3-5 ;
- b) Loss of buildings Yes 3-5 ;
- c) Loss of highways or roads No ;
- d) Loss of bridges No ;

The failure profile can affect a distance of 4000 feet from the dam.

## C. Hazard Potential Classifications

<u>HAZARD</u>	<u>SIZE</u>	<u>TEST FLOOD RANGE</u>
<u>High</u>	<u>Small</u>	<u>1/2 PMF to PMF</u>
Adopted Test Flood = <u>1/2 PMF</u> = <u>490</u> CSM		
= <u>14,200</u> CFS		

## D. Overtopping Potential

Drainage Area 19,164 Acres = 29.9 sq. miles

Spillway crest elevation = 69.65

Top of Dam Elevation = 72.15 (east)

Maximum spillway discharge

Capacity without overtopping of dam = 680 CFS

"test flood" inflow discharge = 14,200 CFS

"test flood" outflow discharge = 14,100 CFS



# MIANUS FILTER PLANT DAM

## Dam Failure Analysis

1. Failure discharge with pool at top of dam (elev. 72.15) = 8463 CFS
2. Depth of water in reservoir at time of failure = 28 ft.
3. Maximum depth of flow downstream of dam = @ Face 9.0 ft.
4. Water surface elevation just downstream)  
of dam at time of failure ) = 50.5±

The failure discharge of 8463 CFS will enter and flow downstream 4000+ feet until the river enters Mianus Pond. Valley storage in this 4000 foot length of brook is substantial in reducing the discharge. Also due to roughness characteristics, obstructions and frictional losses, it is very likely that the unsteady dam failure flow will dissipate its wave and kinetic energy and thus convert to steady and uniform flow obeying Manning's formulae 4000 feet downstream. The failure profile will have the following hydraulic characteristics:

DISTANCE FROM THE DAM	WATER SURFACE ELEVATION	REMARKS
0	72.15	Upstream of dam
0	50.5	Downstream of dam
2000'	25.0	
4000'	19.5	

Beyond 4000 feet, and into Mianus Pond, the failure discharge will flow in the below given channel characteristics:

Q = 4582 CFS; S = .005  
n = 0.05; b = 150; d = 4.5

Side slopes = 1V or 2H.

"Rule of Thumb Guidance for Estimating  
Downstream Dam Failure Analysis"

DATA

Name of Dam Mianus Filter Plant Dam  
Location North of North Mianus  
Drainage Area 29.9 sq. mi., Top of Dam 72.15 (east)  
Spillway Type Broad Crested, Crest of Spillway 69.65  
Surface Area @ Crest Elev. 7.6 Acres = 0.012 sq. mi.  
Pool Bottom Near Dam = 41.5±  
Assumed Side Slopes of Embankments = 2:1  
Depth of Pool at Dam ( $Y_o$ ) = 28 Feet  
Mid-Height Elev. 57.25  
Length of Dam at Crest = 200 Feet  
Length of Dam at Mid-Height = 171 Feet  
20 % of Dam Length at Mid-Height =  $W_b$  = 34 Feet

Step 1

Storage (S) at time of failure 118 Ac-FT  
(Equal to top of dam)

Step 2

$$\begin{aligned} &\text{Peak Failure Discharge} \\ Q_{pl} &= 8/27 W_b \sqrt{g} Y_o^{3/2} \\ &= 1.68 W_b Y_o^{3/2} = 8463 \text{ cfs} \end{aligned}$$

Failure is assumed to coincide with pool elevation at top of dam.

AD-A142 685

NATIONAL PROGRAM FOR INSPECTION OF NON-FEDERAL DAMS  
MIANUS FILTER PLANT D..(U) CORPS OF ENGINEERS WALTHAM  
MA NEW ENGLAND DIV FEB 80

2/2

UNCLASSIFIED

F/G 13/13

NL




END

DATE

FILED

8-84

DTIC

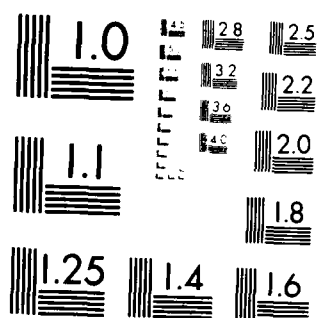

MICROCOPY RESOLUTION TEST CHART  
NATIONAL BUREAU OF STANDARDS-1963-A

Mianus Pond is located 4000 feet downstream of Mianus Filter Plant dam. There is a 26.5 foot drop into Mianus pond which will cause the dissipation of wave and kinetic energy of the failure discharge. Approximately, the water surface elevations between the dam and Mianus pond will be as given on Dam Failure Analysis. The increase of depth in Mianus pond due to failure of Mianus Filter Plant dam is estimated to be 4.5 feet.

BY: ELB DATE: 1/22/77 SUBJECT: DAM INSPECTION  
 CHKD. BY: ELB DATE: 1/15/77 STUDIES

SHEET NO. 1 OF 3  
 JOB NO. 77-345


# DOWNSTREAM W.S. EL. COMPUTATIONS

NAME OF DAM: MIANUS FILTER PLANT DAM

SECTION LOCATION: FACE DOWNSTREAM OF DAM


USING:  $Q = 1.486/n A R^{2/3} S^{1/2}$

WHERE:  $n = \underline{0.05}$   $S = \text{SLOPE} = \underline{0.017\%}$

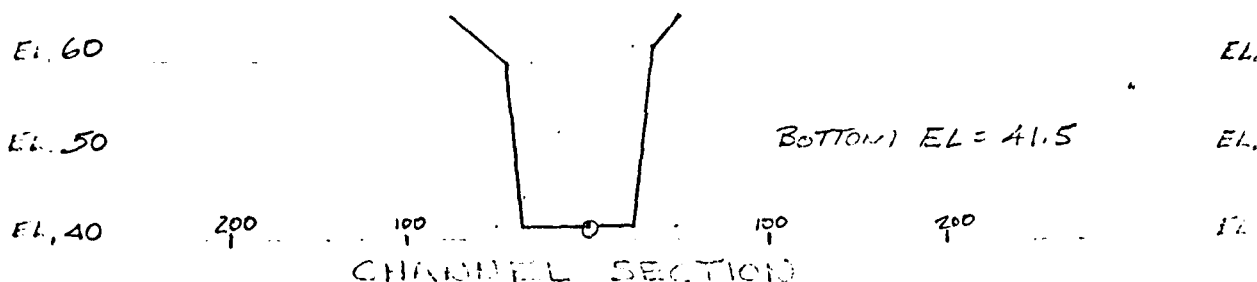

$Q_p = \underline{8463 \text{ cfs}}$  STORAGE (S) 118 AC-FT

EL. 50	AREA	W.P.	F	$R^{2/3}$	$S^{1/2}$	$1.486/n$	Q	STAGE
50	553	77	7.18	3.72	.13	2372	7952	8.5
55	916	87	10.52	4.80	.13	2372	16,996	13.5
52	696	81	8.59	4.20	.13	2372	11,282	

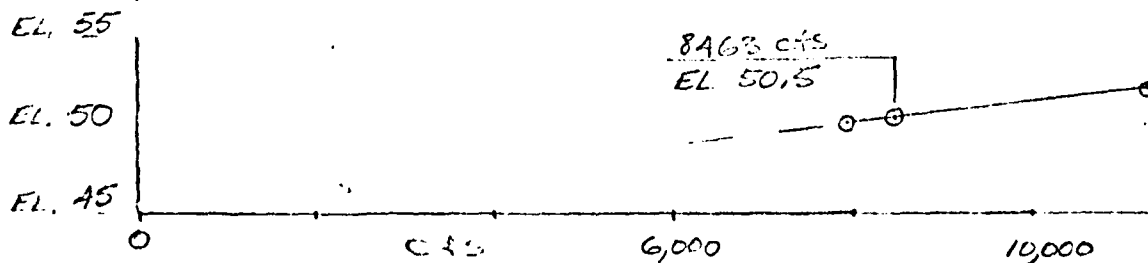

DEPTH @ DOWNSTREAM FACE OF DAM  
 EQUAL TO 9.0 OR EL 50.5

STAGE DISCHARGE 8463 ELEV = 50.5 OR A D = 9.0  
 NEXT DOWNSTREAM SECTION 2000 FT.



PURCELL ASSOCIATES

BY: ERC DATE: 11/22/77 SUBJECT: DAM INSPECTION  
 CHKD. BY: ER1 DATE: 1/15/78 STUDIES: \_\_\_\_\_

SHEET NO. 2 OF 3  
 JOB NO. 77-905


## DOWNSTREAM W.S. EL. COMPUTATIONS

NAME OF DAM: MILANOS FILTER PLANT DAM

SECTION LOCATION: 2000' DOWNSTREAM OF DAM


USING:  $Q = 1.486/n A R^{2/3} S^{1/2}$

WHERE:  $n = \underline{0.05}$   $S = \text{SLOPE} = \underline{.0051/1}$  (ASSUMED)

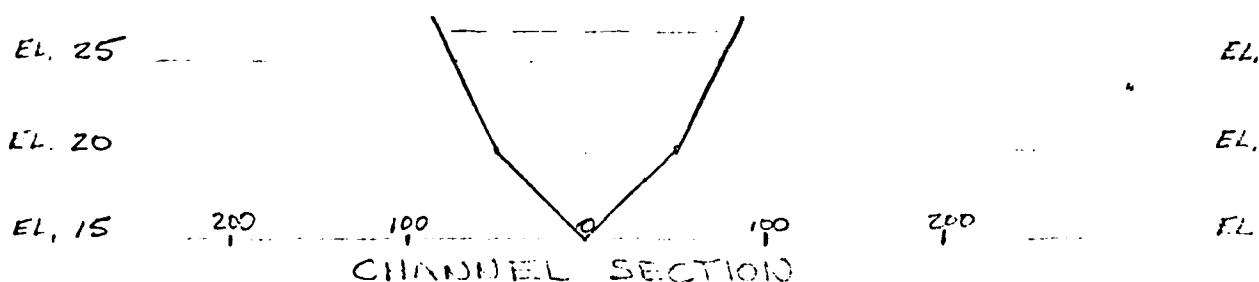

$Q_P = \underline{8463}$  STORAGE (S) 118 AC-FT

ELEV.	AREA	WP	R	$A^{2/3}$	$S^{1/2}$	$1.486/n$	Q cfs	DEPTH
20	250	100	2.5	1.84	.07	29.72	968	5
25	875	150	5.83	5.34	.07	29.72	5899	10
27.5	1281	170	7.54	3.84	.07	29.72	10,245	12.5

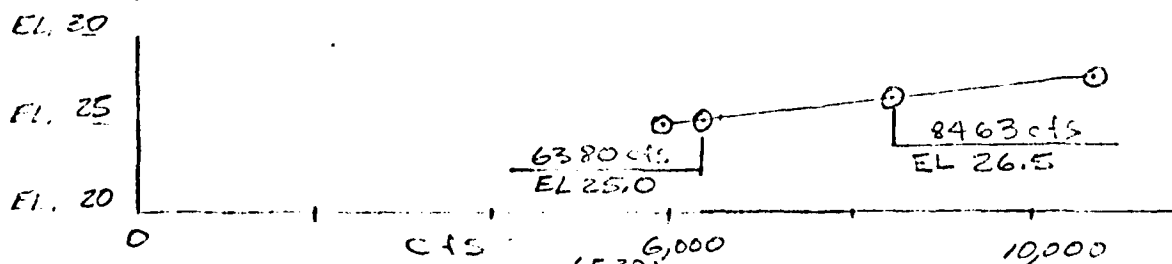

$$V_1 = \frac{9+0+11.5}{2} \times \left( \frac{70+165}{2} \times 2000 - 43530 \right)^{1/2} = 27.6 \text{ AC-FT}$$

$$Q_{P2}(\text{TRIAL}) = Q_{P1} (1 - V_1/S) = 6380 \text{ cfs}$$

$$V_2 = \frac{9+0+10.0}{2} \times 5.39 \times 1/2 = 25.6 \text{ AC-FT} \quad V_{AVE} = 26.6 \text{ AC-FT}$$

$$Q_{P2} = Q_{P1} (1 - V_{AVE}/S) = 6626 \text{ cfs}$$

STAGE DISCHARGE = 6626 cfs ELEV = 25.0 OR A D = 10.0

NEXT DOWNSTREAM SECTION' 2000' FT.

PURCELL ASSOCIATES

BY: ELB DATE: 11/22/77 SUBJECT: DAM INSPECTION  
 CHKD. BY: FRJ DATE: 1/13/78 STORED:

SHEET NO. 3 OF 3  
 JOB NO. 77-385


## DOWNSTREAM W.S. EL. COMPUTATIONS

NAME OF DAM: \_\_\_\_\_

SECTION LOCATION: 4000' DOWNSTREAM OF DAM  
JUST SOUTH OF PALMER'S HILL RD


USING:  $Q = 1.486/n A R^{2/3} S^{1/2}$

WHERE:  $n = \underline{0.05}$   $S = \text{SLOPE} = \underline{.005 \text{ ft/ft}}$

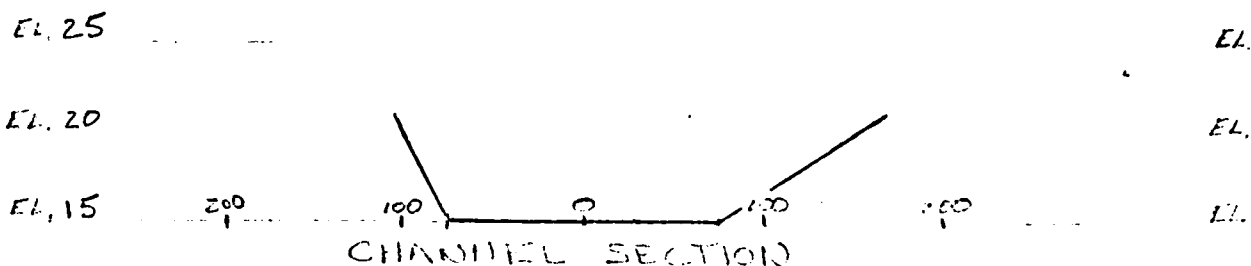

$Q_P = \underline{6626 \text{ cfs}}$  STORAGE (S) 118 AC-FT

ELEV	AREA	WP	R	$A^{2/3}$	$S^{1/2}$	$1.486/n$	S	Q
17.5	444	205	2.16	1.67	.07	29.72	1546	2.5
20	1013	250	4.05	2.54	.07	29.72	5358	5.0
						29.72		

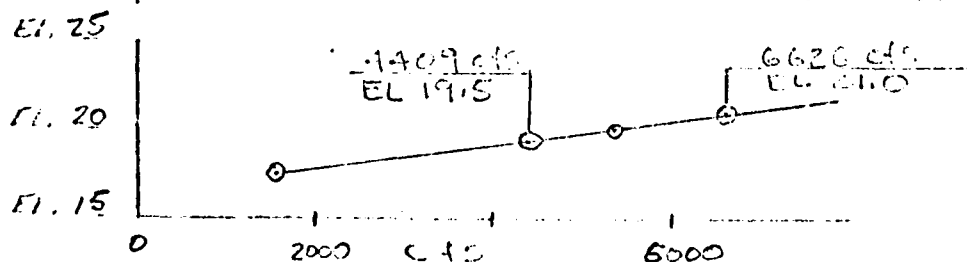

$$V_1 = \frac{10.0 + 6.0}{2} \times \left( \frac{160 + 270}{2} \times \frac{(9.27)}{2000 \div 43,560} \right)^{1/2} = 39.5 \text{ AC-FT}$$

$$Q_{P2}(\text{TRIAL}) = Q_{P1} (1 - V_1/S) = 4409 \text{ cfs}$$

$$V_2 = \frac{10.0 + 4.5}{2} \times \left( \frac{150 + 240}{2} \times \frac{200}{43,560} \right)^{1/2} = 33.2 \text{ AC-FT} \quad V_{\text{AVE}} = 36.4 \text{ AC-FT}$$

$$Q_{P2} = Q_{P1} (1 - V_{\text{AVE}}/S) = 4582 \text{ cfs}$$

STAGE DISCHARGE = 4582 cfs ELEV = 19.5 OR A D = 1.5

NEXT DOWNSTREAM SECTION N/A FT. PURCELL ASSOCIATES



## RATING CURVE DEVELOPMENT

### Mianus Filter Plant Dam

#### Spillway

$$Q = C L H^{2/3}$$

$$C = 2.65$$

$$L = 65 \text{ feet}$$

#### 24 Inch Blowoff

$$Q = c a (2gh)^{1/2}$$

$$c = .6$$

$$a = 3.14 \text{ square feet}$$

#### Floodgates


$$Q = C L H^{2/3} \text{ (unsubmerged)}$$

$$C = 2.7$$


$$L = 8 \text{ feet}$$

$$Q = c a (2gh)^{1/2} \text{ (submerged)}$$


$$c = 40 \text{ square feet}$$

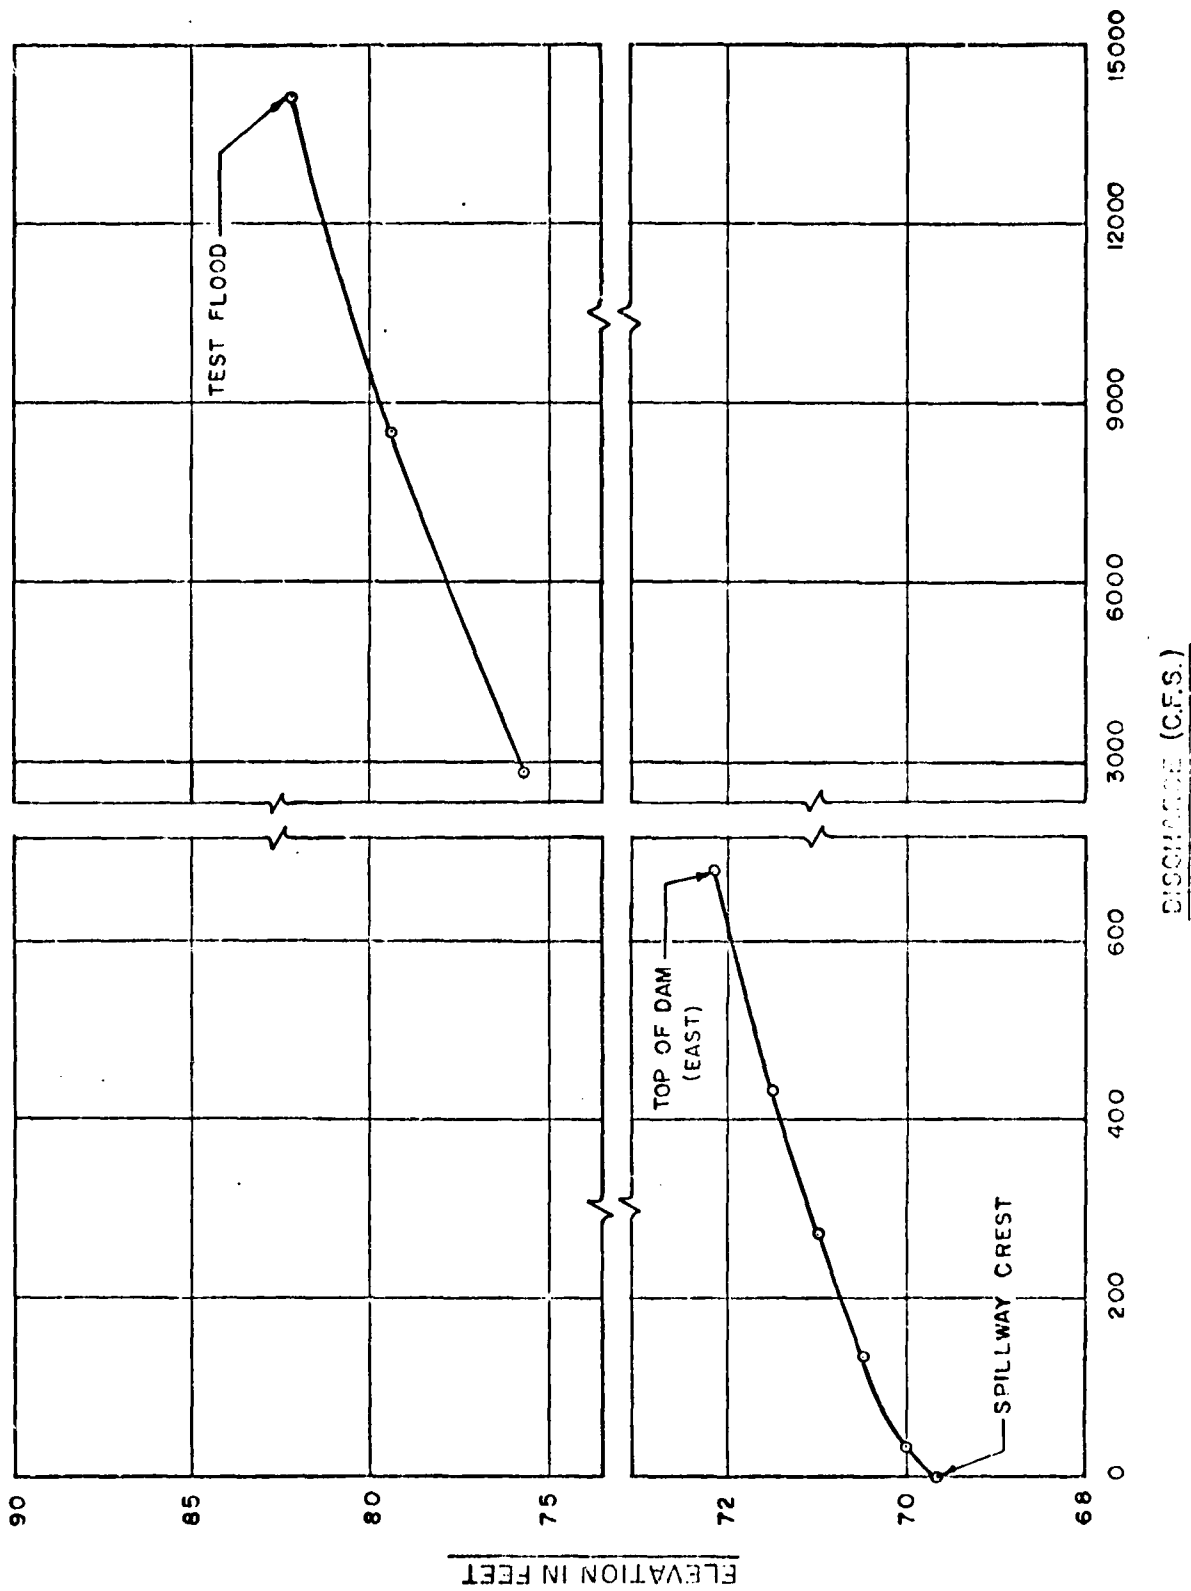


MIANUS FILTER PLANT DAM  
SPILLWAY RATING CURVE

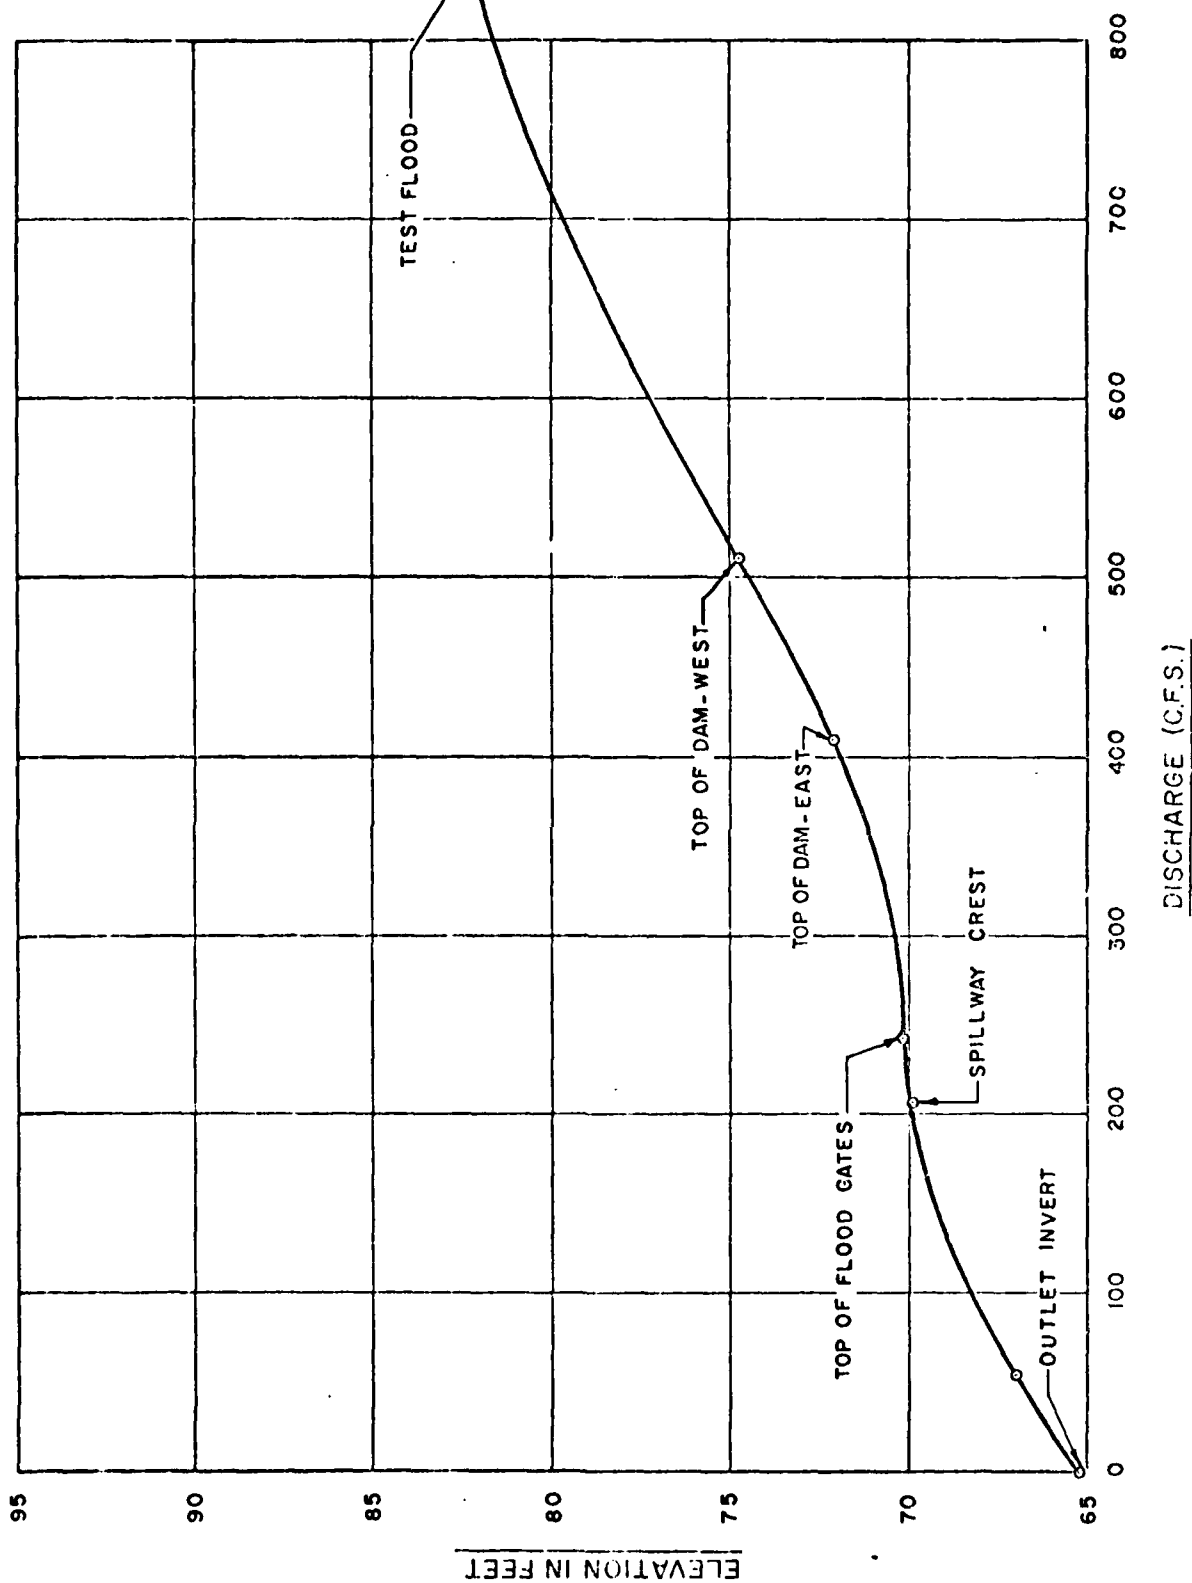

D-27 MIANUS FILTER PLANT DAM  
FLOOD GATES RATING CURVE

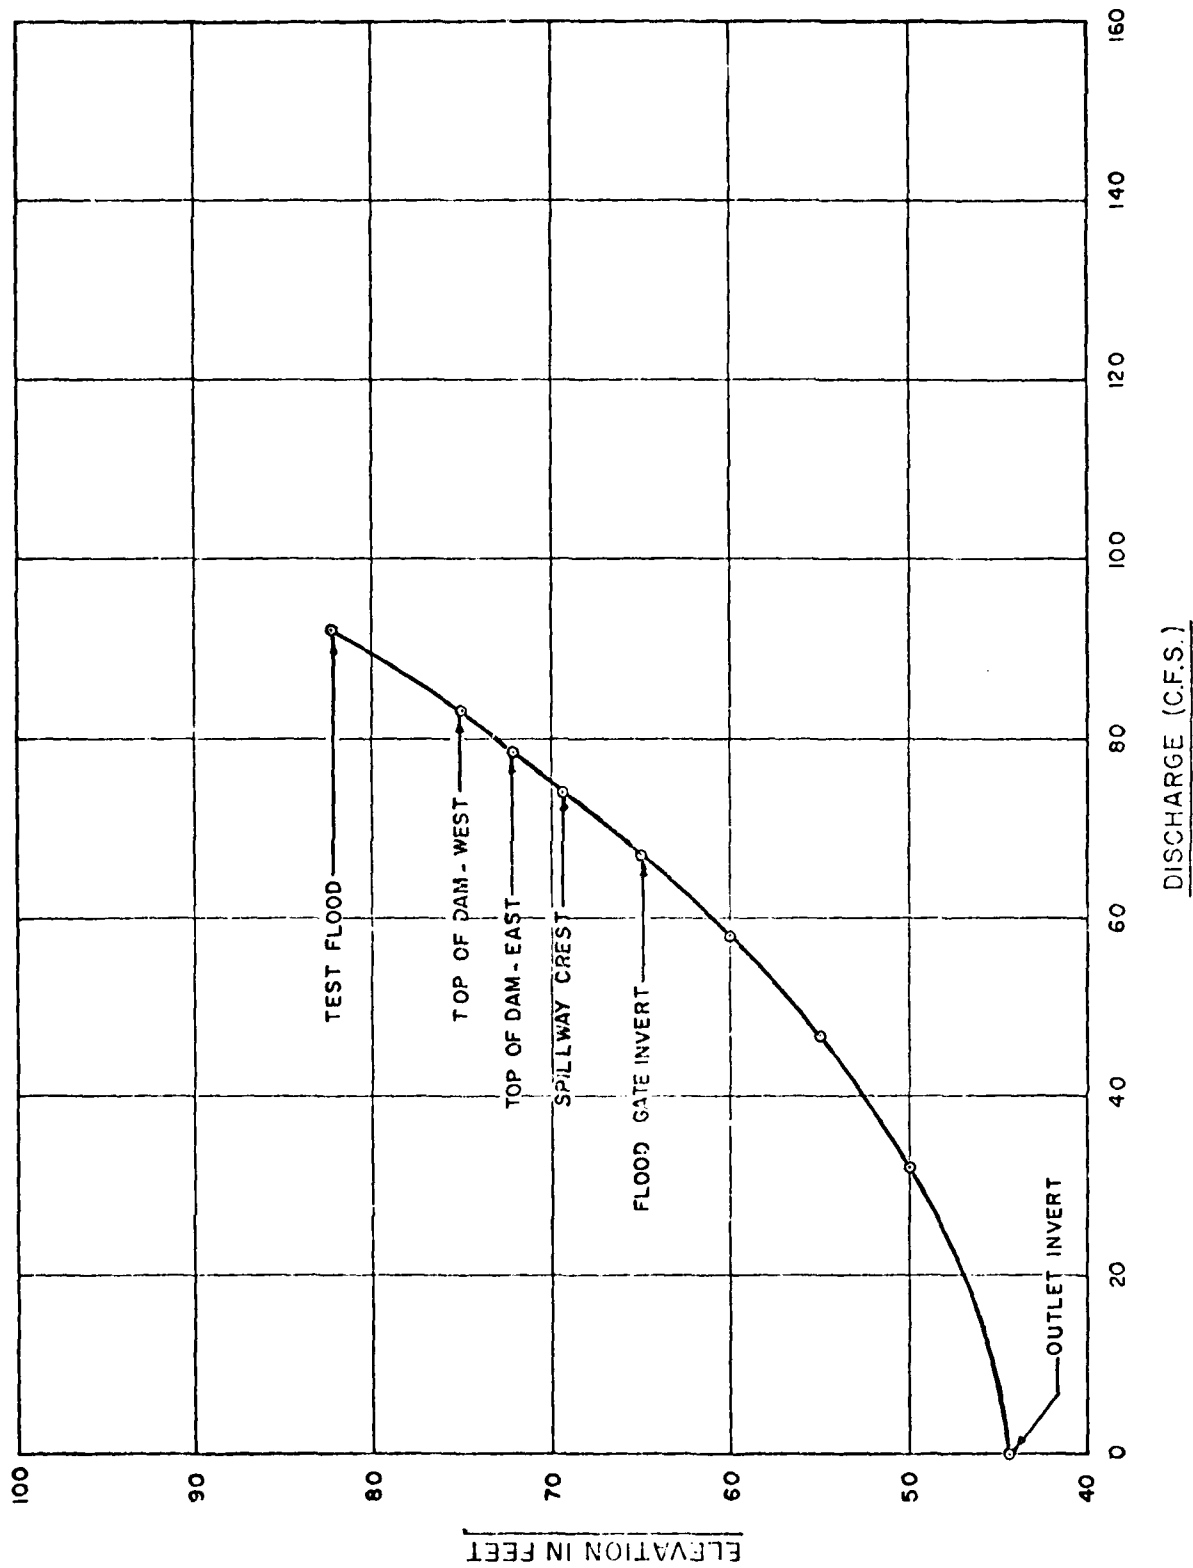

MIANUS FILTER PLANT DAM  
 LOW LEVEL BLOWOFF  
 OUTLET WORKS RATING CURVE

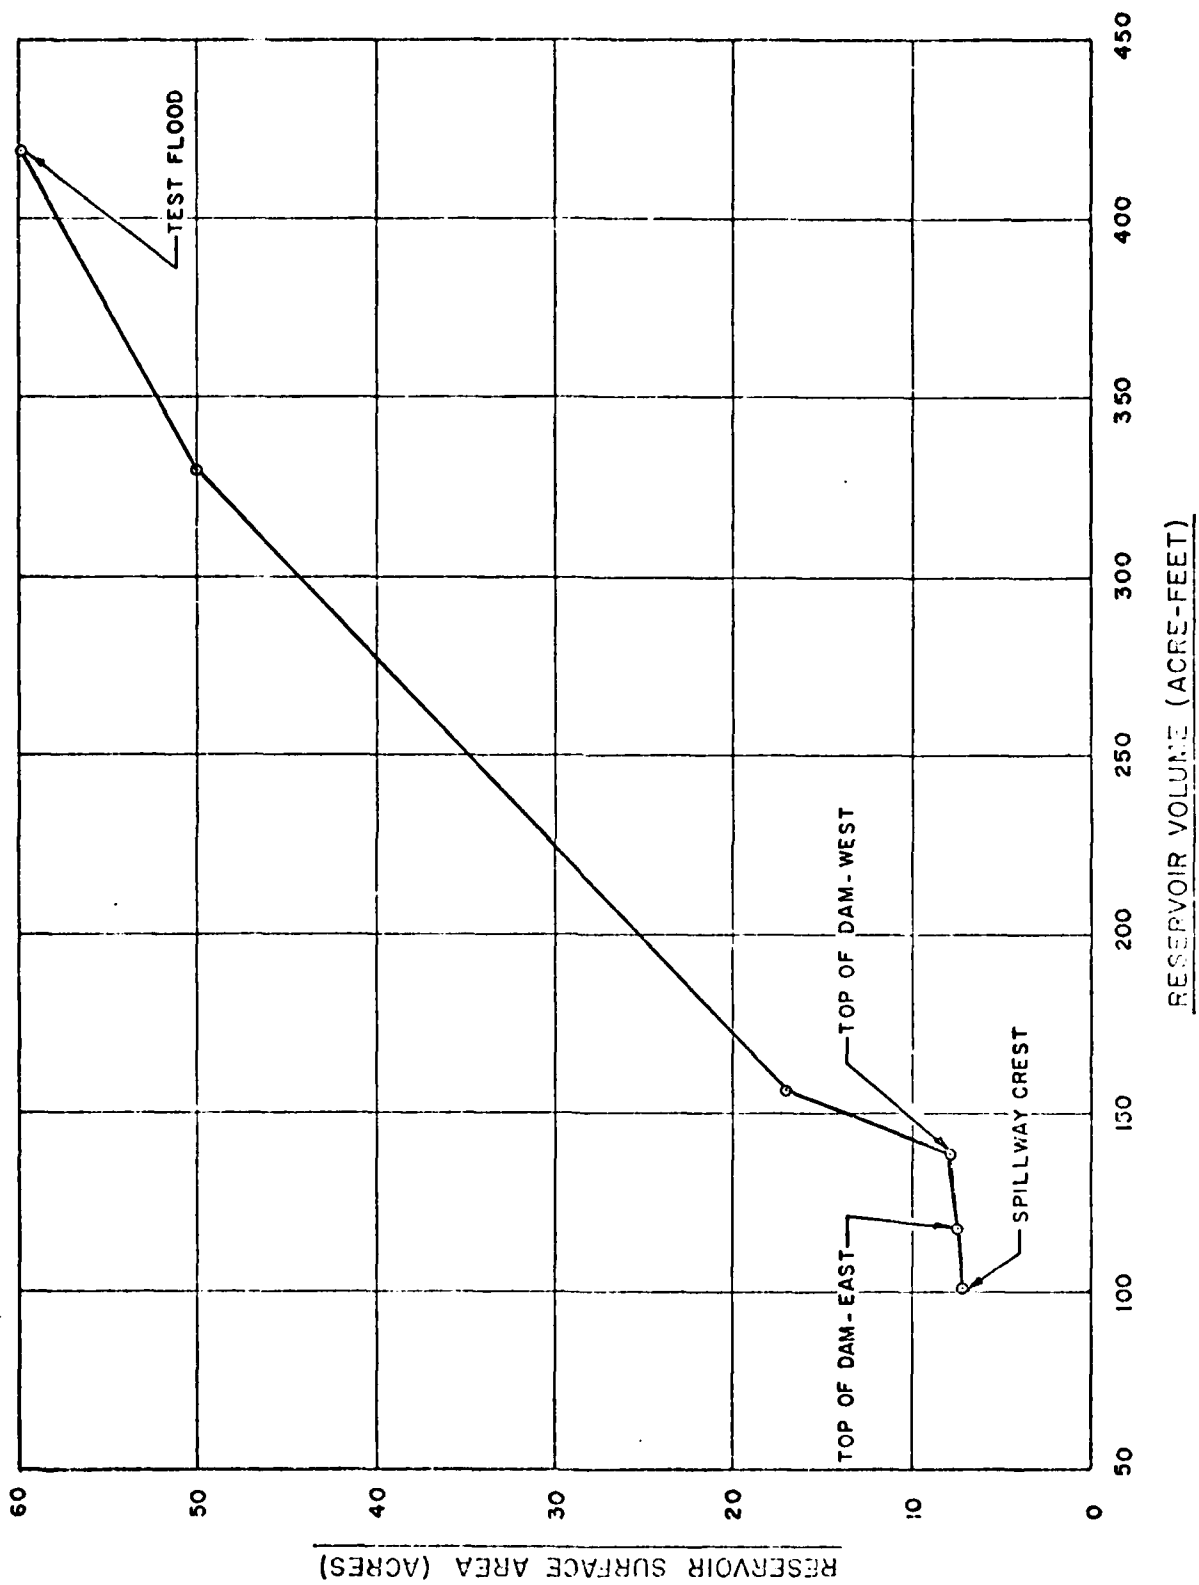

MIANUS FILTER PLANT DAM  
RESERVOIR AREA-CAPACITY CURVE

**APPENDIX E**  
**INFORMATION AS CONTAINED IN THE**  
**NATIONAL INVENTORY OF DAMS**



# INVENTORY OF DAMS IN THE UNITED STATES

STATE	IDENTITY NUMBER	DIVISION	COMB. DIST.	COUNTY	NAME	LATITUDE (NORTH)	LONGITUDE (WEST)	REPORT DATE
CT	40	40	01	04	MIANUS FILTER PLANT DAM	4104.1	7334.7	19DEC79

POPULAR NAME	NAME OF IMPONDMENT
MIANUS RIVER	MIANUS RIVER

REGION	RIVER OR STREAM	NEAREST DOWNSTREAM CITY-TOWN-VILLAGE	LAST FLOOD (YR)	POPULATION
01 07	MIANUS RIVER	NORTH MIANUS	1	2000

TYPE OF DAM	YEAR COMPLETED	PURPOSES	STILL HEIGHT (FT)	HYDRAULIC HEIGHT (FT)	IMPOUNDING CAPACITIES (ACRE-FT)
PGOT	1875	S	31	31	MAXIMUM 116 NORMAL 101

DIST U-M N FED R PHV/FED SCS A VER/DATE  
NEU - N N N ; N

## REMARKS

21-STONE MASONRY, 22-APPROXIMATE, MODIFIED IN 1955

U.S. HAS	SPILLWAY	MAXIMUM DISCHARGE (CFS)	VOLUME OF DAM (CY)	POWER CAPACITY (KW)	INSTALLED PROPOSED	NAVIGATION LOCKS
1	130 U	65	2100	680	2100	NO

OWNER	ENGINEERING BY	CONSTRUCTION BY
CT AMERICAN WATER CO	AM WATER WORKS SERV CO	

DESIGN	CONSTRUCTION	OPERATION	MAINTENANCE
		CT DEPT ENVIR PROT	CT DEPT ENVIR PROT

INSPECTION BY	INSPECTION DATE	AUTHORITY FOR INSPECTION
JAMES P PURCELL ASSOCIATES INC	13NOV79	76-3-1

REMARKS
47-1955 MODIFICATIONS ONLY

**DATE**  
**ILME**