

AJ636296

486474

**R 452**

Technical Report

TUNNEL VENTILATION AND  
HEAT-LOAD SURVEY - BYRD STATION,  
ANTARCTICA, 1965

July 1966

*code 1*

CLEARING HOUSE  
FOR FEDERAL SCIENTIFIC AND  
TECHNICAL INFORMATION

Hardcopy

Microfilm

\$1.00

\$0.50

*22/98*

NAVAL FACILITIES ENGINEERING COMMAND

ARCHIVE

COPY



U. S. NAVAL CIVIL ENGINEERING LABORATORY

Port Hueneme, California

Distribution of this document is unlimited.

DDC  
RECEIVED  
AUG 3 1966  
C

**BLANK PAGE**

TUNNEL VENTILATION AND HEAT-LOAD SURVEY — BYRD STATION,  
ANTARCTICA, 1965

Technical Report R-452

Y-F015-11-01-163

by

C. R. Hoffman

ABSTRACT

A ventilation and heat-load survey was conducted in the undersnow tunnels at Byrd Station, Antarctica, in late December 1965. This work was performed to obtain current information on tunnel cooling requirements and to obtain data for tunnel cooling system design.

The survey showed that average tunnel temperatures are 5 to 6°F lower than during a similar survey conducted in 1963, but are still as much as 18°F higher than the desired temperature of 0°F.

Doors originally installed at tunnel entrances have deformed and become inoperative, allowing the free circulation of warm surface air throughout the undersnow camp.

It was concluded that tunnel temperatures in the undersnow camp can be reduced by installation of airtight bulkheads and suitable selfclosing doors to prevent the inflow of warm, surface air and reduce cross-circulation between tunnels. All tunnels except L-7, which contains the communications galley and generator buildings, can be adequately cooled by drawing cold air from tunnel walls. A cooling system based on the U. S. Naval Facilities Engineering Command's air-plenum concept appears to be the most suitable means of cooling tunnel L-7.

Distribution of this document is unlimited.

The Laboratory invites comment on this report, particularly on the results obtained by those who have applied the information.

ACCESSION FOR

CFSTI  WHITE SECTION

DDC  BUFF SECTION

UNANNOUNCED

JUSTIFICATION *See statement on Doc*

BY *fm*

DISTRIBUTION/AVAILABILITY CODES

DIST.	AVAIL.	2nd	SPECIAL
1			

## CONTENTS

	page
INTRODUCTION . . . . .	1
BACKGROUND . . . . .	1
VENTILATION AND HEAT LOAD . . . . .	7
Air Velocity and Temperature . . . . .	7
Air Movement and Heat Load . . . . .	11
TUNNEL COOLING . . . . .	13
FINDINGS . . . . .	15
CONCLUSIONS . . . . .	16
RECOMMENDATIONS . . . . .	17

**BLANK PAGE**

## INTRODUCTION

The structural integrity and useful life of the undersnow camp at Byrd Station, Antarctica, is dependent upon the rate of snow deformation in the tunnel walls and roof arches. Studies of the structural properties of snow have shown that load-bearing characteristics improve and rate of deformation decreases as the snow temperature decreases. Several systems have been proposed for maintaining low temperatures in the snow tunnels during the critical summer months.

This report presents the results of a ventilation and heat load study conducted at Byrd Station during December 1965 and recommendations regarding construction of a cold-air-plenum system for lowering tunnel air temperatures.

## BACKGROUND

Byrd Station, Antarctica, is an undersnow camp designed by the U. S. Naval Facilities Engineering Command (NFEC)\* and constructed by Navy Seabees during the antarctic summers of 1960-61 and 1961-62. The Station consists of a network of tunnels containing prefabricated buildings and other equipment. While most facilities are in the tunnels, some small buildings are elevated above the surface. A few scientific facilities which require freedom from electromagnetic disturbance are located a mile or more from the Station without subsurface communication. The general layout of the tunnel complex is shown in Figure 1.

The tunnels were constructed by excavating trenches in the snow, placing timber sills on the abutments and roofing the trenches with corrugated steel arches. Snow was backfilled to the peak of the arch to provide a smooth undisturbed surface to drifting snow. Entrance to and from the surface was by vehicle ramps at the end of tunnels M-1 and L-3, or by vertical escape shafts from the lateral tunnels.

In designing the undersnow camp, tunnel ventilation and cooling were known to be of great importance in minimizing deformation of snow tunnels. Operating instructions for Byrd Station reportedly specified 0°F as the maximum desired tunnel temperature. Systems for cooling the tunnels during the critical summer months were based on utilization of the immense heat sink on which the camp is built. Because of the insulating properties of snow, the temperatures at depths below 25 feet remain constant and are equivalent to the mean annual temperature for the specific location. At Byrd Station, where mean monthly temperatures range from +5°F in December to

---

\* Formerly the U. S. Navy Bureau of Yards and Docks.

-35°F in July and August, the snow temperature at that depth is -19°F. During most of the year, surface temperatures are below 0°F and large quantities of cold air flow naturally through the porous snow or tunnel openings to maintain tunnel air temperatures near the desired 0°F level. In the summer months, however, surface temperatures rise above 0°F and the warmer air is unsuitable for tunnel ventilation.

Ventilation at Byrd Station was originally designed for horizontal circulation, with floor-level fans at lateral tunnel entrances discharging into the central corridor M-1. This was changed during camp construction with the installation of surface-ducted exhaust fans at the arch crown in all tunnels where heat is liberated. Air wells were also installed in the tunnel floors. These consisted of a high-pressure axial blower mounted over a 16-inch-diameter, 40-foot-deep hole. When operating, they draw air from the tunnel downward through the porous cold snow floor and discharge the cooled air back to the tunnel via the fan. Many of the air wells in the original installation were inoperative because of fan damage incurred in transit. Those which were operated were found unsatisfactory because the cooling capacity of the units was inadequate, and the tunnel floor near the air well was softened by the absorbed heat.

Tunnel cooling and ventilation studies were conducted by the U. S. Army Cold Regions Research and Engineering Laboratory (CRREL) in 1961-62 during the first summer of occupancy and again in late January 1963.<sup>1</sup> The temperature and air flow information obtained during the 1963 studies (Figures 2 and 3) showed generally unsatisfactory tunnel temperatures during the summer months. The entrance of warm surface air and inadequate ventilation in tunnels with high heat gain resulted in temperatures in the tunnels as much as 23°F higher than the desired 0°F. As a result, a number of operational and maintenance recommendations were made for improving tunnel cooling. In addition, a tunnel cooling method was proposed to supplant the inadequate air wells.

The cooling system proposed by CRREL after the 1963 study was described as follows:

Pressure in the closed tunnels would be reduced by means of the arch crown exhaust fans so that cold air would flow out of the snow walls and floor. With seepage across the extensive snow area, large volumes of cold air could flow while seepage velocities in the snow pores remained low. In general, the highest seepage velocities of cold air would occur near the top of the walls because of the lower snow density. This higher seepage rate was considered by CRREL to be satisfactory since the arch seats are critical deformation zones. No action was taken on the proposed cooling method and therefore conditions remained relatively unchanged.

In 1965, NFEC proposed an air-plenum system for tunnel cooling. In this system, a small room would be excavated in the snow behind the tunnel wall and at the same elevation as the tunnel floor. A passageway of minimum dimension would connect the room and tunnel, and would be fitted with an airtight bulkhead. A fan mounted in the bulkhead would pull cold air from the snow walls and ceiling of the plenum room for delivery through a duct to the tunnel. Figure 4 shows a plan for proposed plenum location in tunnel L-7 which houses the generator building, mess hall and galley, and communications and shipstore buildings.

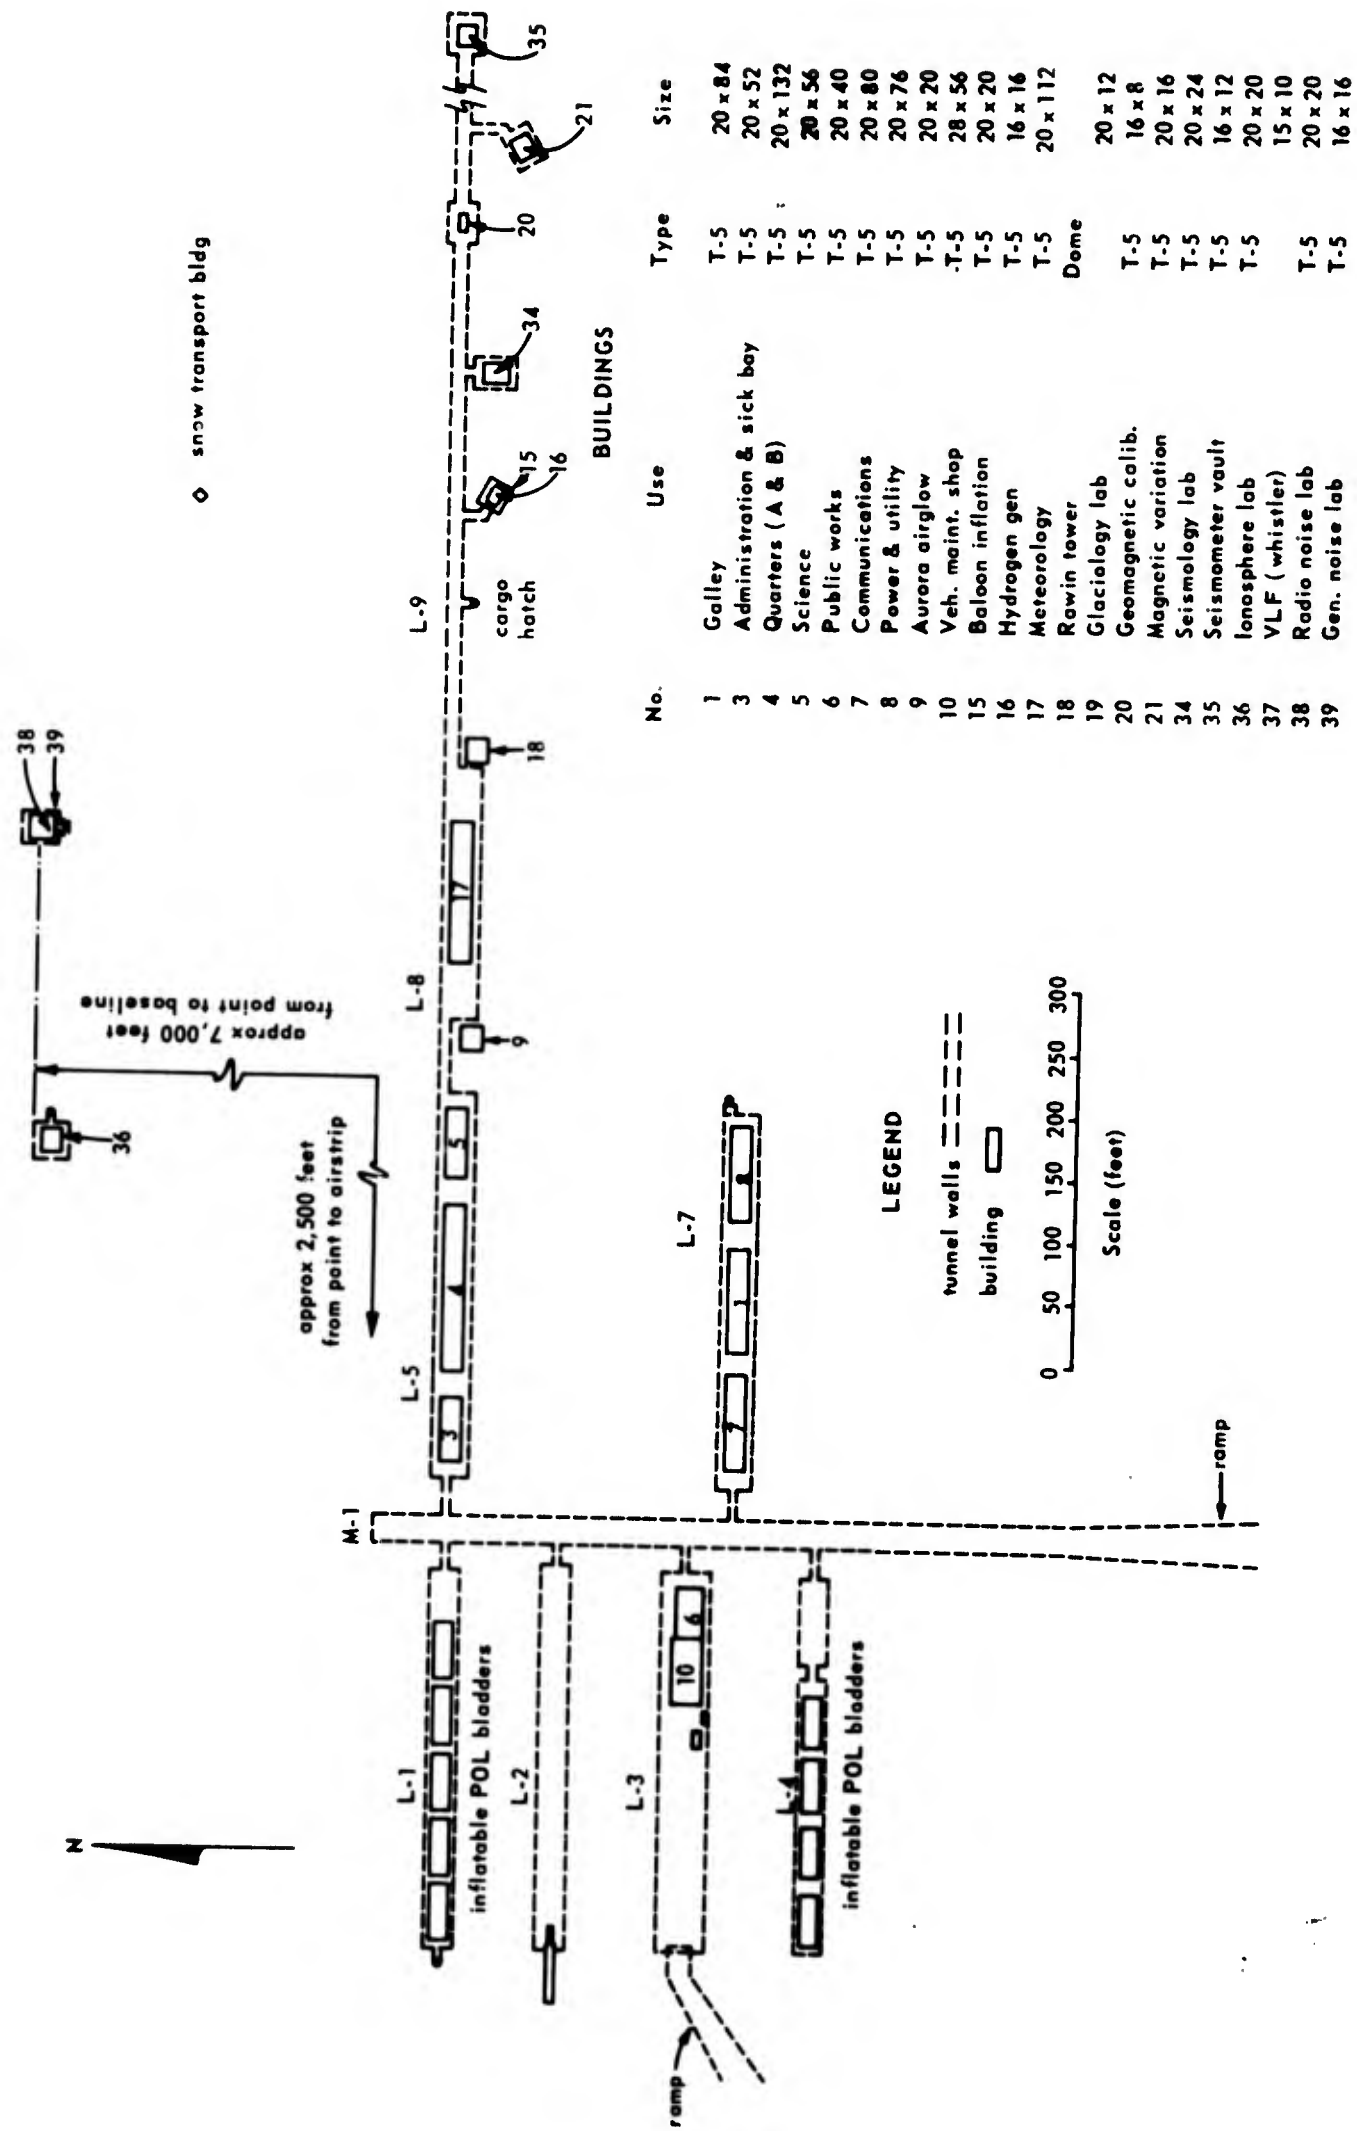


Figure 1. Plot plan of Byrd Station, Antarctica. Conditions as of DF65.




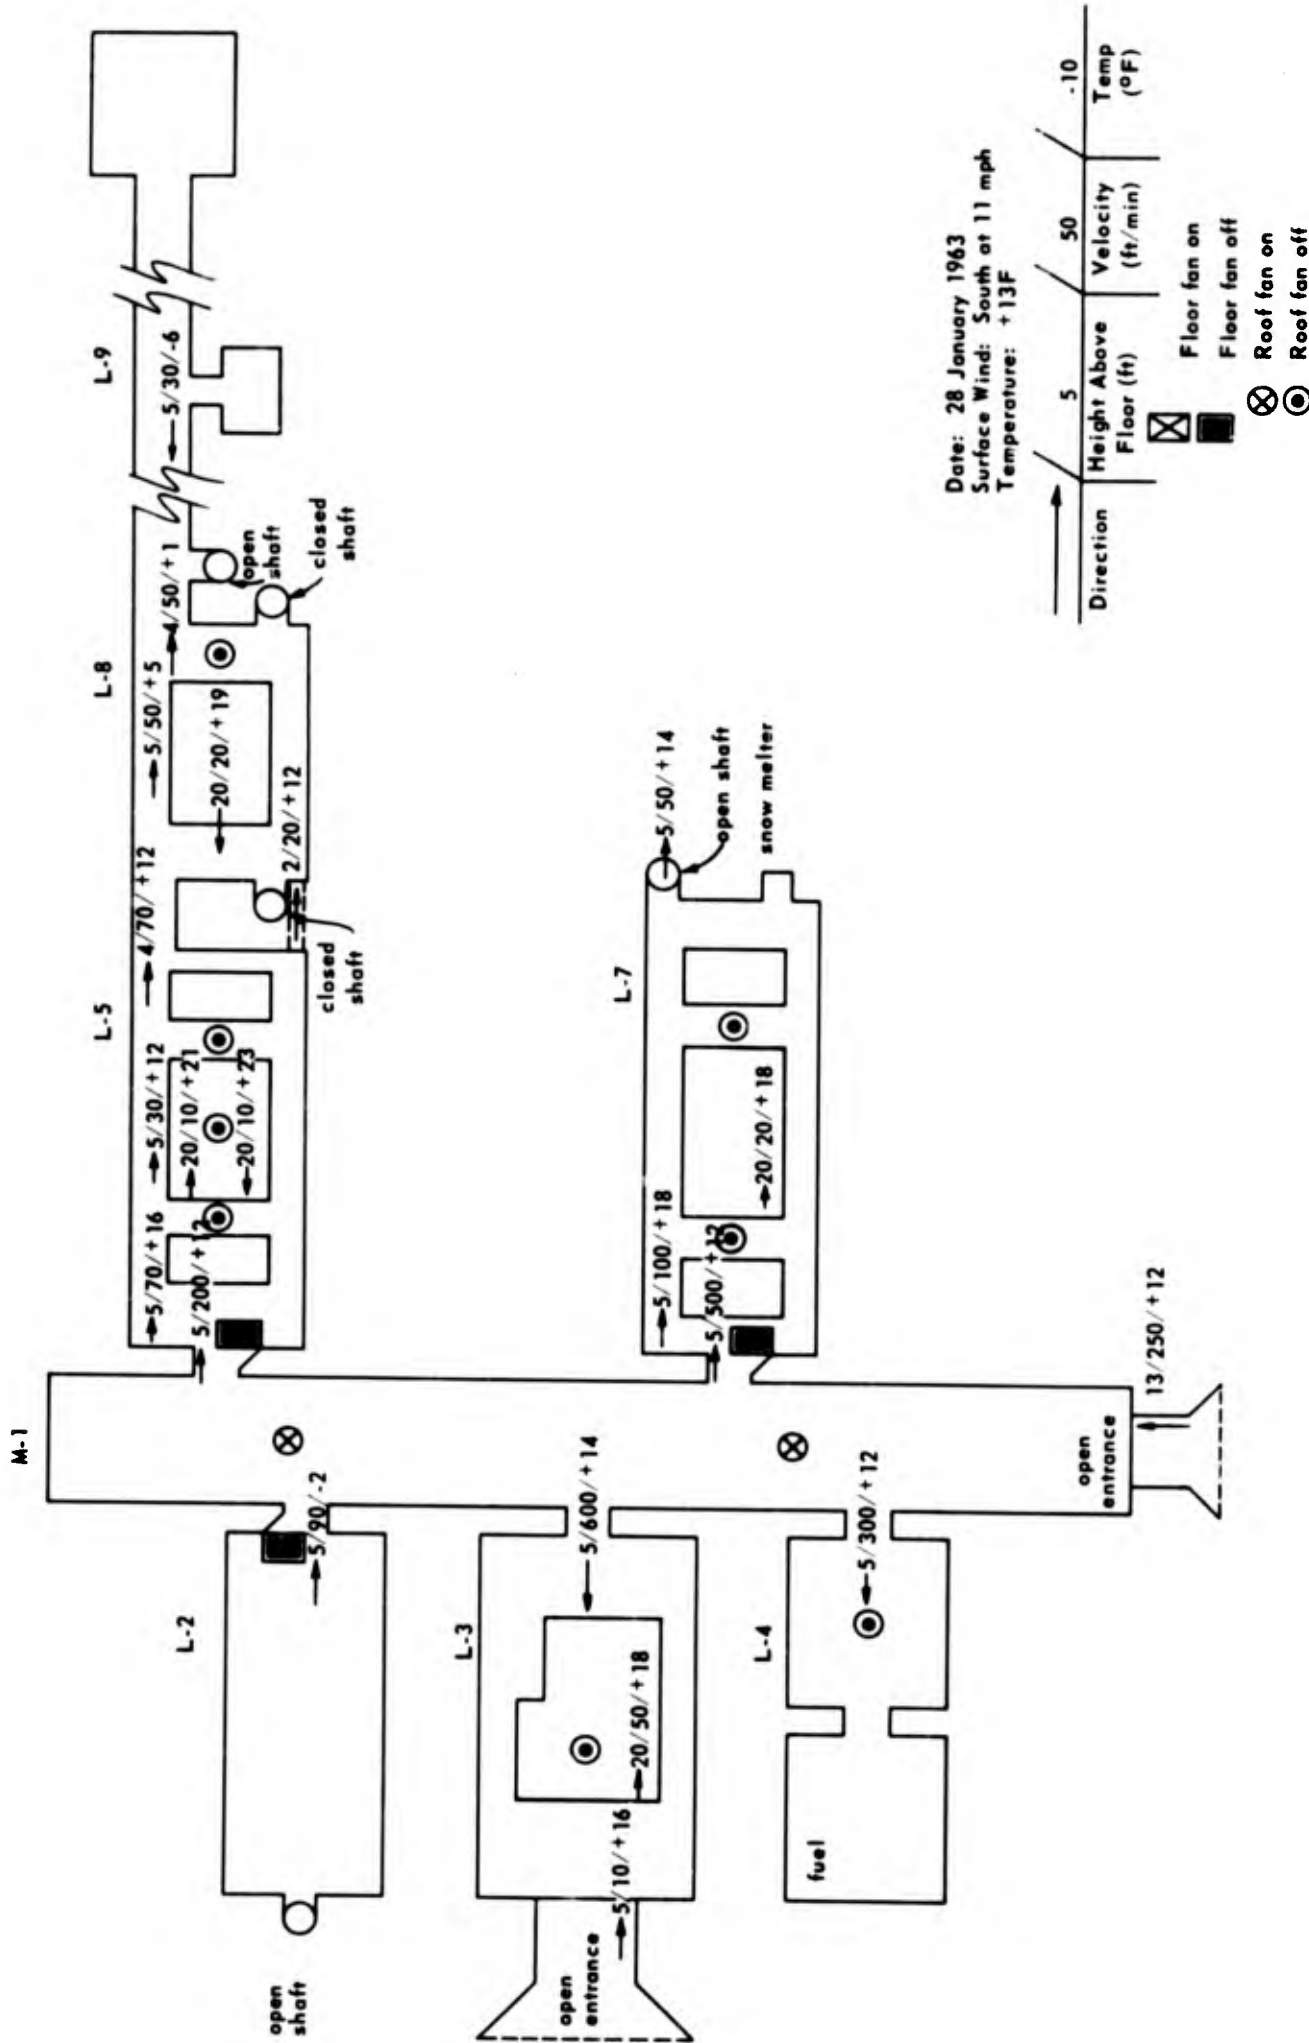


Figure 2. Air-temperature and air-velocity measurements taken with exhaust fans shut down as far as possible; Byrd Station, Antarctica, summer, 1963.

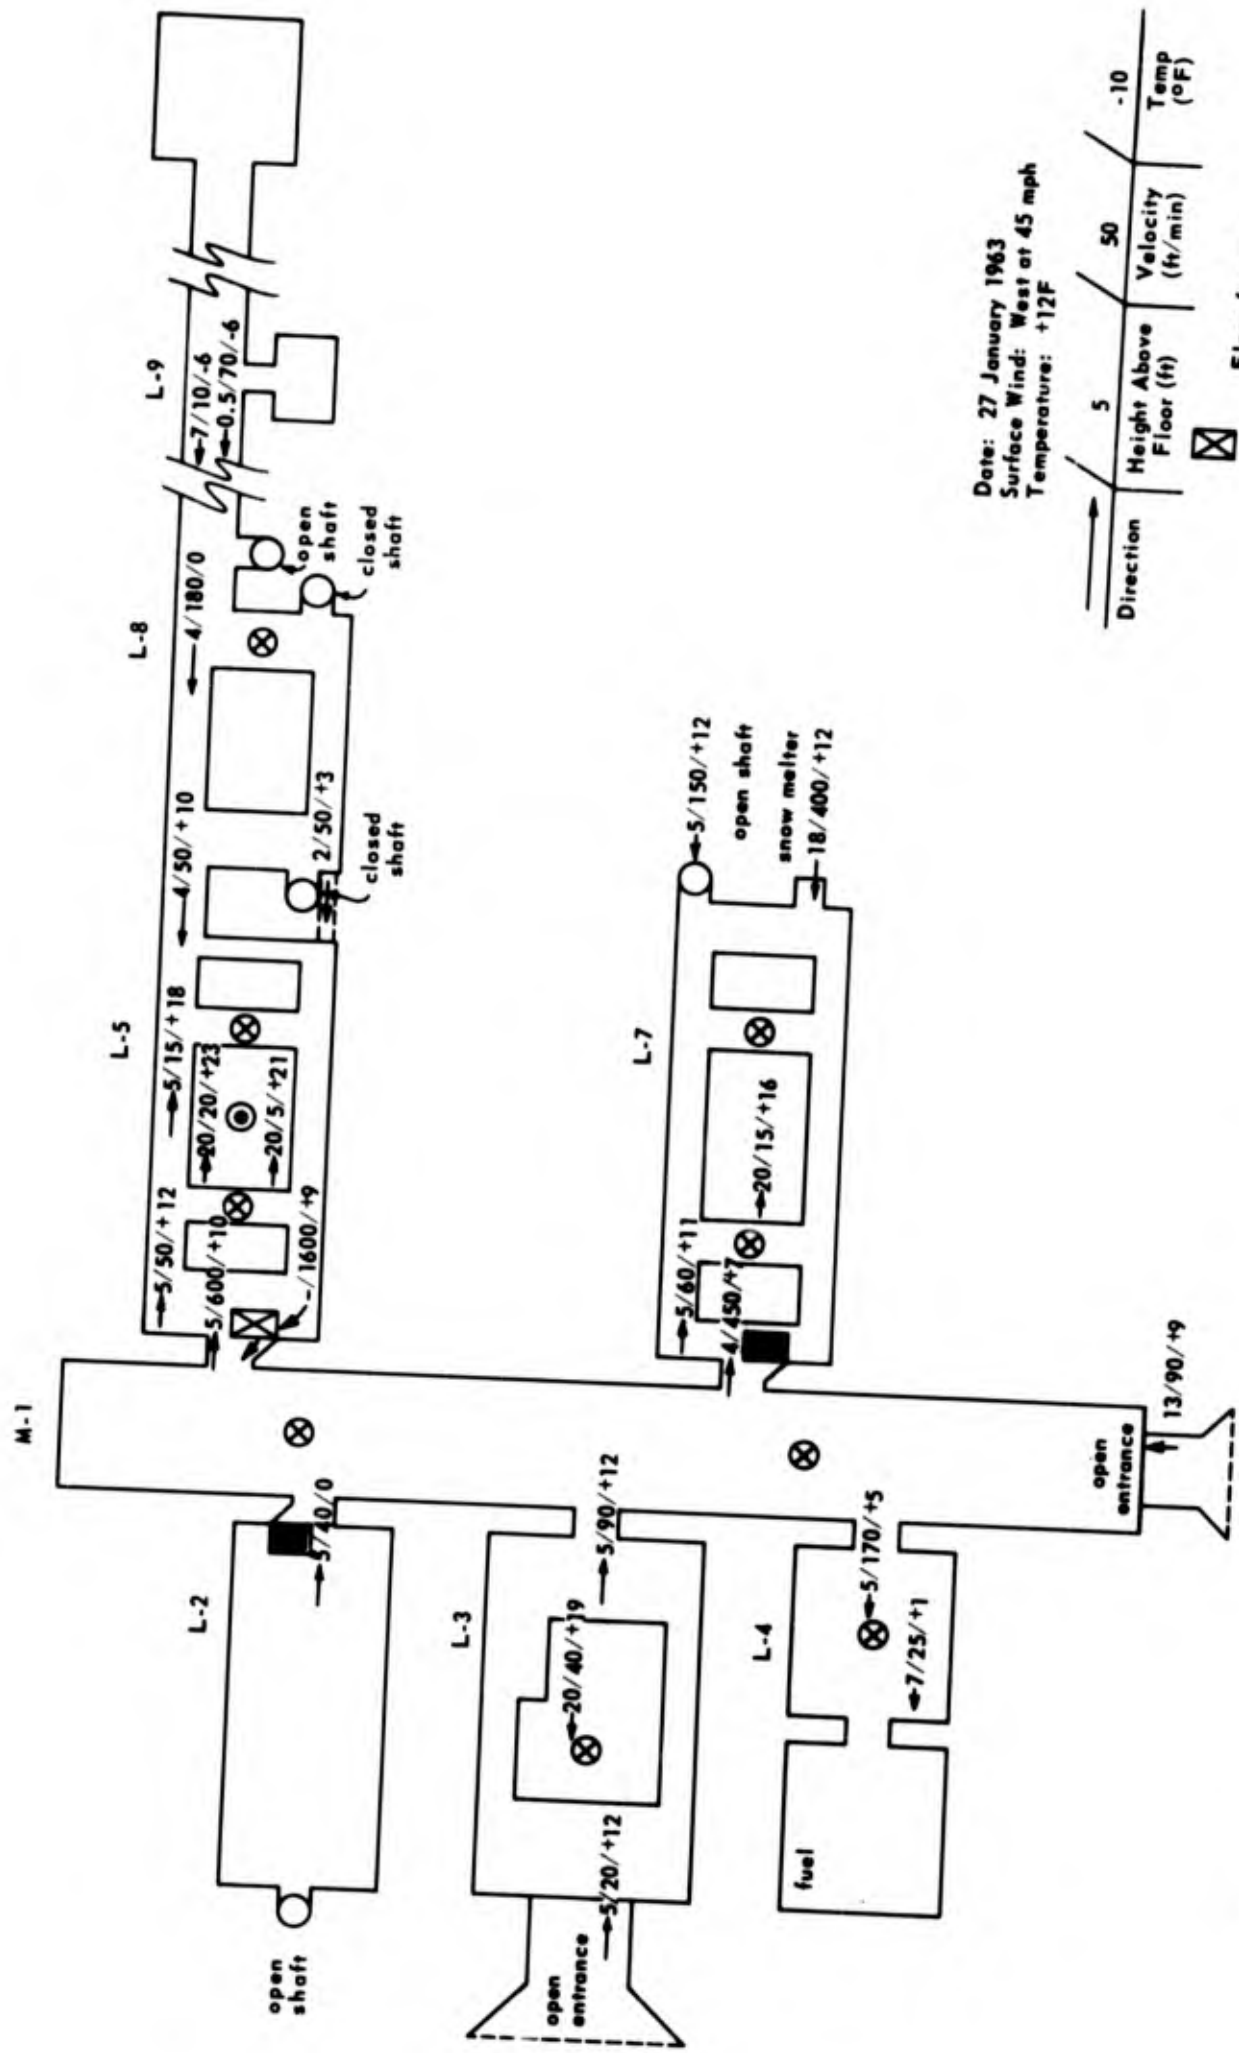

Date: 27 January 1963  
 Surface Wind: West at 45 mph  
 Temperature: +12F

Direction	Height Above Floor (ft)	Velocity (ft/min)	Temp (°F)
→	5	50	-10

⊗ Floor fan on  
 ⊙ Floor fan off  
 ⊗ Roof fan on  
 ⊙ Roof fan off

Figure 3. Air temperature and air-velocity measurements taken with hatches and doorways open and exhaust fans operating; Byrd Station, Antarctica, summer, 1963.

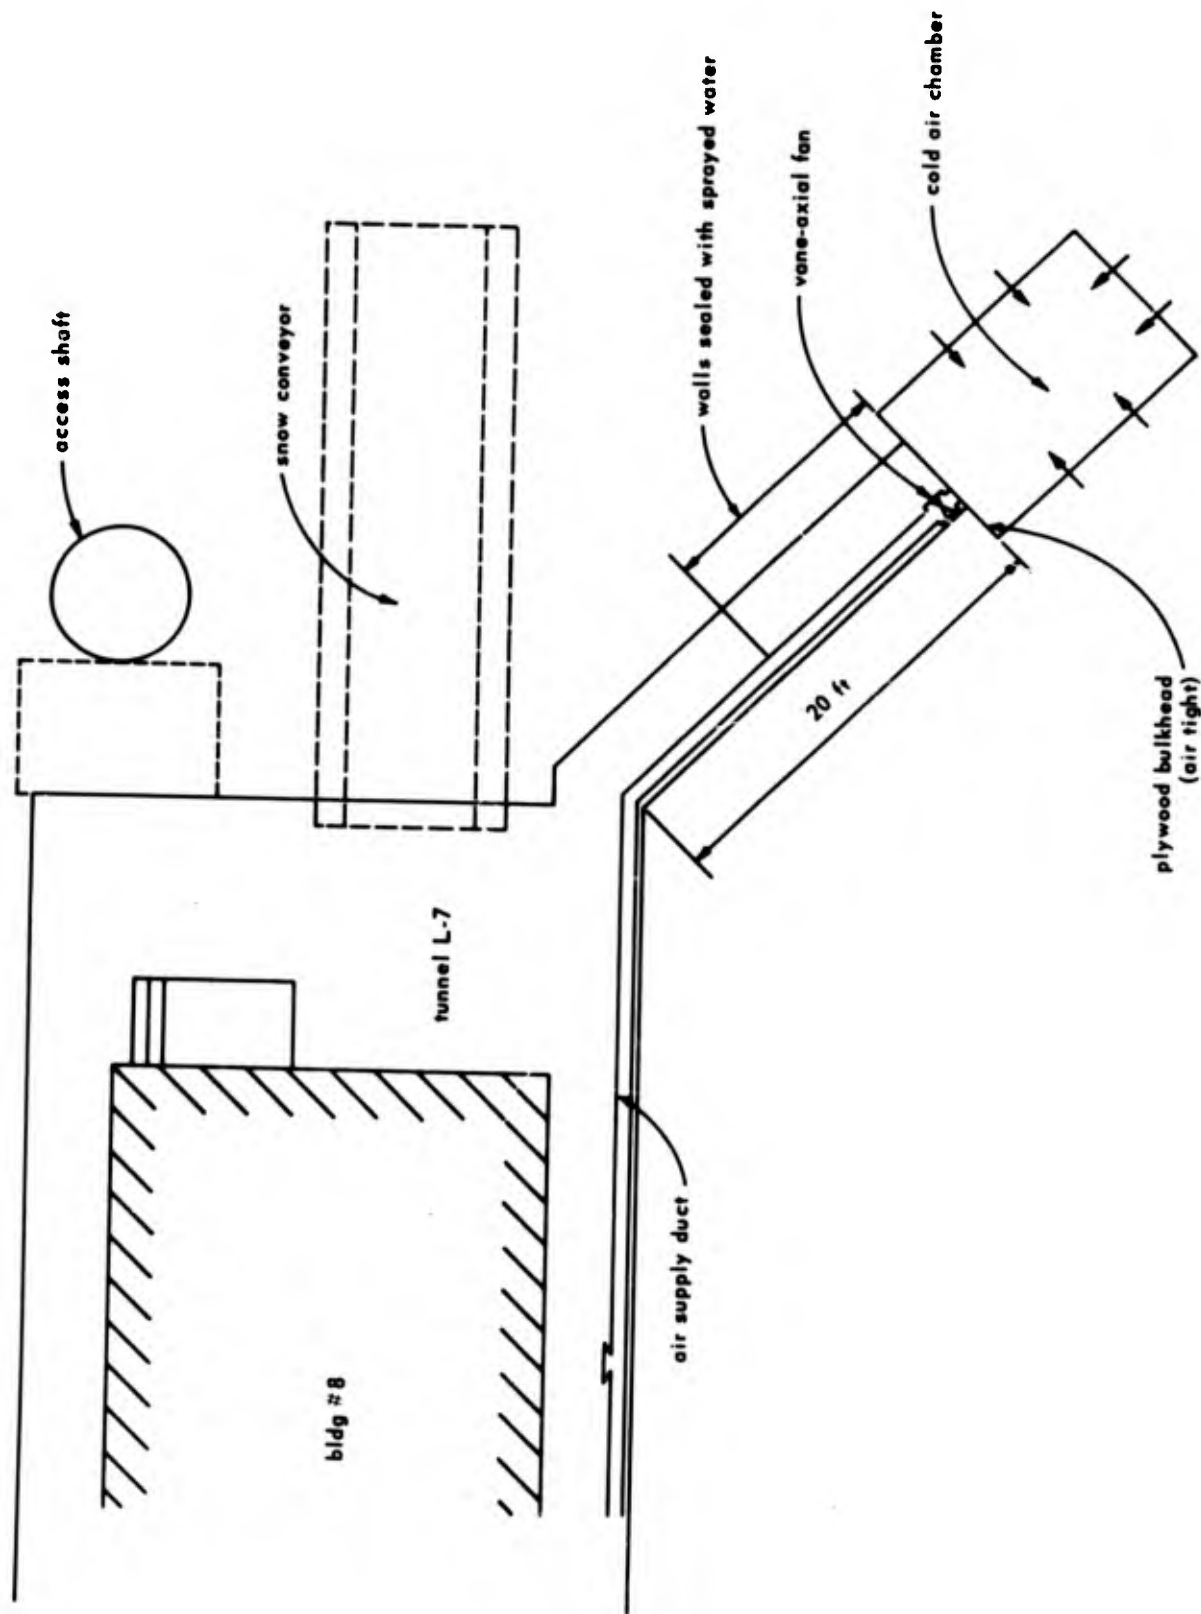


Figure 4. Plan of NFEC-proposed cold-air plenum chamber.

During Deep Freeze 66, NFEC sponsored a ventilation and heat-load study to obtain current information for evaluation of the cooling plenum concept<sup>2</sup> and to obtain data for cooling systems design. Study of the plenum concept showed the system to be practical. The ventilation and heat-load information required for tunnel cooling system design is discussed in the following section of this report.

## VENTILATION AND HEAT LOAD

The study of tunnel ventilation at Byrd Station was conducted in late December and, for ease of comparison, was patterned after ventilation studies conducted by CRREL personnel in late January 1963.<sup>1</sup> Air velocity measurements were made with an Alnor heated thermocouple anemometer having a range of 10 to 2,000 fpm in two scales and an advertised accuracy of 3%. Temperature measurements were made with mercury thermometers and Taylor dial thermometers. The results of the study are shown in Figures 5 and 6. One set of measurements was made with all fans running; another set was made the next day with all fans shut down. In addition to velocity and temperature measurements, observations were made on air movement and heat load within the tunnels.

### Air Velocity and Temperature

Comparison of the velocity and temperature data obtained during this study (Figures 5 and 6) and that obtained during the 1963 study (Figures 2 and 3) show an average decrease in tunnel temperatures of 5 to 6°F. This may be partially attributed to slightly cooler surface temperature or to the study being made 4 weeks earlier in the summer. However, the principal factor resulting in lower temperatures is believed to be the closing of the vehicle ramp at the south end of M-1, which partially eliminated the circulation of warmer, surface air through the tunnels.

Fuel tunnels L-1 and L-4, supply tunnel L-2, and seismic tunnel L-9 continued to be the coldest locations in the undersnow camp and were as much as 12°F below the 0°F target temperature. Operation of the arch crown exhaust fan in the antechamber of fuel tunnel L-4 is detrimental to tunnel cooling, since it draws in warmer air from M-1. When this fan was shut down, direction of air flow reversed and the tunnel entrance temperature dropped from +1°F to -10°F.

Tunnels L-5, L-8, and L-9 which are, in effect, one continuous tunnel partitioned by wide snow firewalls, illustrate the effect of air seepage through tunnel walls and the effect of various internal heat sources on tunnel temperature. Tunnel L-9 at the extreme outward end of the three-tunnel complex is the coldest location (-13°F) and is only 6 degrees warmer than the minimum in-situ snow temperature at tunnel depth. Air flows out of this dead-end tunnel into L-8 and contributes significantly to reducing its temperature. With the arch crown fans operating in L-5 and

L-8, air enters through the open escape hatch in L-9. This hatch is used extensively by scientific personnel going to and from the surface. Because of the difficulty of opening and closing this hatch and the inherent danger in performing the operation while hanging on the vertical ladder, the shaft is seldom closed. As the air flows from L-9 to L-8 and L-5, then into M-1, it is progressively warmed by heat lost from the consecutive buildings. When the arch crown fan are shut down, the air flow is reversed, flowing from M-1 into L-5, L-8 and L-9 and exiting by gravity flow to the surface through the fan shafts and open escape hatch.

The maintenance tunnel (L-3) with the large vehicle ramp open to the surface is a few degrees warmer than the surface temperature. The effectiveness of the arch crown fan in this tunnel is questionable in view of the large inflow of surface air.

It was found that tunnel L-7, containing the communications, mess hall, and generator buildings, is the warmest tunnel in the undersnow camp and is nearly 10°F above the desired temperature. The heat loss from the three buildings and the large inflow of warm air from M-1 are the major cause of temperature elevation.

The surface air intake for cooling the generator engines is inadequate at warmer surface temperatures. When required, ports are opened in the generator building and additional engine cooling air is obtained directly from the tunnel. This is basically undesirable because it requires the induction of surface air to the tunnel to make up for the air used for cooling. Under present conditions, this is of little importance because of the large quantities of surface air already entering the tunnel.

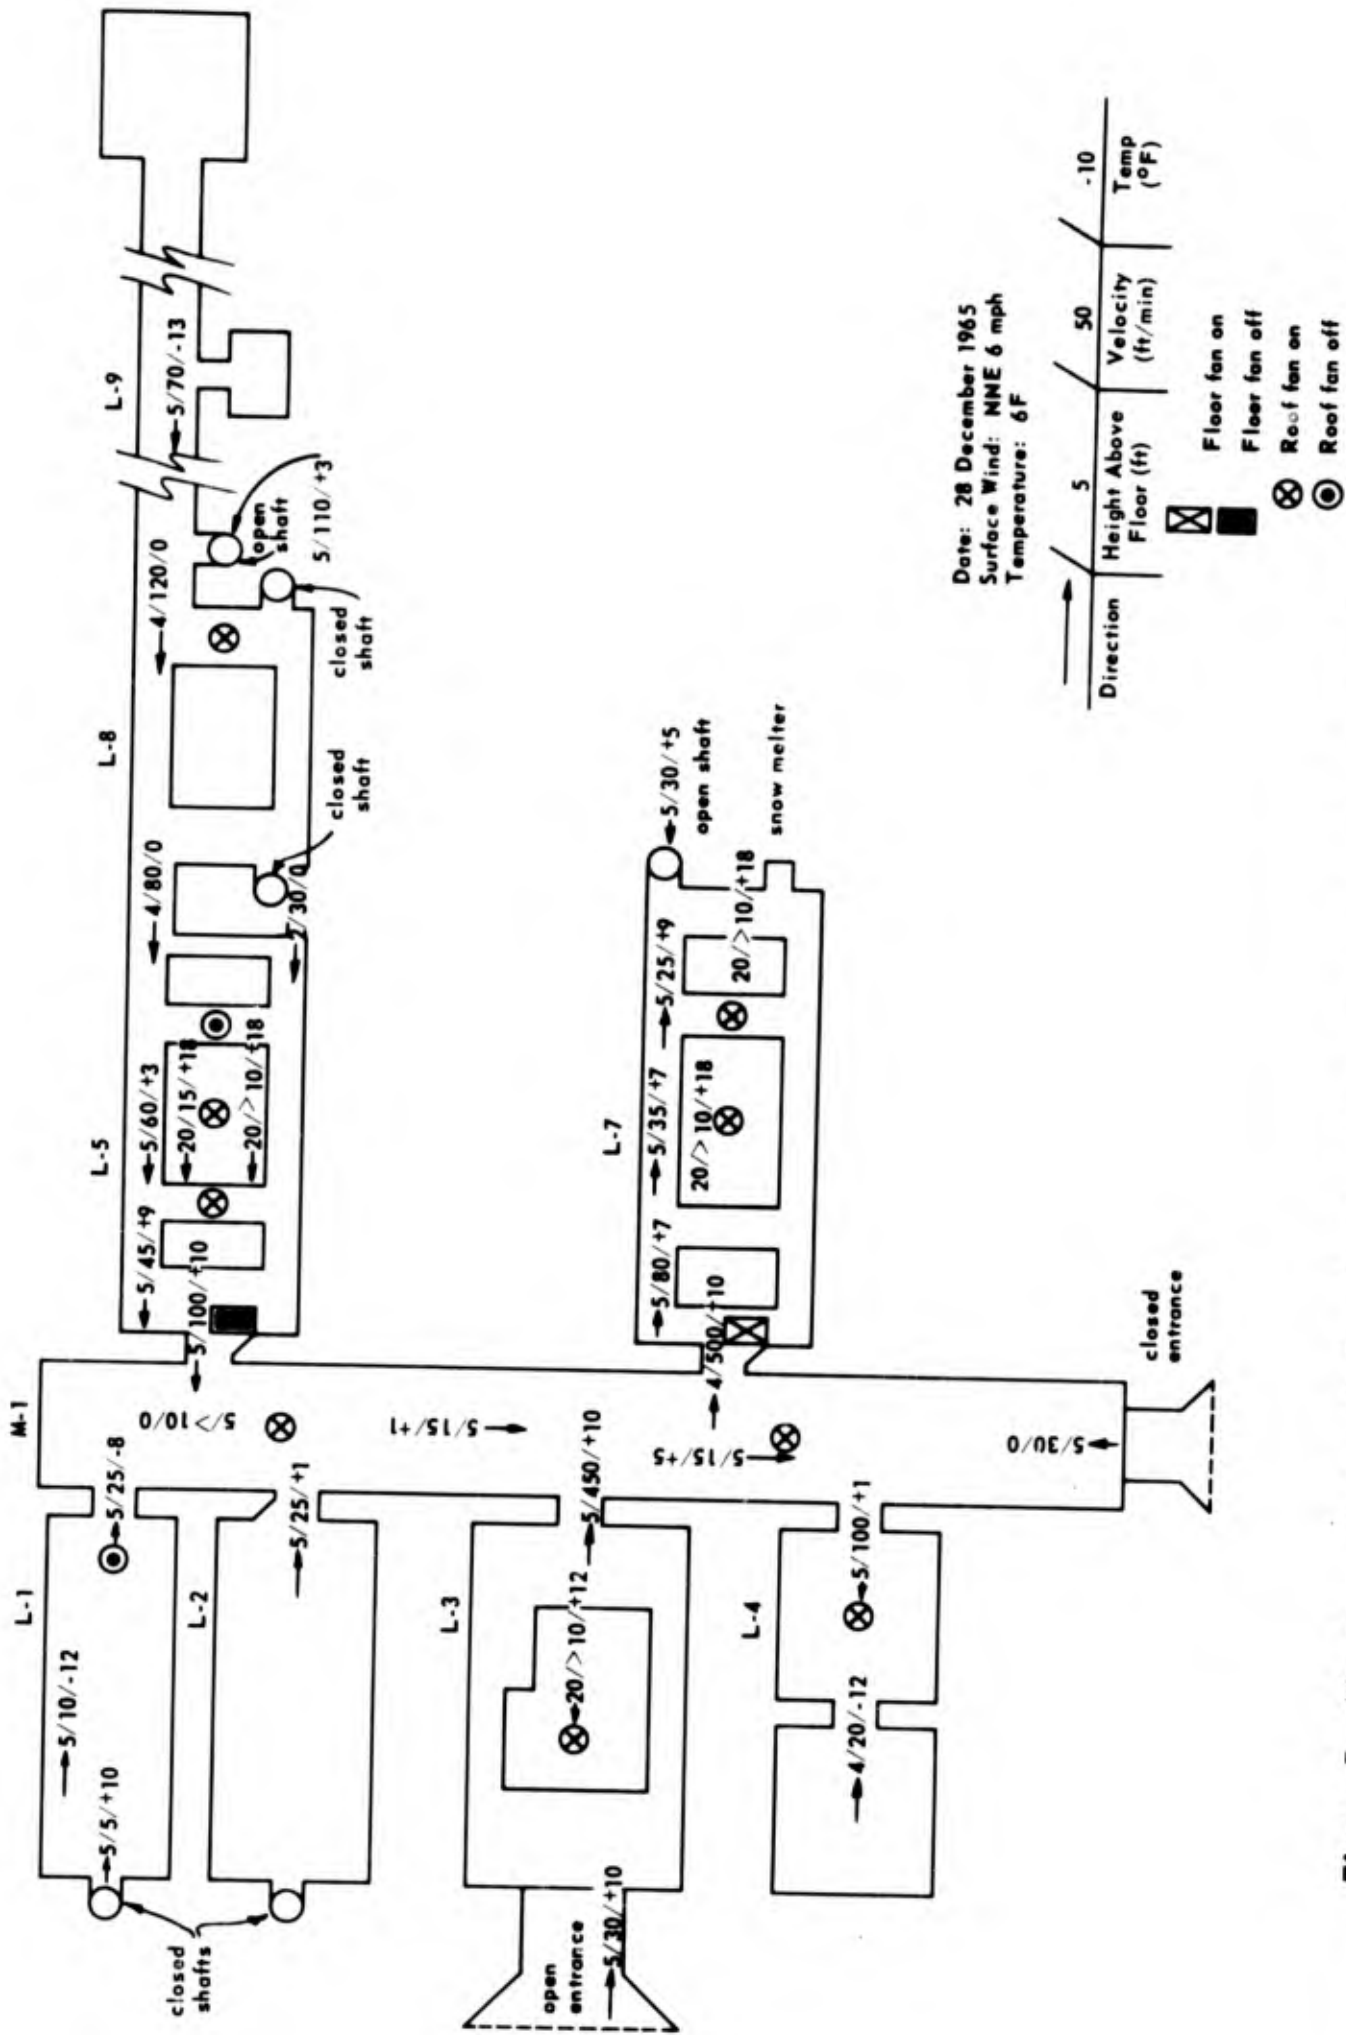


Figure 5. Air-temperature and air-velocity measurements taken with exhaust fans operating; Byrd Station, Antarctica, summer, 1965.

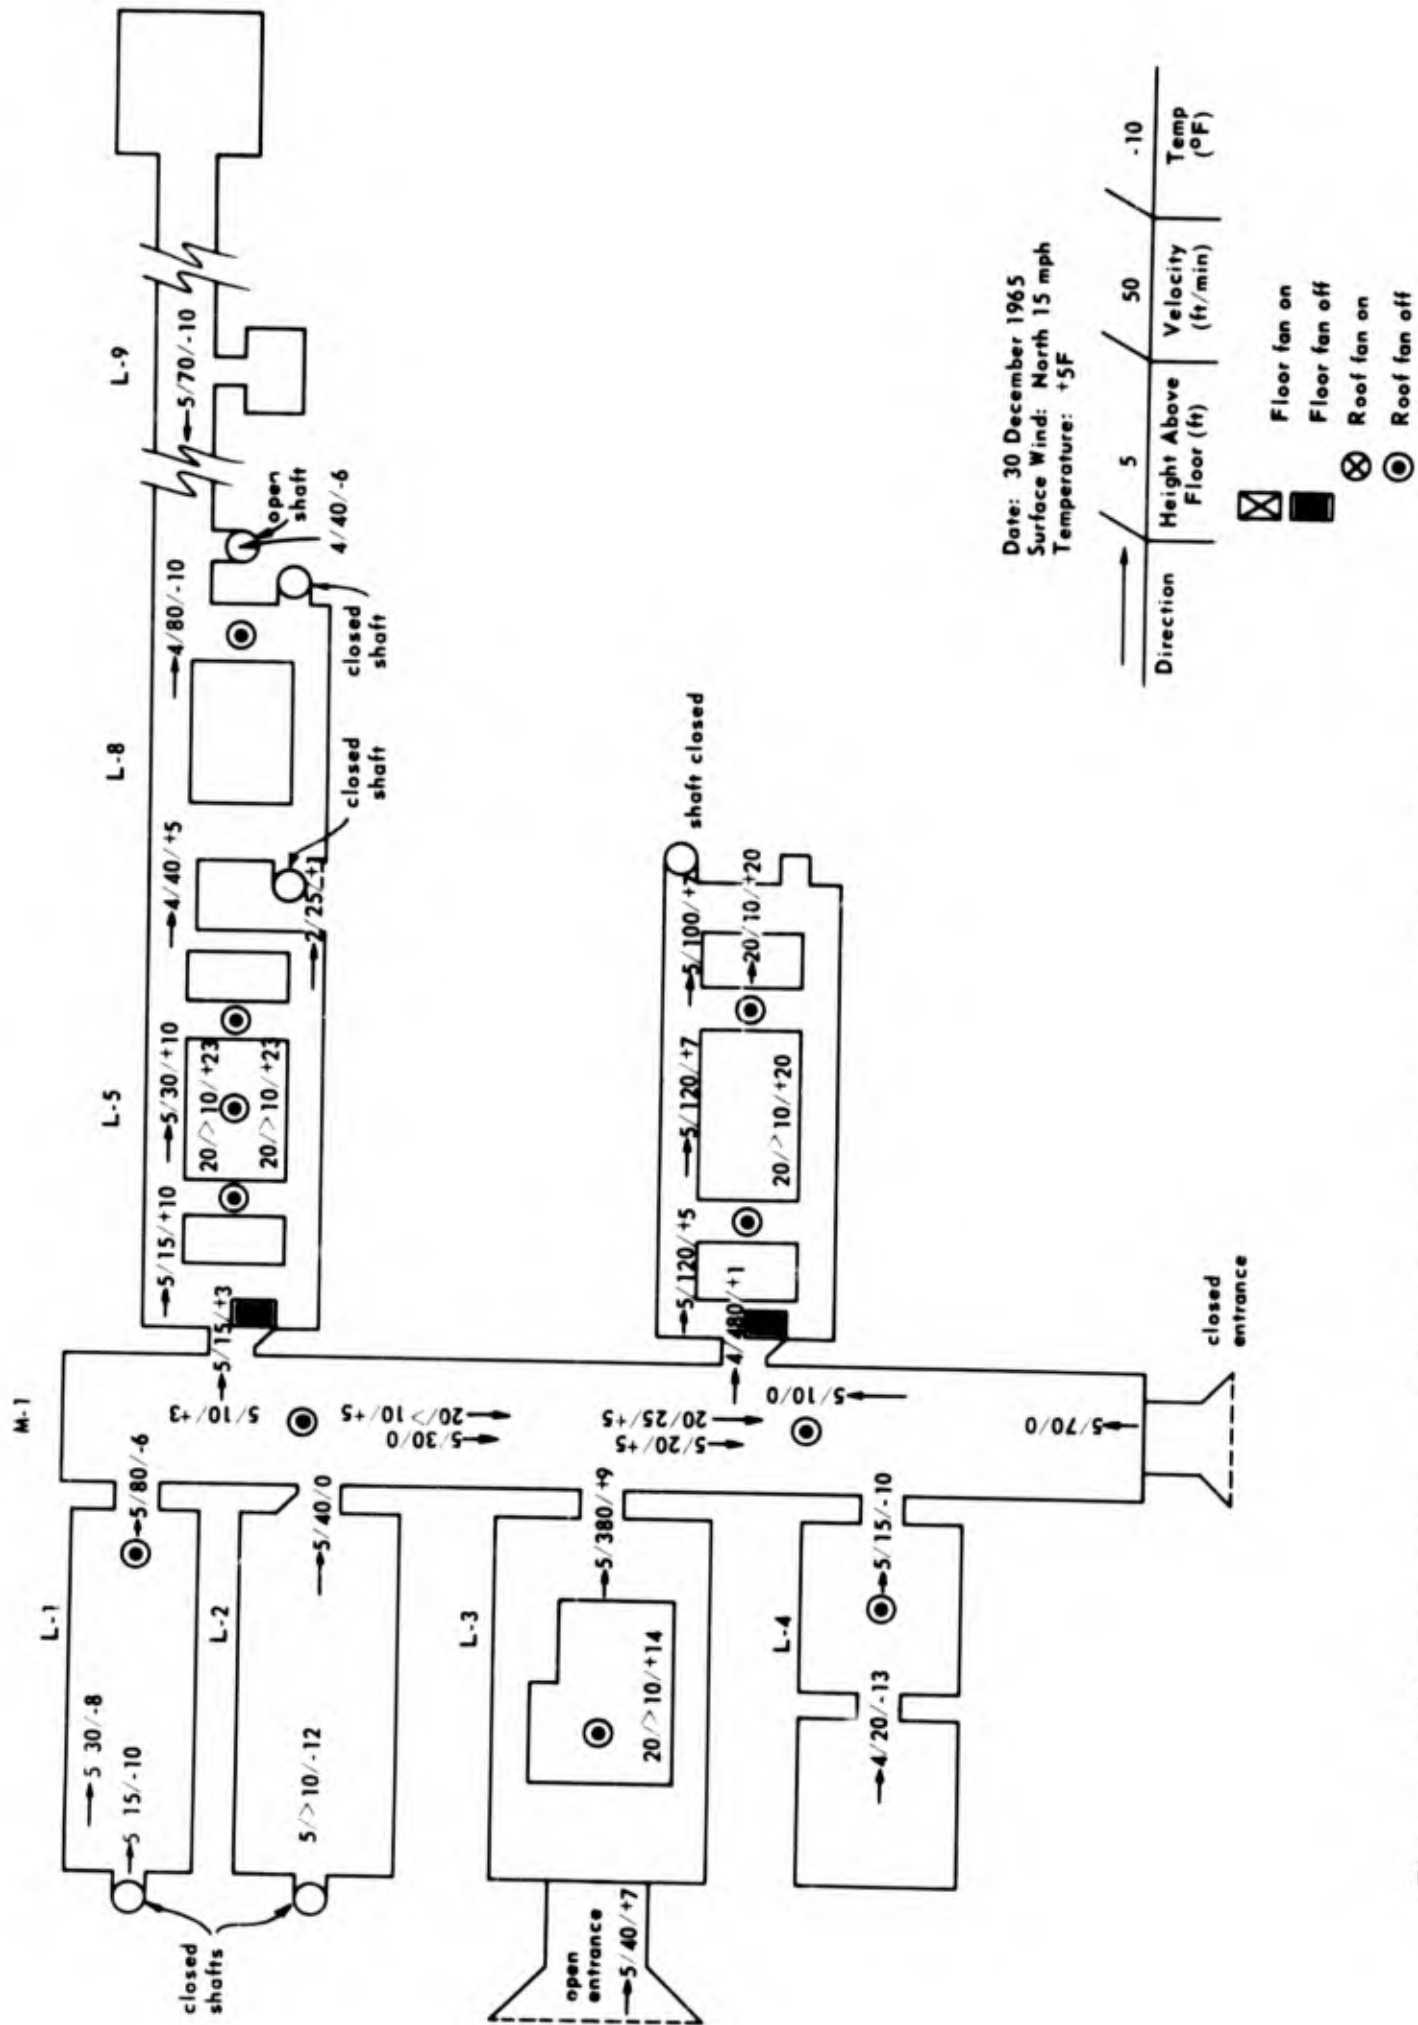


Figure 6. Air-temperature and air-velocity measurements taken with exhaust fans shut down; Byrd Station, Antarctica, summer, 1965.

## Air Movement and Heat Load

During the study, the following observations were made on air movement and heat load within the tunnels:

### Tunnel L-1 (fuel storage)

- Inflow: Probably by seepage through snow walls and by leakage around closed escape hatch
- Outflow: Through doorless passage to M-1
- Heat Load: None
- Comments: Improved closure on the escape hatch could reduce flow of surface air into tunnel. This tunnel was excavated during Deep Freeze 65 and was never fitted with a door to M-1 either for fire stop or air flow control

### Tunnel L-2 (material storage)

- Inflow: Probably by seepage through snow walls
- Outflow: Through poor fitting door and perforated bulkhead to M-1
- Heat Load: None
- Comments: Original bulkhead fan discharging into M-1 has been removed. Opening remains. No air was observed entering the cargo shaft

### Tunnel L-3 (maintenance)

- Inflow: Down equipment ramp
- Outflow: Arch crown fan and to M-1 via doorless passage
- Heat Load: Loss from maintenance buildings and running vehicles and inflow of warm air from surface via vehicle ramp
- Comments: A temporary door was installed in the passage between M-1 and L-3 during the preceding winter to reduce inflow of cold air and increase personal comfort. Door was not in place during study.

### Tunnel L-4 (fuel storage)

- Inflow: Probably seepage through tunnel walls and via warped door from M-1
- Outflow: Arch crown fan to surface
- Heat Load: None
- Comments: Fan at arch crown is not needed except for possible ventilation should fuel vapors accumulate in tunnel



#### Tunnel L-5 (quarters and administration)

- Inflow: From L-8 via culvert passage and M-1 via passageway
- Outflow: To M-1 via open door, miscellaneous opening in bulkhead and to surface via fans at arch crown
- Heat Load: Heat loss from buildings, uninsulated furnace vent stacks on all buildings, open 7-inch-diameter hole through roof to quarters building
- Comments: Door to M-1 does not close well. Bulkhead has number of large openings around waterlines, etc. Arch crown fan at east end of L-5 has been removed and duct to surface filled with snow

#### Tunnel L-7 (communications, galley, generators)

- Inflow: From M-1 via open door, leakage around escape hatch, snow-melter door and annular space around engine exhaust ducts to surface
- Outflow: Arch crown fan and generator engine radiator cooling duct system
- Heat Load: Heat loss from buildings, uninsulated vent stacks on all furnaces. Galley range hood discharging directly to tunnel. Leakage from generator cooling air vent system
- Comments: Floor fan operating in bulkhead to M-1 is ineffective because it operates against the natural flow of air and the discharged air reenters the tunnel through open door. Exhaust fan on galley range appears ineffective due to small vent size and makeshift fan arrangement. No condensation noted on tunnel walls in vicinity of galley. Arch crown fan at north end of tunnel restricted by to-surface duct extension of smaller size

#### Tunnel L-8 (scientific)

- Inflow: From L-9 via culvert passage
- Outflow: To L-5 via culvert passage and sewer trench and to surface via arch crown fan
- Heat Load: Heat loss from buildings, uninsulated furnace vent stacks on all buildings. Broken vent stack on science building
- Comments: None

#### Tunnel L-9 (science)

- Inflow: Probably seepage through snow walls and through open escape hatch
- Outflow: To L-8

Heat Load: Heat loss from seismic building. Inflow of surface air through open hatch

Comments: Relatively heavy traffic to surface via escape hatch and hazardous operation of hatch results in this passage being open almost continuously, allowing entrance of surface air and snow

## TUNNEL COOLING

Cooling of undersnow tunnels requires the venting or absorbing of internally generated heat. Since the use of mechanical refrigeration for this purpose is beyond consideration economically, any air cooling undertaken is dependent on the use of the surrounding snowfields as a heat sink. Use of this heat sink appears feasible but careful design will be required because of:

1. The small temperature differential between the minimum snow temperature at tunnel depth and the desired tunnel temperature
2. The low heat absorbing capacity of a given volume of snow as represented by its low specific heat
3. The relatively poor thermal conductivity of the snow, which retards the dissipation of heat and the recovery of the sink

Laboratory studies have been made of the thermal conductivities of unconsolidated snow, its permeability, and thermal conductivity;<sup>2, 3, 4</sup> however, much of the information is not readily applicable to field conditions.

Before the design and construction of any tunnel cooling system for Byrd Station is undertaken, the uncontrolled circulation of warm surface air through the camp must be eliminated. Until this is done, no cooling system can be effective. Self-closing doors and impermeable bulkheads are needed at each lateral tunnel leading from M-1. Doors are also required at the bottom of the frequently used escape hatches in tunnel L-9 and probably L-7. Halting the inflow of surface air to L-3 is also highly desirable; however, no simple and practical closure system for the large vehicle ramp is visualized. An elevator, as proposed in the DF-66 Byrd Station Survey,<sup>6</sup> would fulfill the requirements but would require a major design and construction effort.

The light wood and steel frame doors installed during original camp construction (Figure 7) deformed and became inoperative after a short time because of pressures imposed on the casing by the surrounding snow.



Figure 7. Typical passageway door showing bulkhead perforated by waterline and out-of-service ventilation fan.

Closure of the suggested passages requires a door design compatible with the slow but continuous deformation of the passageway walls. This might be accomplished by using:

1. A door casing of sufficient rigidity and strength to withstand the hydraulic pressures of the plastically deforming snow
2. A deformable diaphragm between the passage walls and door casing to absorb movement
3. A door system fitting against the face of the passageway bulkhead rather than set into the passage

With the undersnow camp compartmented into smaller zones and uncontrolled air flow between the main tunnel M-1 and the lateral tunnels eliminated, air cooling systems can be considered.

Tunnel L-7, in greatest need of cooling, poses severe requirements. The internal heat load in this tunnel results from heat lost from the galley, communications and generator buildings, and is estimated to be in excess of 200,000 Btuh based on a measured heat-loss coefficient of  $0.158 \text{ Btuh/sq ft/}^\circ\text{F}^7$  and a tunnel temperature of  $0^\circ\text{F}$ . Displacement of this heat during the period when surface temperatures are above  $0^\circ\text{F}$  requires a cooling system of considerable size. Drawing cold air from the snow walls by slight reduction of tunnel air pressure as outlined in the CRREL survey<sup>1</sup> is not considered suitable for cooling this tunnel because of the nearly unavoidable to-surface openings at the generator exhaust stacks, snow-melter chute, etc. A cooling system based on the proposed NFEC's plenum chamber concept appears to offer the greatest possibility of success in this area.

Cooling of the L-5, L-8, L-9 tunnel complex appears to present little problem. With a door at the passage to M-1 and at the escape hatch in L-8, the existing arch crown fans can be expected to draw cold air from the tunnel walls and provide the required cooling.

Tunnels L-1, L-2, L-4, and M-1, with negligible internal heat gain, should require no special cooling procedure following installation of doors. Existing arch crown exhaust fans can be operated if required to draw cold air from the tunnel walls.

Cooling of tunnel L-3 is considered impractical so long as the vehicle ramp is open to the surface. With this opening closed, the tunnel could be cooled.

## FINDINGS

Study of Byrd Station ventilation and tunnel cooling requirements in December 1965 showed that:

1. Temperatures within the tunnels average 5 to  $6^\circ\text{F}$  lower than during the preceding study conducted in 1963.

2. Surface air enters the tunnels through the vehicle ramp and open escape hatches and flows uncontrolled through the camp.
3. Existing tunnel doors and bulkheads are in bad repair and are not capable of controlling airflow through the tunnels.
4. Tunnels containing heated buildings are as much as 17°F higher in temperature than the desired 0°F temperature.
5. Internal heat load within the tunnels can be reduced by:
  - a. Insulation and proper maintenance of furnace vent stacks
  - b. Replacement and surface venting of galley range exhaust hood

## CONCLUSIONS

It is concluded that:

1. Installation of air-impermeable bulkheads with self-closing doors at tunnel entrances and frequently used escape hatches will:
  - a. Halt inflow and uncontrolled circulation of warm air (important when surface temperatures are above 0°F)
  - b. Compartmentize the camp for greater air circulation and temperature control by eliminating crossflow between tunnels
  - c. Isolate high heat gain areas for more effective venting and tunnel cooling
2. Temperatures in the snow tunnels can be reduced by:
  - a. Isolating the L-5, L-8, L-9 tunnel complex and drawing cold air through the snow walls with existing arch fans
  - b. Isolating low-heat-gain tunnels L-1, L-2, L-4, and M-1 and drawing air through the snow walls with existing arch fans as required
  - c. Isolating tunnel L-7 and installing a cooling system based on NFEC's plenum chamber concept
  - d. Operating tunnel cooling systems during coldest winter weather to accelerate heat sink recovery and, if possible, cool the snow below its natural temperature

## RECOMMENDATIONS

Based on the results of the ventilation and heat-load study, it is recommended that:

1. The inflow of warm surface air and crossflow of air between tunnels be eliminated with installation of impermeable bulkheads and self-closing doors at tunnel entrances and frequently used escape hatches.
2. Cooling of the snow tunnels be implemented as outlined, including construction of an experimental cold-air plenum adjoining tunnel L-7.

## REFERENCES

1. U. S. Cold Regions Research and Engineering Laboratory. Technical Report 138: Undersnow structures: Byrd Station, Antarctica, by M. Mellor and G. Hendrickson. Hanover, N. H., Feb. 1965. (AD 613 051)
2. U. S. Naval Civil Engineering Laboratory. Technical Note N-816: Experimental snow plenum air cooling system for Byrd Station, Antarctica, by C. R. Hoffman. Port Hueneme, Calif., July 1966.
3. Y. C. Yen. "Effective thermal conductivity of ventilated snow," *Journal of Geophysical Research*, vol. 67, no. 3, Mar. 1962, pp. 1,091 - 1,098.
- 4.———. "Heat transfer by vapor transfer in ventilated snow," *Journal of Geophysical Research*, vol. 68, no. 4, 15 Feb. 1963, pp. 1,093 - 1,101.
5. Y. C. Yen and D. Fisher. "On the isothermal flow of air into a rectangular snow trench," *Journal of Geophysical Research*, vol. 68, no. 24, 15 Dec. 1963, pp. 6,475 - 6,480.
6. U. S. Naval Civil Engineering Laboratory. Technical Note N-815: Technical progress survey — Byrd Station, Antarctica, by C. R. Hoffman. Port Hueneme, Calif., June 1966.
- 7.———. Technical Report R-286: Modified T-5 barracks: Controlled climatic heating studies, by C. R. Hoffman. Port Hueneme, Calif., May 1964.

**BLANK PAGE**

**DOCUMENT CONTROL DATA - R&D**

*(Security classification of title, body of abstract and indexing annotation must be entered when the overall report is classified)*

<b>1. ORIGINATING ACTIVITY (Corporate author)</b> U. S. Naval Civil Engineering Laboratory Port Hueneme, California 93041		<b>2a. REPORT SECURITY CLASSIFICATION</b> Unclassified	
		<b>2b. GROUP</b>	
<b>3. REPORT TITLE</b> Tunnel Ventilation and Heat-Load Survey — Byrd Station, Antarctica, 1965			
<b>4. DESCRIPTIVE NOTES (Type of report and inclusive dates)</b> Survey December 1965			
<b>5. AUTHOR(S) (Last name, first name, initial)</b> Hoffman, C. R.			
<b>6. REPORT DATE</b> July 1966		<b>7a. TOTAL NO. OF PAGES</b> 20	<b>7b. NO. OF REFS</b> 7
<b>8a. CONTRACT OR GRANT NO.</b>		<b>9a. ORIGINATOR'S REPORT NUMBER(S)</b> TR-452	
<b>b. PROJECT NO.</b> Y-F015-11-01-163		<b>9b. OTHER REPORT NO(S) (Any other numbers that may be assigned this report)</b>	
<b>c.</b>			
<b>d.</b>			
<b>10. AVAILABILITY/LIMITATION NOTICES</b> Distribution of this document is unlimited.			
<b>11. SUPPLEMENTARY NOTES</b>		<b>12. SPONSORING MILITARY ACTIVITY</b> Naval Facilities Engineering Command	
<b>13. ABSTRACT</b> A ventilation and heat-load survey was conducted in the undersnow tunnels at Byrd Station, Antarctica, in late December 1965. This work was performed to obtain current information on tunnel cooling requirements and to obtain data for tunnel cooling system design. The survey showed that average tunnel temperatures are 5 to 6°F lower than during a similar survey conducted in 1963, but are still as much as 18°F higher than the desired temperature of 0°F. Doors originally installed at tunnel entrances have deformed and become inoperative, allowing the free circulation of warm surface air throughout the undersnow camp. It was concluded that tunnel temperatures in the undersnow camp can be reduced by installation of airtight bulkheads and suitable selfclosing doors to prevent the inflow of warm, surface air and reduce cross-circulation between tunnels. All tunnels except L-7, which contains the communications galley and generator buildings, can be adequately cooled by drawing cold air from tunnel walls. A cooling system based on the U. S. Naval Facilities Engineering Command's air-plenum concept appears to be the most suitable means of cooling tunnel L-7.			



14. KEY WORDS  Snow tunnels Temperature control Air-plenum concept	LINK A		LINK B		LINK C	
	ROLE	WT	ROLE	WT	ROLE	WT

**INSTRUCTIONS**

1. **ORIGINATING ACTIVITY:** Enter the name and address of the contractor, subcontractor, grantee, Department of Defense activity or other organization (*corporate author*) issuing the report.
- 2a. **REPORT SECURITY CLASSIFICATION:** Enter the overall security classification of the report. Indicate whether "Restricted Data" is included. Marking is to be in accordance with appropriate security regulations.
- 2b. **GROUP:** Automatic downgrading is specified in DoD Directive S200.10 and Armed Forces Industrial Manual. Enter the group number. Also, when applicable, show that optional markings have been used for Group 3 and Group 4 as authorized.
3. **REPORT TITLE:** Enter the complete report title in all capital letters. Titles in all cases should be unclassified. If a meaningful title cannot be selected without classification, show title classification in all capitals in parenthesis immediately following the title.
4. **DESCRIPTIVE NOTES:** If appropriate, enter the type of report, e.g., interim, progress, summary, annual, or final. Give the inclusive dates when a specific reporting period is covered.
5. **AUTHOR(S):** Enter the name(s) of author(s) as shown on or in the report. Enter last name, first name, middle initial. If military, show rank and branch of service. The name of the principal author is an absolute minimum requirement.
6. **REPORT DATE:** Enter the date of the report as day, month, year, or month, year. If more than one date appears on the report, use date of publication.
- 7a. **TOTAL NUMBER OF PAGES:** The total page count should follow normal pagination procedures, i.e., enter the number of pages containing information.
- 7b. **NUMBER OF REFERENCES:** Enter the total number of references cited in the report.
- 8a. **CONTRACT OR GRANT NUMBER:** If appropriate, enter the applicable number of the contract or grant under which the report was written.
- 8b, 8c, & 8d. **PROJECT NUMBER:** Enter the appropriate military department identification, such as project number, subproject number, system numbers, task number, etc.
- 9a. **ORIGINATOR'S REPORT NUMBER(S):** Enter the official report number by which the document will be identified and controlled by the originating activity. This number must be unique to this report.
- 9b. **OTHER REPORT NUMBER(S):** If the report has been assigned any other report numbers (*either by the originator or by the sponsor*), also enter this number(s).
10. **AVAILABILITY/LIMITATION NOTICES:** Enter any limitations on further dissemination of the report, other than those

imposed by security classification, using standard statements such as:

- (1) "Qualified requesters may obtain copies of this report from DDC."
- (2) "Foreign announcement and dissemination of this report by DDC is not authorized."
- (3) "U. S. Government agencies may obtain copies of this report directly from DDC. Other qualified DDC users shall request through \_\_\_\_\_."
- (4) "U. S. military agencies may obtain copies of this report directly from DDC. Other qualified users shall request through \_\_\_\_\_."
- (5) "All distribution of this report is controlled. Qualified DDC users shall request through \_\_\_\_\_."

If the report has been furnished to the Office of Technical Services, Department of Commerce, for sale to the public, indicate this fact and enter the price, if known.

11. **SUPPLEMENTARY NOTES:** Use for additional explanatory notes.
12. **SPONSORING MILITARY ACTIVITY:** Enter the name of the departmental project office or laboratory sponsoring (*paying for*) the research and development. Include address.
13. **ABSTRACT:** Enter an abstract giving a brief and factual summary of the document indicative of the report, even though it may also appear elsewhere in the body of the technical report. If additional space is required, a continuation sheet shall be attached.

It is highly desirable that the abstract of classified reports be unclassified. Each paragraph of the abstract shall end with an indication of the military security classification of the information in the paragraph, represented as (TS), (S), (C), or (U).

There is no limitation on the length of the abstract. However, the suggested length is from 150 to 225 words.

14. **KEY WORDS:** Key words are technically meaningful terms or short phrases that characterize a report and may be used as index entries for cataloging the report. Key words must be selected so that no security classification is required. Identifiers, such as equipment model designation, trade name, military project code name, geographic location, may be used as key words but will be followed by an indication of technical context. The assignment of links, roles, and weights is optional.